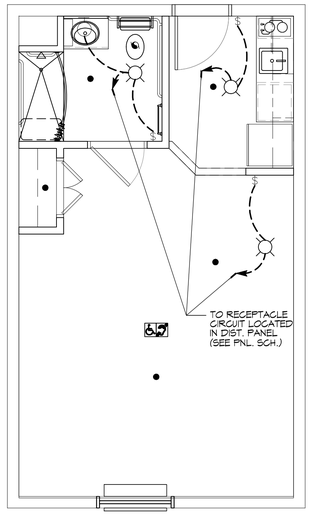

1 ACCESSIBLE DOUBLE QUEEN SUITE (LIGHTING)
SCALE: 1/4"=1'-0"

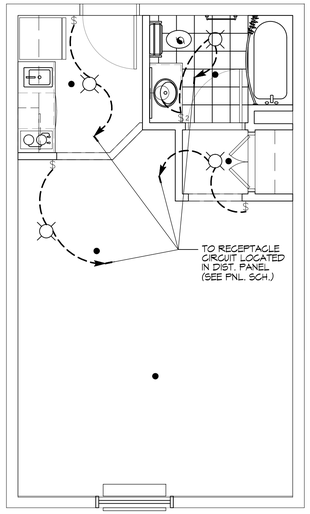

3 DOUBLE QUEEN SUITE (LIGHTING)
SCALE: 1/4"=1'-0"

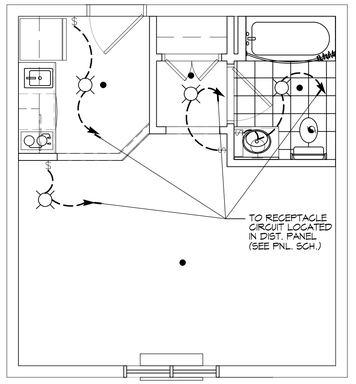

5 KING SUITE (LIGHTING)
SCALE: 1/4"=1'-0"

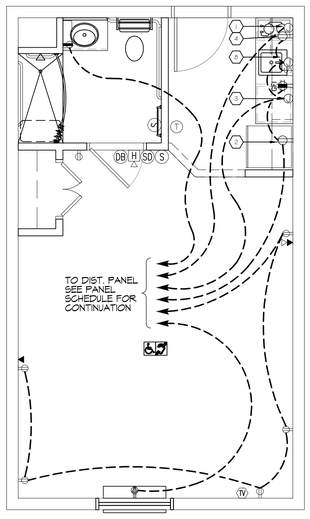

2 ACCESSIBLE DOUBLE QUEEN SUITE (POWER)
SCALE: 1/4"=1'-0"

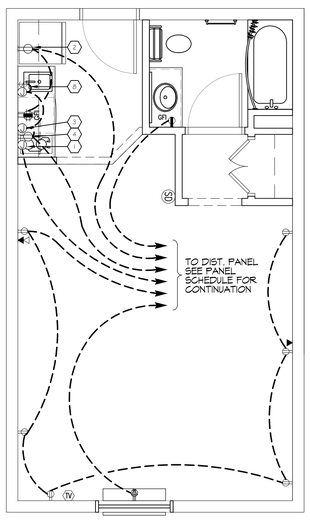

4 DOUBLE QUEEN SUITE (POWER)
SCALE: 1/4"=1'-0"

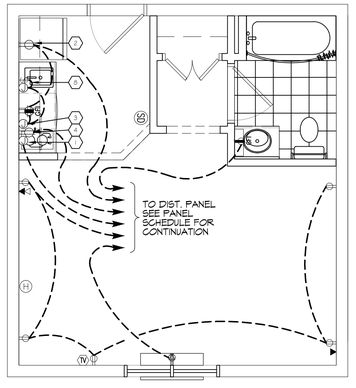

6 KING SUITE (POWER)
SCALE: 1/4"=1'-0"

ELECTRICAL LEGEND - POWER

SYMB

- STANDARD 120V DUPLEX RECEPTACLE, NEMA 5-2 OR 18" AFF (UNLESS OTHERWISE NOTED)
- SINGLE-POLE DEDICATED RECEPTACLE - REFER TO PANEL SCHEDULE FOR CIRCUIT SIZE
- GFCI DUPLEX RECEPTACLE
- GFCI QUAD RECEPTACLE
- 208V DEDICATED RECEPTACLE
- 220V DEDICATED GFCI RECEPTACLE
- WEATHER-PROOF GFCI DUPLEX RECEPTACLE MOUNTED AT 30" AFF (UNLESS OTHERWISE NOTED)
- STANDARD 120V DUPLEX RECEPTACLE - FLOOR MOUNTED
- STANDARD QUAD RECEPTACLE - WALL-MOUNTED
- STANDARD QUAD RECEPTACLE - FLOOR MOUNTED
- 125V, 15 AMP DUPLEX-USB 5VDC 3 AMP HUBBELL USB CHARGER RECEPTACLE
- 125V, 15 AMP QUADPLEX-USB 5VDC 3 AMP HUBBELL USB CHARGER RECEPTACLE
- JUNCTION BOX
- GENERATOR BATTERY CHARGER GFI OUTLET
- 2-BUTTON PUSH BUTTON STATION
- COAX-CABLE CONNECTION FOR TELEVISION
- WALL MOUNTED DATA OUTLET
- FLOOR DATA OUTLET
- POWER DISCONNECT
- GAS WATER HEATER ON DECK OR MEZZANINE ABOVE - SIZE AS NOTED ON PLAN
- AIR CONDITIONING AIR HANDLING UNIT ON DECK OR MEZZANINE ABOVE, SEE MECHANICAL DRAWINGS
- AIR CONDITIONING CONDENSER UNIT ON CONCRETE PAD, SEE MECHANICAL DRAWINGS

NOTES:

1. CONNECT ALL EMERGENCY/EXIT LIGHT FIXTURES TO NEAREST CONSTANT POWER SOURCE.
2. THE #2 NEXT TO A RECEPTACLE OR DATA OUTLET DESIGNATES THAT THERE ARE TO BE TWO OUTLETS AT THAT LOCATION...ONE OVER THE OTHER (ONE HIGH & ONE LOW ON WALL) EXAMPLE: OR
3. REFER TO INTERIOR ELEVATIONS FOR MOUNTING HEIGHT AND ORIENTATION OF OUTLETS MOUNTED ABOVE COUNTERTOPS.
4. ALL OUTLETS IN SUITES SHALL BE ARC FAULT.

ELECTRICAL LEGEND - LIGHTING

- EMERGENCY LIGHT FIXTURE
- EXIT LIGHT FIXTURE - WALL MOUNTED
- EXIT LIGHT FIXTURE - CEILING MOUNTED
- CEILING FAN
- CLNG MTD FLUOR STRIP FIXTURE
- RECESSED CEILING LIGHT FIXTURE
- CLNG HUNG FLOUR STRIP FIXTURE
- SURFACE MOUNTED LIGHT FIXTURE
- WALL MOUNTED LIGHT FIXTURE
- CLNG MTD FLUOR FIXTURE
- OUTDOOR LIGHT ON PHOTO TIMER- MTD IN GROUND
- PENDANT LIGHT FIXTURE
- EXHAUST FAN - SEE MECH
- ELECTRIC PANEL BOARD
- CIRCUIT HOME RUN
- WALL MTD SPEAKER - PROVIDE RATED HOUSING FOR RATED WALLS WHERE INDICATED
- CLNG MTD SPEAKER - PROVIDE RATED HOUSING FOR RATED CEILING WHERE INDICATED
- EXTEND TO FIXTURE(S) NOT SHOWN - SEE NOTE
- LIGHT SWITCH 120V COMMERCIAL GRADE
- LIGHT SWITCH - 3-WAY 120V COMMERCIAL GRADE
- LIGHT SWITCH - DIMMER 120V COMMERCIAL GRADE
- (T) PROVIDED BY MC.

KEY NOTES

1. JUNCTION BOX FOR RANGE TOP.
2. DUPLEX RECEPTACLE FOR REFRIGERATOR, MOUNTED 30"ABOVE FLOOR.
3. JUNCTION BOX FOR DISHWASHER, MOUNTED BELOW COUNTER
4. DUPLEX RECEPTACLE FOR MICROWAVE, MOUNTED IN CABINET ABOVE MICROWAVE.
5. SWITCH AND JUNCTION BOX FOR GARBAGE DISPOSAL. SWITCH TO BE MOUNTED ABOVE COUNTER AND JUNCTION BOX TO BE MOUNTED IN CABINET BELOW SINK.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
Info@dammonengineering.com
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70461

#	DESCRIPTION	DATE
	REVISIONS	

SEAL:

PRELIMINARY NOT FOR CONSTRUCTION

MAIN STAY SUITES

300 MAIN STREET
LOT #1 LA HWY 21
HACKBERRY, LA 70645

JOB No: 2265 DATE: FEBRUARY, 2016

All ideas, designs, arrangements, plans and drawings indicated or represented by this drawing are owned by and the property of Dammon Engineering, Inc. and were created, evolved and developed for use on and in connection with the specified project. None of such ideas, designs, arrangements, plans or drawings shall be used by or disclosed to any person, firm or corporation for any purpose whatsoever without the written permission of Dammon Engineering, Inc.

SHEET TITLE:
POWER & LIGHTING SUITES

DRAWING NUMBER:

E103

SHEET No: 10 of -

FILE NAME: J:_ Active Work\2265 - Main Stay Suites - Hackberry, Louisiana\Drawings\Current Drawings\E103-Power & Plans.dwg, 8/17/2016 7:04:11 PM, Mistich, February 15, 2016 7:04:11 PM