PANEL SCHEDULE

PANEL: MDP
LOCATION: MECHANICAL, ELECTRICAL & PLUMBING ROOM 114 FIRST LEVEL
FEEDER SOURCE: SERVICE
VOLTAGE: 208/120V, 1400A, 3Φ, 4W W/MLO
ENCLOSURE: SURFACE MOUNTED W/ EQUIPMENT GND BAR SQ D TYPE QED SWITCHBOARD

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION / LOCATION	BREAKER AMP	BREAKER POLE	LOAD (VA)	LOAD (VA)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION / LOCATION	THHN WIRE SIZE	CKT NO
1					52,439	16,744					2
3	2 X 250MCM	ELECTRICAL CIRCUIT PANEL P11 FIRST LEVEL	400	3	54,881	13,699	3	175	ELECTRICAL CIRCUIT PANEL P12 FIRST LEVEL	4/0	4
5					50,881	14,025					6
7					9810	18070					8
9	4/0	ELECTRICAL CIRCUIT PANEL P13 FIRST LEVEL	175	3	9276	18,930	3	175	ELECTRICAL CIRCUIT PANEL P14 FIRST LEVEL	4/0	10
11					7962	19,000					12
13					18,070	98,908					14
15	4/0	ELECTRICAL CIRCUIT PANEL P15 FIRST LEVEL	175	3	18,930	102,912	3	400	SECOND LEVEL ELECTRICAL CIRCUIT PANEL P21	2 X 250MCM	16
17					19,000	99,575					18
19					7,800	100,480					20
21	4/0	ELECTRICAL CIRCUIT PANEL P16 FIRST LEVEL	175	3	6,870	105,912	3	400	THIRD LEVEL ELECTRICAL CIRCUIT PANEL P31	2 X 250MCM	22
23					7,730	100,575					24

SOLID NEUTRAL / NEUTRAL WIRE (W) — GROUND BUS / GROUND WIRE (G)

TOTAL CONNECTED LOAD (VA) = 972,479

AΦ = 322,321 | BΦ = 331,410 | CΦ = 318,748

PANEL SCHEDULE

PANEL: P11
LOCATION: MECHANICAL, ELECTRICAL, & PLUMBING ROOM 114 FIRST LEVEL
FEEDER SOURCE: MDP PANEL
VOLTAGE: 208/120V, 400A 3Φ, 4W W/MB PANEL
ENCLOSURE: SURFACE MOUNTED W/ EQUIPMENT GND BAR SQ D TYPE QED SWITCHBOARD

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION / LOCATION	BREAKER AMP	BREAKER POLE	LOAD (VA)	LOAD (VA)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION / LOCATION	THHN WIRE SIZE	CKT NO
1					7956	7500					2
3	#8	15 TON A/C CONDENSER UNIT 1ST LEVEL	80	3	7956	7500	3	90	15 TON HVAC UNIT, 1ST LEVEL, 22.5 KW HEAT	#3	4
5					7956	7500					6
7					1200	3333					8
9	#12	2 1/2 TON A/C CONDENSER UNIT THIS END	15	3	1200	3333	3	60	2 1/2 TON HVAC UNIT, 1ST LEVEL 10 KW HEAT	#6	10
11					1200	3333					12
13					1200	9950					14
15	#12	2 1/2 TON A/C CONDENSER UNIT THIS END	15	3	1200	9950	3	50	ELEVATOR MOTOR POWER DISCONNECT	#8	16
17					1200	9950					18
19					1200	3333					20
21	#12	2 1/2 TON A/C CONDENSER UNIT CENTER, LOUNGE	15	3	1200	3333	3	60	2 1/2 TON HVAC UNIT, 1ST LEVEL LOUNGE 10 KW HEAT	#6	22
23					1200	3333					24
25					1200	3333					26
27	#12	2 1/2 TON A/C CONDENSER UNIT CENTER, CONFERENCE ROOM	15	3	1200	3333	3	60	2 1/2 TON HVAC UNIT, 1ST LEVEL CONFERENCE ROOM 10 KW HEAT	#6	28
29					1200	3333					30
31					1200	917					32
33	#12	2 1/2 TON A/C CONDENSER UNIT OPPOSITE END, FOR 1ST LEVEL	15	3	1200	917	3	15	HOUSE DRYER	#12	34
35					1200	917					36
37					1200	917					38
39	#12	2 1/2 TON A/C CONDENSER UNIT OPPOSITE END, FOR 2ND LEVEL,	15	3	1200	917	3	15	HOUSE DRYER	#12	40
41					1200	917					42
43					1200	1400	2	15	HOUSE WASHER	#12	44
45	#12	2 1/2 TON A/C CONDENSER UNIT OPPOSITE END FOR 3RD LEVEL,	15	3	1200	1400					46
47					1200	1400	2	15	HOUSE WASHER	#12	48
49						1400					50
51						3842	1	40	SEWER TREATMENT PLANT	#8	52
53						3842					54
55						4000	1	30	PARKING LOT LIGHTING	#10	56
57						4000					58
59											60
61											62
63											64

SOLID NEUTRAL / NEUTRAL WIRE (W) — GROUND BUS / GROUND WIRE (G)

TOTAL CONNECTED LOAD (VA) = 158,201

AΦ = 52,439 | BΦ = 54,881 | CΦ = 50,881

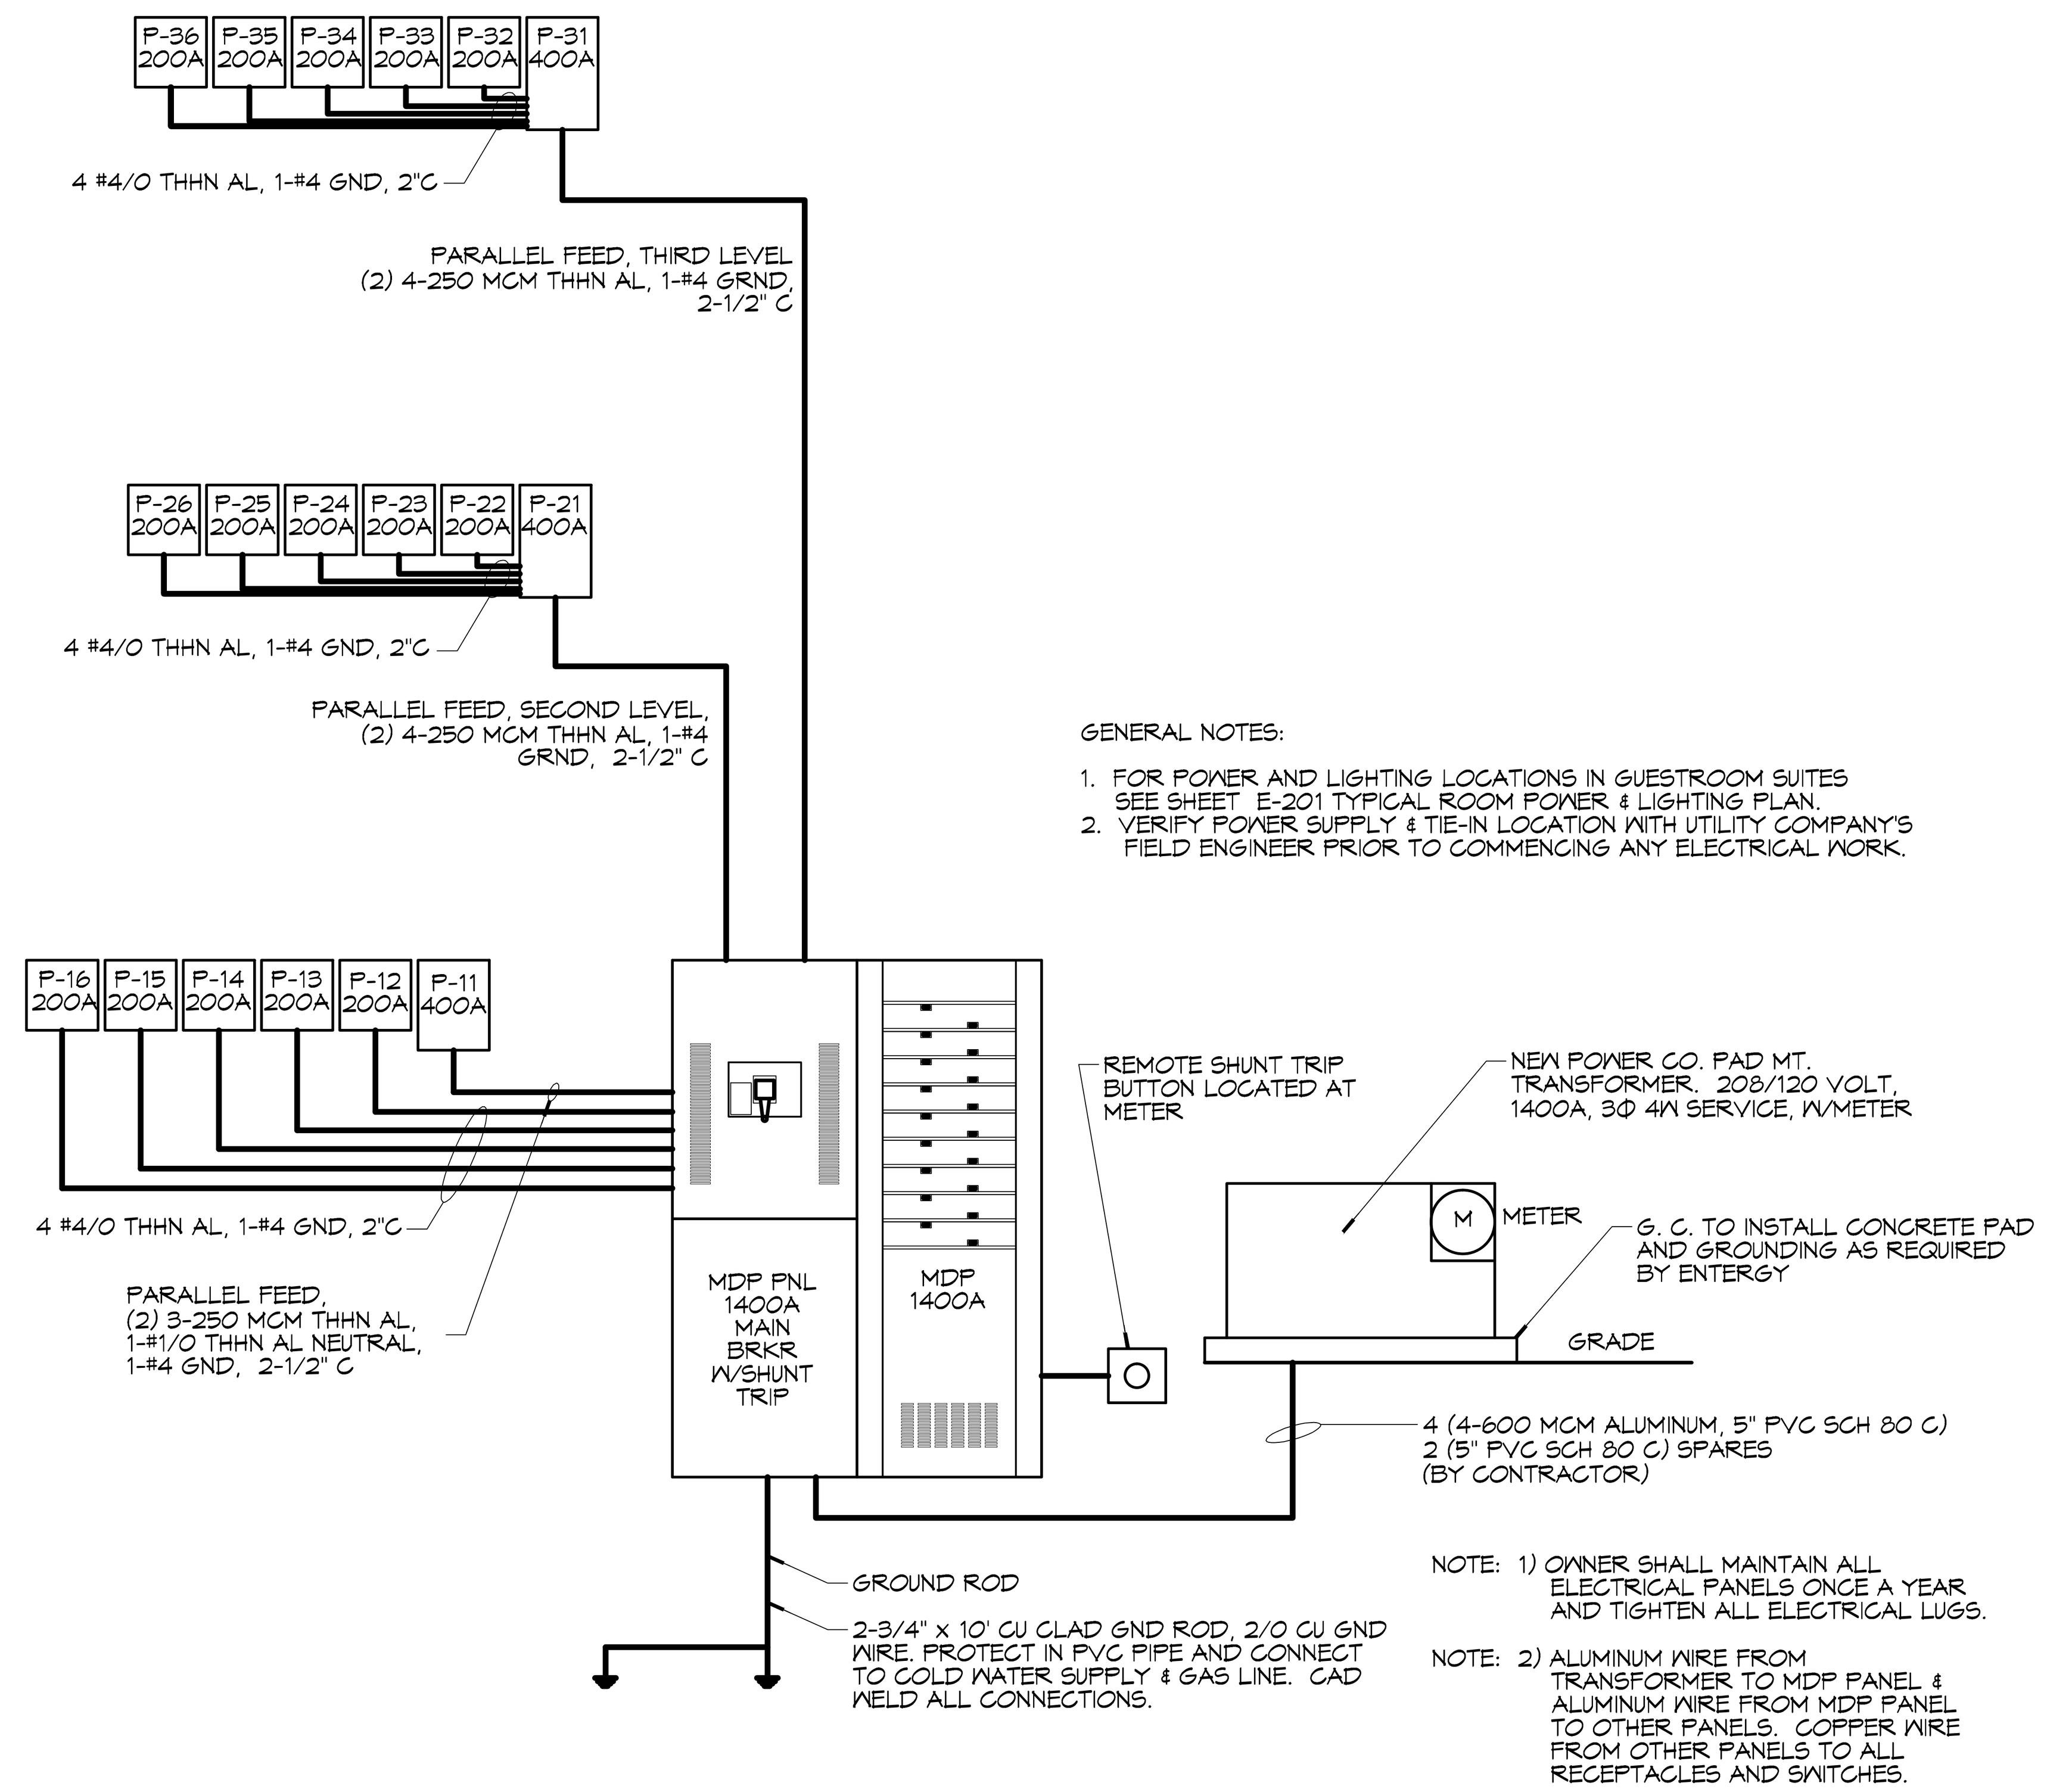

GENERAL NOTES:

1. FOR POWER AND LIGHTING LOCATIONS IN GUESTROOM SUITES SEE SHEET E-201 TYPICAL ROOM POWER & LIGHTING PLAN.
2. VERIFY POWER SUPPLY & TIE-IN LOCATION WITH UTILITY COMPANY'S FIELD ENGINEER PRIOR TO COMMENCING ANY ELECTRICAL WORK.

NOTE: 1) OWNER SHALL MAINTAIN ALL ELECTRICAL PANELS ONCE A YEAR AND TIGHTEN ALL ELECTRICAL LUGS.

NOTE: 2) ALUMINUM WIRE FROM TRANSFORMER TO MDP PANEL & ALUMINUM WIRE FROM MDP PANEL TO OTHER PANELS. COPPER WIRE FROM OTHER PANELS TO ALL RECEPTACLES AND SWITCHES.

ELECTRICAL ONE-LINE DIAGRAM

SCALE: N.T.S.

ELECTRICAL LOAD SUMMARY

ENTERGY POWER COMPANY

PROJECT NAME: SPORTMAN'S LODGE - HACKBERRY, LOUISIANA
PROJECT ADDRESS: LOT #7 HIGHWAY 27
CITY/TOWN: HACKBERRY, LA 70645
INTENDED USER: HOTEL OCCUPANTS

REQ SERV: 208 V 3 PHASE 4 WIRES
SERV ENTR SIZE: 1400 AMPS
HVAC TONNAGE: ____ TONS
LARGEST MOTOR: ____ HP

(**NOTE:** MOTORS ABOVE 20HP MAY REQUIRE REDUCED VOLTAGE STARTING AND ARE NEVER RECOMMENDED FOR USE W/ 120/240V, 1Φ, 3W SERVICE)

TOTAL BUILDING SQ FT: ____ SF
INDIVIDUAL UNIT SQUARE FOOTAGE: ____ SF (MULT OCCUPANCY)
INDIVUDUAL UNIT DESIGNATION: (MULT OCCUPANCY)

LOAD SOURCE	1Φ-kVA	3Φ-kVA	OR	1Φ-kW	3Φ-kW
BUILDING LIGHTING					
ELECTRIC WATER HEATING					
HEAT PUMPS					
SUPPLEMENTAL HEAT SYSTEMS					
AIR COND CONDENSING UNITS					
ELEC HEATING (PRIMARY) - AHU's					
COOKING					
REFRIGERATION					
RECEPTACLES (STANDARD)					
RECEPTACLES (COMPUTER)					
TOTAL MOTORS (EXCLUDE HVAC)					
EXTERIOR LIGHTING					
MISCELLANEOUS - CEILING FANS					
OTHER (SPECIFY)					

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832 F: 985.641.5950

REVISIONS

#	DESCRIPTION	DATE

SEAL:

PRELIMINARY NOT FOR CONSTRUCTION

MAIN STAY SUITES

700 MAIN STREET
LOT #7 LA HWY 27
HACKBERRY, LA 70645

JOB No: 2265 | DATE: FEBRUARY, 2016
DRAWN BY: DD/JTL | CHECKED BY: CKD

The above drawings and specifications, designs and arrangements represented thereby are and shall remain the property of Dammon Engineering, and no part thereof shall be copied, disclosed to others, or used in connection with any work or project other than the specific project for which they have been prepared and developed without written consent of Dammon Engineering. Visual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these restrictions.

SHEET TITLE:
ELECTRICAL PANEL SCHEDULES, ONE-LINE DIAGRAM & LOAD SUMMARY

DRAWING NUMBER:
E601

SHEET No: 00 of -