


SEQN: 139083 / T202 / SY42
FROM:

Ply: 1
Qty: 15
Wgt: 67.2 lbs

Job Number: 1615018-4-L2
The Lofts at Canterbury FLOOR
Truss Label: F207

DRW: ... / ...
07/03/2024

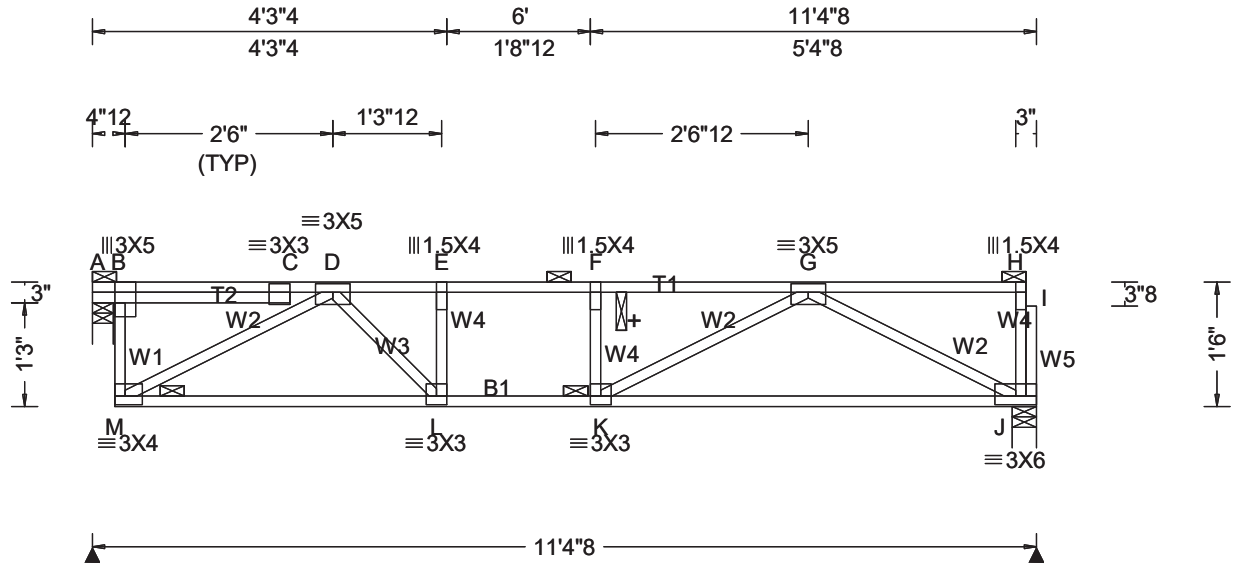

Loading Criteria (psf)

TCLL: 40.00
 TCCL: 17.00
 BCLL: 0.00
 BCDL: 8.00
 Des Ld: 65.00
 NCBCLL: 0.00
 Soffit: 2.00
 Load Duration: 1.00
 Spacing: 24.0 "

Wind Criteria

Wind Std: NA
 Speed: NA mph
 Enclosure: NA
 Category: NA
 EXP: NA Kzt: NA
 Mean Height: NA ft
 TCCL: NA psf
 BCDL: NA psf
 MWFRS Parallel Dist: NA
 C&C Dist a: NA ft
 Loc. from endwall: NA
 I: NA GCpi: NA
 Wind Duration: NA

Snow Criteria (Pg,Pf in PSF)

Pg: NA Ct: NA CAT: NA
 Pf: NA Ce: NA
 Lu: NA Cs: NA
 Snow Duration: NA

Building Code:
 IBC 2012
 TPI Std: 2007
 Rep Fac: Yes
 FT/RT: 12(0)/0(0)
 Plate Type(s):
 WAVE

Defl/CSI Criteria

PP Deflection in loc L/defl L/#
 VERT(LL): 0.117 F 999 360
 VERT(TL): 0.251 F 526 240
 HORZ(LL): 0.015 J - -
 HORZ(TL): 0.038 J - -
 Creep Factor: 1.5
 Max TC CSI: 0.997
 Max BC CSI: 0.720
 Max Web CSI: 0.362
 Mfg Specified Camber:
 VIEW Ver: 16.02.01.1215.14

▲ Maximum Reactions (lbs)

Loc	Gravity			Non-Gravity		
	R+	/R-	/Rh	/Rw	/U	/RL
A	727	-	-	-	-	-
J	733	-	-	-	-	-
A	Brg Wid = 3.0 Min Req = 1.5					
J	Brg Wid = 3.5 Min Req = 1.5					

Bearings A & J are a rigid surface.

Maximum Top Chord Forces Per Ply (lbs)

Chords	Tens.Comp.		Chords	Tens. Comp.	
A - B	0	0	E - F	0	-1414
B - C	20	0	F - G	0	-1406
C - D	46	0	G - H	1	0
D - E	0	-1403			

Lumber
 Value Set: 13B (Effective 6/1/2013)
 Top chord: 4x2 SP #2;
 Bot chord: 4x2 SP #2;
 Webs: 4x2 SP #3;
 Lumber value set "13B" uses design values approved 1/30/2013 by ALSIC

Purlins
 In lieu of structural panels or rigid ceiling use purlins to laterally brace chords as follows:

Chord	Spacing(in oc)	Start(ft)	End(ft)
TC	90	-0.27	10.85
BC	120	0.00	10.85

Apply purlins to any chords above or below fillers at 24" OC unless shown otherwise above.

End Vertical Attachment
 Attach notched end vertical(s) to next end vertical using (3) qty. 10d box or (0.128"x3"min) gun nails, or (5) qty. 15-Gauge, 7/16" Crown, 2-1/2" length wire staples, through wide face; or (3) qty. 16-Gauge, 1" Crown (minimum), 1-1/2" length wire staples on each narrow face.

Additional Notes
 + 2x6 continuous strongback. See detail STRBRIBR1014 for bracing and bridging recommendations.
 Truss must be installed as shown with top chord up.

Maximum Bot Chord Forces Per Ply (lbs)

Chords	Tens.Comp.		Chords	Tens. Comp.	
M - L	1120	0	K - J	1029	0
L - K	1414	0			

Maximum Web Forces Per Ply (lbs)

Webs	Tens.Comp.		Webs	Tens. Comp.	
M - B	618	0	K - G	507	0
M - D	0	-1286	G - J	0	-1176
D - L	533	0	H - J	0	-115
L - E	0	-293	J - I	0	-12
F - K	0	-170			

****WARNING** READ AND FOLLOW ALL NOTES ON THIS DRAWING!**
****IMPORTANT** FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS**
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have continuous lateral restraint (CLR), installed with diagonal bracing installed on the CLR per BCSI sections B3, B7, or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions. Refer to Job's General Notes page for additional information.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation and bracing of trusses. A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see these web sites: Alpine: alpineitw.com; TPI: tpinet.org; SBCA: sbccomponents.com; ICC: iccsafe.org; AWC: awc.org