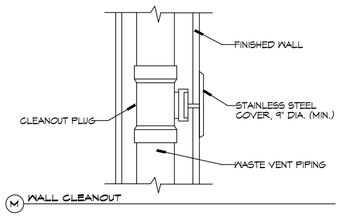


M WALL CLEANOUT

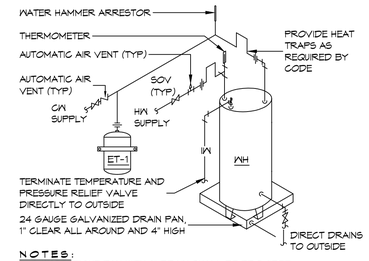


NOTES:
1. A WATERTIGHT PAN WITH 1" DRAIN SHALL BE PROVIDED UNDER WATER HEATER.

N WATER HEATER

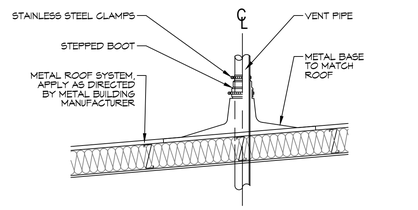


O ROOF VENT

# TYPICAL DETAILS

SCALE: NTS

MISCELLANEOUS PLUMBING

## PLUMBING FIXTURE SCHEDULE

| MK | DESCRIPTION | TYPE | ROUGH - IN - SIZE | | | | NOTES |
|---|---|---|---|---|---|---|---|
| | | | WASTE | VENT | COLD | HOT | |
| WC | WATER CLOSET | VALVE | 4" | 3" | 1-1/2" | - | 3 |
| UR | URINAL | VALVE | 3" | 2" | 3/4" | - | 3 |
| LAV | LAVATORY | WALL HUNG | 2" | 2" | 3/4" | 3/4" | 1,2,3 |
| SH | SHOWER | - | 2" | 2" | 3/4" | 3/4" | 5 |
| FD | FLOOR DRAIN | - | 3" | 2" | - | - | 4 |
| HS | HAND SINK | - | 3" | 2" | 3/4" | 3/4" | - |
| MS | MOP SINK | - | 3" | 2" | 3/4" | 3/4" | - |
| WH | WATER HEATER | - | 3/4" | 2" | 3/4" | 3/4" | - |
| AHU | AIR HANDLER DRAIN | - | 3/4" | 2" | - | - | - |

NOTES:
1. INSULATE PIPING FOR HANDICAP FIXTURE.
2. PROVIDE CHAIR CARRIER FOR WALL HUNG FIXTURE.
3. HANDICAP FIXTURE
4. INSTALL CONTINUOUS DRIP VALVE ON ALL FLOOR DRAINS.
5. PROVIDE ASSE 1016 COMPLIANT VALVE - FOR ALL SHOWERS
6. PROVIDE ASSE 1070 COMPLIANT MIXING VALVE - FOR ALL LAVATORIES/SINKS

## GENERAL PLUMBING NOTES

1. PLUMBING LINES SHOWN ARE DRAWN DIAGRAMMATIC IN NATURE AND REPRESENT CONCEPTUAL ROUTING ONLY. CONTRACTOR IS RESPONSIBLE FOR FIELD VERIFICATION OF ALL ACTUAL CONDITIONS.
2. PROVIDE ALL LABOR, MATERIAL, TRANSPORTATION, SUPERVISION, CLEAN-UP, SERVICES, AND EQUIPMENT FOR A COMPLETE OPERATING SYSTEM. THE SYSTEM SHALL INCLUDE HOT AND COLD WATER PIPING, SEWER AND VENT PIPING, INSULATION, WATER HEATER, HANGERS, VALVES, SUPPORTS WITHOUT ANY RESTRICTIONS TO VOLUME, CUT AND PATCH AS REQUIRED TO INSTALL PIPES.
3. ALL WORK AND MATERIAL SHALL CONFORM STRICTLY TO THE LATEST LOCAL CITY, PARISH, STATE AND NATIONAL GOVERNING CODES. MUST MEET LA STATE PLUMBING CODE 2013 REQUIREMENTS.
4. CONTRACTOR IS TO FIELD VERIFY ALL EXISTING UTILITY LOCATIONS, ELEVATIONS AND SIZES PRIOR TO COMMENCING ANY WORK. CONTRACTOR SHALL PAY NECESSARY FEES FOR THE UTILITIES CONNECTIONS.
5. CONTRACTOR IS RESPONSIBLE TO VERIFY THE EXISTING INVERTS AND SET NEW INVERTS OF SEWERAGE AND DRAINAGE PIPES.
6. SEWERAGE LINES 3-INCH AND SMALLER SHALL BE SLOPED 1/4" PER FOOT AND LINES 4-INCH AND LARGER SHALL BE 1/8" PER FOOT.
7. TEST ALL PIPING AT REQUIRED PRESSURE.
8. ALL PLUMBING SHALL BE CLOSELY COORDINATED WITH STRUCTURAL, MECHANICAL SYSTEM AND ELECTRICAL SYSTEMS TO INSURE NO TRADES WILL CONFLICT WITH EACH OTHER.
9. DO NOT SCALE DRAWINGS. SEE ARCHITECTURAL DRAWINGS FOR EXACT LOCATIONS OF DOORS, WINDOWS, WALLS, FIXTURES, ETC.
10. ALL WATER MAINS AND PIPING NOT SHOWN FOR CLARITY, ALL LOCATIONS FIELD VERIFIED.
11. DOMESTIC HOT AND COLD WATER PIPING AND FITTINGS UNDER SLAB SHALL BE ASTM B88 COPPER WATER TUBE, TYPE K, SOFT ANNEALED. NO JOINTS SHALL BE ALLOWED UNDER THE SLAB. PEX IS ALLOWED.
12. DOMESTIC WATER PIPING AND FITTINGS ABOVE THE SLAB SHALL BE ASTM B88 COPPER WATERTUBE, TYPE L. HARD DRAWN WITH COPPER PRESSURE TYPE FITTINGS, ANSI B16.22. THE JOINTS SHALL BE SOLDERED TYPE USING ASTM B32, ALLOY GRADE 95A (95-5) SOLDER. PEX IS ALLOWED.
13. SOIL, WASTE, VENT PIPING AND FITTINGS ABOVE THE SLAB SHALL BE SERVICE WEIGHT CAST IRON PIPE WITH BELL AND SPIGOT ENDS AND ONE PIECE NEOPRENE INSERT TYPE GASKET. USE PVC SCHEDULE 40 OR ABS DWV PIPES AND FITTINGS WHERE PERMITTED BY CODE. PVC PIPE IS ALLOWED.
14. ALL WATER PIPING AND FITTINGS ABOVE THE FLOOR SHALL BE INSULATED WITH 1/2" THICK FIBERGLASS INSULATION AND JACKET.
15. ALL ELECTRICAL, MECHANICAL AND PLUMBING ELEMENTS PENETRATING FIRE PARTITIONS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
16. ALL VENTS THROUGH ROOF (VTR) SHALL BE LOCATED A MINIMUM OF 10'-0"FROM ANY MECHANICAL OR NATURAL AIR INTAKE.

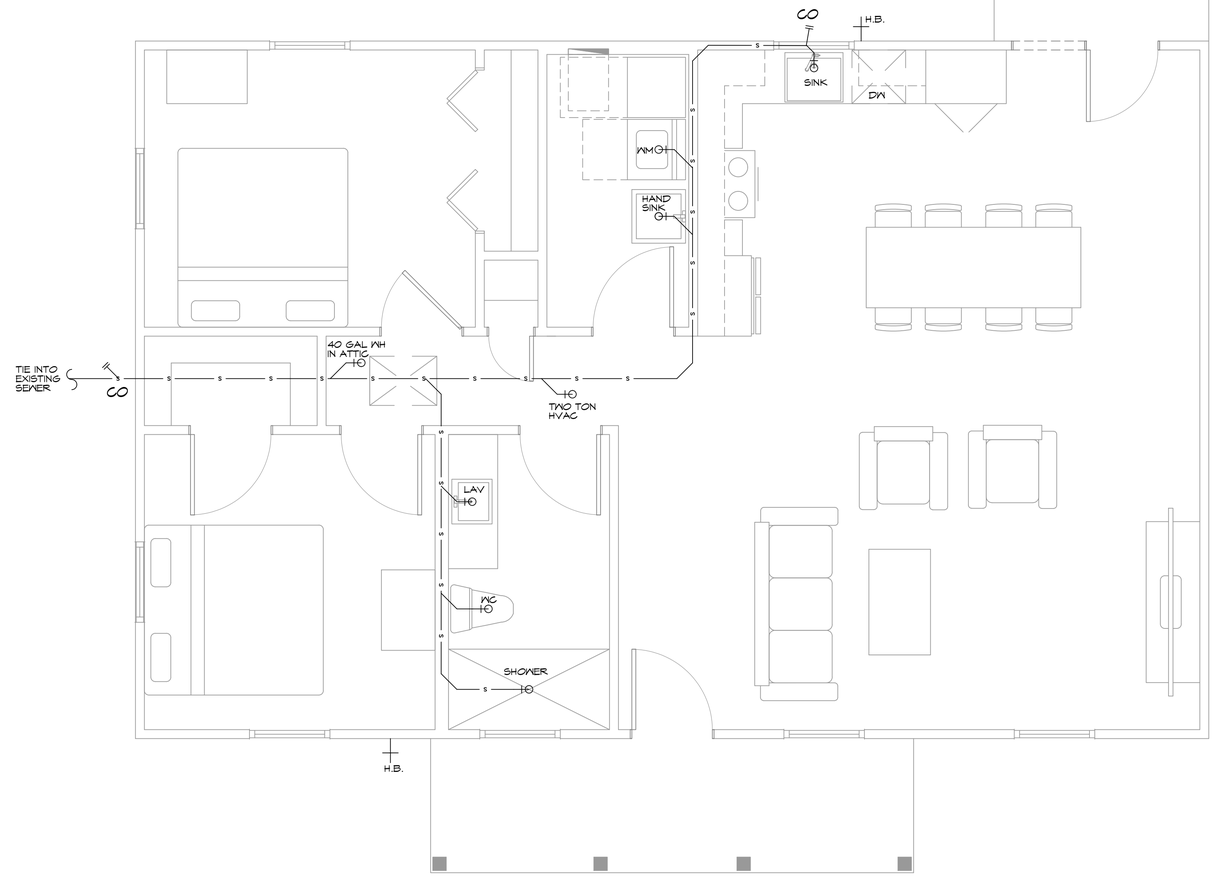


14 PLUMBING PLAN
SCALE: 3/8"=1'-0"

NOTE:
ALL PLUMBING IS DRAWN DIAGRAMMATICALLY FOR CLARITY

## PLUMBING ABBREVIATIONS

| | | | |
|---|---|---|---|
| HS | HAND SINK | MS | MOP SINK |
| LAV | LAVATORY | WH | WATER HEATER (PLACED IN ATTIC |
| WC | WATER CLOSET | | |

## LEGEND

| SYMBOL | DESCRIPTION |
|---|---|
| S S | SEWER LINE |
| V V | VENT PIPE |
| | ELBOW UP |
| FD | FLOOR DRAIN |
| CO | CLEAN OUT |
| HB | HOSE BIB |

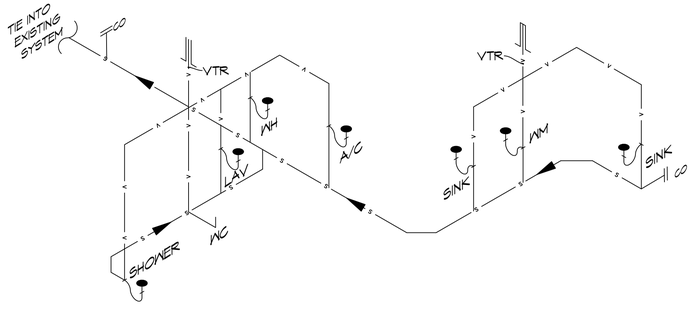


15 PLUMBING RISER DIAGRAM
SCALE: N.T.S.


DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458


| # | DESCRIPTION | DATE |
|---|---|---|
| 1 | ADDED PEX AND PVC | 07-08-25 |

REVISIONS

BRIAN A. MISTICH License No. 30187 PROFESSIONAL ENGINEER STATE OF LOUISIANA


The shared drawings and specifications, design and arrangements represented thereby are and shall remain the property of Dammon Engineering, Inc. and are not to be used in whole or part for any project other than the specific project for which they have been prepared by Dammon Engineering. Any such unauthorized use, without the written permission of Dammon Engineering, is prohibited and shall be at the user's sole risk and without liability to Dammon Engineering. Visual contact with these drawings or specifications shall constitute prima facie evidence of the acceptance of these restrictions.


FIRST COAST PLUMBING

339 ROBERT BLVD
SLIDELL, LA. 70458

| DRAWN BY: | JOB No: | SCALE: |
|---|---|---|
| BAM | 03-24-2025 | CHECKED BY: |

SHEET TITLE:
PLUMBING PLAN AND PLUMBING RISER DIAGRAM

DRAWING NUMBER:
P101

SHEET No: 11 of 11