FILE NAME: J:\... Foundations w/ Structural Grid\Bobby Harrison\Current Drawings\E101 - Electrical Plan.dwg, PLOT DATE & TIME: Tuesday, March 17, 2026 1:39:03 PM

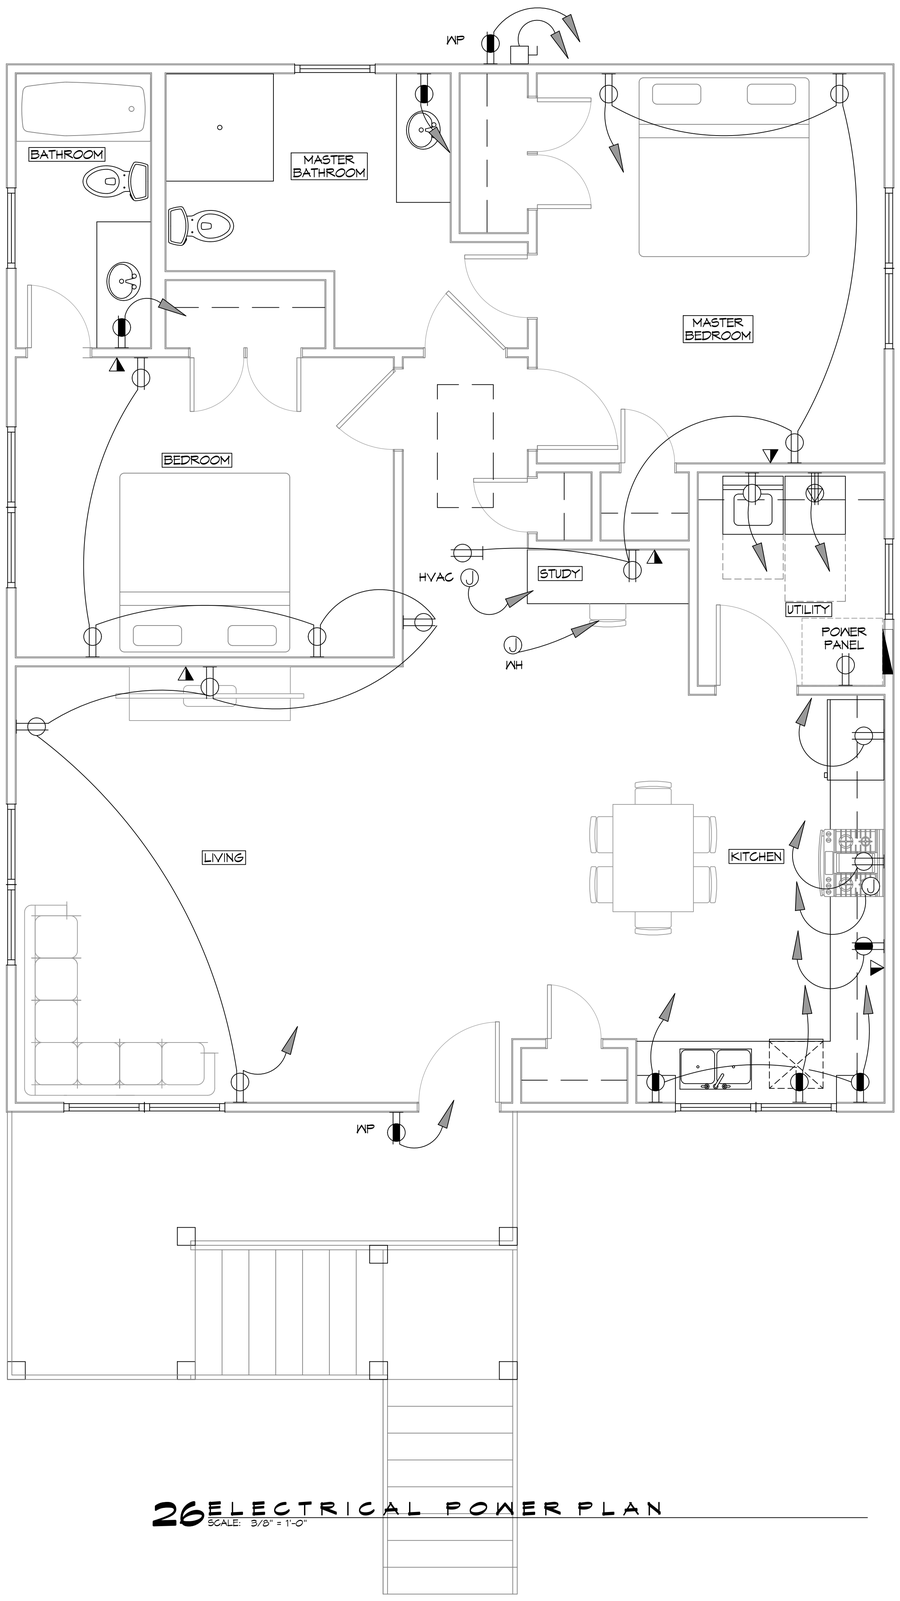

26 ELECTRICAL POWER PLAN
SCALE: 3/8" = 1'-0"

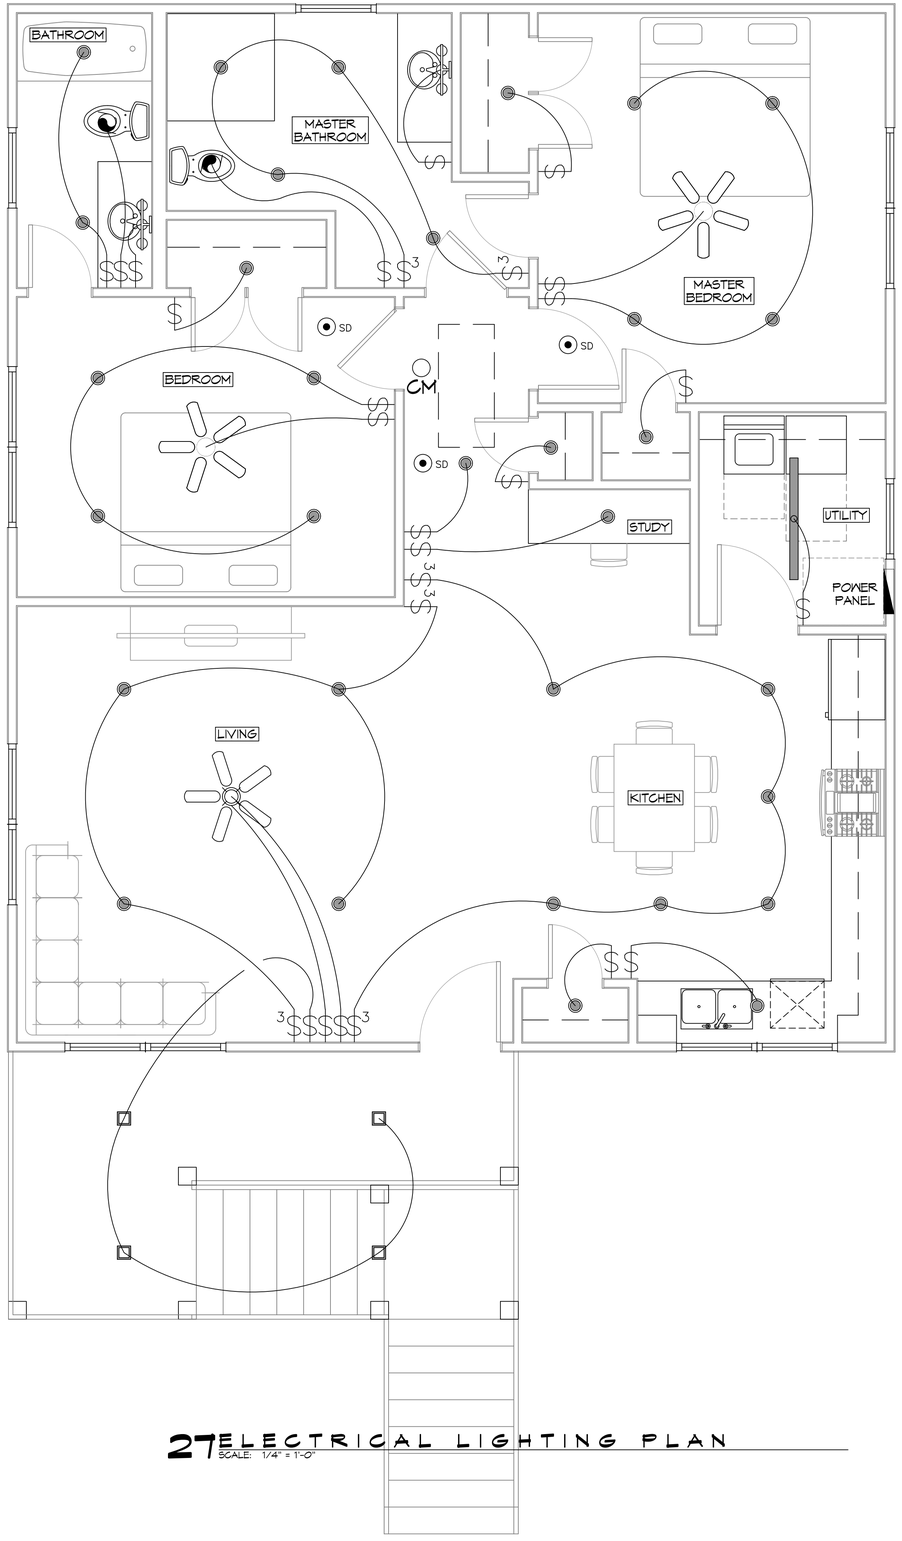

27 ELECTRICAL LIGHTING PLAN
SCALE: 1/4" = 1'-0"

GENERAL POWER NOTES

1. ALL ELECTRICAL SHALL BE INSTALLED PER THE 2020 NATIONAL ELECTRICAL CODE.
2. MAIN FEED INTO HOUSE TO BE TRENCHED UNDERGROUND FROM SUPPLY POLE TO METER THEN MAIN DISCONNECT OUTSIDE.
3. ALL SMOKE DETECTORS TO BE ELECTRIC POWERED WITH BATTERY BACKUP AND WIRED TO SET ALL ALARMS OFF IF ONE IS TRIPPED.
4. ALL EXTERIOR, KITCHEN, AND BATH OUTLETS TO BE GROUND FAULT CIRCUIT INTERRUPT EQUIPPED AND ON A SEPARATE CIRCUIT.
5. ELECTRICAL DISCONNECTS ARE TO BE AT A/C UNIT, CONDENSING UNIT, AND WATER HEATER.
6. HEAT VENT LIGHTS ARE TO BE ON A SEPARATE CIRCUIT.
7. OUTLETS, INCLUDING PHONE AND CABLE, MAY BE ADDED OR CHANGED UPON OWNERS REQUEST.
8. ELECTRICAL CONTRACTOR TO VERIFY EQUIPMENT TYPE AND SIZE.
9. INSTALL LIGHTS IN ATTIC SPACE W/ SWITCH AT FOOT OF DISP. STAIRS
10. ELECTRICAL SERVICE TO BE A 42 CIRCUIT 200 AMP MAIN LOCATED IN THE HOUSE.
11. A SUB-PANEL MAY NEED TO BE ADDED FOR ENOUGH CIRCUITS.
12. HOUSE TO BE WIRED FOR A SECURITY SYSTEM.
13. ALL KITCHEN OUTLETS ARE TO BE GFI EXCEPT APPLIANCE OUTLETS NOT EASILY ACCESSIBLE.
14. ARC FAULT BREAKERS ARE TO BE USED IN ALL BEDROOMS.
15. IF GAS FIRED APPLIANCES ARE USED IN HOME, CARBON MONOXIDE ALARMS ARE NEEDED (IRC R315).

LIGHTING LEGEND

- CEILING FIXTURE
- BATHROOM FIXTURE
- CEILING FAN W/ LIGHT FIXTURE
- CEILING FAN
- SD — SMOKE DETECTOR
- $ — ONE WAY SWITCH
- CM — CARBON MONOXIDE DETECTOR
- $3 — THREE WAY SWITCH
- OUTDOOR CEILING LIGHTS
- TUBE LIGHTS
- EXHAUST FAN

POWER LEGEND

- DUPLEX RECEPTACLE
- GFI DUPLEX RECEPTACLE
- WP — WEATHER-PROOF GFI DUPLEX RECEPTACLE
- 240V DRYER RECEPTACLE
- WALL MOUNTED DATA
- DISCONNECT

PRE-WIRE NOTES

1. TELEPHONE *ONE INCOMING LINE*
2. CABLE VISION *ONE OUTLET PER ROOM MINIMUM*
3. SECURITY SYSTEM: COORDINATE W/ OWNER
4. COORDINATE ELECTRICAL SYSTEM WITH MECHANICAL CONTRACTOR
5. ALL WIRING TO BE COPPER MIN. 12/2 W/ GROUND
6. VERIFY LOCATION OF FLOOR OUTLETS IN FAMILY ROOM
7. PROVIDE 110V OUTLET FOR GARAGE DISPOSAL UNDER KITCHEN SINK
8. PROVIDE 110V OUTLET FOR WHIRLPOOL TUB MOTOR UNDER WHIRLPOOL TUB IN MASTER BATH
9. PROVIDE 220V OUTLET FOR CLOTHES DRYER
10. COORDINATE SURROUND SYSTEM W/ OWNER

ALL ELECTRICAL DRAWINGS ARE DIAGRAMMATICALLY DRAWN FOR CLARITY.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
5647 Galeria Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

STATE OF LOUISIANA — BRIAN A. MISTICH License No. 30187 — PROFESSIONAL ENGINEER

NEW HOUSE PLAN

BOBBY HARRISON

3030 CAREY DRIVE
SLIDELL, LOUISIANA
70458

DRAWN BY:	CAD	DATE:	03-16-2026
JOB No:		CHECKED BY:	BAM

All plans, specifications and designs prepared by Dammon Engineering, Inc. are and shall remain the property of Dammon Engineering, Inc. and are protected by the laws of the United States Copyright Act. They are not to be changed or copied in any form or manner whatsoever nor are they to be assigned to any third party without first obtaining the expressed written permission and consent of Dammon Engineering, Inc. Any unauthorized use of these plans and designs will be at the user's sole risk and without liability to Dammon Engineering, Inc. and the user will indemnify and hold harmless Dammon Engineering, Inc. from all claims, damages, losses and expenses including attorney's fees arising out of or resulting therefrom.

SHEET TITLE:
ELECTRICAL LIGHTING & POWER PLAN

DRAWING NUMBER:
E101

SHEET No: 11 of 11