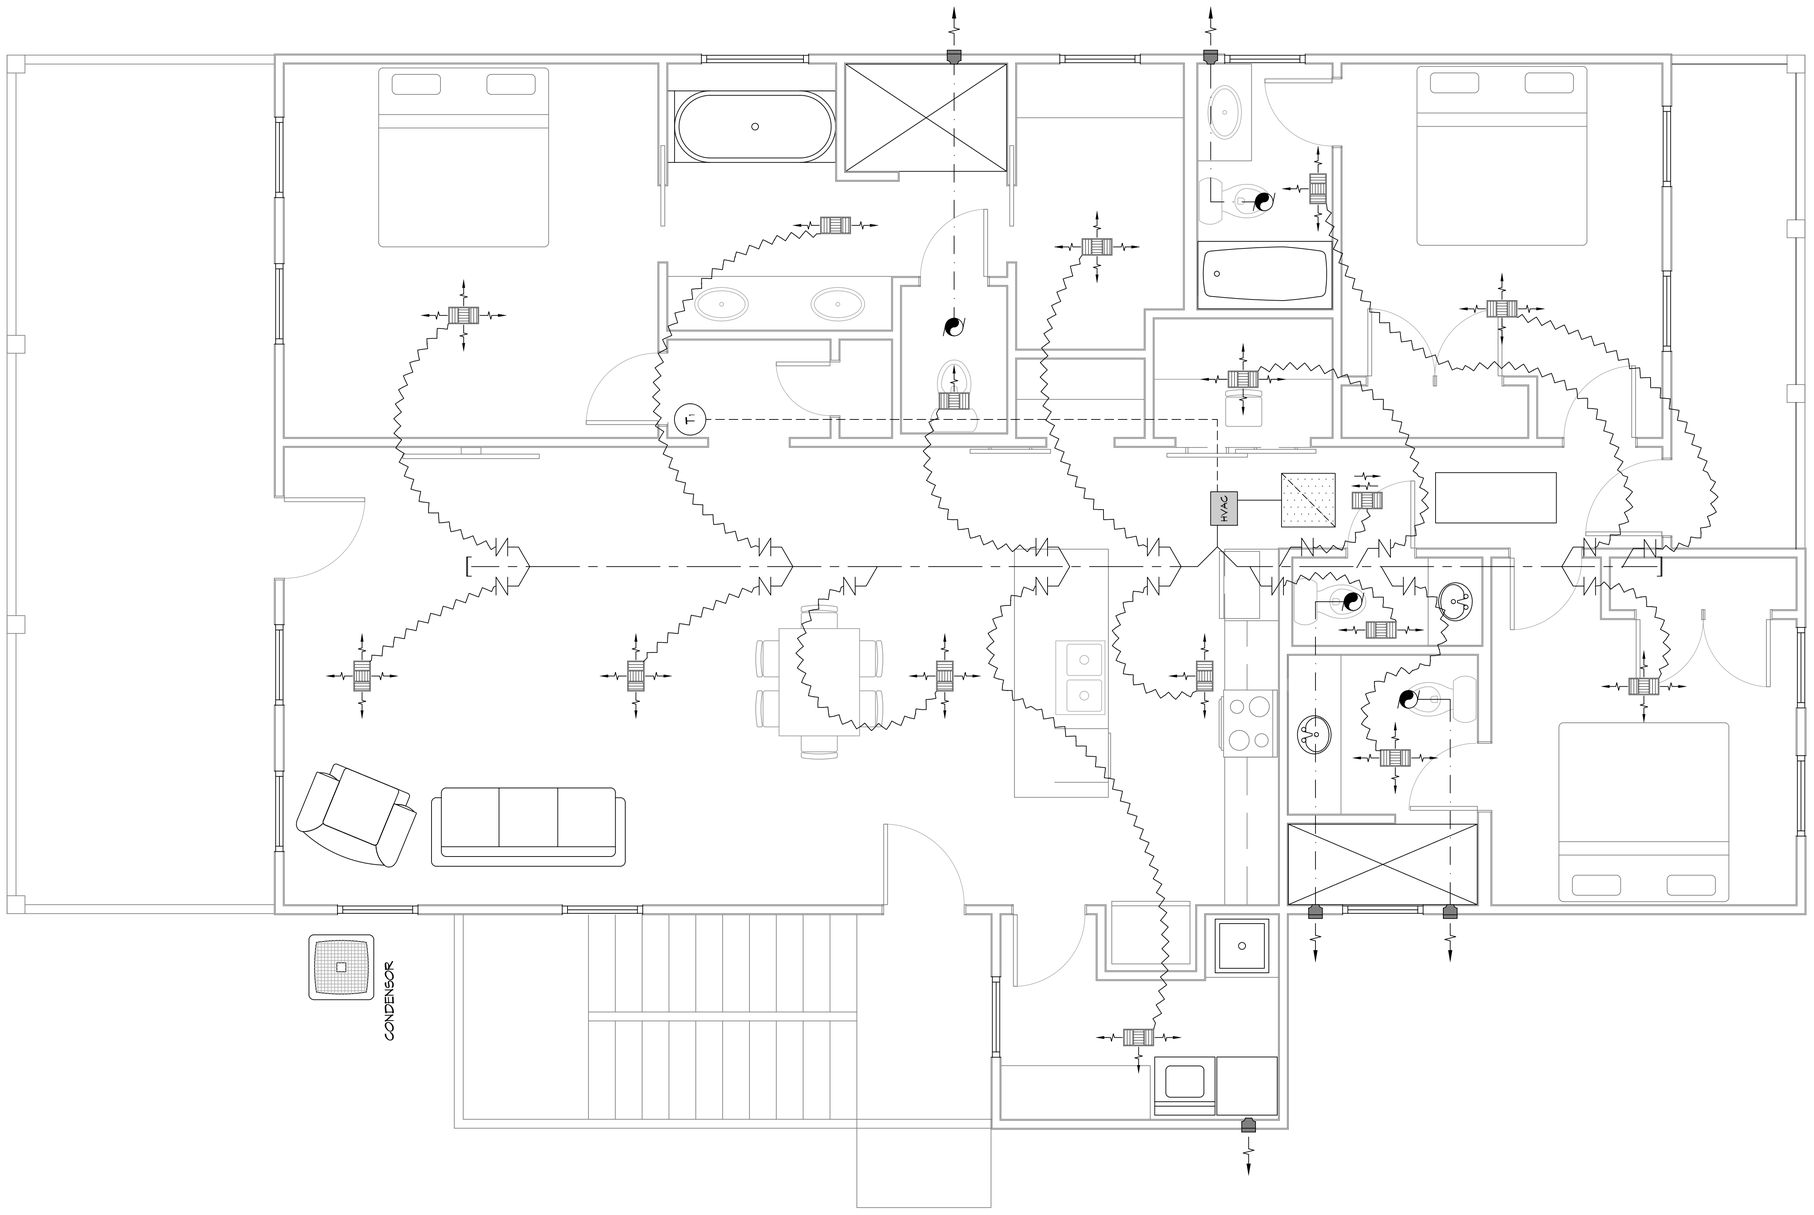

15 MECHANICAL PLAN
SCALE: 1/4" = 1'-0"

MECHANICAL LEGEND

- SUPPLY AIR GRILLE
- WALL LOUVER
- EXHAUST FAN
- RETURN AIR GRILLE

MECHANICAL NOTES

1. MECHANICAL SUBCONTRACTOR TO INSTALL HVAC SYSTEM, ACCORDING TO NATIONAL, STATE AND CITY CODE.
2. MECHANICAL SUBCONTRACTOR TO VERIFY HVAC DESIGN LOADS.
3. OWNER TO SELECT PLUMBING FIXTURES WITH CONTRACTOR.
4. DRAWINGS OF SYSTEM ARE SCHEMATIC AND SHOULD BE CONFIRMED BY SUBCONTRACTOR.
5. DUCTS AS SHOWN 26 GAUGE 6.1 INSULATE W/ 2" FIBERGLASS INSULATION. * MIN. DUCT SIZE 8" DIAMETER * MIN. DIFF. SIZE 10" DIAMETER WITH AIR VOLUME REG.
6. PLACE DAMPER CONTROLS IN ALL DUCT RUNS.
7. THERMOSTAT MIN. HONEYWELL. - WALL MOUNTED
8. MIN. CLEARANCE AT UNIT TO BE 4'-0"
9. PROVIDE 3/4" PLYWOOD, 24" MIN. WIDE CATWALK TO ALL MECHANICALS IN ATTIC. CATWALK - GREATER THAN 20' NEED 6' HEADROOM - MAX. 50' LENGTH. MAINTAIN PROPER CLEARANCE AT UNITS SERVICE AREA
10. CLEARANCE OF ALL HEAT PRODUCING APPLIANCES TO BE GREATER THAN 18" ABOVE OR 6" TO THE SIDE.
11. SEC. R315: CARBON MONOXIDE ALARMS - REQUIRED IN THE SMOKE ALARMS
12. A/C DRAIN TO 1-1/2" P-TRAP
13. PROVIDE 30" MIN. WIDE WORKING PLATFORM TO ACCESS SIDE OF HVAC. ATTIC DECKED WORK AREA MIN. 30" X 30".
14. HVL'S, VL'S, HV'S & GAS RANGE HOODS MUST VENT OUTSIDE. BATHROOM EXHAUST VENTS TO THE OUTSIDE OR PROVIDE MINIMUM 1.5 SQUARE FEET OPENABLE AREA. 15 DRYER MUST BE VENTED TO THE EXTERIOR OF THE RESIDENCE, IN COMPLIANCE WITH THE MECHANICAL CODE. DRYER VENT, LENGTH (MAX. LENGTH 25', - 5' FOR 90 DEGREE TURN, - 2.5' FOR 45 DEGREE TURN OR PER MANUFACTURER) AND DISCHARGE LOCATION.

ALL HVAC & SANITARY SEWER ARE DIAGRAMMATICALLY DRAWN FOR CLARITY.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

REVISIONS

#	DESCRIPTION	DATE

SEAL:

STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
PROFESSIONAL ENGINEER

NEW HOUSE PLAN

JASON GUY

LOT 228
MONGA DRIVE, LAZY RIVER ESTATES.
COVINGTON, LOUISIANA 70433

JOB No:	
DATE:	06-24-2025
DRAWN BY:	CKD
CHECKED BY:	BAM

The contents of this document, including, but not limited to, the design, plans, specifications, technical information, or other data, are the property of Dammon Engineering, Inc. and shall not be reproduced, distributed, or used for any purpose without written consent of Dammon Engineering, Inc. A fee is due upon receipt of this document and shall be paid within 30 days of receipt. Failure to pay the fee shall cancel the license to use the information contained in this document. Any use of this document for which no fee has been paid shall be a violation of the copyright and shall be subject to legal action.

SHEET TITLE:
MECHANICAL & PLUMBING PLAN

DRAWING NUMBER:

M101

SHEET No: 11 of 12