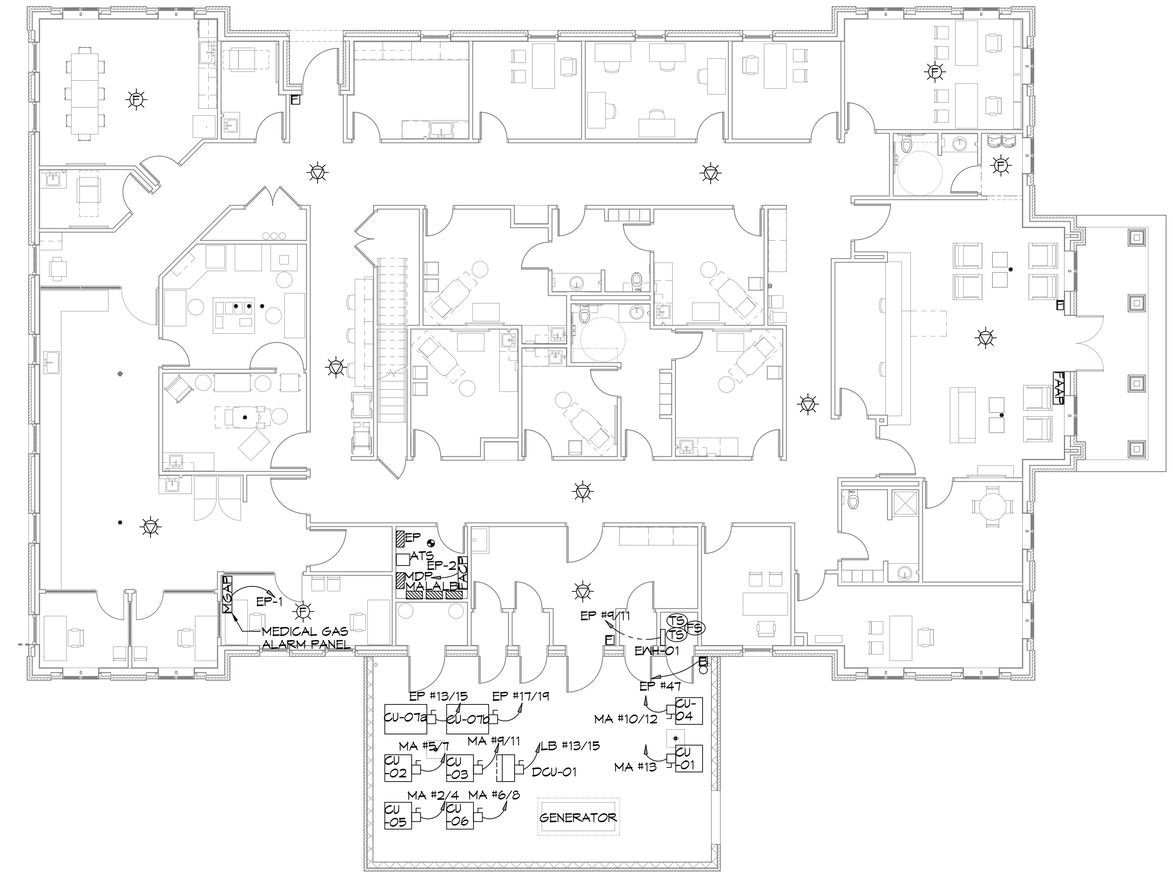

5 AUXILIARY PLAN

SCALE: 3/16"=1'-0"

FIRST FLOOR

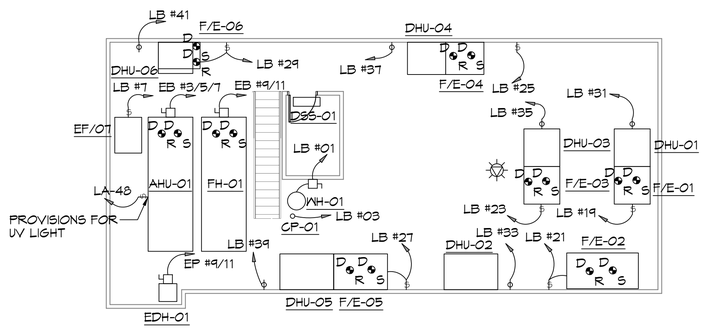

6 AUXILIARY PLAN- MEZZANINE

SCALE: 3/16"=1'-0"

SECOND FLOOR

MECHANICAL EQUIPMENT CONNECTIONS SCHEDULE

MARK	VOLTAGE	PANEL	CIRCUITRY	LOCAL DISCONNECT	REMARKS
AHU-01	208V3Φ	EP	3#12, #12(G), 1/2"C.	30/3I	
CU-01	208V1Φ	MA	2#8, #10(G), 3/4"C.	60/2/3R	
CU-02	208V1Φ	MA	2#10, #10(G), 3/4"C.	30/2/3R	
CU-03	208V1Φ	MA	2#8, #10(G), 3/4"C.	60/2/3R	
CU-04	208V1Φ	MA	2#12, #12(G), 1/2"C.	30/2/3R	
CU-05	208V1Φ	MA	2#8, #10(G), 3/4"C.	60/2/3R	
CU-06	208V1Φ	MA	2#10, #10(G), 3/4"C.	30/2/3R	
CU-07a	208V1Φ	EP	2#10, #10(G), 3/4"C.	30/2/3R	
CU-07b	208V1Φ	EP	2#10, #10(G), 3/4"C.	30/2/3R	
DCU-01	208V1Φ	MDP	2#12, #12(G), 1/2"C.	30/2/3R	INTERLOCKED WITH DSS-01
DSS-01	208V1Φ	MDP	2#12, #12(G), 1/2"C.	TWO POLE SWITCH (3^{20})	INTERLOCKED WITH DCU-01
F/E-01	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (3^{T})	
F/E-02	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (3^{T})	
F/E-03	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (3^{T})	
F/E-04	120V, 1Φ	LB	2#12, #12(G), 1/2"C.	MOTOR RATED SWITCH (3^{T})	
F/E-05	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (3^{T})	
F/E-06	120V, 1Φ	LB	2#10, #10(G), 3/4"C.	MOTOR RATED SWITCH (3^{T})	
DH-01	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-02	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-03	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-04	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-05	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
DH-06	120V,1Φ	LB	2#12,#12(G), 1/2"C.	NEMA 5-20R	
EWH-01	208V, 1Φ	MA	2#12,#12(G), 1/2"C.	TWO POLE SWITCH (3^{20})	
EF-01	120V, 1Φ	LA	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH LIGHTS
EF-02	120V, 1Φ	LA	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH LIGHTS
EF-03	120V, 1Φ	LA	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH LIGHTS
EF-04	120V, 1Φ	LA	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH LIGHTS
EF-05	120V, 1Φ	EP	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH AHU-01
EF-06	120V, 1Φ	EP	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH AHU-01
EF-07	120V, 1Φ	LB	2#12,#12(G), 1/2"C.	PROVIDED WITH EQUIPMENT	INTERLOCKED WITH EMS SYSTEM
FH-01	208V, 1Φ	EP	2#12,#12(G), 1/2"C.	TWO POLE SWITCH (3^{20})	INTERLOCKED WITH EMS SYSTEM
EDH-01	208V, 1Φ	EP	2#1, #6(G), 1-1/4"C.	100/2/1	
CP-01	120V, 1Φ	LB	2#12, #12(G), 1/2"C.	30/1/1	
WH-01	120V, 1Φ	LB	2#12, #12(G), 1/2"C.	5-20R	

GENERAL NOTE 1: PRIOR TO SUBMITTING ELECTRICAL EQUIPMENT BROCHURES, THE CONTRACTOR SHALL VERIFY LOCATION, ACTUAL EQUIPMENT SUBMITTAL DATA AND ADJUST EQUIPMENT SERVICES ACCORDINGLY.

NOTE A: CORD AND PLUG PROVIDED BY MECHANICAL CONTRACTOR AND INSTALLED BY ELECTRICAL CONTRACTOR.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5321
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

NEW MEDICAL OFFICE

POSITIVE STEPS FERTILITY

500 OAK HARBOR BLVD
SLIDELL, LA 70458

JOB No:	2513
DRAWN BY:	CKD
DATE:	05-01-2025
CHECKED BY:	BAM

THE DRAWINGS AND SPECIFICATIONS, INCLUDING BUT NOT LIMITED TO ELECTRONIC FORMATS, INDICATED AS PREPARED BY THE ARCHITECT AND ENGINEER ARE AND SHALL REMAIN THE PROPERTY OF THE ARCHITECT AND ENGINEER WHETHER THE PROJECT FOR WHICH THEY ARE MADE IS EXECUTED OR NOT. THEY ARE NOT TO BE USED BY THE OWNER OR OTHERS ON EXTENSIONS OF THIS PROJECT OR ON ANY OTHER PROJECT WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT AND ENGINEER. VISUAL CONTACT WITH THESE DRAWINGS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF ACCEPTANCE OF THESE RESTRICTIONS.

SHEET TITLE:
FIRST FLOOR
SECOND FLOOR
AUXILIARY PLAN

DRAWING NUMBER:

E3

SHEET No: 16 of 18

FILE NAME: J:_Projects__MedOps__Permit Drawings_Positive Steps Office\Current Drawings for Use\E03 - Electrical Auxiliary.dwg, 05-01-2025 7:09:03 AM, Wednesday, May 14, 2025 7:09:03 AM