


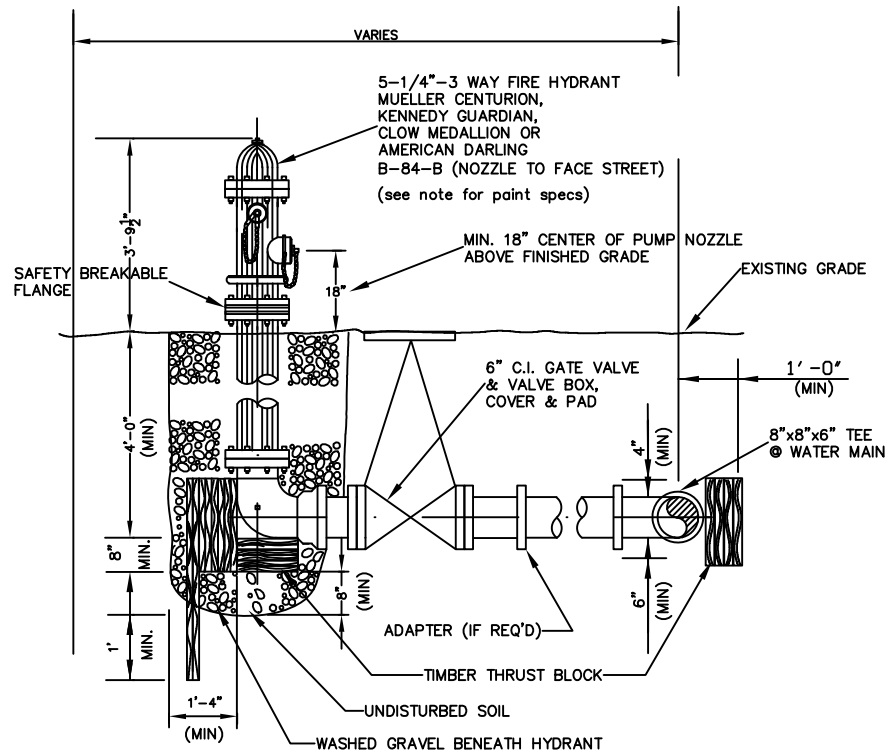


FIRE HYDRANT DETAIL

NOTES:

HYDRANT PAINT SHALL BE FACTORY APPLIED.
(FIELD APPLIED PAINT SHALL NOT BE APPROVED)

PAINT COLOR SHALL BE:


1. KENNEDY HYDRANTS: KENNEDY SAFETY YELLOW NUMBER 05
2. MUELLER HYDRANTS: SAFETY YELLOW, F63RXY9659, MA0150, PAINT CODE (M7)
3. CLOW MEDALLION: SAFETY YELLOW
4. AMERICAN DARLING HYDRANTS: DUPONT SAFETY YELLOW 1663IE

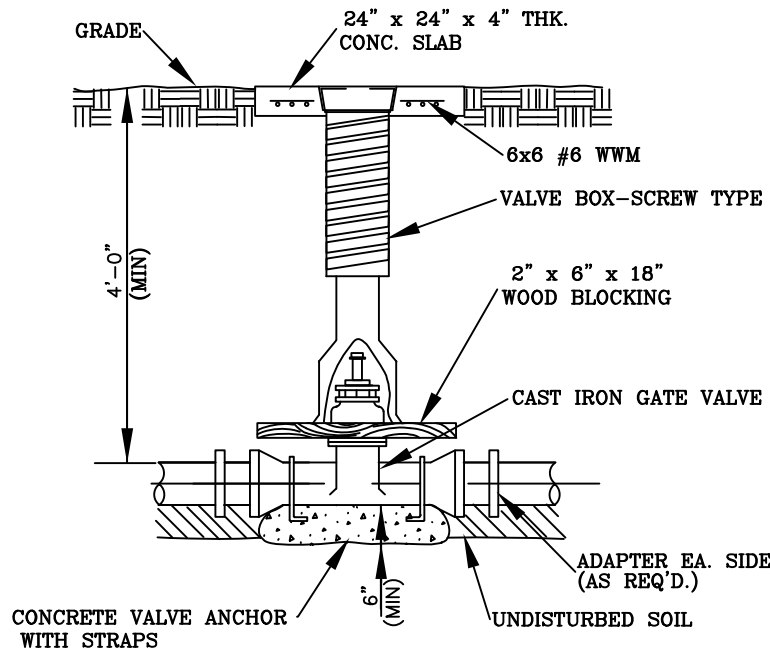

TYPICAL VALVE BOX DETAIL


NTS

BACKFILL WITH GRANULAR MATERIAL IN
6" LIFTS, COMPACTED TO 95% DENSITY
(BACKFILL w/ EXISTING ACCEPTABLE
MATWERIAL w/ APPROVAL OF ENGINEER)

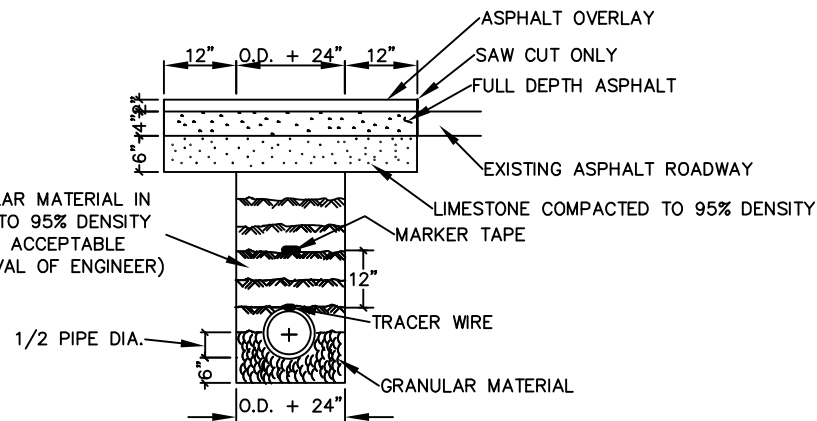


TYPICAL ASPHALT ROADWAY
SAW CUT SECTION
FOR WATER OR SEWER LINES

NTS

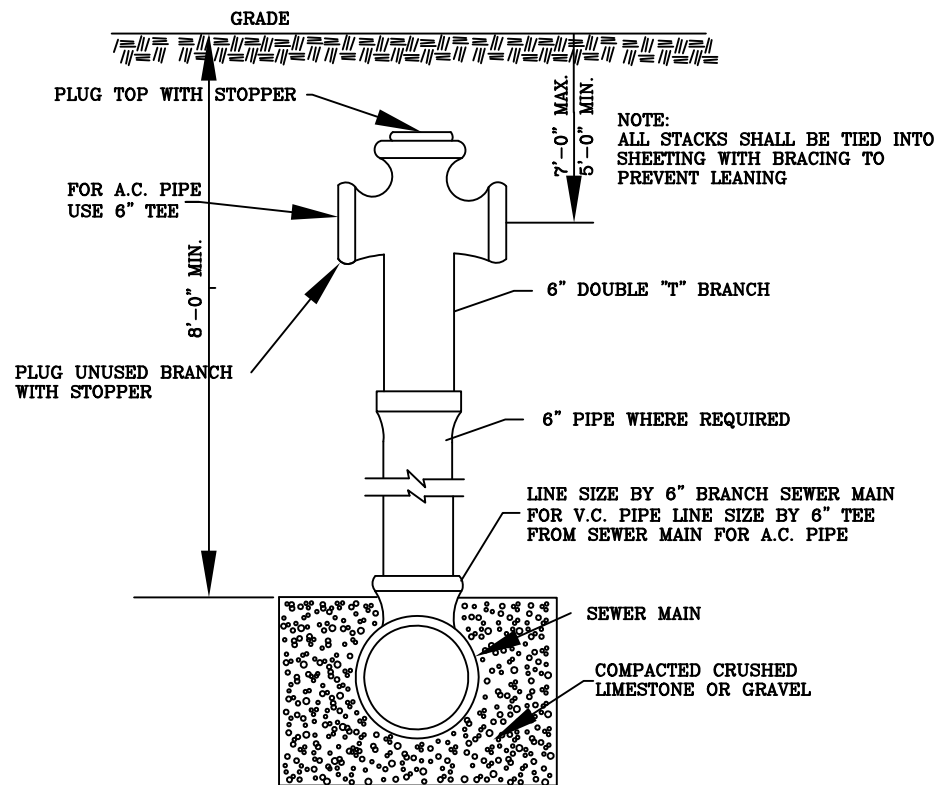

DETAIL OF RISER


NTS

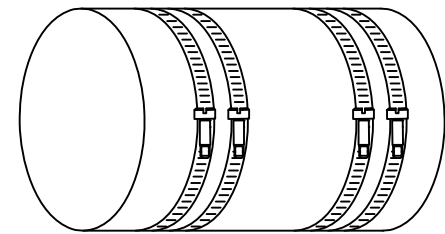

Sewer Repair Coupling


NTS

NOTE: STAINLESS STEEL SHEAR RING
IN 6", 8", 10" AND 12" SIZES REQ'D.

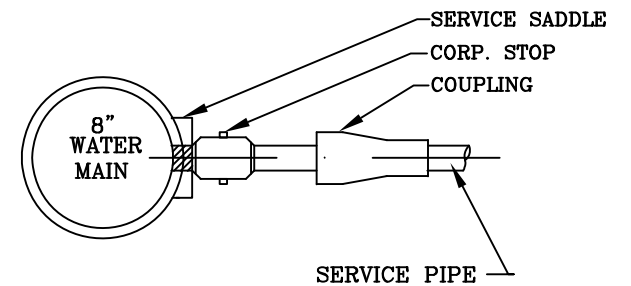

DETAIL OF SERVICE CONNECTION
FOR TAPS TO MAINS

NTS

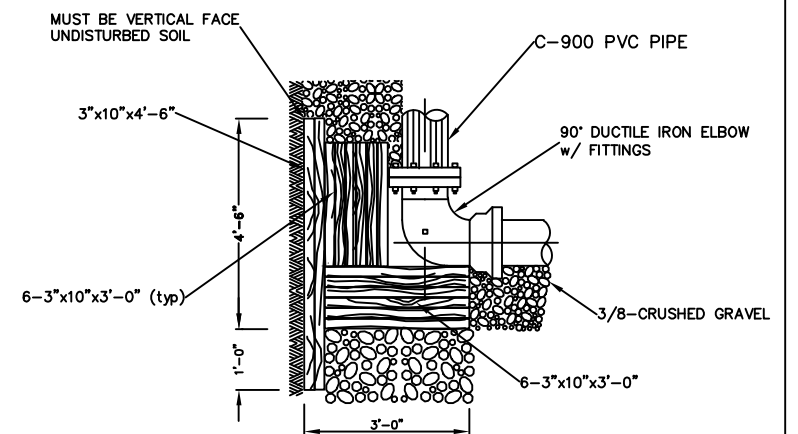

TIMBER THRUST BLOCK DETAIL

NTS

NOTE:
TIMBER BLOCKING REQUIRED AT ALL CHANGES
IN DIRECTION GREATER THAN 22 1/2'.
ALL TIMBER BLOCKING SHALL BE TREATED LUMBER.



WATER DETAILS

CITY OF SLIDELL ENGINEERING DEPT.

Annual Maintenance Contract FY' 2024

DRAWN BY: JMC FILE No: 950-41H

Approved By: BAC DATE: 3/10/2021

SHT 12