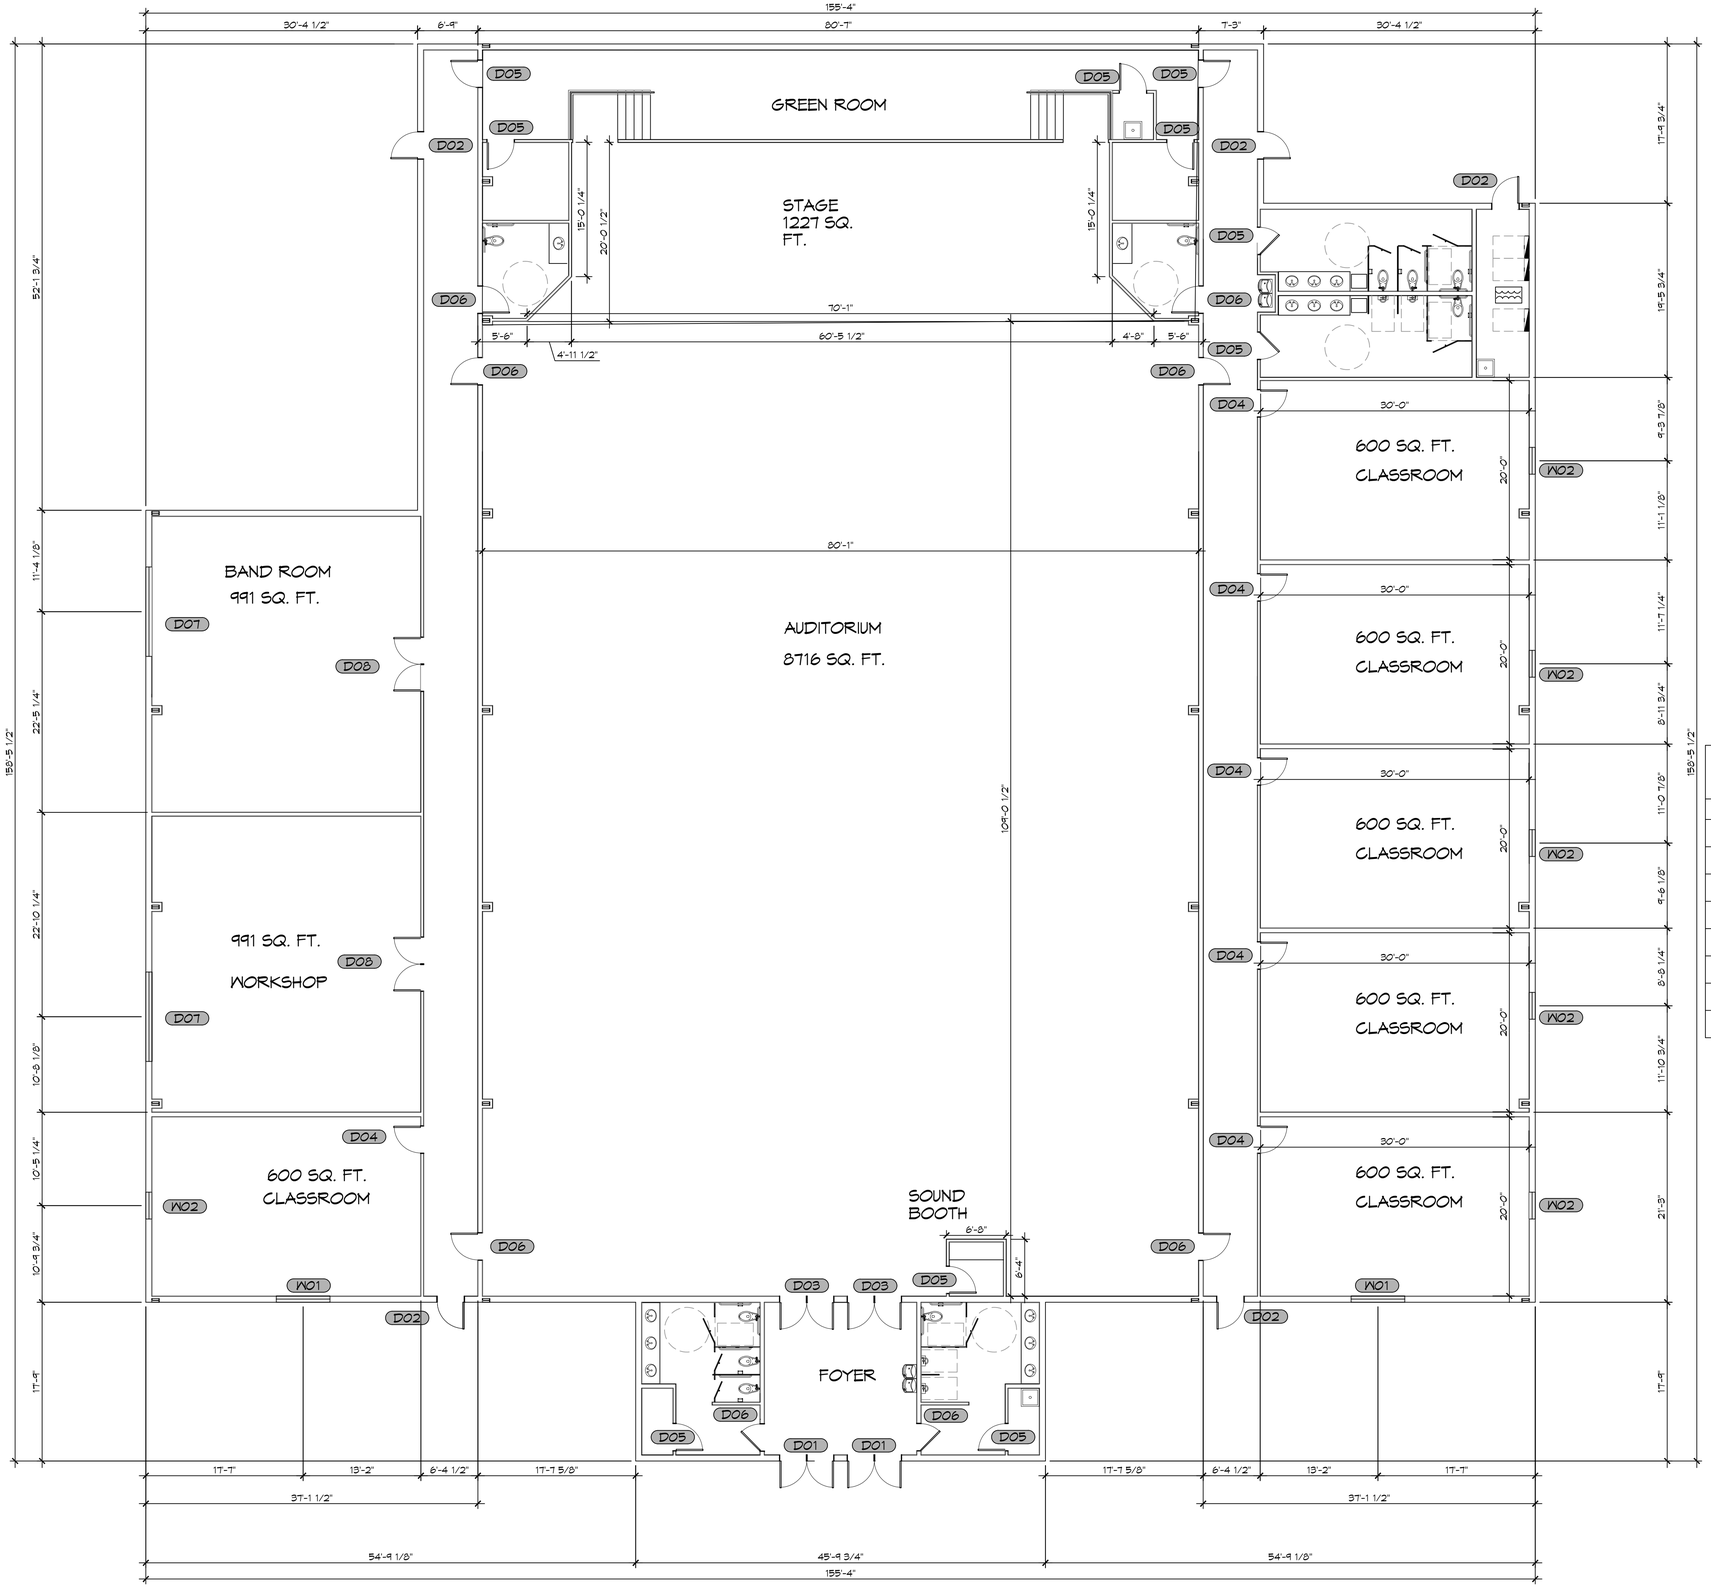


## 2 FLOOR PLAN
SCALE: 1/8"=1'-0"

## GENERAL NOTES

1. INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF IBC 2012 SECTION 719.
   A. CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450, EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
   B. FACING SHALL COMPLY WITH IBC 2012.
2. ALL MATERIALS SHALL BE NEW AND UL LISTED.
3. NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
4. CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
5. CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR FROM DATE OF SUBSTANTIAL COMPLETION.
6. CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
7. EXTERIOR CAULKING SHALL BE THIOKAL CAULK.
8. PAINT SHALL BE SHERWIN WILLIAMS OR EQUIVALENT AND APPROPRIATE FOR THE SUBSTRATE TO WHICH IT IS APPLIED AS RECOMMENDED BY PAINT MANUFACTURER. ALL WORK TO RECEIVE THREE COATS (ONE PRIMER COAT, TWO FINISH COATS) UNLESS OTHERWISE RECOMMENDED BY PAINT MANUFACTUER. COLORS TO BE SELECTED BY OWNER.
9. PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH SHALL BE STORED INSIDE BUILDING PREMISES.
10. ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH IBC 2012.
11. USE 2x6 STUDS, OR TWO 2x4 STAGGERED STUDS WITH 2x6 SILL PLATE AT ALL WALLS WHERE 4" PIPE IS INDICATED. SEE PLUMBING RISER DIAGRAM FOR PIPE SIZE.
12. PROVIDE GALVANIZED METAL PAN WITH DRAIN AT ALL WATER HEATERS.
13. ALL FLOORING SHALL MEET OR EXCEED ADA GUIDELINES REQUIREMENTS FOR SLIP RESISTANCE.
14. INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
15. INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
16. ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
17. PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
18. ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF DECK AND BE SEALED WITH AN APPROVED FIRE CAULK.
19. ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
20. SERVICE COUNTERS SHALL HAVE AN ACCESSIBLE WRITING SURFACE IN COMPLIANCE WITH ADAAG ACCESSIBILITY GUIDELINES 2010, SECTION 902.3.

## DOOR SCHEDULE

| MK | WD | HT | THK | MAT | FRM | FR | NOTES |
|---|---|---|---|---|---|---|---|
| D01 | (2) 3'-0" | 8'-0" | 1-3/4" | METAL | METAL | NR | EXTERIOR DOUBLE DOOR WITH WINDOW & CLOUSER |
| D02 | 3'-0" | 7'-0" | 1-3/4" | METAL | METAL | NR | EXTERIOR DOOR WITH CLOUSER |
| D03 | (2)3'-0" | 8'-0" | 1-3/4" | WOOD | METAL | 45 MIN | INTERIOR DOUBLE DOOR WITH CLOUSER |
| D04 | 3'-0" | 7'-0" | 1-3/4" | WOOD | METAL | NR | INTERIOR DOOR WITH WINDOR & CLOUSER |
| D05 | 3'-0" | 7'-0" | 1-3/4" | WOOD | METAL | NR | INTERIOR DOOR |
| D06 | 3'-0" | 7'-0" | 1-3/4" | WOOD | METAL | 45 MIN | INTERIOR DOOR WITH CLOUSER |
| D07 | 10'-0" | 10'-0" | - | METAL | METAL | - | ROLL UP GARAGE DOOR |
| D08 | (2)3'-0" | 7'-0" | 1-3/4" | WOOD | METAL | NR | INTERIOR DOUBLE DOOR WITH WINDOW & CLOUSER |

## WINDOW SCHEDULE

| MK | WD | HT | FRAME | TYPE | NOTES |
|---|---|---|---|---|---|
| W01 | 6'-0" | 5'-0" | METAL | FIXED | TEMPERED |
| W02 | 3'-0" | 5'-0" | METAL | FIXED | TEMPERED |

NOTE; ALL EXTERIOR WINDOW ASSEMBLES TO BE RATED FOR 140 MPH WINDS AND SHALL BE MISSILE IMPACT RESISTANT.


DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832 F: 985.641.5950
Chief Engineer: Brian Mistich, PE
1550 Oak Harbor Trail
Slidell, LA 70458


| # | DESCRIPTION | REVISIONS | DATE |
|---|---|---|---|

NEW AUDITORIUM
POPE JOHN PAUL
1901 JAGUAR DR
SLIDELL, LA 70461

JOB No: 2522 | DATE: 12-5-2025
DRAWN BY: CKD | CHECKED BY: JMS


The architectural drawings, specifications and other documents prepared by Dammon Engineering, Inc. are instruments of service and shall remain the property of Dammon Engineering, Inc. and such consent shall be limited to the specific project for which they have been prepared and delivered without written consent of Dammon Engineering, Inc. Visual contact with these plans shall constitute prima facie evidence of the acceptance of these restrictions.


SHEET TITLE:
FLOOR PLAN

DRAWING NUMBER:
A101

SHEET No: 2 of 4


FILE NAME: J:\1 Schools Projects\2522 - Pope John Paul Sidell Auditorium\Current Drawings\A101 - Floor Plan.dwg PLOT DATE & TIME: Thursday, January 15, 2026 3:20:14 PM