FILE NAME: J:\...Closed Jobs\...Hospitals – Medical – Dental\2425 – Home ADR Addition\Drawings\Current Drawings\E102 – Electrical Lighting Site Plan, PLOT DATE & TIME: Wednesday, February 25, 2026 3:24:06 PM

LIGHTING LEGEND

- 2x4 COLUMBIA LGAT24-30-MLG-EU ("E" INDICATES EMERGENCY LIGHT) — A1
- 2x4 COLUMBIA LGAT24-30-HLG-EU — A2
- 2x2 COLUMBIA LGAT22-30ML6-EU ("E" INDICATES EMERGENCY LIGHT) — B
- 2x2 COLUMBIA LGAT22-LS35 (4400LM) — C
- PRESCOLITE LTR-4RD-H-SL15L-DM1-LTR-4RD-T-SL30KSMDS — D
- 48" COLUMBIA MPS4-35VW-CN-EDU — F
- 48" LITECONTROL 4L-P-D-4-SOF-X-CX-35K-D030 — G
- EXTERIOR LIGHT, MATCH EXISTING AND CONNECT TO EXISTING CIRCUIT — H
- VANITY LIGHT FIXTURE
- EXIT LIGHT FIXTURE - CEILING MOUNTED
- EXHAUST FAN - SEE MECHANICAL
- POLE MOUNTED LIGHT; MATCH EXISTING; CONNECT TO EXISTING CIRCUIT
- JUNCTION BOX
- SINGLE POLE LIGHT SWITCH
- EXISTING POWER PANEL (LPA)
- 3 WAY LIGHT SWITCH
- NEW POWER PANEL (LPD)
- CEILING OUTLET
- CEILING SENSOR
- HOME RUN

GENERAL LIGHTING NOTES

1. ALL WORK SHALL COMPLY WITH APPLICABLE NATIONAL, STATE, AND LOCAL CODES, RULES, REGULATIONS, AND REQUIREMENTS OF THE SERVICE UTILITY COMPANY.
2. GENERAL CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY IF ANY CONFLICTS OCCUR BETWEEN LIGHTING AND ANY OTHER TRADE. DO NOT PROCEED WITH INSTALLATION IN THAT AREA UNTIL CONFLICT HAS BEEN RESOLVED TO THE SATISFACTION OF THE ARCHITECT AND ENGINEER.
3. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATION AND MOUNTING INSTRUCTIONS FOR ALL LIGHT FIXTURES. NOTIFY THE ARCHITECT AND ENGINEER OF ANY DISCREPANCIES BETWEEN THESE PLANS AND THE ARCHITECTURAL PLANS RELATING TO QUANTITY, TYPE AND LOCATION OF DEVICES AND/OR FIXTURES.
4. WHEN SPECIFIC LIGHT FIXTURE HAS BEEN SPECIFIED IN THE FIXTURE SCHEDULE, ELECTRICAL CONTRACTOR SHALL PROVIDE COMPLETE ASSEMBLY INCLUSIVE ALL PARTS AND HARDWARE TO INSURE PROPER FUNCTIONING FIXTURE.
5. ALL CONDUCTORS SHALL BE A MINIMUM OF #12 AWG UNLESS NOTED OTHERWISE.
6. ALL 120V RUNS LONGER THAN 60 FEET SHALL BE #10 AWG AND 277V RUNS LONGER THAN 150 FEET SHALL BE #10 AWG UNLESS NOTED OTHERWISE.
7. ALL CONDUCTORS SHALL BE COPPER.
8. WHERE CONDUCTOR SIZES ARE NOTED ON DRAWINGS, THAT WIRE SIZE SHALL BE THROUGH THE ENTIRE RUN UNLESS OTHERWISE NOTED.
9. MOUNTED LIGHT SWITCHES 48" AFF UNLESS NOTED OTHERWISE ON ARCHITECTURAL DRAWINGS.
10. WHERE MORE THAN ONE SWITCH OCCURS IN THE SAME LOCATION, THEY SHALL BE INSTALLED IN A GANG TYPE BOX UNDER ONE COVER PLATE. ALL GANGED SWITCHES SHALL HAVE A COMMON SEAMLESS FACEPLATE. EACH MULTI-GANGED BOX SHALL BE NO MORE THAN SIX (6) SWITCHES WIDE. WHERE MORE THAN SIX (6) SWITCHES ARE SHOWN AT ONE (1) LOCATION, ADDITIONAL MULTI-GANGED BOXES SHALL BE STACKED VERTICALLY AND THE WIDTH OF THE MULTI-GANGS SHALL BE AS EVEN AS POSSIBLE.
11. EACH DIMMER SWITCH SHALL HAVE A WATTAGE RATING 25% HIGHER THAN THE TOTAL WATTAGE OF AL LIGHTS TO BE CONTROLLED BY THE DIMMER. DIMMER SIZES 600, 1000, 1500 AND 2000 WATTS, LUTRON NOVA T-STAR. WHERE SWITCHES ARE GANGED WITH DIMMERS, THE SWITCHES SHALL ALSO BE LUTRON NOVA T-STAR. FLUORESCENT AND LOW VOLTAGE DIMMERS SHALL BE LUTRON NOVA T-STAR.
12. ALL EMERGENCY EXIT LIGHT FIXTURES SHALL HAVE 90 MINUTE BATTERY BACKUP WITH INTEGRAL TEST BUTTON AND SHALL BURN CONTINUOUSLY.
13. ALL FLUORESCENT FIXTURES THAT UTILIZE DOUBLE-ENDED LAMPS AND CONTAIN BALLASTS SHALL BE PROVIDED WITH A DISCONNECTING MEANS IN ACCORDANCE WITH NEC 410.130.

SITE LIGHTING

WALL OR POLE MOUNTED EXTERIOR LIGHTING SHALL HAVE EITHER A FULL CUT-OFF FIXTURE OR A FULLY SHIELDED FIXTURE. NO DIRECT LIGHTING OR GLARE BE CAST BEYOND THE PROPERTY LINE. THE INTENSITY OF SUCH LIGHTING SHALL NOT EXCEED ONE FOOT CANDLE AS MEASURED AT THE ABUTTING PROPERTY LINE.

KEYED NOTES

1. PROVIDE CONNECTION TO UN-SWITCHED HOT LIGHTING CIRCUIT AND SHALL HAVE 90 MINUTE EMERGENCY BATTERY BACKUP.

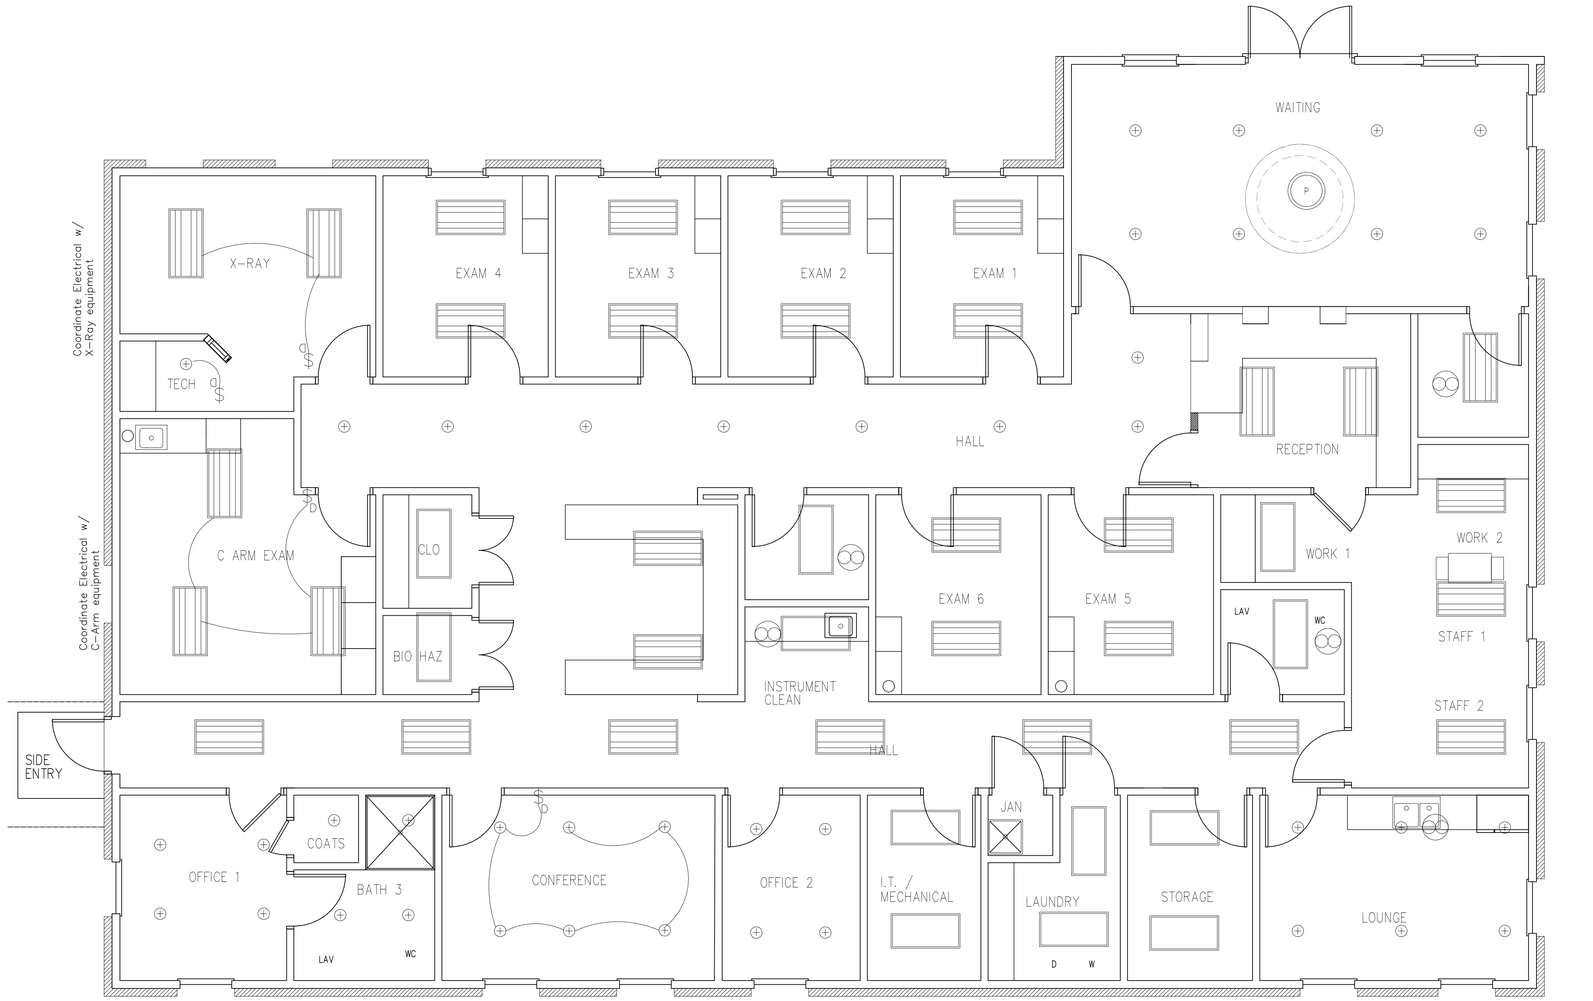

N 27 LIGHTING PLAN
SCALE: 3/16"=1'-0"

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

#	DESCRIPTION	DATE
1	Revised HVAC Returns in Existing Facility	2-16-2026
2	Added Exam Rooms 1 & 3	1-15-2026
3	Revised Exam Rm's 4 & 5 Layouts	12-1-2025

SEAL:

FINAL PRACTICE

KEVIN DARR, MD

DAUPHIN DRIVE
MANDEVILLE, LA

JOB No:	2523	DATE:	3-6-2026
DRAWN BY:	DMT	CHECKED BY:	CAD

These drawings and specifications, as instruments of service, are and shall remain the property of Dammon Engineering, and are not to be used in whole or part on any other project without the written permission of Dammon Engineering. Visual contact with these drawings and specifications shall constitute prima facie evidence of the acceptance of these restrictions.

SHEET TITLE:
LIGHTING PLAN

DRAWING NUMBER:
E102

SHEET No: 22 of 22