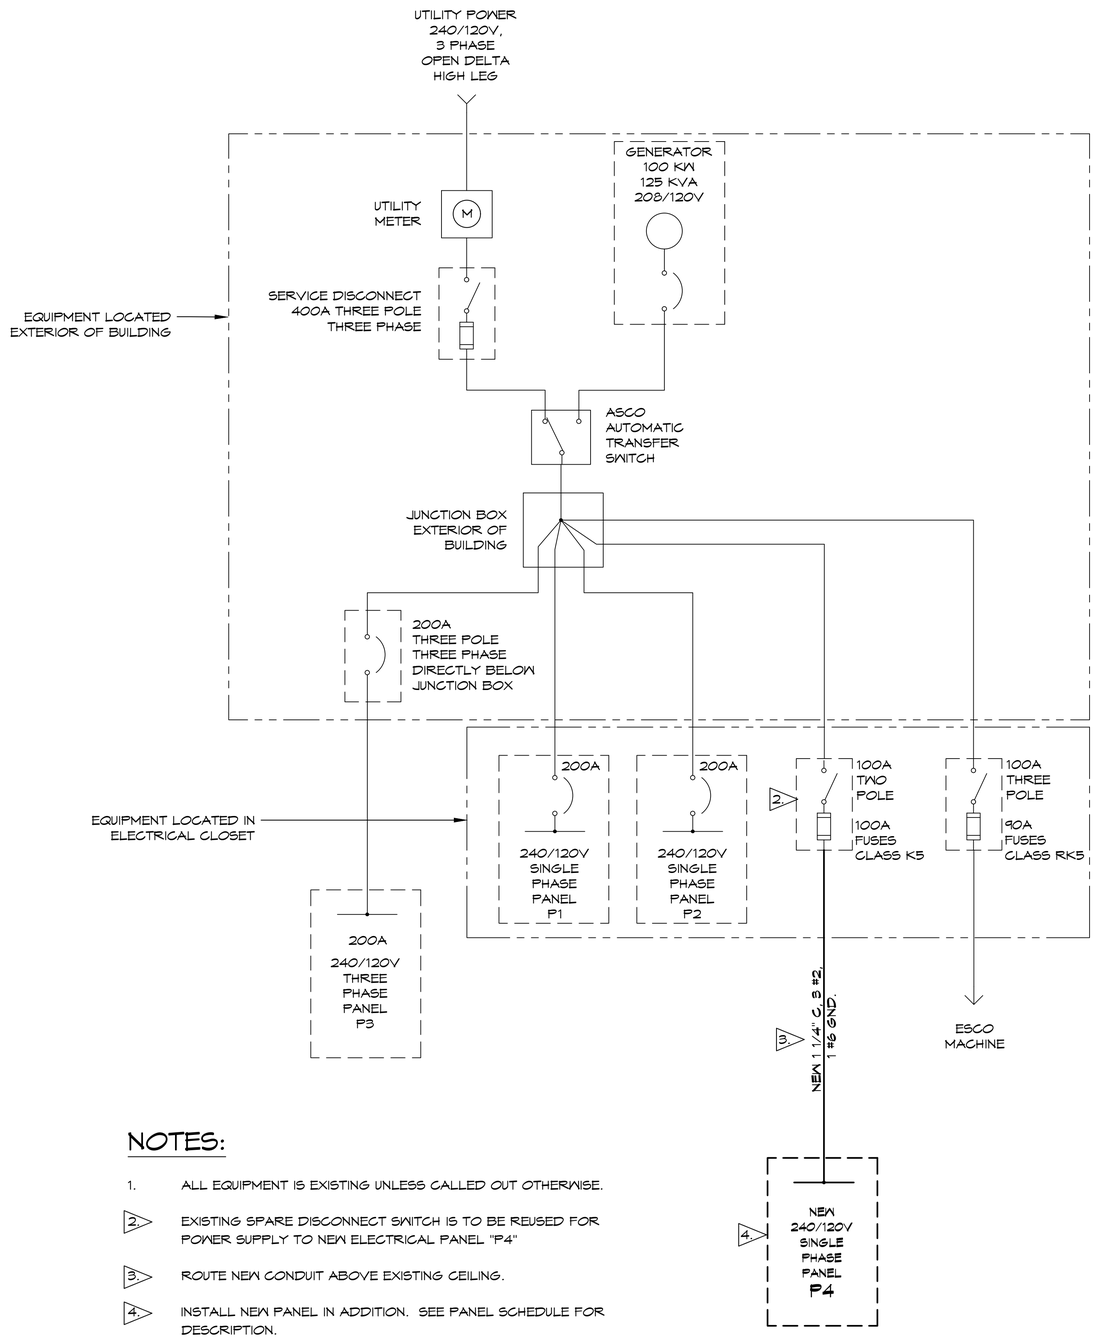

NOTES:

1. ALL EQUIPMENT IS EXISTING UNLESS CALLED OUT OTHERWISE.
2. EXISTING SPARE DISCONNECT SWITCH IS TO BE REUSED FOR POWER SUPPLY TO NEW ELECTRICAL PANEL "P4"
3. ROUTE NEW CONDUIT ABOVE EXISTING CEILING.
4. INSTALL NEW PANEL IN ADDITION. SEE PANEL SCHEDULE FOR DESCRIPTION.

32 ONE LINE DIAGRAM (EXISTING BUILDING)
SCALE:

NOTES:

1. MARK HIGH LEG WITH ORANGE TAPE PER NEC ART 230.56.
2. FIELD MARK PANEL AS FOLLOWS: "CAUTION B PHASE HAS 208 VOLTS TO GROUND" PER NEC ART 408.3 (F)

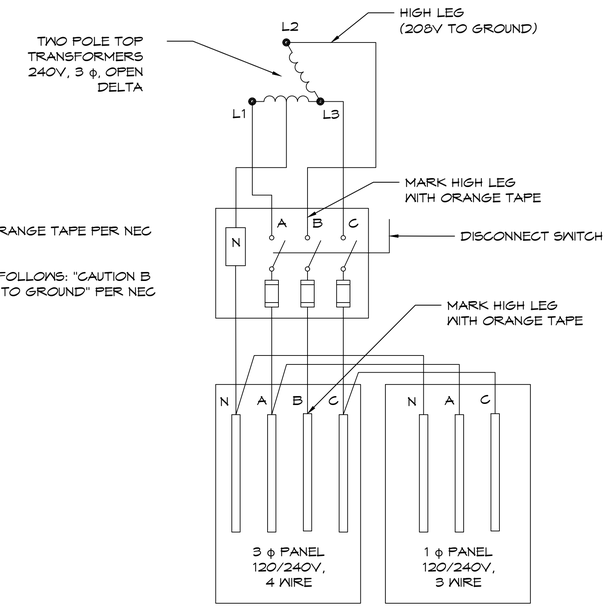

33 DELTA HIGH LEG DIAGRAM
SCALE:

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.3832
Chief Engineer: Brian Wistich, PE
5500 Clouds Trail
Slidell, LA 70458

#	DESCRIPTION	DATE

REVISIONS

SEAL:

NEW WAREHOUSE
SEC-SPECIALITY
ENHANCED
IMAGING
424 SOUTH STREET
SLIDELL, LA 70460

JOB No:	2469
DATE:	03-20-2025
DRAWN BY:	DD/JTL
CHECKED BY:	BAW

These construction documents are property of Dammon Engineering, and are not transferable to other parties or projects. Reproduction or reuse of these documents in whole or in part without written permission of Dammon Engineering is prohibited. These documents are intended for use only in the project for which they have been prepared and envisaged and do not extend to any other project or site. Dammon Engineering assumes no responsibility for any reuse or alteration made to these documents.

SHEET TITLE:
ELECTRICAL ONE LINE DIAGRAM

DRAWING NUMBER:
E105

SHEET No: 15 of 15

FILE NAME: J:_Office Warehouse\2469 - Sp. State 424 South Street Slidell\Drawings\Current Drawings\E105 - One Line.dwg PLOT DATE & TIME: Wednesday, August 20, 2025 10:37:46 AM