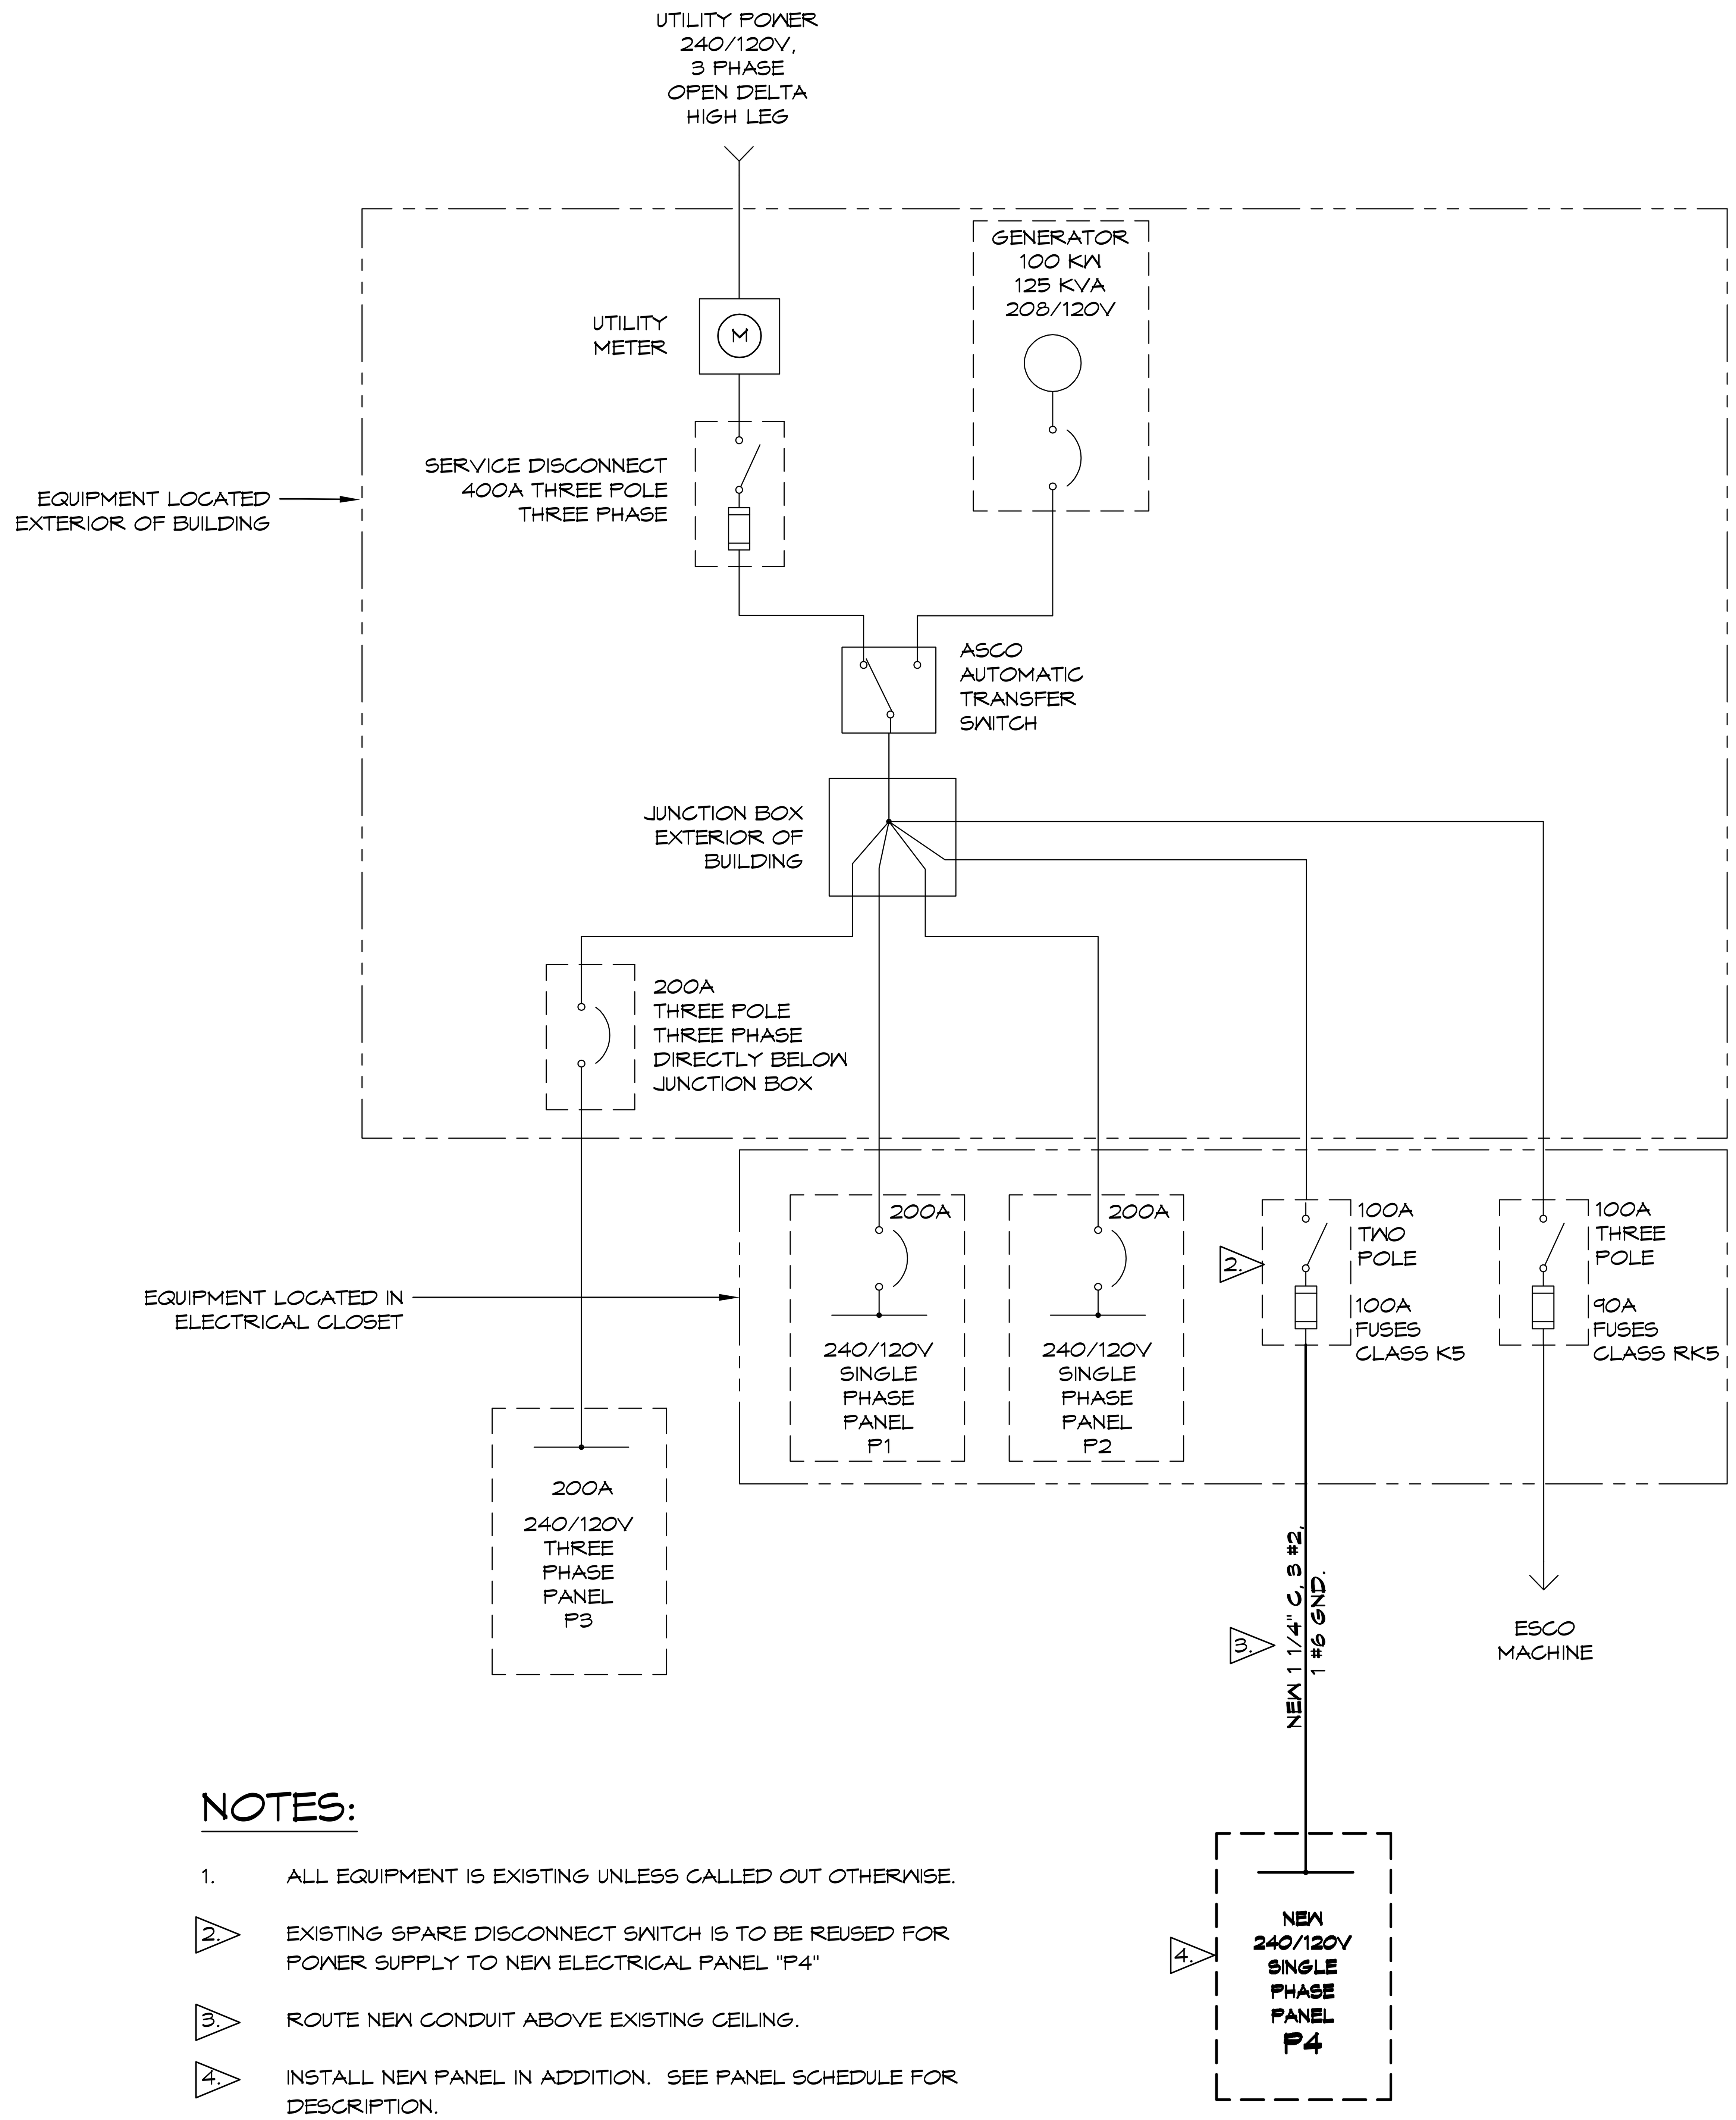

NOTES:

1. ALL EQUIPMENT IS EXISTING UNLESS CALLED OUT OTHERWISE.
2. EXISTING SPARE DISCONNECT SWITCH IS TO BE REUSED FOR POWER SUPPLY TO NEW ELECTRICAL PANEL "P4"
3. ROUTE NEW CONDUIT ABOVE EXISTING CEILING.
4. INSTALL NEW PANEL IN ADDITION. SEE PANEL SCHEDULE FOR DESCRIPTION.

33 ONE LINE DIAGRAM (EXISTING BUILDING)
SCALE:

NOTES:

1. MARK HIGH LEG WITH ORANGE TAPE PER NEC ART 230.56.
2. FIELD MARK PANEL AS FOLLOWS: "CAUTION B PHASE HAS 208 VOLTS TO GROUND" PER NEC ART 408.3 (F)

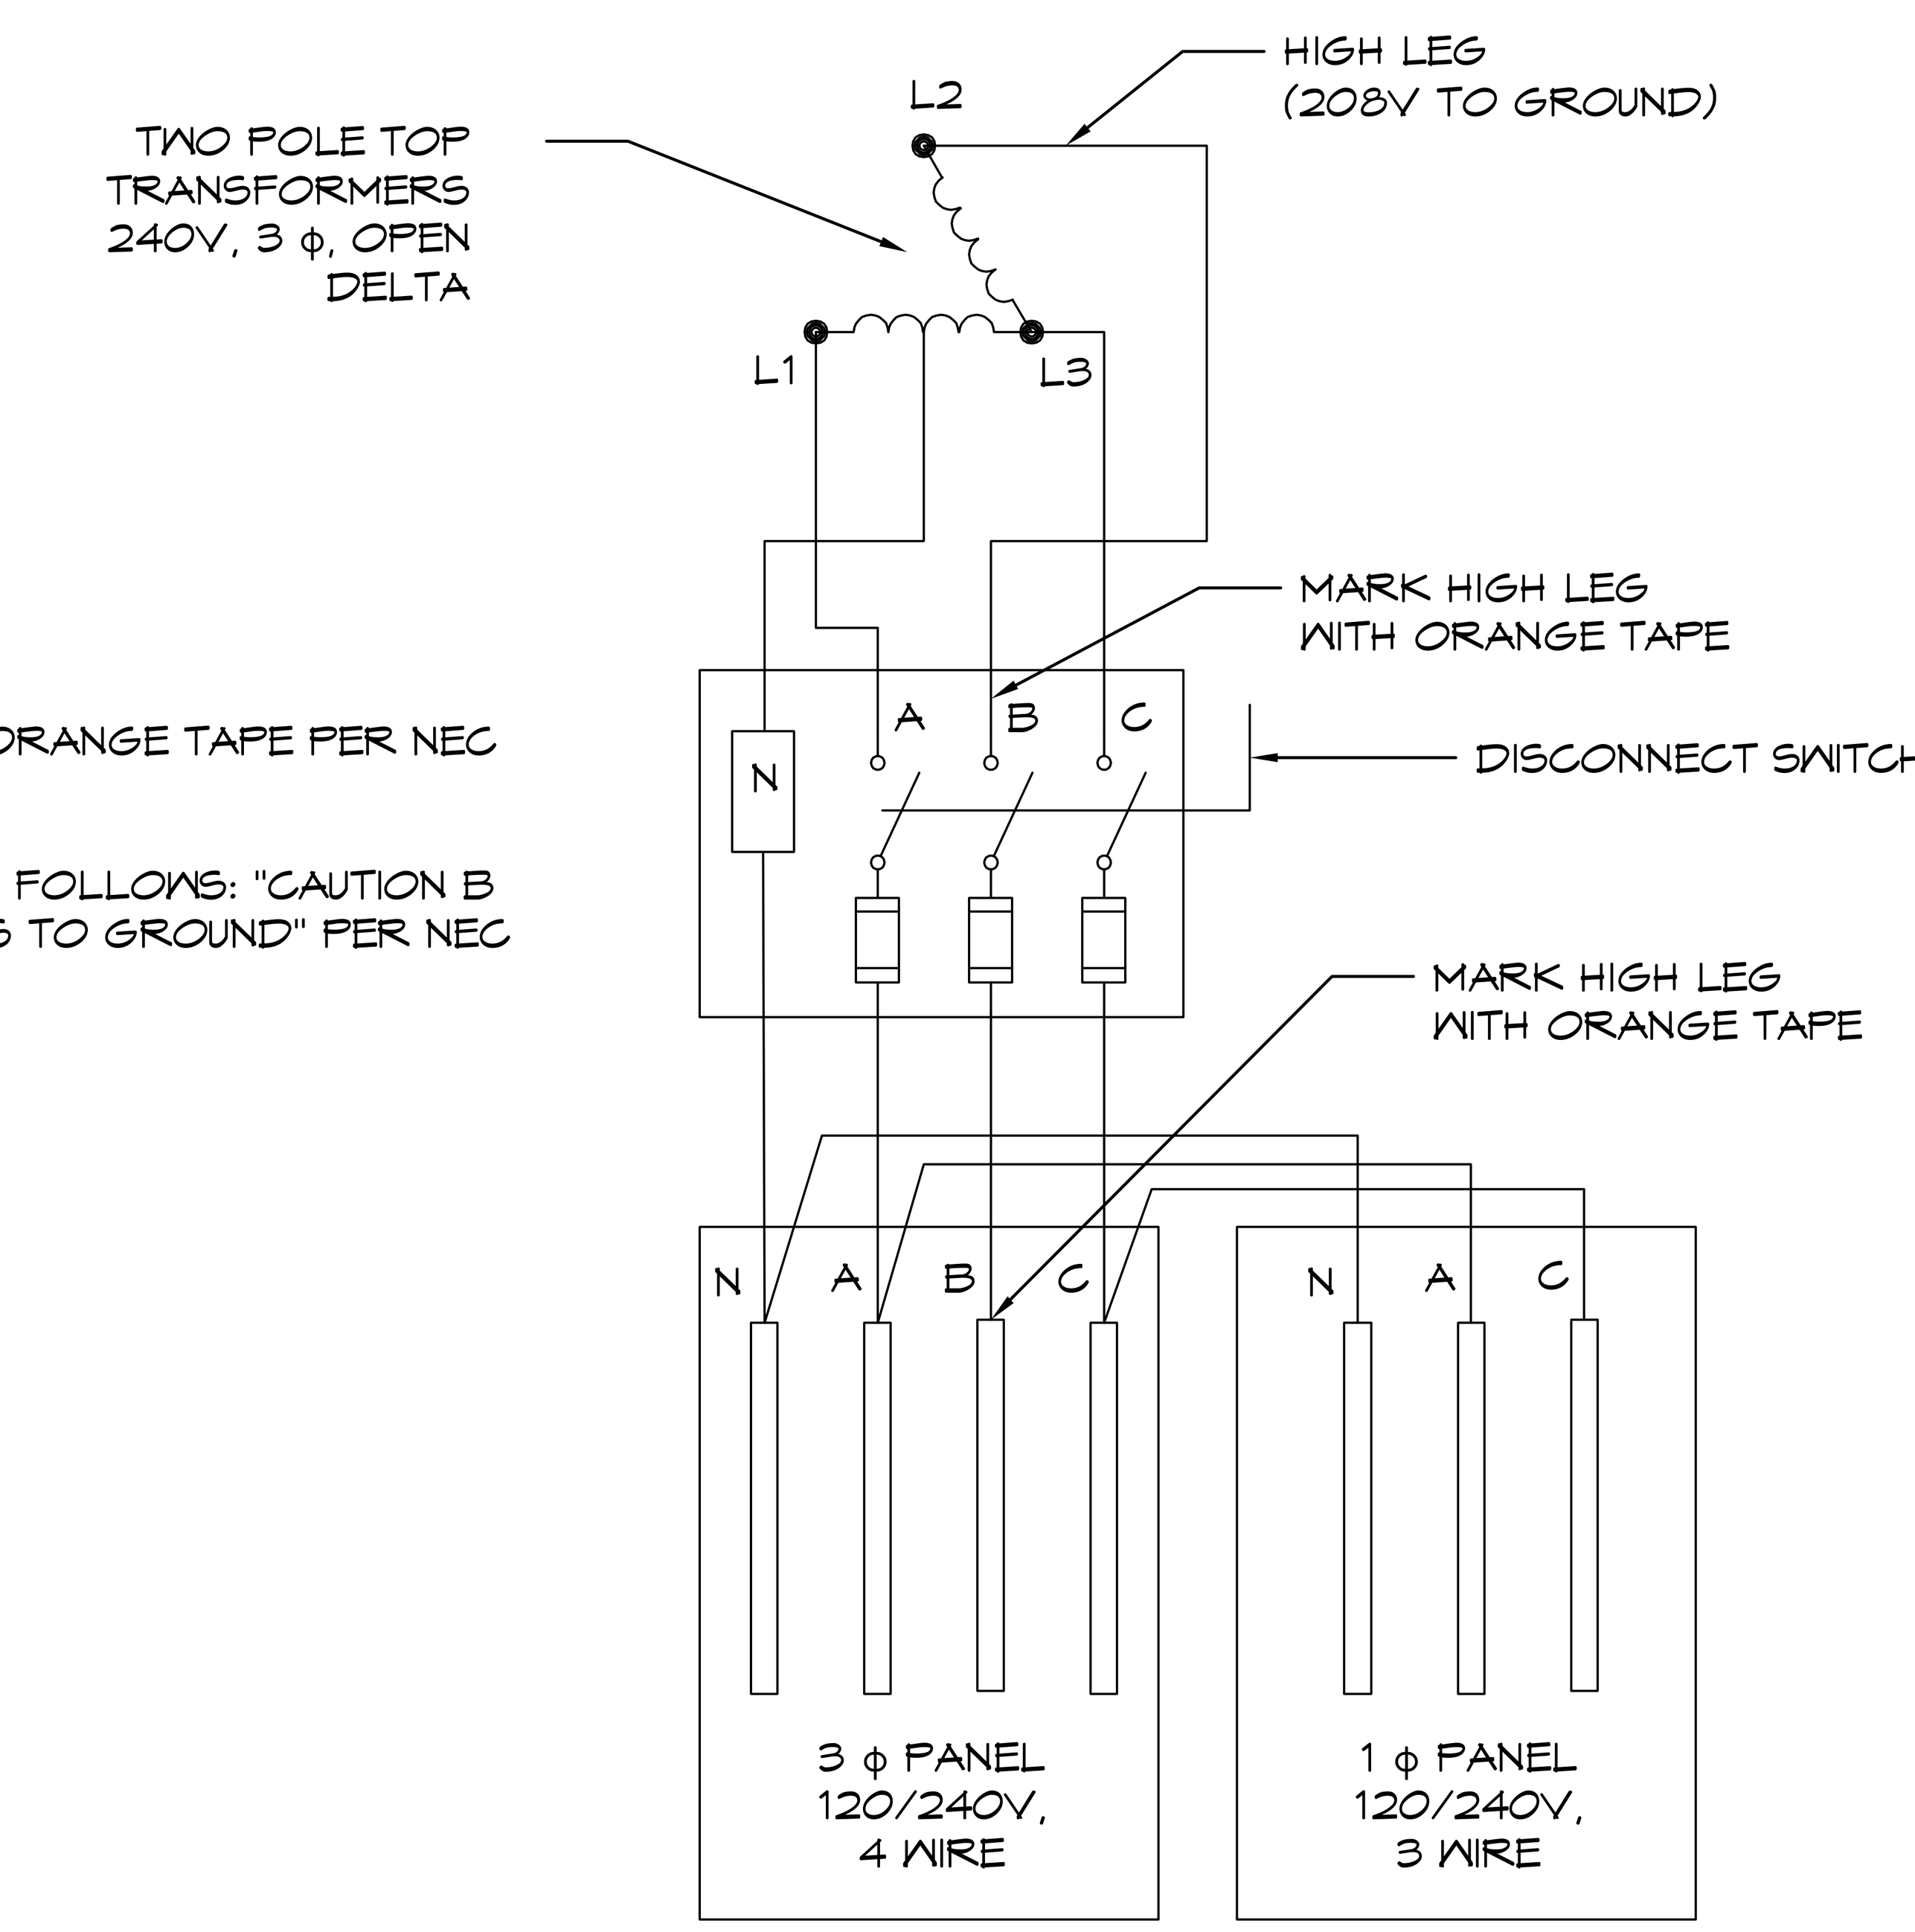

34 DELTA HIGH LEG DIAGRAM
SCALE:

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

#	DESCRIPTION	DATE

REVISIONS

SEAL:
STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
PROFESSIONAL ENGINEER

NEW WAREHOUSES
SEC-SPECIALITY ENHANCED IMAGING
429 SOUTH STREET
SLIDELL, LA 70460

JOB No: 2498	DATE: 08-21-2025
DRAWN BY: DD/JTL	CHECKED BY: BAM

The above drawings and specifications, designs and arrangements represented thereby are and shall remain the property of Dammon Engineering, and no part thereof shall be copied, disclosed to others, or used in connection with any work or project other than the specific project for which the have been prepared and developed without written consent of Dammon Engineering. Visual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these restrictions.

SHEET TITLE:
ELECTRICAL ONE LINE DIAGRAM

DRAWING NUMBER:
E105