

**GENERAL SHEET NOTES**

- ELECTRICAL CONTRACTOR TO REFER TO ARCHITECTURAL DRAWINGS FOR ALL LIGHT FIXTURE LOCATIONS.
- ALL LINEAR FLUORESCENT LIGHT FIXTURES SHALL BE INSTALLED TO MEET THE REQUIREMENTS OF NEC 410.130(B) REGARDING LOCAL DISCONNECTING MEANS.
- ALL BRANCH CIRCUIT WIRING SHALL BE #10 AWG UNB. EACH BRANCH CIRCUIT SHALL HAVE A SEPARATE NEUTRAL CONDUCTOR.
- JUNCTION BOXES FOR TRACK LIGHTING TO BE INSTALLED ABOVE CEILING. COORDINATE LOCATION WITH ARCHITECT. REFER TO TYPICAL TRACK WIRING DIAGRAMS ON THIS SHEET FOR ADDITIONAL INFORMATION.

**EXIT AND EMERGENCY LIGHTING NOTES**

- EXTERIOR DOORS MUST HAVE A WALL MOUNTED LIGHT, PER WALL SPECIFICATION, MOUNTED ABOVE DOOR.
- EVERY DOORWAY LEADING TO THE MALL OR AN EXIT CORRIDOR MUST BE EQUIPPED WITH EMERGENCY BATTERY PACK EXIT LIGHTS.
- IN ADDITION TO THE EXIT IDENTIFICATION LIGHTS, SPACE MUST BE EQUIPPED WITH EMERGENCY ILLUMINATION. ALL EMERGENCY LIGHTS MUST BE UL APPROVED AND HAVE A CONVENIENCE TEST FEATURE. DURATION AND LIGHT LEVELS TO BE SPECIFIED BY FIRE AND BUILDING CODES.
- WIRE ALL NIGHT LIGHTING, EXIT SIGNS, EMERGENCY FIXTURES AHEAD OF LOCAL SWITCHING UNB.
- ALL EXIT SIGNS AND EGRESS FIXTURES LOCATED IN OPEN CEILING AREAS SHALL BE MOUNTED AT 12'-0" AFF OR TO UNISTRUTS WHERE POSSIBLE.


**SHEET KEYNOTES**

- CONNECT LIGHT FIXTURE EMERGENCY BALLAST SENSING LEG TO H-2 TO MAINTAIN CONSTANT POWER AND CONNECT NORMAL AND EMERGENCY BALLASTS TO SWITCHED CIRCUIT INDICATED FOR ON/OFF CONTROL.
- LOCATION OF LOW VOLTAGE MASTER SWITCH BANK, REFER TO DETAIL ON SHEET E6.0.0 FOR ADDITIONAL INFORMATION.
- PROVIDE 90 MINUTE REMOTE BATTERY BACKUP FOR TYPE RH FIXTURE. VERIFY MOUNTING LOCATION WITH ARCHITECT.
- UNPOWERED BLANK SECTIONS OF TRACK SHALL BE PROVIDED BY OWNER WITH LIGHTING PACKAGE AND SHALL BE INSTALLED BY EC. REFER TO ARCHITECTURAL PLANS FOR SIZES, LOCATIONS, AND SPECIFICATIONS.

**FOREVER 21, INC.**  
 3880 N. MISSION ROAD  
 LOS ANGELES, CA 90031  
 213.747.5100 TEL  
 213.741.5111 FAX

NOTES: THE DESIGNS SHOWN AND DESCRIBED HEREIN INCLUDING ALL TECHNICAL DRAWINGS, GRAPHICS AND MODELS THEREOF, ARE PROPRIETARY AND CANNOT BE COPIED OR COMMERCIALY EXPLOITED, IN WHOLE OR IN PART, WITHOUT EXPRESS WRITTEN PERMISSION OF THE FOREVER 21. THESE ARE AVAILABLE FOR LIMITED REVIEW AND EVALUATION BY CLIENTS, CONSULTANTS, CONTRACTORS, GOVERNMENT AGENCIES, VENDORS AND OTHER PERSONNEL ONLY IN ACCORDANCE WITH THIS NOTICE.  
 COPYRIGHT © FOREVER 21 2014. ALL RIGHTS RESERVED.

START DATE: DECEMBER, 2014  
 F21 JOB NO: 3K-083  
 STORE NO: 0618  
 DRAWN: SJD  
 CHECKED: MAR

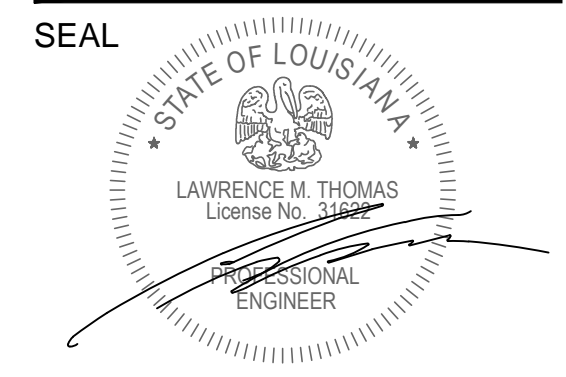


**FOREVER 21**  
 TENANT IMPROVEMENT  
**FREMAUX TOWN CENTER**  
 1000 FREMAUX AVE.  
 SUIDELL, LA 70668

**SUBMITTALS:**  
 01.20.2015  
 LANDLORD PRELIM SUBMITTAL  
 03.05.2015  
 BID SET

**REVISIONS**

NO	DATE	DESCRIPTION

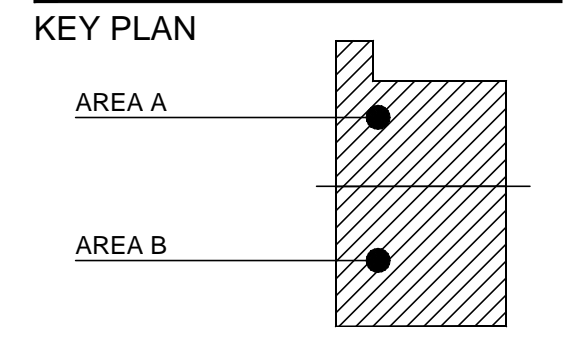

SHEET NAME  
**LIGHTING PLAN**

SHEET NUMBER  
**E1.1.0**  
 SCALE: NONE

**1 LIGHTING PLAN**  
 E1.1.0 SCALE: 1/8"=1'-0"

**2 TRACK WIRING DIAGRAM (HARD CEILING)**  
 E1.1.0 SCALE: NONE

