



TO DATA ROOM 202:  
ALL CABLES SHALL BE PLENUM  
RATED. ALL LOOSE/BUNDLED  
CABLES SHALL BE SUPPORTED ON  
J-HOOKS OR INSIDE CABLE TRAY

NOTE: PROVIDE FIRE SAFING IN CONDUITS  
PENETRATING FIRE RATED ASSEMBLIES.



TO DATA ROOM 202:  
ALL CABLES SHALL BE PLENUM  
RATED. ALL LOOSE/BUNDLED  
CABLES SHALL BE SUPPORTED ON  
J-HOOKS OR INSIDE CABLE TRAY

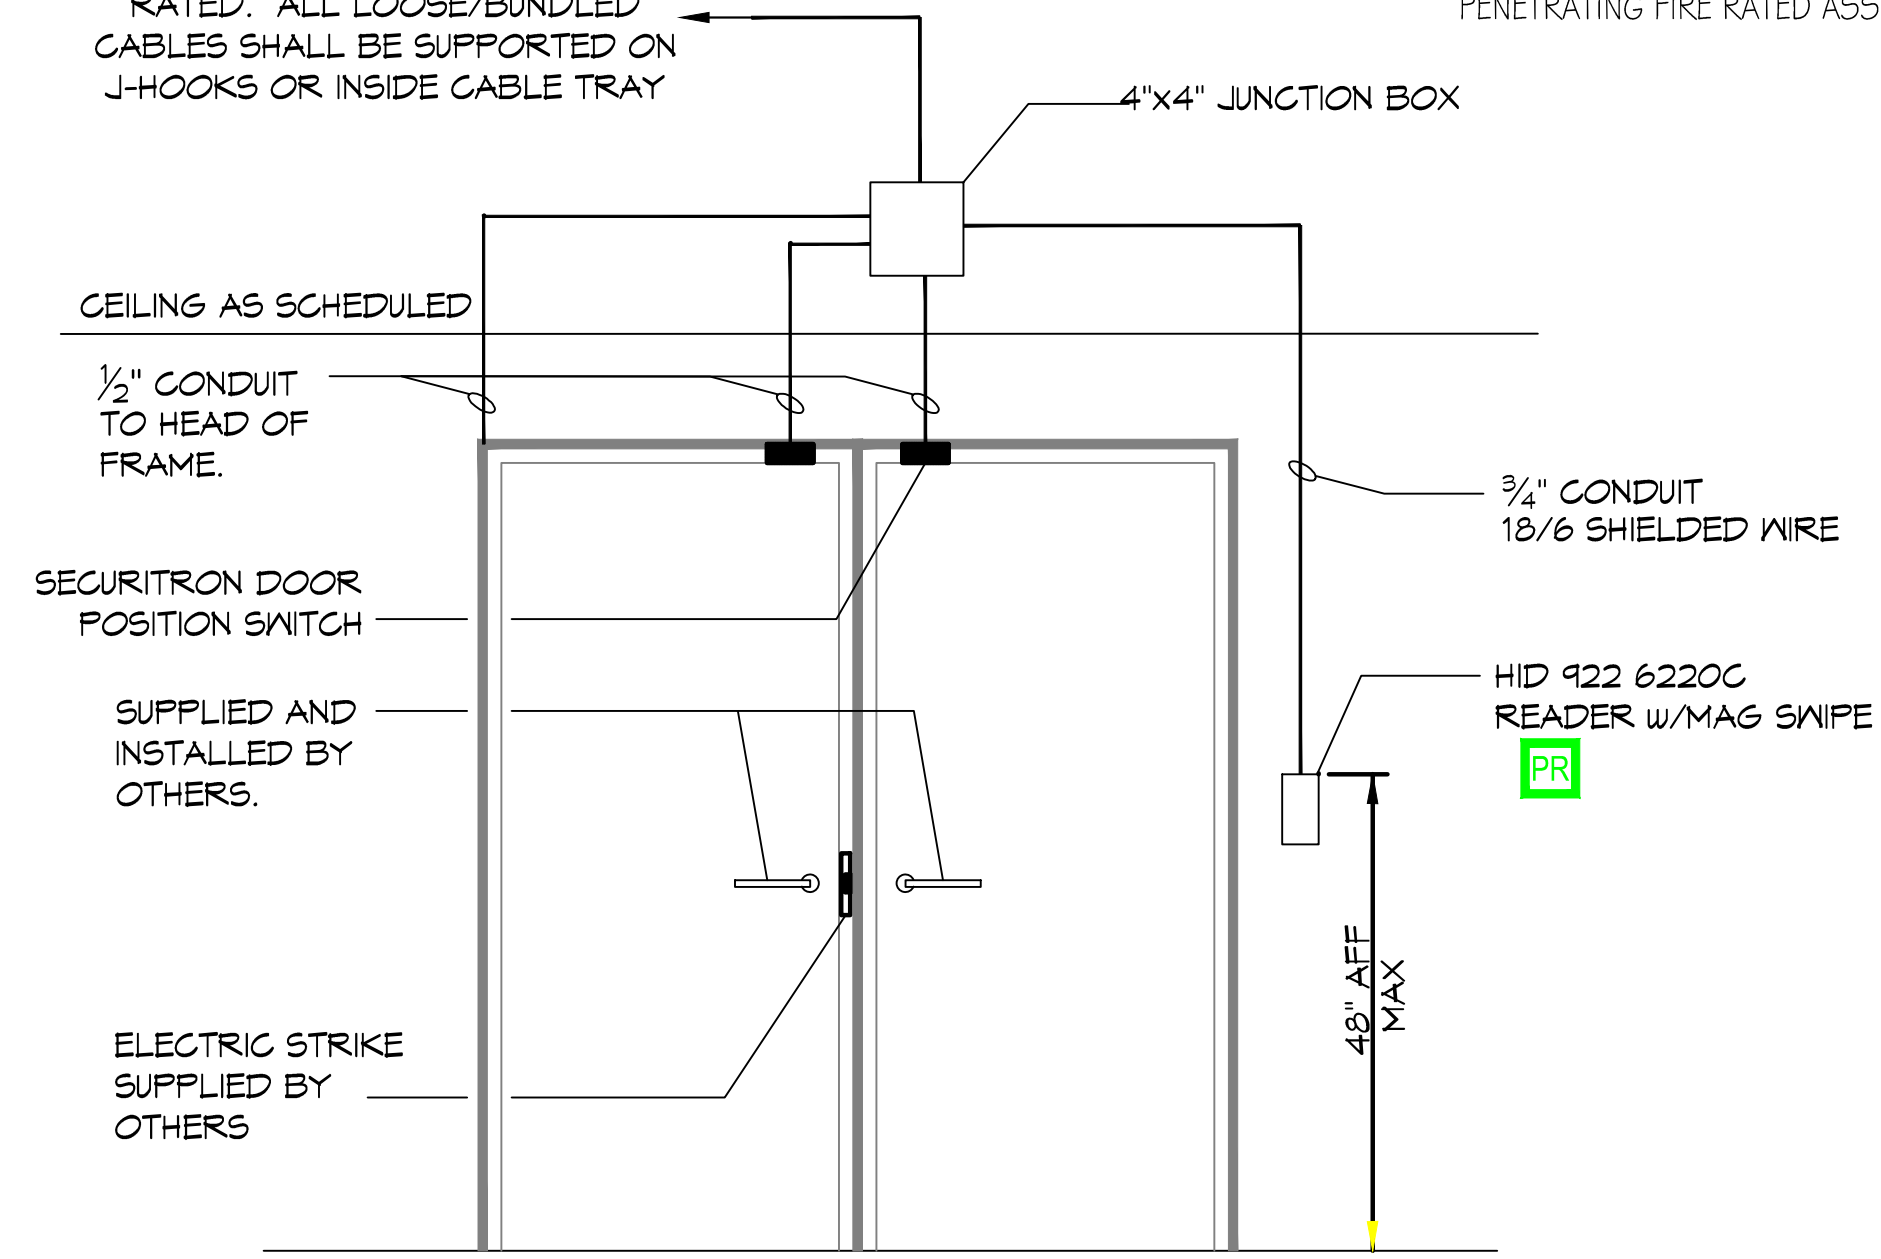


**A** DOUBLE DOOR DOORS: 100A, 101, 127A, 201

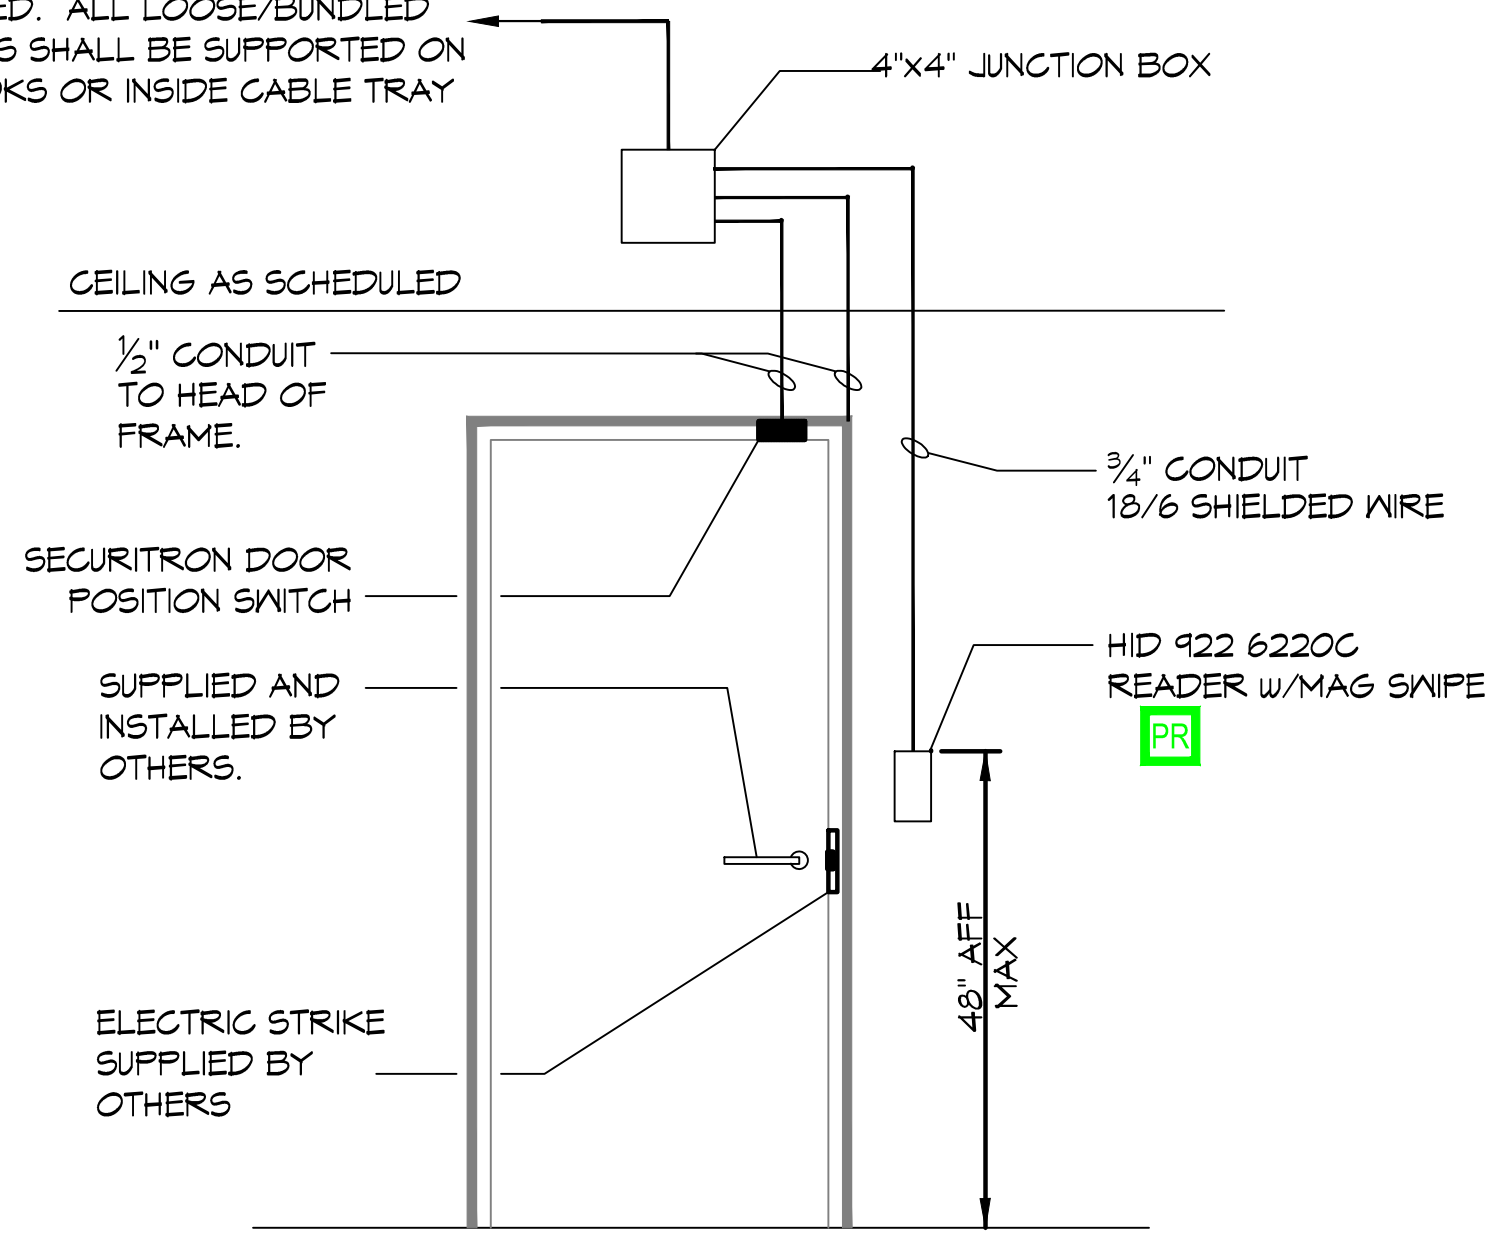

**B** SINGLE DOOR DOORS: 134A, 140, 202

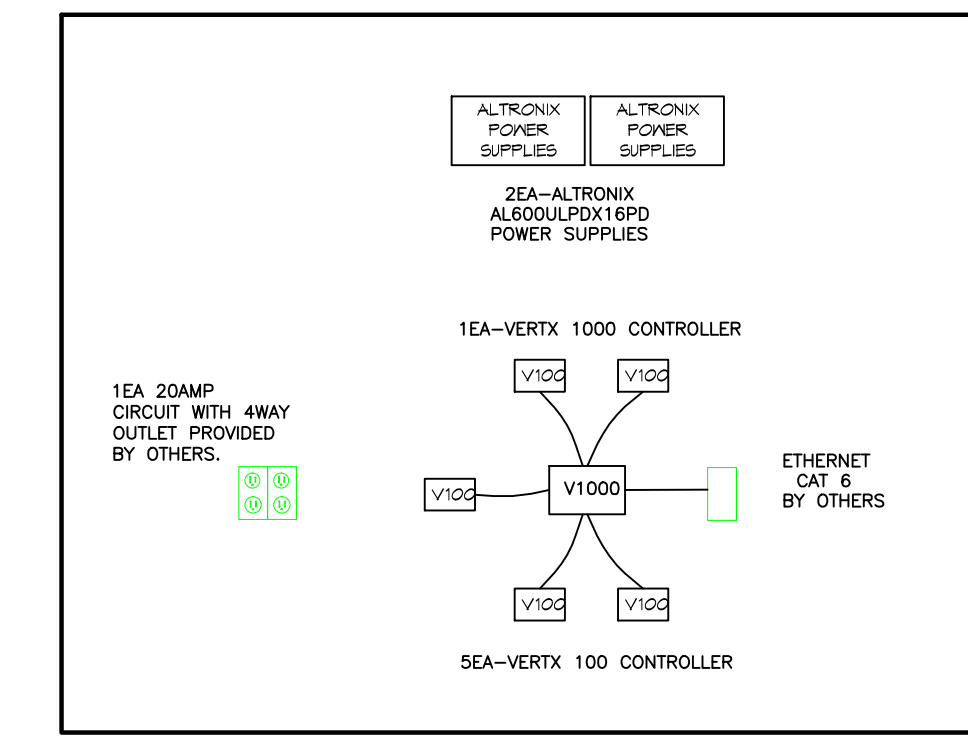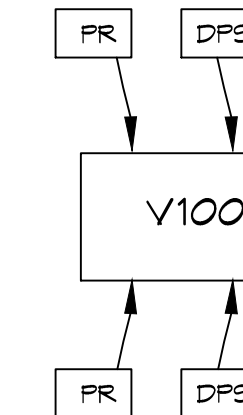

DATA RM 202

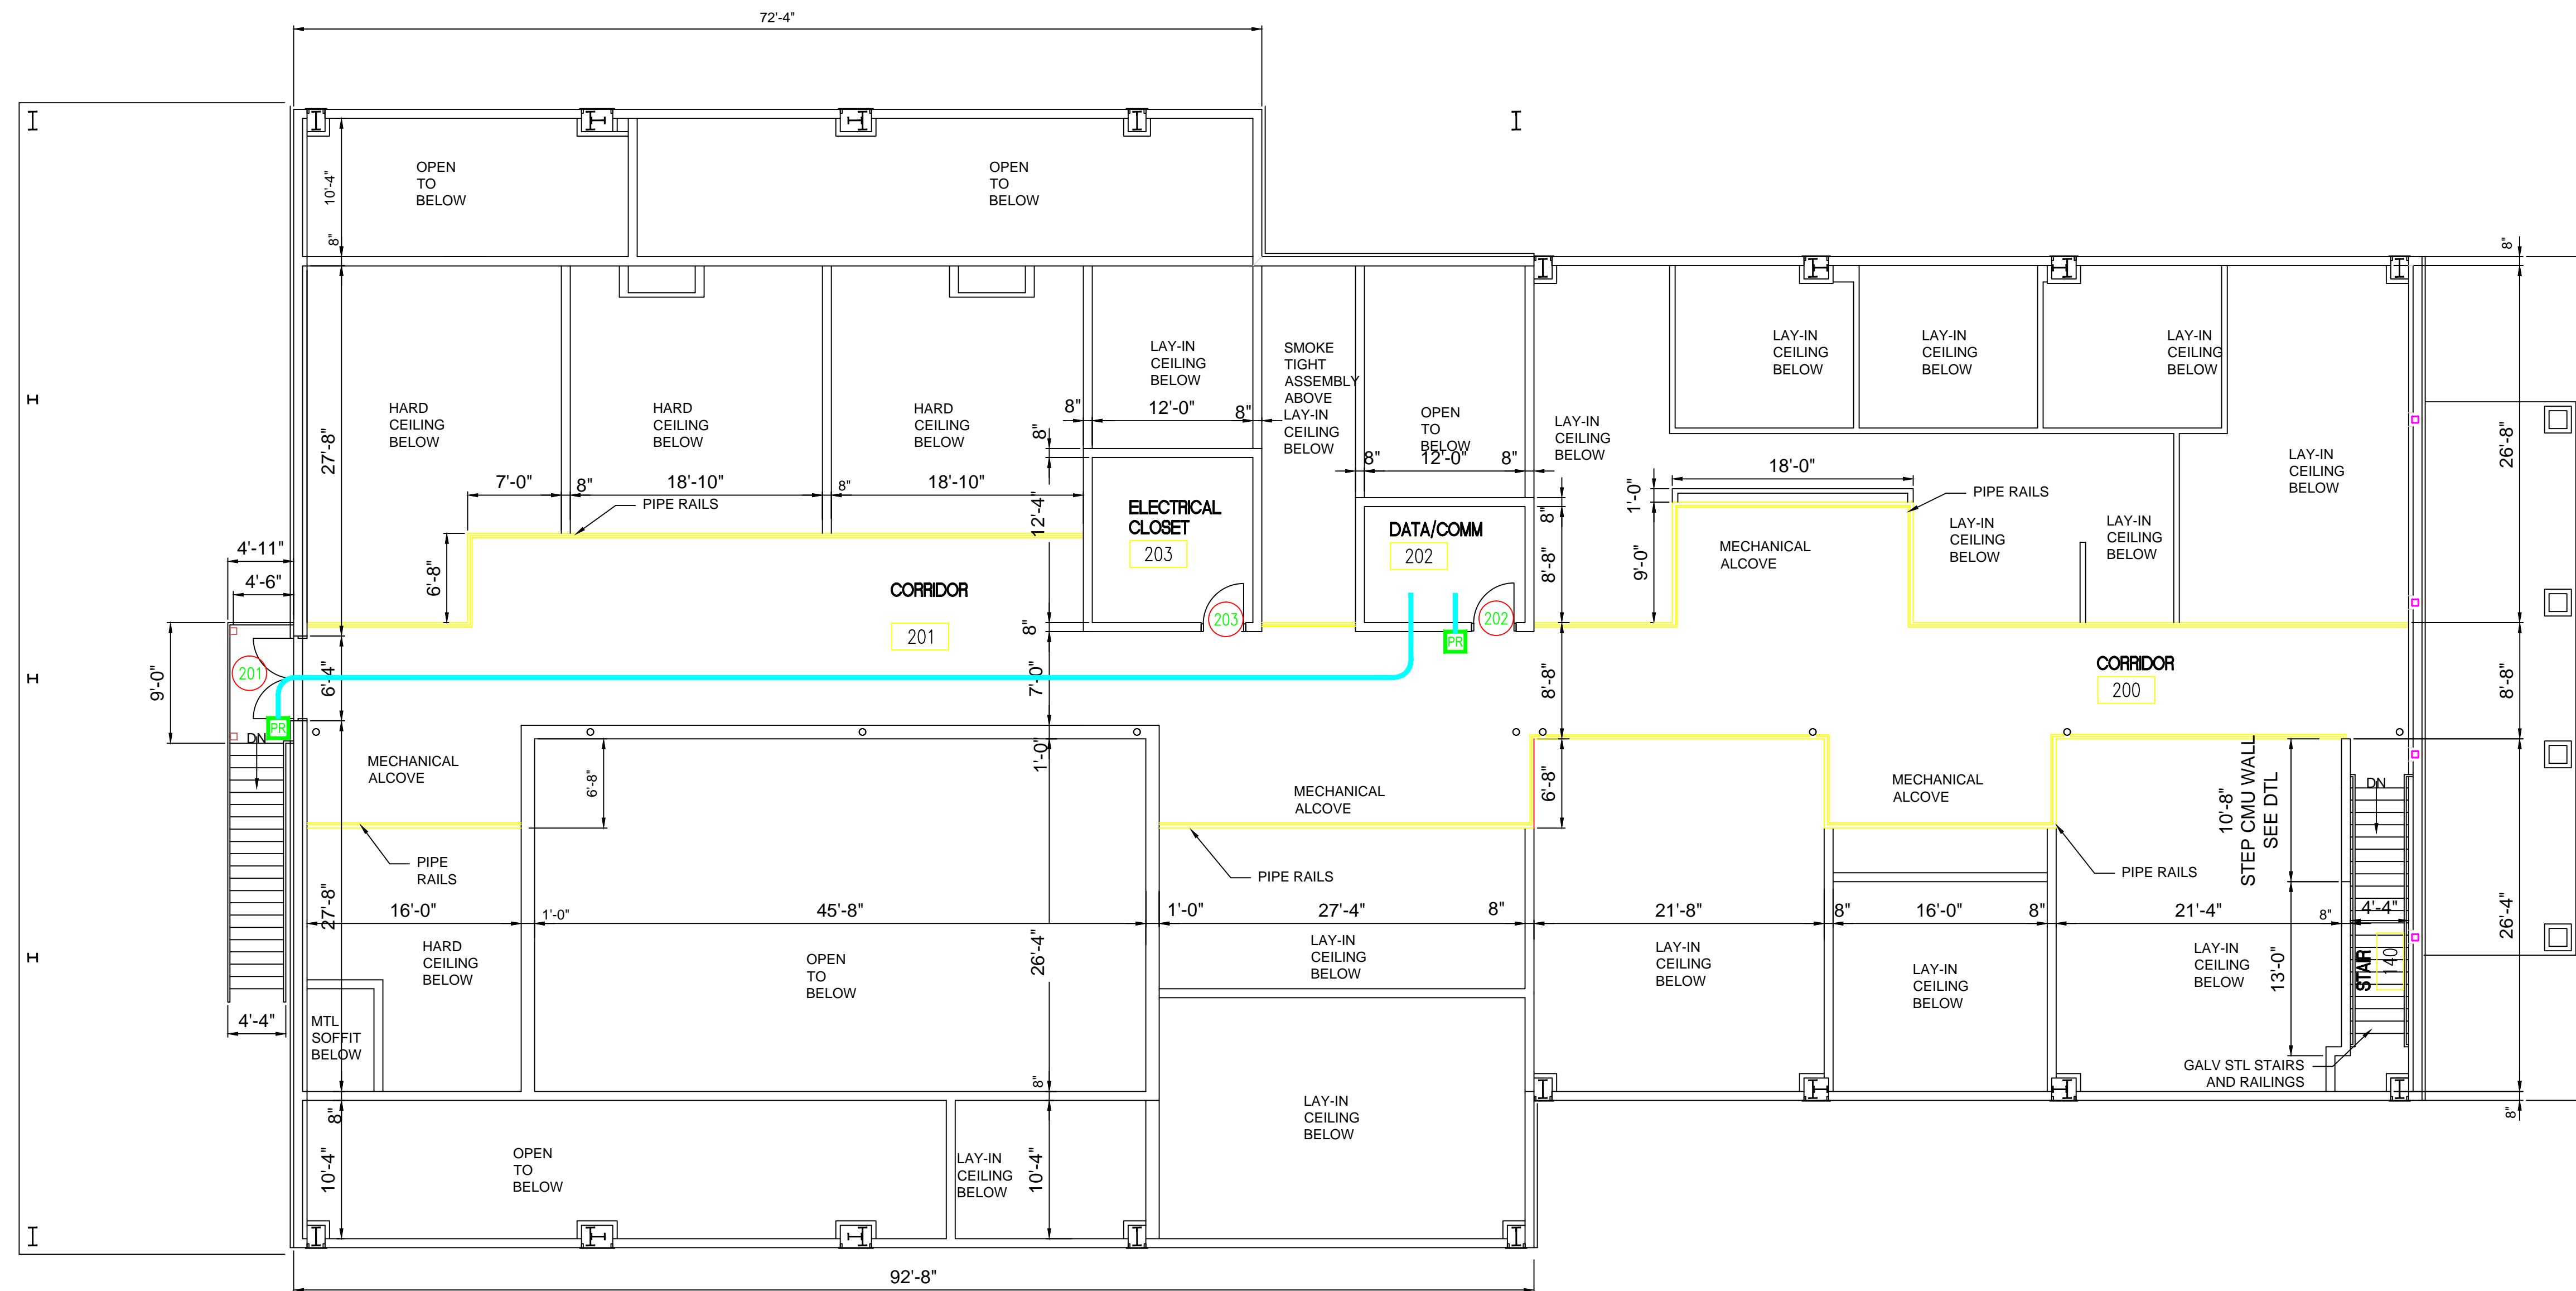

SCALE IN FEET

**1** MEZZANINE ACCESS CONTROL PLAN  
SCALE: 1/8" = 1'-0"

ACCESS CONTROL SYMBOL LEGEND

- PR = HID READER
- = CABLING
- = SMOKE WALL

**DAMMON ENGINEERING, INC.**  
554 Old Spanish Trail  
Slidell, LA 70458  
Phone: 985.649.5832  
www.dammonengineering.com  
info@dammonengineering.com

REVISIONS	DATE

#	DESCRIPTION

ACCESS CONTROL  
**SOUTHERN UNIVERSITY OF MISSISSIPPI**  
GULF COAST RESEARCH LABORATORY  
CEDAR POINT SITE  
OCEAN SPRINGS, MISSISSIPPI  
JOB No: 2/19/2016  
DATE: 2/19/2016  
DRAWN BY: [Signature]  
CHECKED BY: [Signature]

SHEET TITLE:  
MEZZANINE ACCESS CONTROL PLAN

DRAWING NUMBER:  
**SEC-1M**

SHEET No: 2 of 2