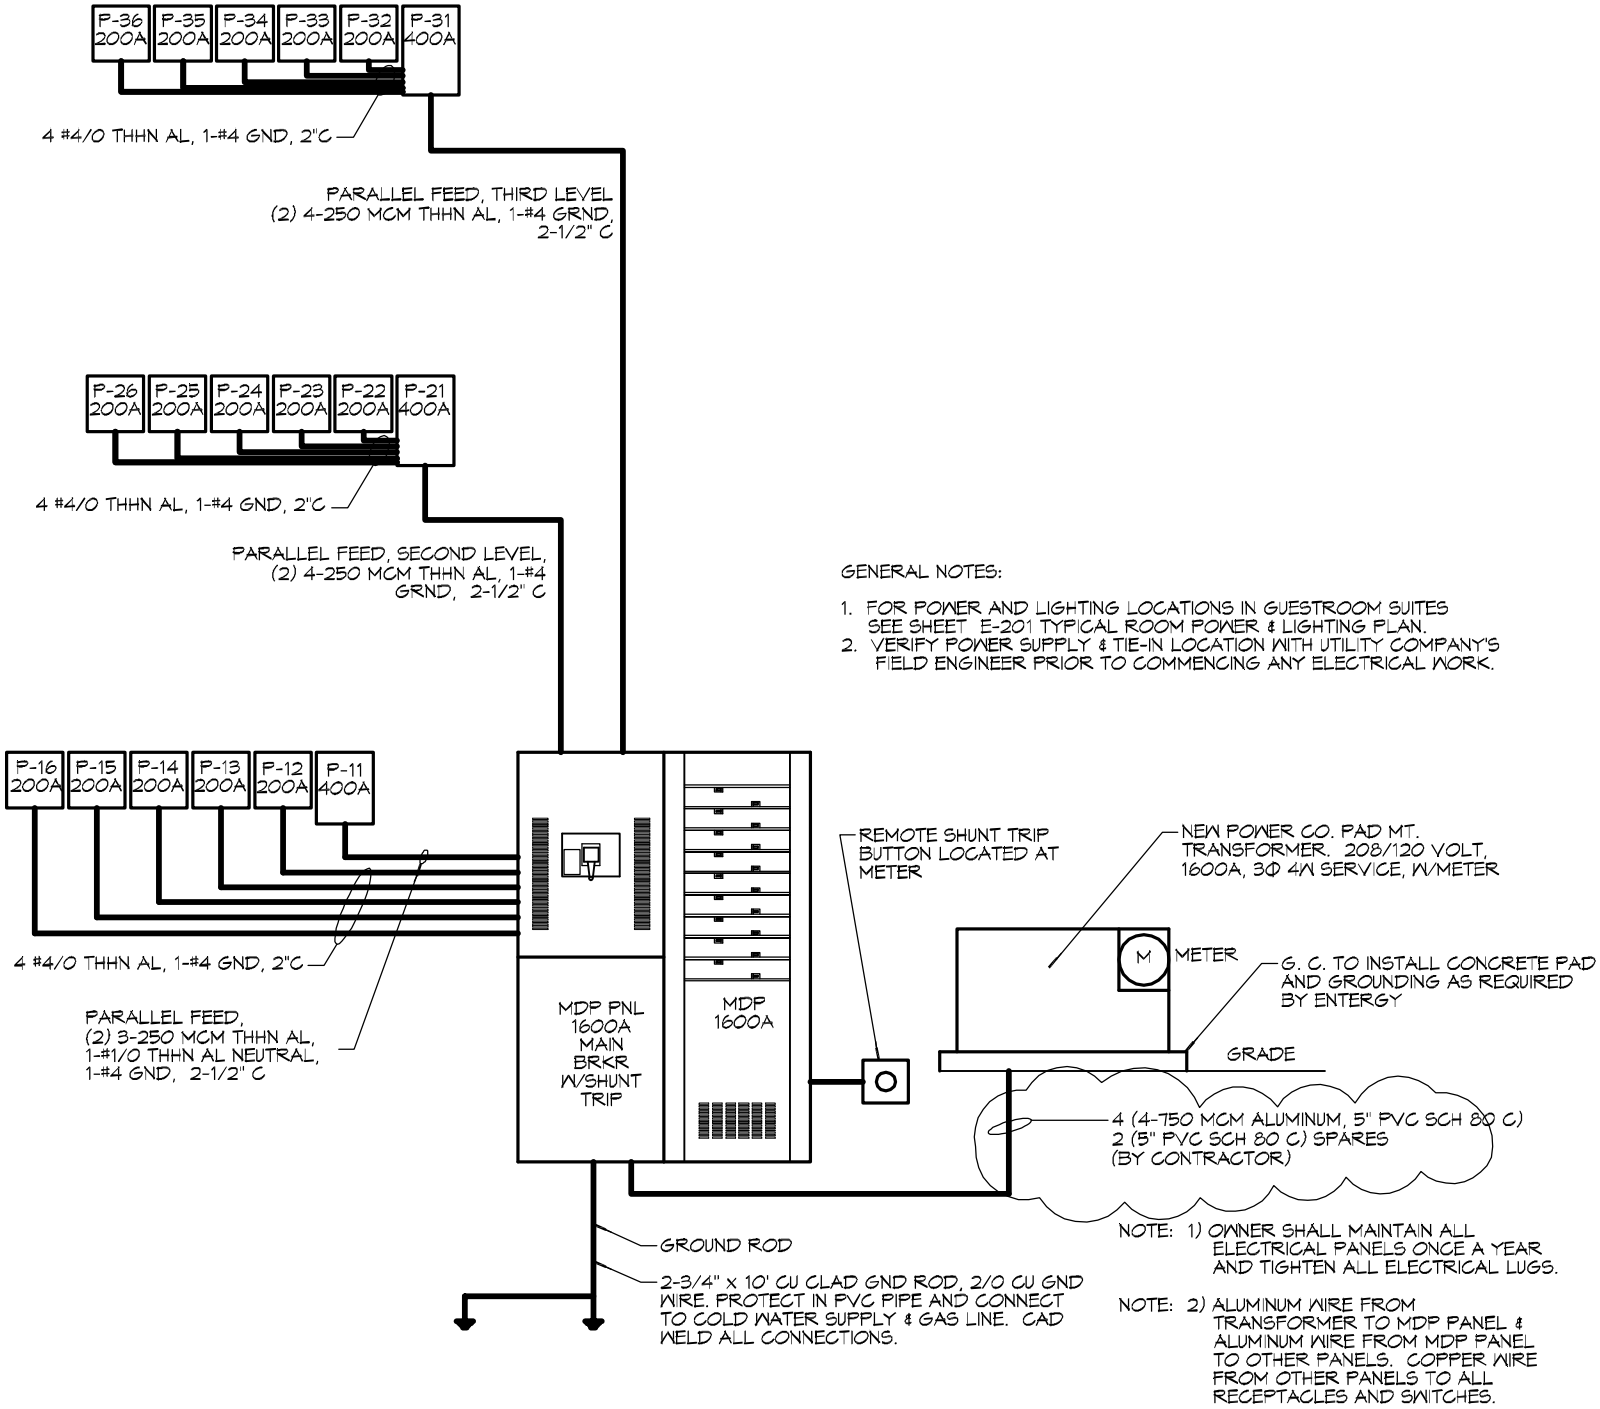

GENERAL NOTES:

1. FOR POWER AND LIGHTING LOCATIONS IN GUESTROOM SUITES SEE SHEET E-201 TYPICAL ROOM POWER & LIGHTING PLAN.
2. VERIFY POWER SUPPLY & TIE-IN LOCATION WITH UTILITY COMPANY'S FIELD ENGINEER PRIOR TO COMMENCING ANY ELECTRICAL WORK.

NOTE: 1) OWNER SHALL MAINTAIN ALL ELECTRICAL PANELS ONCE A YEAR AND TIGHTEN ALL ELECTRICAL LUGS.

NOTE: 2) ALUMINUM WIRE FROM TRANSFORMER TO MDP PANEL & ALUMINUM WIRE FROM MDP PANEL TO OTHER PANELS. COPPER WIRE FROM OTHER PANELS TO ALL RECEPTACLES AND SWITCHES.

ELECTRICAL ONE-LINE DIAGRAM

SCALE: N.T.S.