
PROJECT SPECIFICATION
for

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1



NEW TRAINING FACILITY

34780 S. RANGE ROAD
SLIDELL, LOUISIANA 70460

OWNER:

St. Tammany Fire Protection District No. 1
522 Robert Blvd
Slidell, Louisiana 70458

Prepared by:

ARCHITECT:

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Tel: (985) 649-5832
Email: info@dammonengineering.com



February 10, 2025

ARCHITECT'S PROJECT NO. 2507

DOCUMENT 000001

TABLE OF CONTENTS

	No. of Pages
000001 - TABLE OF CONTENTS	4
INTRODUCTORY INFORMATION	
000103 - PROJECT DIRECTORY	1
BIDDING REQUIREMENTS	
ADVERTISEMENT FOR BIDS	2
INSTRUCTIONS TO BIDDERS	10
LOUISIANA UNIFORM PUBLIC WORK BID FORM.....	1
BID BOND.....	1
004519 - NONCOLLUSION AFFIDAVIT	1
004543 - CORPORATE RESOLUTION.....	1
CONTRACTING REQUIREMENTS	
005200 - STANDARD FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR (AIA DOCUMENT A101 INCORPORATED BY REFERENCE)	1
006113 - PERFORMANCE AND PAYMENT BOND (AIA DOCUMENT A312 INCORPORATED BY REFERENCE) ..	1
007200 - GENERAL CONDITIONS (AIA DOCUMENT A201 INCORPORATED BY REFERENCE)	1
007300 - SUPPLEMENTARY CONDITIONS	28
DIVISION 1 - GENERAL REQUIREMENTS	
010280 -TAX EXEMPT STATUS - FILING PROCEDURES.....	2
011000 - SUMMARY	3
012500 - SUBSTITUTION PROCEDURES	3
012600 - CONTRACT MODIFICATIONS PROCEDURES.....	3
012900 - PAYMENT PROCEDURES.....	5
013100 - PROJECT MANAGEMENT AND COORDINATION	8
013300 - SUBMITTALS	11
014000 - QUALITY REQUIREMENTS.....	8
015000 - TEMPORARY FACILITIES AND CONTROLS	6
015813 - PROJECT ID SIGN	4
016000 - PRODUCT REQUIREMENTS.....	9
017300 - EXECUTION REQUIREMENTS	10
017700 - CLOSEOUT PROCEDURES	5
017823 - OPERATION AND MAINTENANCE.....	8
017839 - PROJECT RECORD DOCUMENTS	5
DIVISION 2 - NOT USED	

DIVISION 3 - CONCRETE

033000 - CAST-IN-PLACE CONCRETE..... 13

DIVISION 4 - NOT USED

DIVISION 5 - METALS

051200 - STRUCTURAL STEEL..... 12
054000 - COLD FORMED METAL FRAMING..... 14
055000 - METAL FABRICATIONS8

DIVISION 6 - NOT USED

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

072000 - INTERIOR PARTITION ACOUSTICAL INSULATION.....3
072100 - THERMAL INSULATION6
072500 - WEATHER BARRIERS.....7
076100 - PREFORMED METAL ROOFING6
076200 - SHEET METAL FLASHING AND TRIM 12
079200 - JOINT SEALANTS..... 13

DIVISION 8 - DOORS AND WINDOWS

081300 - STEEL DOORS AND FRAMES 12
081313 - HOLLOW METAL FRAMES7
081416 - FLUSH WOOD DOORS6
085000 - WINDOWS.....6
088000 - GLAZING 14

DIVISION 9 - FINISHES

092900 - GYPSUM BOARD..... 12
093000 - TILE SETTING MATERIALS7
093013 - CERAMIC TILING 15
096513 - RESILIENT BASE AND ACCESSORIES4
099113 - EXTERIOR PAINTING 22
099123 - INTERIOR PAINTING 15
099600 - HIGH PERFORMANCE COATING.....5

DIVISION 10 - SPECIALTIES

102113 - TOILET COMPARTMENTS4
102800 - TOILET, BATH AND LAUNDRY ACCESSORIES3
103000 - ENGINEERED COMPOSITES FABRICATIONS.....4
104413 - FIRE PROTECTION CABINETS3
104416 - FIRE EXTINGUISHERS.....3

DIVISION 11 - NOT USED

DIVISION 12 - FURNISHINGS

123000 - CASEWORK.....3
123640 - STONE COUNTERTOP5

DIVISION 13 - SPECIAL CONSTRUCTION

133419 - METAL BUILDING SYSTEMS 17

DIVISION 14 thru 21 - NOT USED

DIVISION 22 - PLUMBING

220500 - COMMON WORK RESULTS FOR PLUMBING 15
220523 - GENERAL DUTY VALVES FOR PLUMBING PIPING 19
221113 - FACILITY WATER DISTRIBUTION PIPING 20
221116 - DOMESTIC WATER PIPING 15
221313 - FACILITY SANITARY SEWERS 15
224000 - PLUMBING FIXTURES 16

DIVISION 23 - MECHANICAL

230500 - COMMON WORK RESULTS FOR HVAC 14
230529 - HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT9
230593 - TESTING, ADJUSTING, AND BALANCING FOR HVAC..... 15
230713 - DUCT INSULATION..... 19
233113 - METAL DUCTS 17
233300 - AIR DUCT ACCESSORIES 13
237313 - INDOOR CENTRAL STATION AIR HANDLING UNITS 11

DIVISION 26 - ELECTRICAL

260500 - COMMON WORK RESULTS FOR ELECTRICAL.....5
260519 - LOW VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES4
260526 - GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS6
260533 - RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS 12
260544 - SLEEVES AND SLEEVE SEALS FOR ELECTRICAL RACEWAYS.....4
260553 - IDENTIFICATION FOR ELECTRICAL SYSTEMS.....8
260529 - HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS6
262416 - PANELBOARDS.....7
262726 - WIRING DEVICES 10
265100 - INTERIOR LIGHTING9

DIVISION 27 thru 30 - NOT USED

DIVISION 31 - EARTHWORK

311000 - SITE CLEARING6
312000 - EARTHMOVING 14
313116 - TERMITE CONTROL5

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1
NEW TRAINING FACILITY
34780 S. RANGE ROAD
SLIDELL LA 70460

DIVISION 32 - EXTERIOR IMPROVEMENTS

321313 - CONCRETE PAVEMENT 19

END OF DOCUMENT 000001

INTRODUCTORY INFORMATION

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: www.dammonengineering.com



ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1
NEW TRAINING FACILITY
34780 S. RANGE ROAD
SLIDELL LA 70460

DOCUMENT 000103

PROJECT DIRECTORY

OWNER: ST TAMMANY FIRE PROTECTION DISTRICT NO. 1
522 Robert Blvd.
Slidell, Louisiana 70458
Tel: (985) 649-3665
Owner's Representative: Chad Duffaut

ARCHITECT: DAMMON ENGINEERING, INC.
an Architectural and Engineering firm
554 Old Spanish Trail
Slidell, Louisiana 70458
Tel: (985) 649-5832
Email: info@dammonengineering.com
Website: www.dammonengineering.com

END OF DOCUMENT 000103

BIDDING REQUIREMENTS

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: www.dammonengineering.com



St. Tammany Fire Protection District No. 1
522 Robert Blvd.
Slidell, LA 70458

St. Tammany Fire Protection District No. 1 will be accepting sealed bids for the construction of a 1,950 square foot new Training Facility located at 34780 S. Range Rd, Slidell, LA 70458 (On Camp Villere).

Those interested in submitting bids may obtain drawings and specifications, upon deposit of \$400.00 at Dammon Engineering, Inc located at 554 Old Spanish Trail, Slidell La. 70458 or by emailing info@dammonengineering.com for information, or by downloading documents at Central Bidding.

Sealed bids shall be marked "SEALED-TRAINING FACILITY" and shall also contain the respondent's Louisiana Contractor's Name and License Number on the outside of the envelope. In accordance with La. R.S. 37:2163, the Contractor shall certify that he holds an active license. The contractor shall hold a Louisiana Contractor's license in Municipal & Public Works Construction and/or Building Construction.

Bids will be accepted through **Central Bidding** or manual submission. Manually-submitted bids can be submitted to the Receptionist at the St. Tammany Fire Protection District No. 1 Headquarters, 522 Robert Boulevard, Slidell, LA 70458 no later than 4:00 p.m., Thursday, March 20, 2025. Any bid received after 4:00 p.m. will be returned unopened.

In the case of an electronic bid, a contractor may submit an authentic digital signature on the electronic bid accompanied by the contractor's license number in order to meet the requirements of La. R.S. 37:2163. Except as otherwise provided in R.S. 37:2163, if the bid does not contain the contractor's certification and show the contractor's license number on the bid envelope, the bid shall be automatically rejected and shall be returned to the bidder marked "Rejected" and shall not be read aloud.

Bids will be opened on Thursday, March 20, 2025, at 4:00 PM at Fire District Headquarters, 522 Robert Blvd, Slidell, LA 70458.

In accordance with La. R.S. 37:2163, the Contractor shall certify that he holds an active license under the provisions of La. R.S. 37:2163 and all architects, engineers, and awarding authorities shall place in their bid specifications the requirement.

There will be a mandatory pre-bid meeting held of all respondents at the jobsite at 34780 S. Range Rd, Slidell, LA 70460 (On Camp Villere) on Monday, March 10, 2025, at 10:00 AM. All prime respondents must have an officer, principal, manager, or supervisor present during the entire duration of the pre-bid meeting.

The signature on the bid must be that of an authorized representative of the corporation, partnership or other legal entity, as defined by Louisiana Public Bid Law Revised Statute 38:2212.A.(1)(c) which dictates parties authorized to submit bids for public contracts.

All entities submitting a bid must have at least 5 years previous construction experience in the State of Louisiana. This requirement is applicable to all persons holding an ownership interest of five (5%) percent or greater in any partnership or joint venture submitting a bid.

All required Certificates of Liability Insurance shall list the Fire District as an "additional insured."

All applicable Federal, State, Local laws, ordinance, and the rules and regulations of all authorities having jurisdiction over construction of the project shall apply to the contract throughout.

The bid must be accompanied by a bid security equal to five percent (5%) of the base bid and must be in the form of a certified check, cashier's check or bid bond written by a company licensed to do business in Louisiana. If submitting a bid online, vendors must submit an electronic bid bond through the respective online clearing house bond management system(s) as indicated in the electronic bid Solicitation on Central Auction House. No scanned paper copies of any bid bond will be accepted as part of the electronic bid submission. The successful bidder will be required to furnish a Performance and Payment Bond written by a company licensed to do business in Louisiana, in the amount equal to one hundred percent (100%) of the Bid amount. Certificates of Insurance will also be required

No bidder may withdraw his/her Bid within forty-five (45) days after the actual date of opening thereof.

All proposals, bids and applications are welcomed. The Fire District encourages participation by Minority, Women-Owned, and Disadvantaged Business Enterprise firms.

Deposits are refundable to bonafide prime respondents and will be 50% refundable to all others with return of complete and unmarked documents no later than 10 days after receipt of bids.

Instructions to Bidders for New Training Facility

INSTRUCTIONS TO BIDDERS

COMPLETION TIME:

The Bidder shall agree to achieve Substantial Completion of the entire Work not later than One Hundred Twenty (120) calendar days from the date of commencement specified in the written "Notice to Proceed" from the Owner, subject to adjustments of this Contract Time as provided in the Contract Documents.

LIQUIDATED DAMAGES:

The Bidder shall agree to pay as Liquidated Damages the amount of Five Hundred Dollars (\$500) for each consecutive calendar day for which the work is not complete, beginning with the first day beyond the completion dated state on the "Notice to Proceed". Said sum shall in no event be construed to be a penalty; but only as damages fixed and agreed upon in advance.

CONSTRUCTION CLASSIFICATION:

Bids will be accepted from Contractors who are properly licensed for the classification of "Building Construction" (see La. R.S. 37:2156.2 for classifications).

TABLE OF SECTIONS

1. Definitions and Introduction
2. Bidder's Representation
3. Bidding Documents
4. Bidding Procedure
5. Consideration of Bids
6. Post Bid Information
7. Performance and Payment Bond & Insurance
8. Form of Agreement between Owner and Contractor
9. Environmental Considerations
10. Additional Bidder Information
11. Post-Bid Submittal Forms

SECTION 1 DEFINITIONS AND INTRODUCTION

- 1.1 The Bidding Documents and the Contract Documents include the following:
Advertisement for Bids, Instructions to Bidders, Bid Form, General Conditions of the Contract for Construction, AIA Document A201, 2007 Edition, Supplementary General Conditions, Contract Between Owner and Contractor, AIA Document A 101, Standard Form of Agreement Between Owner and Contractor where the basis of payment is a STIPULATED SUM, Performance and Payment Bond(s), Specifications Divisions 1 through 33, Drawings, and Addenda.
- 1.2 The Owner of the proposed work is
St. Tammany Fire Protection District No. 1
522 Robert Blvd.
Slidell, LA 70458
- 1.3 The title of work will be as indicated in the Advertisement for Bids.

Instructions to Bidders for New Training Facility

- 1.4 All definitions set forth in the General Conditions of the Contract for Construction, AIA Document A 201 or in other Contract Documents are hereby made a part of the Instructions to Bidders.
- 1.5 **Addenda** are written or graphic instruments issued by the Architect prior to the opening of bids which modify or interpret the Bidding Documents by additions, deletions, clarifications, corrections and prior approvals.
- 1.6 A **Bid** is a complete and properly signed proposal to do the Work or designated portion thereof for the sums stipulated therein, submitted in accordance with the Bidding Documents.
- 1.7 The **Base Bid** is the sum stated in the Bid for which the Bidder offers to perform the Work described as the Base Bid, to which Work may be added for sums stated in Alternate Bids.
- 1.8 An **Alternate Bid** (or Alternate) is an amount stated in the Bid to be added to the amount of the Base Bid if the corresponding change in the Work or change in materials or methods of construction described in the Bidding Documents is accepted.
- 1.9 A **unit price** is an amount stated in the Bid as a price per unit of measurement for materials, equipment, or services or a portion of the Work as described in the Bidding Documents.
- 1.10 A **Bidder** is a person or entity who submits a Bid.
- 1.11 A **Sub-bidder** is a person or entity who submits a bid to a Bidder for materials, equipment, or labor for a portion of the Work.
- 1.12 **Architects and Engineers:** The Architect of record or his authorized representative, and the consulting Engineer(s) whose seal(s) occur on the Construction Documents will administer the construction contract.
- 1.13 **Bid Forms** can be found immediately following these instructions to bidders.
- 1.14 A **Unit Price** is an amount proposed by Bidder and stated on the Bid Form as a price per unit of measurement for materials and/or services that shall be added or deducted from the contract sum by Change Order in the event the estimated quantities of work required by the Contract Documents are increased or decreased.

SECTION 2

BIDDER'S REPRESENTATION

- 2.1 The Bidder by making his Bid represents that:
 - 2.1.1 The Bidder has read and understands the Bidding Documents and his Bid is made in accordance therewith, and,
 - 2.1.2 The Bidder has visited the site(s) and has familiarized himself with all of the local conditions under which the Work is to be performed, and has correlated the Bidder's personal observations with the requirements of the proposed Contract Documents, and,
 - 2.1.3 The Bid is based upon the materials, systems, and equipment described in the Bidding Documents as advertised and as modified by Addenda, without exception, and,
 - 2.1.4 The Bidder is fully qualified under all Louisiana State Laws, and all local licensing laws for Contractors in effect at the time and at the location(s) of the Work before submitting his Bid, and that all of his Sub-bidders or prospective Sub-contractors are duly licensed in accordance with all

Instructions to Bidders for New Training Facility

laws, (if required).

- 2.1.5 His bid is not based on any verbal instructions contrary to the Contract Documents and addenda.

SECTION 3 BIDDING DOCUMENTS

3.1 COPIES

- 3.1.1 Bidding Documents may be obtained directly from the Architect for a deposit of amount per set as described in Section 10. Deposits will be refunded only if Bidding Documents are received by the Architect within 10 days after bid date specified in the Advertisement for Bids. No deposits will be refunded if Bidding Documents are received late. No deposit will be refunded for returned torn, not bound, nor incomplete, partial sets of Bidding Documents which are not in good condition. The Architect will not call to warn bidders when Bidding Documents are due. Submit Louisiana Contractor's License Number, name and address phone, and fax when ordering plans.
- 3.1.2 Cost of postage paid by bidders to receive plans will not be refunded. All costs of postage or delivery to return sets of documents to the Architect shall be paid for by the company which procured said sets.
- 3.1.3 Bid documents are also available from this website: www.slidelfire.org
- 3.1.4 Bidders shall use complete sets of Bidding Documents in preparing bids; neither the Owner nor the Architect assumes responsibility for errors, omissions, and misinterpretations resulting from the use of incomplete sets of Bidding Documents. Prior to bidding, verify all specification page numbers and Drawing sheet numbers with the specified index to insure receipt of all documents.
- 3.1.5 The Owner or Architect in making copies of the Bidding Documents available on the above terms, do so only for the purpose of obtaining bids on the Work and do not confer a license or grant permission for any other use of the Bidding Documents.

3.2 INTERPRETATION OR CORRECTION OF BIDDING DOCUMENTS

- 3.2.1 The Bidder shall carefully study and compare the Bidding Documents with each other, and with other work of separate contractors to the extent that it relates to the Work for which the Bid is submitted, shall examine the site and all local conditions, and shall at once report to the Architect all ambiguities, inconsistencies, or errors discovered in the Bidding Documents or errors relating to the Project site.
- 3.2.2 Bidders and Sub-bidders requiring clarification or interpretation of the Bidding Documents shall make a written request to the Architect to reach him at least seven (7) working days, exclusive of weekends and holidays, prior to the date for receipt of Bids.
- 3.2.3 Interpretations, corrections, or changes of the Bidding Documents will be made by written Addendum. Interpretations, corrections, or changes of the Bidding Documents made in any other manner will not be binding, and Bidders shall not rely upon them.

3.3 SUBSTITUTIONS- (PRIOR APPROVAL REQUIRED)

- 3.3.1 The materials, products, and equipment described in the Bidding Documents establish a standard of required function, dimension, appearance and quality to be met by any proposed substitution.
- 3.3.2 No substitution will be considered prior to receipt of Bids unless a complete written request for approval has been submitted by the proposer and has been received by the Architect at least seven (7) working days, exclusive of weekends and legal holidays, prior to the date for receipt of Bids (RS

Instructions to Bidders for New Training Facility

38:2295C).

- 3.3.3 All request shall include the name of the material or equipment for which it is to be substituted, the location, and a complete description of the proposed substitute including model numbers, colors, textures, drawings, cuts, performance and test data and all other detailed information necessary for a complete evaluation. A written statement setting forth all changes in other materials, equipment, or other portions of the Work including changes in the work of other contracts that incorporation of the proposed substitution would require shall be included.
- 3.3.4 The burden of proof of the merit of the proposed substitution is upon the proposer. Incomplete product submittals not indicating meeting the standards specified, colors, textures, actual samples, sufficient dimensions, quality, and strength of materials, and other standards specified will not be reviewed and will not be added to the list of prior approvals specified by addendum.
- 3.3.5 The Architect's decision of approval or disapproval of a proposed substitution shall be final.
- 3.3.6 The Architect reserves the right to reject products for which incomplete test data, samples, telephone numbers of users of products and information has been submitted. All test data and information shall meet or exceed standards specified. Manufacturers are responsible for submitting all information and all additional information requested by the Architect prior to the date specified above. Substitutions which require substantial revision of the Contract Documents will not be considered. The Architect reserves the right to reject materials and equipment proposed for this Project.
- 3.3.7 The Contractor shall have the option to use prior approval substitutions. No extra payment by Change Order will be approved for additional Work, materials, and equipment required to incorporate prior approved substitutions.
- 3.3.8 If the Architect approves a proposed substitution, prior to receipt of Bids, such approval will be set forth in a written Addendum. Bidders shall not rely upon approvals made in any other manner.
- 3.3.9 The Architect reserves the right to reject materials and equipment at a later date after opening of bids if it is detected by the Architect that incomplete or false information was submitted prior to bidding.

3.4 ADDENDA

- 3.4.1 Addenda will be attempted to be mailed by the Architect to all who are known by the Architect to have received a complete set of Bidding Documents. Because of errors in addresses, mistakes by mail carriers, and other human errors, all addenda are not always delivered to all bidders on time, all of the time.
- 3.4.2 All bidders who have received or who have reviewed bidding documents shall be responsible for verifying whether or not they have received all Addenda. Do not rely solely on mail, published reports, printed journals, published reports, or other delivery or information systems to verify receiving all Addenda.
- 3.4.3 All bidders shall be responsible for calling the Architect's Office within 72 hours prior to the date and time of opening of Bids to verify receipt of all Addenda issued by the Architect. All Bidders shall be responsible for picking up all Addenda not yet received from the Architect's office.
- 3.4.4 Copies of Addenda will be attempted to be made available for inspection wherever Bidding Documents are on file for that purpose, however, call the Architect to verify Addenda receipt.
- 3.4.5 Addenda shall normally not be issued within a period of seventy-two (72) hours, excluding weekends and any legal holiday, prior to the advertised time for the opening bids except an Addendum withdrawing the specified request for Bids, or one which includes postponement of the date for receipt of Bids. If it is necessary to issue an addendum within the seventy-two (72) hour period prior to receipt of bids, the receipt of such bids shall be extended a minimum of exactly seven

Instructions to Bidders for New Training Facility

(7) days, or more, up to 30 days without the requirement of re-advertising. The Owner shall be consulted prior to issuance of such an addendum, and shall approve such issuance.

- 3.4.6 All Bidders shall ascertain prior to submitting Bids that they have received all Addenda issued by the Architect, and all Bidders shall acknowledge said receipt in the space indicated on the Bid Form.
- 3.4.7 Failure to acknowledge receipt of all Addenda issued for this Project in the space(s) specified on the Bid Form will render the proposal informal and will cause its rejection.
- 3.4.8 All addenda shall become part of the Contract Documents. All Bidders shall be bound by all Addenda whether or not received by said Bidders.
- 3.4.9 The Owner shall have the right to extend the bid date by up to (30) days. Any such extensions shall be made by addendum issued by the Architect.

SECTION 4 BIDDING PROCEDURE

4.1 FORM AND STYLE OF BIDS

- 4.1.1 Bids shall be submitted on forms identical to the bid form included with the Bidding Documents, or as modified by Addenda. Legible copies of the bid form are acceptable.
- 4.1.2 All blanks on the bid form shall be filled in by typewriter or manually in ink.
- 4.1.3 Where so indicated by the makeup of the bid form, sums shall be expressed in both words and figures, and in case of discrepancy between the two, the written words shall govern.
- 4.1.4 Interlineations, alterations, and erasures of the filled in information shall be initialed by the signer of the Bid, or his duly authorized representative.
- 4.1.5 Bidders are cautioned to complete all alternates should such be required in the Bid Form. Failure to submit alternate prices will render the Proposal informal and will cause its rejection. If no change in the Base Bid is required by the Alternate, enter "No Change" for the Alternate(s), (if any).
- 4.1.6 The Bidder shall make no additional stipulations on the bid form nor qualify his Bid in any other manner.
- 4.1.7 The Bid shall include the legal name of Bidder and a statement that the Bidder is a sole proprietor, a partnership, a corporation, or other legal entity where indicated on the bid form. The Bid shall be signed by the person or persons legally authorized to bind the Bidder to the specified Contract. A Bid by a legal entity shall have filed in the Secretary of State's office a resolution indicating the names of all parties authorized to submit public bids for public contracts if required by State law, or a bid by a legal entity shall have a corporate resolution attached to the bid if required by State law, and shall give the state of incorporation. A Bid by a corporation shall have the person signing the Bid who is an officer of the corporation. A Bid submitted by an agent shall have a current Power of Attorney attached certifying the agent's authority to bind the Bidder. Verify complying with all Louisiana bidding law requirements prior to submitting bids.
- 4.1.8 On any bid in excess of fifty thousand dollars (\$50,000.00), the Contractor shall certify that he is licensed under R. S. 37:2150-2163 and indicate his Louisiana Contractor's license number on the outside of the bid envelope.

4.2 BID SECURITY

Instructions to Bidders for New Training Facility

- 4.2.1 No Bid will be considered or accepted unless the bid is accompanied by a bid security in an amount of not less than five percent (5%) of the Base Bid and all additive alternates. The bid security shall be in the form of a certified check or cashier's check drawn on a bank insured by the Federal Deposit Insurance Corporation, or a bid bond (A.I.A. Document A310) written by a surety company licensed to do business in Louisiana, countersigned by a person who is under contract with the surety company or bond issuer as a licensed agent in Louisiana who is residing in Louisiana and accompanied by appropriate power of attorney and in favor of the Owner. The surety company shall be licensed to do business in the State of Louisiana listed in the Department of the Treasury Circular 570, latest revision. The Surety Company shall have an A.M. Best Company minimum rating with a minimum financial size in accordance with the General Conditions. No company, regardless of the size or financial rating, will be allowed to write its own bond.
- 4.2.2 Bid security furnished by the Contractor shall guarantee that the Contractor shall, if awarded the Work according to the terms of his proposal, enter into the Contract and furnish Performance and Payment Bond(s) and insurance as required by these Contract Documents, within the time specified in the Supplemental General Conditions, Article 11 or after verbal or written notice has been issued that the instrument is ready for his signature.
- 4.2.3 Should the Bidder refuse to enter into such Contract or fail to furnish such bonds or insurance, the amount of the bid security shall be forfeited to the Owner as liquidated damages, not as penalty.
- 4.2.4 The Owner will have the right to retain the bid security of Bidders until either (a) the Contract has been executed and bonds and insurance have been furnished, or (b) the specified time has elapsed so that Bids may be withdrawn, or (c) all Bids have been rejected.
- 4.2.5 If the Bid Security attached to the bid form is a Bid Bond, then said Bid Bond shall be prepared as specified herein.
- 4.3 SUBMISSION OF BIDS
- 4.3.1 Bids, bid security, and all other additional required information, (if any, and if specified), shall be enclosed and sealed in an opaque bid envelope.
- 4.3.2 The outside of the bid envelope (or outermost envelope if mailed by and delivered by United States Mail, Express Mail, Priority Mail, UPS, Federal Express, and all other similar types of carrier delivery,) shall be labeled as follows:
- Addressed to the Owner
 - Identify the name of the Bidder
 - Identify the sealed bid envelope exactly as follows
SEALED - NEW TRAINING FACILITY
 - Identify the Louisiana Contractor's license number of the Bidder (if applicable)
- **Failure to label all envelopes or boxes exactly as stated above shall result in a MANDATORY rejection of this bid. Owner does not have the right to waive informalities as dictated by public bid law. Sole responsibility for properly labelling, mailing and delivering of bids is that of the bidder.**
- 4.3.3 Sealed Bids will be received by the Owner until the time and date, and at the location specified in the Advertisement for Bids.

Instructions to Bidders for New Training Facility

- 4.3.4 Bidders submitting bids to the Owner's bid receipt location shall assume full responsibility for the timely delivery and Owner's receipt of bids at the specified location prior to the time and date specified for receipt of Bids.
- 4.3.5 Owner's receipt of a bid for any reason after the date and time stipulated on the Advertisement for Bids, including but not limited to late delivery by carrier service, late mail, late hand delivery by anyone, leaving bid(s) with someone not specifically designated by the Owner to receive bid(s) prior to bid receipt, incorrect addresses, misunderstood information, misunderstood directions, or all other types of late delivery, and excuses shall disqualify the bid.
- 4.3.6 Thoroughly review Bid Form early to insure having all of the required information on time.
- 4.3.7 Bids received after the time and date specified for the receipt of bids will be returned unopened.
- 4.3.8 Oral, telephonic, "faxed", or telegraphic Bids or modifications to bids are invalid and will not receive consideration. The Owner will not consider notations written on the outside of the Bid Envelope which have the effect of the Bidder trying to amend the Bid.
- 4.3.9 Bids will be accepted only from Contractors that attend the Pre-Bid Conference. Date, time and location of the Pre-Bid Conference are indicated in the Advertisement for Bids.
- 4.4 MODIFICATION OR WITHDRAWAL OF BID
 - 4.4.1 A bid may not be modified, withdrawn or cancelled by the Bidder during the time stipulated in the Advertisement for Bids, for the period following the time and bid date designated for the receipt of bids, and the Bidder so agrees in submitting his Bid, except in accordance with Act 111 of 1983 which states, in part, "Bids containing patently obvious mechanical, clerical, or mathematical errors may be withdrawn by the Contractor if clear and convincing sworn, written evidence of such errors is furnished to the public entity or Owner within forty-eight hours of the bid opening excluding Saturdays, Sundays and legal holidays".
 - 4.4.2 Prior to the time and date designated for receipt of Bids, Bids submitted early may be modified or withdrawn only by notice to the party receiving Bids at the place and prior to the time designated for receipt of Bids. A change shall be so worded as not to reveal the amount of the original bid.
 - 4.4.3 Withdrawn bids may be changed, re-sealed, and resubmitted up to the time designated for the receipt of Bids provided that they are then fully in conformance with these Instructions to Bidders and all of the Bidding Documents and Contract Documents.
 - 4.4.4 Bid Security shall be in an amount sufficient for the Bid as modified or resubmitted.

SECTION 5 CONSIDERATION OF BIDS

- 5.1 RECEIPT OF BIDS
 - 5.1.1 All properly identified Bids received on time will be opened publicly and will be read aloud as specified in the Advertisement for Bids.
 - 5.1.2 Bids without Louisiana Contractor's license numbers on the bid envelopes may be opened and may be read aloud if it is thought that the proposed Project may be under \$50,000.00. Said Bids may be acceptable if the Bids are under \$50,000.00 and they meet all requirements of the Contract Documents.
- 5.2 REJECTION OF BIDS
 - 5.2.1 The Owner will have the right to reject any or all Bids and in particular to reject a Bid not

Instructions to Bidders for New Training Facility

accompanied by a required bid security or data or information required by the Bidding Documents or reject a Bid which is in any way incomplete, irregular, or not in compliance with the Contract Documents.

5.3 ACCEPTANCE OF BID (AWARD)

- 5.3.1 Determination of the low Bidder shall be on the basis of the sum of the Base Bid, and the Alternates accepted by the Owner, (if any).
- 5.3.2 The Owner reserves the right to accept or reject alternates which, in the Owners judgement, is in the Owner's own best interest.
- 5.3.3 If the Owner decides to accept one (1) or more Alternates, (if any), and if accepting certain Alternates determines a low bidder, Alternate(s) will be accepted in numerical order.
- 5.3.4 If the Owner decides to accept one (1) or more Alternates, (if any), and if accepting certain Alternates does not determine a low bidder, Alternate(s) may be accepted out of numerical order.

SECTION 6 POST-BID INFORMATION

6.1 CONTRACTOR'S QUALIFICATION STATEMENT

- 6.1.1 Upon request by the Architect or the Owner, Bidders may be required to submit properly executed AIA Document A 305, Contractor's Qualification Statements. In addition, any bidder may be required, at the discretion of the Owner, to furnish evidence satisfactory to the Owner that his proposed subcontractors have sufficient means and experience in the types of work called for to assure completion of the contract in a satisfactory manner.
- 6.2 At the Pre-Construction Conference, the contractor shall submit the following information to the Architect.
 - 6.2.1 A designation of the work to be performed by the Contractor with his own forces.
 - 6.2.2 A breakdown of the contract cost attributable to each item listed in the Schedule of Values Form (attached). No payments will be made to the Contractor until this is received.
 - 6.2.3 A list of names and business domiciles of all Subcontractors, manufacturers, suppliers or other persons or organizations (including those who are to furnish materials or equipment fabricated to a special design) proposed for the principal portions of the work. It is the preference of the Owner that, to the greatest extent possible or practical, the Contractor utilize Louisiana and St. Tammany Parish Subcontractors, manufacturers, suppliers and labor.

SECTION 7 PERFORMANCE AND PAYMENT BOND & INSURANCE

7.1 BOND REQUIREMENTS

- 7.1.1 The Contractor shall furnish and pay for a performance and payment bond written by a company licensed to do business in Louisiana, and shall be countersigned by a person who is contracted with the surety company or bond issuer as an agent of the company or issuer, and who is licensed as an insurance agent in this state, and who is residing in Louisiana, in an amount equal to the 100% of the Contract amount to guarantee delivery of completed work under contract and payment for labor and materials. These bonds shall be written on A.I.A. Document A312, Current Edition.

Instructions to Bidders for New Training Facility

No company, regardless of size or financial rating, will be allowed to write its own bonds. The Surety Company shall have an A.M. Best Company minimum rating with a minimum financial size in accordance with the General Conditions. Bonds must be accompanied by letter stating bonding company's current rating for verification prior to acceptance by the Owner and execution of the formal Owner/Contractor agreement.

7.2 TIME OF DELIVERY

- 7.2.1 The Bidder shall hand deliver the specified required bond(s) to the Owner prior to the Owner's signing of the Contract. The Bidder shall be responsible for picking up a copy of the Contract from the Architect and delivering same to the bonding agency, securing the required, signed bond(s) and delivering same to the Architect and Owner in a very timely manner.
- 7.2.2 The bond(s) shall be dated on the date of commencement of Work indicated in the Contract.
- 7.2.3 The Bidder shall require the Attorney-in-Fact who executes the required bond(s) on behalf of the surety to affix thereto a certified and current copy of his power of Attorney.
- 7.2.4 Original insurance certificates, signed in ink, indicating amounts of insurance required, Louisiana Workmen's Compensation, and all other specified insurance shall be presented to the Owner with the bond(s). Copies of originals and "faxed" copies of certificates of insurance are not acceptable.
- 7.2.5 No actual physical on-site work shall begin prior to securing specified insurance and bonds.

SECTION 8 FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR

8.1 FORM TO BE USED

- 8.1.1 Unless otherwise specified, the form of the Contract to be used shall be AIA Document A101, Standard Form of Agreement between Owner and Contractor, 2007 Edition where the basis of payment is a Stipulated Sum. The agreement form will be prepared by the Architect for the Owner and issued to the Contractor for execution and returned to the Owner for signature. Executed bonds and insurance certificate must be submitted to the Owner by the Contractor within ten (10) days of the date of the Notice of Award.

8.2 AWARD

- 8.2.1 If awarded, the Contract will be let to the lowest responsible bidder whose base bid is within the project budget and is able to furnish satisfactory surety company bonds. Before award of the Contract, the successful bidder shall furnish to the Owner a certified copy of the minutes of the corporation or partnership meeting which authorized the party executing the bid to sign on behalf of the Contractor. Should all bids exceed the project budget, award will be made at option of the Owner to the lowest responsible bidder whose base bid is within funds available.

SECTION 9 ENVIRONMENTAL CONSIDERATIONS

- 9.1 Inspection and Testing for Asbestos Content of Building Materials:

NOTICE!

Building materials which are scheduled to be incorporated into the work under the agreement shall first either be certified by the Manufacturer to be asbestos free or be inspected and tested by accredited parties and certified to be free of asbestos content in accordance with by EPA, AHERA,

Instructions to Bidders for New Training Facility

and 1982 School Rules.

Materials shall not be incorporated into the work prior to the receipt of either manufacturer certification or accredited laboratory test results indicating the building material is asbestos free. Copies of the test reports shall be furnished to the Owner and the Architect.

The Owner reserves the right to inspect and take samples at random at the job site. Materials containing asbestos shall be removed immediately at the Contractor's expense using current EPA protocol for the removal of asbestos containing materials.

SECTION 10 ADDITIONAL BIDDER INFORMATION

10.1 Bidding Document may be obtained from the Architect:

Firm Name:	St. Tammany Fire Protection District No 1 Headquarters
Contact Name:	Chad Duffaut
Address:	522 Robert Blvd
City, Louisiana Zip Code:	Slidell, La 70458
Phone:	
E-mail:	cduffaut@slidellfire.org

10.1.1 A plan deposit of \$400.00 is required for each set of complete bidding documents requested. No partial sets will be issued.

10.1.2 Deposits on the first set of documents issued to bonafide prime bidders (bidders submitting bids for the entire project on the specified project bid forms) will be fully refunded (100%) upon return of complete bound documents, received by the architect in good condition no later than ten (10) days after the bid date as specified in the Advertisement for Bids. All other sets of documents will be refunded (50%) of the deposit upon return of complete bound documents, received by the architect in good condition no later than ten (10) days after the bid date as specified in the Advertisement for Bids.

SECTION 11 POST-BID SUBMITTAL FORMS

11.1 Only the apparent low bidder is required to submit the following completed forms within ten days after bid opening. These blank forms are included in the project specifications manual.

- Attestation Clause Form
- Verification of Employees Affidavit
- Non-collusion Affidavit

11.2 The Bidder SHOULD NOT include these forms in the bid envelope.

11.3 The apparent low bidder has a maximum of 10 days from the bid opening to produce any required post bid submittal forms. If the apparent low bidder does not submit the proper information or documentation as required by the bidding documents with the ten-day period, such bidder shall be declared non-responsive, which will result in the automatic disqualification of the bid.

END OF INSTRUCTIONS TO BIDDERS

LOUISIANA UNIFORM PUBLIC WORK BID FORM

TO: St. Tammany Fire Protection District No. 1
522 Robert Blvd.
Slidell, Louisiana 70458

BID FOR: St. Tammany Fire Protection District No. 1
New Training Facility
34780 S. Range Road
Slidell, Louisiana 70458

The undersigned bidder hereby declares and represents that she/he; a) has carefully examined and understands the Bidding Documents, b) has not received, relied on, or based his bid on any verbal instructions contrary to the Bidding Documents or any addenda, c) has personally inspected and is familiar with the project site, and hereby proposes to provide all labor, materials, tools, appliances and facilities as required to perform, in a workmanlike manner, all work and services for the construction and completion of the referenced project, all in strict accordance with the Bidding Documents prepared by: Dammon Engineering, Inc. and dated: September 25, 2023

Bidders must acknowledge all addenda. The Bidder acknowledges receipt of the following **ADDENDA:** (Enter the number the Designer has assigned to each of the addenda that the Bidder is acknowledging) _____ .

TOTAL BASE BID: For all work required by the Bidding Documents (including any and all unit prices designated "Base Bid" * but not alternates) the sum of:
_____ Dollars (\$ _____)

ALTERNATES: For any and all work required by the Bidding Documents for Alternates including any and all unit prices designated as alternates in the unit price description.

Alternate No. 1 (Owner to provide description of alternate and state whether add or deduct) for the lump sum of:
N/A _____ Dollars (\$ _____)

Alternate No. 2 (Owner to provide description of alternate and state whether add or deduct) for the lump sum of:
N/A _____ Dollars (\$ _____)

Alternate No. 3 (Owner to provide description of alternate and state whether add or deduct) for the lump sum of:
N/A _____ Dollars (\$ _____)

NAME OF BIDDER: _____

ADDRESS OF BIDDER: _____

LOUISIANA CONTRACTOR'S LICENSE NUMBER: _____

NAME OF AUTHORIZED SIGNATORY OF BIDDER: _____

TITLE OF AUTHORIZED SIGNATORY OF BIDDER: _____

SIGNATURE OF AUTHORIZED SIGNATORY OF BIDDER **: _____

DATE: _____

* The Unit Price Form shall be used if the contract includes unit prices. Otherwise it is not required and need not be included with the form. The number of unit prices that may be included is not limited and additional sheets may be included if needed.

** If someone other than a corporate officer signs for the Bidder/Contractor, a copy of a corporate resolution or other signature authorization shall be required for submission of bid. Failure to include a copy of the appropriate signature authorization, if required, may result in the rejection of the bid unless bidder has complied with La. R.S. 38:2212(B)5.

BID SECURITY in the form of a bid bond, certified check or cashier's check as prescribed by LA RS 38:2218.A is attached to and made a part of this bid.

BID BOND

FOR

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1 – NEW TRAINING FACILITY

Date: _____

KNOW ALL MEN BY THESE PRESENTS:

That _____ of _____, as Principal, and _____, as Surety, are held and firmly bound unto the St. Tammany Fire Protection District No. 1 (Obligee), in the full and just sum of five (5%) percent of the total amount of this proposal, including all alternates, lawful money of the United States, for payment of which sum, well and truly be made, we bind ourselves, our heirs, executors, administrators, successors and assigns, jointly and severally firmly by these presents.

Surety represents that it is listed on the current U. S. Department of the Treasury Financial Management Service list of approved bonding companies as approved for an amount equal to or greater that the amount for which it obligates itself in this instrument or that it is a Louisiana domiciled insurance company with at least an A - rating in the latest printing of the A. M. Best's Key Rating Guide. If surety qualifies by virtue of its Best's listing, the Bond amount may not exceed ten percent of policyholders' surplus as shown in the latest A. M. Best's Key Rating Guide.

Surety further represents that it is licensed to do business in the State of Louisiana and that this Bond is signed by surety's agent or attorney-in-fact. This Bid Bond is accompanied by appropriate power of attorney.

THE CONDITION OF THIS OBLIGATION IS SUCH that, whereas said Principal is herewith submitting its proposal to the Obligee on a Contract for:

NOW, THEREFORE, if the said Contract be awarded to the Principal and the Principal shall, within such time as may be specified, enter into the Contract in writing and give a good and sufficient bond to secure the performance of the terms and conditions of the Contract with surety acceptable to the Obligee, then this obligation shall be void; otherwise this obligation shall become due and payable.

PRINCIPAL (BIDDER)

SURETY

BY: _____
AUTHORIZED OFFICER-OWNER-PARTNER

BY: _____
AGENT OR ATTORNEY-IN-FACT(SEAL)

DOCUMENT 004519
NONCOLLUSION AFFIDAVIT

STATE OF LOUISIANA
ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1

BEFORE ME, the undersigned authority, personally came and appeared _____
_____, who after being by me duly sworn, deposed and said
that he is the fully authorized _____ of

(hereinafter referred to as Bidder) the party who submitted a bid to perform all work for construction of the St. Tammany Fire Protection District No. 1 - New Training Facility, 34780 S. Range Rd Slidell, Louisiana 70460 which Bid was received by St. Tammany Fire Protection District No. 1 (District) on _____ 20 _____ and said affiant further said:

- (1) That Bidder employed no person, corporation, firm, association, or other organization, either directly or indirectly, to secure the public contract under which he received payment, other than persons regularly employed by the Bidder whose services in connection with the construction of the public building or project or in securing the public contract were in the regular course of their duties for Bidder; and
- (2) That no part of the contract price received by Bidder was paid or will be paid to any person, corporation, firm, association, or other organization for soliciting the contract, other than the payment of their normal compensation to persons regularly employed by the Bidder whose services in connection with the construction of the public building or project were in the regular course of their duties for Bidder.
- (3) Said bid is genuine and Bidder has not colluded, conspired or agreed directly or indirectly with any other Bidder to offer sham or collusive bid.
- (4) Said Bidder has not in any manner directly or indirectly agreed with any other person to fix the bid price of affiant or any other Bidder, or to fix any overhead, profit or cost element of said bid price, or that of any other Bidder, or to induce any other person to refrain from bidding.
- (5) Said Bidder is not intended to secure an unfair advantage or benefit from the District or in favor of any person interested in the proposed contract.
- (6) All statements contained in said bid are true and correct.
- (7) Neither affiant nor any member of his company has divulged information regarding said bid or any data relative thereto to any other person, firm or corporation.

SWORN TO AND SUBSCRIBED BEFORE ME _____

THIS _____ DAY OF _____ 20 _____

(Notary Public)

END OF DOCUMENT 004519

DOCUMENT 004543

CORPORATE RESOLUTION

EXCERPT FROM MINUTES OF THE BOARD OF DIRECTORS OF _____, At the meeting of the directors of _____, duly noticed and held on _____ 20_____, a quorum being there present, on motion duly made and seconded. It was:

RESOLVED. That _____, be and is hereby appointed, constituted and designated as agent and attorney-in-fact of the Corporation with full power and authority to act on behalf of this Corporation in all negotiations, bidding, concerns and transactions with St. Tammany Fire Protection District No. 1 or any of its agencies, departments, employees or agents, including but not limited to, the execution of all bids, papers, documents, affidavits, bonds, sureties, contracts and acts and to receive and receipt therefore all purchase orders and notices issued pursuant to the provisions of any such bid or contract, this Corporation hereby ratifying, approving, confirming and accepting each and every such act performed by the said agent and attorney-in-fact.

I hereby certify the foregoing to be a true and correct copy of an excerpt of the minutes of the above dated meeting of the Board of Directors of said Corporation, and the same has not been revoked or rescinded

(Secretary - treasurer)

_____ 20_____
(Date)

(This form or other document which established Evidence of Agency in accordance with LA R.S. 38:2212 et seq. shall be included in Bid Envelope)

END OF DOCUMENT 00420

CONTRACTING REQUIREMENTS

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832

Email: info@dammonengineering.com
Website: www.dammonengineering.com



DOCUMENT 005200

STANDARD FORM OF AGREEMENT BETWEEN OWNER AND CONTRACTOR

- A. Agreement Form: The Agreement Form to be used for this Contract for Construction shall be the latest edition of A.I.A. Document A101, STANDARD FORM OF AGREEMENT BETWEEN OWNER and CONTRACTOR. This document is included in the project by reference.
- B. Upon request to the Architect, copies will be furnished for reference.
- C. Contractor shall provide this document once selected as the general contractor.

END OF DOCUMENT 005200

DOCUMENT 006113

PERFORMANCE AND PAYMENT BOND

- A. Performance Bond: The Performance Bond and Payment Bond Forms to be used for this Contract for Construction shall be A.I.A. Document A312 - PERFORMANCE BOND AND PAYMENT BOND - 2010 Edition. This document is included in the project by reference.
- B. Upon request to the Architect, copies will be furnished for reference.
- C. Contractor shall provide this document once selected as the general contractor.

END OF DOCUMENT 006113

DOCUMENT 007200

GENERAL CONDITIONS

- A. **General Conditions: A.I.A. Document A201, General Conditions of the Contract for Construction – 2007 Edition**, of the American Institute of Architects, are the General Conditions of this Contract and are included in this project by reference.
- B. Copies of this document are available, upon request, for review at the Architect's Office.
- C. Contractor shall provide this document once selected as the general contractor.

END OF DOCUMENT 007200

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1
NEW TRAINING FACILITY
34780 S. RANGE ROAD
SLIDELL LA 70460

DOCUMENT 007300

SUPPLEMENTARY CONDITIONS

These Supplementary Conditions modify, change, delete from, or add to the *General Conditions of the Contract for Construction, AIA Document A201 - 2007 Instructions*.

Where any Article of the General Conditions is modified or any Paragraph, Subparagraph or Clause thereof is modified or deleted by these supplements, the unaltered provisions of that Article, Paragraph, Subparagraph or Clause shall remain in effect.

Articles, Paragraphs, Subparagraphs or Clauses modified or deleted have the same numerical designation as those occurring in the General Conditions.

**ARTICLE 1
GENERAL PROVISIONS**

1.1 DEFINITIONS

1.1.1 THE CONTRACT DOCUMENTS

In Subparagraph 1.1.1 delete the third sentence, and add the following sentence:
The Contract Documents shall include the Bidding Documents as listed in Article 9, of the A101 –2007 Agreement between Owner and Contractor and any modifications made thereto by addenda.

1.1.9 through 1.116 Add the following paragraphs after paragraph 1.1.8:

1.1.9 PROJECT MANUAL

The Project Manual is a volume assembled for the Work that may include bidding requirements, samples forms, Conditions of the Contract, Specifications, Drawings and Addendum issued prior to Bid Opening.

1.1.10 PRODUCT

The term “Product” includes materials, systems and equipment.

1.1.11 PROVIDE

The term “Provide” means the furnishing and installing of a product, complete in place, operating, tested and approved: and includes paying for the cost of all labor, materials, equipment, tools, construction equipment and machinery, permits, water, heat, gas, electricity, utilities, shipping, transportation, taxes and all other facilities and services necessary for the proper execution and completion of the Work, whether temporary or permanent and whether or not incorporated or to be incorporated in the Work.

1.1.12 BUILDING CODE AND CODE

The terms “building code” and “code” refer to regulations of governmental entities having jurisdiction.

1.1.13 “SHOWN,” “INDICATED,” “DETAILED,” “NOTED,” “SCHEDULED”

The terms “shown,” “indicated,” “detailed,” “noted,” “scheduled,” and terms of similar import, refer to requirements contained in the Contract Documents.

1.1.14 “ACCEPTABLE,” “APPROVED,” “REQUIRED,” AND “AS DIRECTED”

The terms “acceptable,” “approved,” “required,” and “as directed” refer to or indicate work or materials that may be acceptable or approved by the Architect, as the Owner’s agent, only to the extent the work or materials conform to the requirements of the Contract Documents and in no way shall be interpreted to imply any responsibility on the part of the Architect concerning the Contractor’s obligations under Paragraphs 3.3, 3.11, 3.12, 4.2, 10.2.

1.1.15 ‘KNOWLEDGE’ AND ‘RECOGNIZED’

The terms “knowledge” and “recognized” , their respective derivatives and similar terms in the Contract Documents as used in reference to the contractor, shall be interpreted to mean that which the Contractor knows, or should know, recognizes, or should recognize, in exercising the care, skill and diligence required by the Contract Documents. Analogously, the expression “reasonably inferable” and similar terms of the Contract Documents shall be interpreted to mean reasonably inferable by a bidding the Project and exercising the care, skill and diligence required of the Contractor by the Contract Documents.

1.1.16 “NIC” AND “NOT IN CONTRACT

The terms “NIC” and “Not in Contract” indicate items which are shown or indicated for convenience but are not included as part of this Contract.

1.2.1 After the last sentence, add the following:

In the event of a discrepancy in the Contract Documents, the more specific and more detailed descriptive information will take precedence over the general and less detailed description. In case of doubt, the Contractor shall assume that the owner intends that the higher quality, more complete method, system, or process is required. Any work, labor, materials or equipment that may reasonably be inferred from the Contract Documents as being required to produce a functionally complete Project or part thereof, will be supplied by the Contractor whether or not specifically stated in the Contract Documents. Reference to standard specifications, manuals, or codes of any technical society, organization, or association or to the laws or regulations of any governmental authority, whether such reference is specific or by implication shall mean the latest standard specifications, manual, code or laws or regulations in effect at the time of the opening of the bids (or the date of the Contract if no advertised bids), unless otherwise specifically stated. However, no provision of any standard specification, manual, or code shall be effective to change the amount of the contract or to change the duties or the responsibilities of the Owner, Contractor or Architect or any of their consultants, agents or employees from those set forth in the Contract Documents.

ARTICLE 2

OWNER

2.1.2 Add the following after the end of the paragraph:

The Owner reserves the right to require the Contractor, all subcontractors and material suppliers to provide lien releases at any time. The Owner reserves the right to withhold progress payments until such lien releases are received for all work for which prior progress payments have been made. Upon the Owner's demand for lien releases (either verbally or written), the Contractor, all subcontractors and material suppliers shall provide such releases with every payment request until Final Acceptance of the Project.

2.2 INFORMATION AND SERVICES REQUIRED OF THE OWNER

2.2.1 Delete this paragraph.

2.2.3. Add at the end of the sentence:

Notwithstanding, the Owner does not guarantee the accuracy of surveys provided regarding the location of utility lines, cables, phone lines, pipes or pipelines or the presence or absence of easements. The Contractor shall confirm the location of each utility and make further investigation of all structural, surface and subsurface conditions of the site of the Project.

2.5 Add 2.5 and 2.6 as follows:

2.5 OWNER'S REPRESENTATIVE

The Architect or Engineer or other professional retained by the Owner to design the Project has the responsibility to administer the Contract for Construction, including observation by himself and his consultants. The assignment of an Owner's Representative in no way transfers any of the professionals of record responsibilities to the Owner.

2.6 OWNERS RIGHT TO AUDIT

The Contractor shall keep full and accurate records of all costs incurred and items invoiced in connection with the Work. These records shall be made available and open to audit by the Owner or its authorized representatives, or the Legislative Auditor for the State of Louisiana during the performance of the Work and for a period of three (3) years after Final Payment.

ARTICLE 3 CONTRACTOR

3.2.1 Add the following at the end of the paragraph:

The Contractor thoroughly understands the Contract Documents and their intent and purpose. The Owner assumes no responsibility or liability for the physical condition or safety of the Project site or any improvements located on the site. The Contractor is solely responsible for providing a safe place for the performance of the Work. Contractor shall comply with the provisions of the Louisiana Underground Utilities and Facilities Damage Prevention law, R.S. 40:1749.11 et al, as amended prior to any portions of the Work that may require excavation including but not limited to pile driving, digging, auguring, boring, backfilling, dredging, compressing, plowing-in, trenching, ditching, tunneling, land leveling, grading and or mechanical probing. Damage to any existing underground utilities by the Contractor shall be repaired at the Contractor's sole expense if surveys or other information that has been provided or is available to the contractor indicate the location of said utilities. The Contractor shall undertake to make such further investigations, and coordinate with the Owner to determine the appropriate course of action. Once the course of action is determined, the owner reserves the right to make the appropriate modifications and back-charge the contractor if immediate action is not taken.

3.2.5 Add the following 3.2.5:

3.2.5 Building materials to be incorporated into the Work shall either be certified, in writing, by the manufacturer to be asbestos free or be inspected and tested by accredited testing laboratories and certified to be free of asbestos content in accordance with applicable federal standards, including but not limited to the Asbestos Hazard Emergency Response Act (AHERA) and the Toxic Substance Control Act (TSCA). The word "asbestos" means the Asbestiform, Tremolite, and Actinolite. Copies of tests reports shall be furnished to the Architect. Material discovered to contain asbestos shall be removed immediately at the Contractor's sole cost and expense using current standards of the Louisiana Department of Environmental Quality (DEQ).

3.3.4 Add the following paragraph:

3.3.4 The Contractor shall take all precautions necessary to prevent loss or damage caused by vandalism, theft, burglary, pilferage or any unexplained disappearance of property of the Owner. The Contractor shall have full responsibility for the security of such property of the owner for any such loss, damage or injury.

3.5 Add the following sentence to the end of the Paragraph:

The Contractor shall warrant and guarantee all material and workmanship for a period of one calendar year from the date of recordation of a certificate of Substantial Completion. This warranty shall be in addition to and not in limitation of any other warranty or remedy provided by law or by the Contract Documents.

3.6 TAXES

At the beginning of the sentence, add: "Unless otherwise provided in the Contract Documents,"

3.7 PERMITS, FEES, NOTICES, AND COMPLIANCE WITH LAWS

Add 3.7.1.1

3.7.1.1 Before any Work begins, or within thirty (30) days from the date the Contract is executed, whichever occurs first, the Contractor, at his own expense, shall record the Contract and Bond or Bonds required with the Clerk of Court for the required parish or county. The Contractor shall furnish the Architect and Owner with a Certificate of Recordation, including date, time, book, and folio number. No payment shall be made until Owner received certificate of recordation.

3.8 SUPERINTENDENT

3.8.1 : Add the following sentence to the end of the paragraph:

“All communications potentially having a bearing on the project schedule, scope or cost shall be documented in writing by the superintendent, and distributed to the Architect. Other communications shall be similarly documented on written request in each case.”

3.9 CONTRACTOR’S CONSTRUCTION SCHEDULES

3.9.1 : Add the following sentence to the end of the paragraph:

The Contractor shall include with the schedule, for the Owner’s and Architect’s information, a network analysis to identify those tasks which are on the critical path to completion. Note where any delay in the completion of these tasks will lengthen the project timescale. A revised schedule showing an updated critical path to completion shall be submitted monthly, with each Application and Certificate for Payment. No payment will be made until this schedule is received.

3.10.3 : Add the following sentence to the end of the paragraph:

If the work is not on schedule, as determined by the Architect, and the Contractor fails to take action to bring the work on schedule, then the Contractor shall be deemed in default under this Contract and the progress of the work shall be deemed unsatisfactory. Such default may be considered grounds for termination by the Owner for cause in accordance with 14.2.

3.10.4 Add the following:

Submittal by the contractor of a schedule or other documentation showing a completion date for his work prior to the completion date stated in the contract shall not impose any obligation or responsibility on the Owner or Architect for the earlier completion date.

3.12.7 Add at the end of the sentence:

Should the Contractor, subcontractor or sub-subcontractor install, construct, erect or perform any portion of the Work without approval of any required submittal, the Contractor shall bear the cost, responsibility and delay for removal, replacement and/or correction of any and all items, materials and/or labor.

3.13 Use of Site, Add the following sections:

3.13.1 The Contractor acknowledges that the Contractor has inspected the site prior to award and accepted the areas for parking, storage and lay-down of materials and access to the site. The Owner will not be required to alter or interrupt any other operations at the Project site.

3.13.2 The Contractor and any entity for which the Contractor is responsible shall not erect any sign on the Project site without the prior written consent of the Owner.

3.13.3 Without the prior written approval of the Owner, the Contractor shall not permit any worker to use any existing facilities (lavatories, toilets, entrances or similar items) at the Project site other than those designated in the Contract Documents.

Add the following Sections:

3.19 LOG OF CHANGES

The Contractor shall maintain a current log of all RFI's, Change Orders and Construction Change Directives at the site of the Project and shall provide the Owner and Architect access to the same as requested. All such logs must be updated and reviewed at monthly project meetings.

3.20 FAILURE TO PERFORM WORK

Contractor shall be liable to the Owner for all cost or damages that the Owner incurs as a result of the Contractor's failure to perform the Work, or any part thereof, in accordance with the Contract Documents. Contractor's failure to perform shall include, but not be limited to, the failure of its subcontractors and/or suppliers of any tier to perform. The Contractor's liability to the Owner shall include, but not be limited to (1) the increased cost of performance, including extended services of the Architect, Owner's Construction Manager and other consultants, resulting from the Contractor's failure to comply with the Contract Documents; (2) costs of corrective or warranty work; (3) liability to third parties; (4) re-procurement costs; (5) attorney fees and related costs, including costs incurred in enforcing Owner's rights under the Contract Documents; and (6) liquidated damages.

3.21 LIENS

In the event a lien is filed by anyone in relation to the Work, the Owner shall have the right (1) to require the Contractor furnish to the Owner a release of a Lien or claim recorded by the person or entity filling the claim; (2) to require the Contractor to discharge the Lien by posting a bond with the Clerk of Court within five (5) calendar days of notice by the Owner to the Contractor; and/or (3) to retain out of any payment due or thereafter to become due an amount sufficient to indemnify the Owner against any Lien or claims of a Lien, including bond premiums and attorney fees and to apply the same in such manner as Owner deems necessary to satisfy such claim and Liens.

In the event such Lien is not discharged, the Contractor at its sole cost and expense, including attorney fees, shall hold harmless and defend Owner of and from any and all claims, lawsuits, causes of actions and demands of any person or entity asserting or claiming any right as a result of any Lien or claim recorded or unrecorded, against the Contract Funds or the Owner's property.

The Owner shall have the right to terminate the Contract for default or to bond off said Lien (s) all costs incurred as a result thereof, including but not limited to, bond premiums and attorney fees.

Prior to the receipt of partial or Final Payment, as appropriate, Contractor shall provide the Owner a partial or final release of any liens or claims and a partial or final release of all Liens and claims of all persons furnishing labor and/or materials to the Work with satisfactory evidence that there are no other Liens or claims whatsoever outstanding against the Work or Contract.

3.22 WORK RELATED TO EXISTING FACILITIES

3.22.1 The Contractor shall not perform Work in existing buildings that will interfere with

normal operations, normal traffic flow, produce excessive noise or shut down utilities without forty-eight (48) hours written notice to the Owner and then only with their concurrence.

3.22.2 All means of egress shall be maintained at all times during school occupancy to comply with exit requirements in the NFPA 101 Life Safety Code.

3.22.3 The Contractor shall not allow traffic or operations to encumber vehicle or pedestrian traffic during occupied hours to include before school and after school programs. Space for parking of Contractor's personnel and subcontractors is designated in the Contract Documents.

ARTICLE 4 ARCHITECT

4.1 GENERAL

Delete Subparagraph 4.1.1 and substitute the following:

4.1.1 The term Architect, when used in the Contract Documents, shall mean the prime Designer (Architect, Engineer or Landscape Architect), or his authorized representative, lawfully licensed to practice architecture, engineering or landscape architecture in the State of Louisiana, identified as such in the Agreement and is referred to throughout the Contract Documents as if singular in number. Where the term "Initial Decision Maker" (IDM) is used in the Contract Documents, the Architect is the Initial Decision Maker.

4.2 ADMINISTRATION OF THE CONTRACT

4.2.1 In the first sentence, delete the phrase "the date the Architect issues the final Certificate for Payment" and replace with the phrase "*expiration of (1) one year correction period.*"

4.2.10 Delete the second sentence of this paragraph.

ARTICLE 5 SUBCONTRACTORS

5.2 AWARD OF SUBCONTRACTS AND OTHER CONTRACTS FOR PORTIONS OF THE WORK

Delete Subparagraph 5.2.1, and substitute the following:

5.2.1 Unless otherwise required by the Contract Documents, the Contractor shall furnish at the Pre-Construction Conference, to the Owner and the Architect, the following prior to commencement of any work: No Contractor payments shall be made until this information is received in detail.

- a) Fixed job site overhead cost itemized with documentation to support daily rates.
- b) A written list of the names of the Persons or entities (including those who are to furnish materials or equipment fabricated to a special design), proposed for each of the principal portions of the Work.
- c) Labor Burden by trade for both Subcontractors and General Contractor.
- d) Internal Rate Charges for all significant company owned equipment.
- e) Preliminary Schedule for Architect and Owner review. It is imperative that the schedule includes a critical path to completion. This Schedule shall be due within 14 calendar days following award of the contract.

f) Contact list for General Contractor to include Project Manager and Superintendent.

5.2.4 Add the following: The Contractor shall notify the Architect and Owner of any change or substitution of any Subcontractor, and the owner reserves the right to make objections prior to commencement of work.

ARTICLE 7 CHANGES IN THE WORK

7.1 GENERAL

7.1.3 Add the following sentence at the end of the paragraph:

Contractor shall not proceed without executed/signed Change Order or other written authorization by the Owner.

7.2 CHANGE ORDERS

Add new : 7.2.1.4 Any and all adjustments to the Contract Time requested or claimed by the Contractor as a result of a Change Order shall require the following written documentation and justification:

- a) The Contractor's most recent schedule in use prior to the change.
- b) A revised schedule indicating how the Change affects the Critical Path.
- c) Changes that affect or concern activities containing float or slack time (i.e. not on critical path) that can be accomplished within such float or slack time shall not result in an increase in the Contract Time.

Add the following new paragraphs:

7.2.2 Before a Change Order is prepared, the Contractor shall provide and deliver to the Architect the following information, not subject to waiver, within ten days after being notified to prepare said Change Order:

1. An itemized list of material and labor cost for each Subcontractor's and/or Sub-subcontractor's Work, including quantities and unit prices for each item of material.
2. An itemized list of material and labor cost for the General Contractor's Work, including quantities and unit prices for each item of labor and each item of material.
3. An updated project schedule clearly showing the impact the proposed change might have on the critical path to completion.

7.2.3 After a Change Order has been approved, no future request for extension/adjustments of Contract Time, Sum or cost shall be considered for that particular Change Order

7.2.4 The Architect will prepare a draft of the proposed Change Order. If all parties are in agreement to the scope of work changes and the Change Order is signed within 14 days of the original issuance, it shall be made part of the Contract Documents. If agreement is not reached within that time frame, the Owner reserves the right to instruct the Architect to issue a Change Directive, which will be administered per section 7.3.

7.3 CONSTRUCTION CHANGE DIRECTIVES

7.3.7 Delete the following phrase from the end of the first sentence: “the Agreement, or if no such amount is set forth in the Agreement, a reasonable amount.” Replace with the following phrase: “section 7.3.7.6 found below.”

7.3.7 Delete the following from .1 of the list: “fringe benefits required by agreement or custom,”

Add : 7.3.7.6 Portions of profit and overhead listed above that will be included in the Change Order, shall not exceed the following:

1. For the Contractor for work that is performed with its own forces, not to exceed 15% of the cost of the items listed above.
2. For the Contractor for work performed by his Subcontractor, 5% of the amount due the Subcontractor.
3. For each Subcontractor, or Subcontractor involved, for work performed by that Subcontractor’s of Subcontractor’s own forces, 15%.
4. For each Subcontractor, for work performed by the Subcontractor’s Subcontractors, 5% of the amount due to the Subcontractor.
5. In order to facilitate checking of quotations for extras or credits, all proposals shall be accompanied by a complete itemization of costs including labor, materials, and subcontractors. Labor and materials shall be itemized in the manner specified above. Where major cost items are Subcontractor’s cost items, they shall be itemized also.

Add 7.3.11 and 7.3.12

7.3.11 Changes in the Work performed by the Contractor without approval or consent of the Owner shall be performed at no cost to the Owner and without adjustment in the Contract Time.

7.3.12 By executing the Change Order, the Contractor acknowledges that:

1. The Owner bears no responsibility for the conditions resulting in the change to the scope of work.
2. The Change Order is for the full and final amount of the Contract Sum and the Contract Time adjustments due the Contractor for all additional Work related to the Change Order.
3. Any stated extension of Contract Time is equitable in nature and the Contractor waives any further claims for any additional Contract Time or any Contract Sum for whatever reason and of whatever kind, whether direct or indirect costs, profit, overhead or any other expenses for the work, enumerated in the Change Order and any and all claims for an extension of Contract Time or additional Contract Sum are waived in their entirety.

ARTICLE 8 TIME

8.2 PROGRESS AND COMPLETION

Add the following paragraphs to Subparagraph 8.2.1:

Completion of the work must be within the Time for Completion stated in the Agreement, subject to such extensions as may be granted under Section 8.3. The Contractor agrees to commence work not later than fourteen (14) days after the transmittal date of Written Notice to Proceed from the Owner and to substantially complete the project within the time stated in the Contract. The owner shall be entitled to the sum stated in the Contract Documents. Such Liquidated Damages shall be withheld by the owner from the amounts due the Contractor for progress payments.

8.3 DELAYS AND EXTENSIONS OF TIME

8.3.1 In the first sentence after the words "owner pending" delete the words "mediation and arbitration" and replace with the word "litigation". Delete the last word "determine" through the end of the sentence and substitute the following:

"...recommend, subject to Owner's approval of Change Order. If the claim is not made within the limits of Article 15, all right for future claims for that month are waived."

To the end of paragraph 8.3.1, add: "In any instance, the Contractor will be required to submit an updated project schedule, clearly showing the impact on the critical path to completion. In no instance will additional time be granted if the critical path to completion is not impacted."

Add 8.3.4 and 8.3.5

8.3.4 The Owner's operations will be impacted and delayed if the project is not substantially complete within the time set forth in the Contract Documents. The Contractor and the Contractor's surety shall be liable for and shall pay to the Owner the sum stated in the Contract Documents as fixed and agreed liquidated damages for each consecutive calendar day (Saturday's, Sunday's and holidays included), of delay until the Work is substantially complete or, as applicable until the Work is finally complete or the Punch List is complete (whichever occurs last). The Owner shall be paid the sum stated in the Contract Documents for liquidated damages.

Such liquidated damages shall be withheld by the Owner from the amounts due the Contractor for progress payments and deducted from the Contract Sum by a Construction Change Directive signed only by the Owner and Architect. If no funds are remaining, the Contractor shall pay the amount of liquidated damages within 15 days of written notification of the amount due.

8.3.5 If at any time the Work lags, sufficient increased Work forces and overtime hours, including weekends shall be provided by the Contractor to maintain the schedule to insure that the Project is completed in accordance with the time set forth by the Contract Documents. Said overtime and cost of additional Work forces shall be paid for by the Contractor.

ARTICLE 9 PAYMENTS AND COMPLETION

9.2 SCHEDULE OF VALUES

Delete Subparagraph 9.2 and substitute the following 9.2 and 9.2.1:

9.2 At the Pre-Construction Meeting, the Contractor shall submit to the Architect and Owner a Schedule of Values allocated to the various portions of the Work, providing a detailed breakdown of the Contract Sum. The Contractor shall also submit such data to support and substantiate the accuracy of the schedule as the Architect and the Owner may require. The contents of the Project Manual shall be used as a basis for format for listing cost of Work.

9.2.1 The schedule of values shall be submitted on AIA Documents G 703 – 1992, Continuation Sheet, submitted in detail.

1. Use the Index of the Project Manual to list the description of Work required under column B of G 703. List costs of Work for each Division of the Specifications. The cost for each division shall include labor, materials, to be shown separately.
2. Under the General Conditions and Division 1, costs of Work of General conditions, Supplementary Conditions, Temporary Requirements, and Cleaning shall be listed separately with separate cost indicated for Insurance, Bonds, Temporary requirements, and Cleaning, listed separately thereafter and shall be paid for monthly, spread out during the entire period of the Contract. Large sums requested by the Contractor in an early part of the Contract, for items listed in this Paragraph, shall be submitted with invoices, marked paid, showing that these bills have been paid. Up-front unidentified cost of Work shall not be arbitrarily lumped under the General Conditions and Division 1.
3. Round off cost figures of each heading to the nearest dollar. The total of all items shall equal the total Contract Sum.
4. For a multiple site or location Contract, the Schedule of Values shall be allocated for each separate site or location.

9.3 APPLICATIONS FOR PAYMENT

Delete Subparagraph 9.3.1 substitute the following:

9.3.1 Monthly, the Contractor shall submit to the Architect an Application & Certificate for Payment on the AIA Document G702-1992, accompanied by AIA Document G703-1992, a Current Schedule, a notarized Contractor's Waiver and Release of Liens to Owner and supported by any additional data substantiating the Contractor's right to payment as the Owner or the Architect may require.

Change Orders and Construction Change Directives shall be individually identified as a separate item in any application for payment.

A Draft application for payment is to be provided and reviewed by the Architect and Owner at the Monthly Progress Meeting. The Final Monthly Application for Payment shall be submitted following the monthly meeting for the value of labor and materials incorporated into the work and of materials, suitably stored, at the site as of the twenty-fifth day of the preceding month, less normal retainage as follows, per R.S.38:2248:

- A) Projects with Contract price up to \$500,000.00 - 10% of the Contract price.
- B) Projects with Contract price of \$500,000.00, or more - 5% of the Contract price.
- C) No payment will be made until the revised schedule required by 3.10.1 is received.
- D) The normal retainage shall not be due and payable to the Contractor until after substantial completion and expiration of the forty-five day lien period and submission by the Contractor to the Architect of a clear lien certificate and invoice for retainage."

9.5.1 add 9.5.1.8 and 9.5.1.9 as follows:

9.5.1.8 the value of the Punch List:

9.5.1.9 or rejection of any part of the Work by any governmental authority having jurisdiction over the Project.

9.6 PROGRESS PAYMENTS

9.6.2 Delete the phrase: “no later than seven days” from the first sentence.

After the end of the second sentence, add the following:

"R.S. 9:2784 (A) and (C) requires a Contractor or Subcontractor to make payment due to each Subcontractor and supplier within fourteen (14) consecutive days of the receipt of payment from the Owner. If not paid, a penalty in the amount of 1/2 of 1% per day is due, up to a maximum of 15%, from the expiration date until paid. The contractor or subcontractor, whichever is applicable, is solely responsible for payment of a penalty."

9.6.4 Add the following to the end of the Subparagraph:

Pursuant to La. R.S. 38:2242, when the Owner receives any claim of nonpayment arising out of the Contract, the owner shall deduct 125% of such claim from the Contract Sum. The Contractor, or any interested party, may deposit security, in accordance with La. R.S. 38:2242.2, guaranteeing payment of the claim with the recorder of mortgages of the parish where the Work has been done. When the Owner receives original proof of such guarantee from the recorder of mortgages, the claim deduction will be added back to the Contract Sum.

9.7 FAILURE OF PAYMENT

Delete Subparagraph 9.7.

9.8 SUBSTANTIAL COMPLETION: Delete this entire section and substitute the following:

9.8 SUBSTANTIAL COMPLETION

9.8.1 Substantial Completion is the stage in the progress of the Work when the Work is sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work for its intended use and when all required occupancy permits, if any, have been issued and copies of the same delivered to the Owner.

The Architect shall determine if the Project is substantially complete in accordance with the Contract Documents.

9.8.2 When the Contractor considers that the Work, or a portion thereof which the Owner agrees to accept separately, is substantially complete, the Contractor shall prepare and submit to the Architect a comprehensive list of items to be completed or corrected prior to final payment and request the Architect's review. Failure to include an item on such list does not alter the responsibility of the Contractor to complete all Work in accordance with the Contract Documents.

9.8.3 The Work will not be considered suitable for Substantial Completion review until a) all Project systems included in the Work are operational as designed; b) designated instruction of the Owner's personnel in the operations systems has been completed; and c) all finishes within the Contract Documents are in place.

In general, the only remaining Work shall be minor in nature, so that the Owner may occupy the building on a certain date and the completion of the Work by the Contractor will not materially interfere or hamper the normal business operations of the Owner. A further prerequisite to the Work being accepted as Substantially Complete, is the Owner's receipt of the Roofing Manufacturer's warranties, where roof Work is a part of the Contract, and all other Required Warranties and Operating and Maintenance manuals

9.8.4 Upon receipt of the request for review and Contractor's list, the Architect will make an inspection to determine whether the Work or designated portion thereof is substantially complete. The Contractor shall also notify the Architect when the Project is ready for inspection by the State Fire Marshall's Office. The Contractor and his mechanical, electrical and fire alarm/fire suppressive Subcontractors shall attend all inspections for Substantial Completion and inspections for occupancy conducted by the Louisiana State Fire Marshal, and other local officials.

If the Architect's inspection discloses any item, whether or not included on the Contractor's list, which is **not** sufficiently complete in accordance with the Contract Documents so that the Owner can occupy or utilize the Work or designated portion thereof for its intended use, the Contractor shall, before issuance of the Certificate of Substantial Completion, complete or correct such items upon notification by the Architect. In such case, the contractor shall then submit a request for another inspection by the Architect to determine Substantial Completion. The Architect will make only two (2) such inspections to determine Substantial Completion, after which the Contractor shall pay the Architect at the rate established in the Owner-Architect Agreement.

9.8.5 In addition to the inspection described in 9.8.4, upon receipt of the Contractor's list described in 9.8.2, the Architect shall prepare a "Punch List" of exceptions and the dollar value of each item. The monetary value assigned to this list will be **twice** of the estimated actual value of the items to be completed or corrected. Cost of these items shall be prepared in the same format as the schedule of values. No funds assigned for the Punch List value shall be due the Contractor until all the Punch list items are completed and accepted by the Architect.

If the dollar value of the Punch List exceeds the remaining Contract Sum less the retainage amount, then the Project shall not be accepted as substantially complete.

As a further condition of obtaining certification of Substantial Completion, the Contractor shall certify that all remaining Work will be completed within Forty Five (45) consecutive calendar days following the date of Substantial Completion, or as otherwise agreed upon.

If the remaining funds are less than that required to complete the Work, the Contractor shall pay the difference within 10 calendar days of notice thereof.

9.8.6 When the Work or designated portion thereof is substantially complete as determined by the Architect, the Architect will prepare a Certificate of Completion that 1) shall establish the date of Substantial Completion, 2) shall establish responsibilities of the Owner and Contractor for security, maintenance, heat, utilities, damage to the Work, and insurance, and 3) shall fix the 'punch list period' of forty-five (45) calendar days or such other agreed upon period within which the Contractor shall finish all items on the Punch List accompanying the Certificate.

Warranties required by the Contract Documents shall commence on the date of Substantial Completion of the Work or designated portion thereof unless otherwise provided in the Certificate of Substantial Completion.

9.8.7 The Certificate of Substantial Completion shall be submitted to the Owner and the Contractor for their written acceptance of responsibilities assigned to them in such Certificate.

Upon receipt of a fully executed Certificate of Substantial Completion with an attached Punch List, the Contractor shall record the Certificate of Substantial Completion, within 72 hours of issuance with the Clerk of Court in the Parish of Ascension, Louisiana and provide the recording information to the Owner and Architect.

9.9.1 Delete section 9.9.1 and substitute the following:

Partial Occupancy is that stage in the progress of the Work when a designated portion of the Work is sufficiently complete in accordance with the Contract Documents so the Owner can occupy or utilize the designated portion of the Work for its intended use. The Owner may occupy or use any substantially completed portion of the Work so designated by separate agreement with the Contractor and authorized by public authorities having jurisdiction over the Work. Such occupancy or use may commence provided the Owner and Contractor have accepted in writing the responsibilities assigned to each of them for payments, if any, security, maintenance, heat, utilities, damage to the Work and insurance, and have agreed in writing concerning the period for correction of the Work and commencement of warranties required by the Contract Documents. When the Contractor considers the designated portion substantially complete the Contractor shall prepare and submit a list to the Architect as provided under Subparagraph 9.8.2. Consent of the Contractor to partial occupancy or use shall not be unreasonably withheld.

9.10 FINAL COMPLETION AND FINAL PAYMENT

9.10.1 After the first sentence, add the following:

If the Architect does not find the work acceptable under the Contract Documents, the Architect shall make one additional inspection. If the work is still not acceptable, the Architect, and each of the Architect's principal consultants, shall be paid at the rate established in the Owner-Architect Agreement, for their time at the project site for each additional inspection, to be withheld from the unpaid funds remaining in the Contract sum. The payment shall be made by the owner and deducted from the construction contract funds, or if no funds remain, paid directly by the Contractor or its surety.

9.10.2 Add the following to the end of the first sentence: (6) Neither the final payment nor any part of the retained percentage shall become due to the Contractor, until the Contractor delivers to the Owner a Certificate by the Clerk of Court of the Parish that the Owner's

Substantial Completion Certificate has been recorded, more than 45 days has elapsed since the recordation, no liens have been recorded affecting this property, and all affidavits, consents and releases specified in these General Conditions.”

9.10.2 Add this sentence at the end of the paragraph:

Upon receipt by the Architect of all Project close-out documents and a recommendation for acceptance of final completion, a close-out meeting will be scheduled by the Architect and Owner with the Contractor for the review and acceptance of all of the above identified items. Provided all items are complete and accepted by the Owner, the Owner will then authorize the issuance of the Final Payment.

9.11 LIQUIDATED DAMAGES

ADD 9.11 To the extent that such are due, owing, and payable to the Owner pursuant to the terms of the Contract, the Contractor and the Contractor’s Surety agree and shall be liable for and pay to the Owner the sum stipulated in the Contract Documents as liquidated damages, which are to start on the first day after the final date of the contract and continue until the date of Substantial Completion, as issued by the Architect. Any liquidated damages shall be deducted from the remaining Contract Funds by a Construction Change Directive signed only by the Architect and Owner, or if no funds remain, to be paid by the Contractor or the Contractor’s Surety.

In addition, if the “punch list” items are not complete before the end of the 45 day ‘punch list’ period, the contractor will be charged additional liquidated damages in an amount equal to half of the stipulated liquidated damages indicated in the Instructions to Bidders for this project. The Contractor shall also pay the expenses of the Architect as provided hereafter and the Owner may hold the Contractor in default. If the Owner finds the Contractor is in default, the Surety shall be notified. If within thirty (30) days after notification, the Surety has not completed the Punch List, the Owner may, at its option, contract to have the balance of the Work completed and pay for such Work with unpaid funds remaining in the Contract Sum. Finding the Contractor in default shall constitute a reason for disqualification of the Contractor from bidding on future contracts with the owner. If the Surety fails to complete the Punch List within the stipulated time period, the Owner may not accept bonds submitted from the company in the future.

ARTICLE 10 PROTECTION OF PERSONS AND PROPERTY

10.2 SAFETY OF PERSONS AND PROPERTY

10.2.1 Add the following sub-sections:

.4 the indoor air quality of buildings where employees and visitors occupy the areas adjacent to or near the work on the Project site;

.5 the exhaust systems and existing fresh air intake devices to prevent dust or fumes caused by the Work entering such systems; and

.6 the Contractor expressly agrees that it is exclusively responsible for compliance with the Occupational Safety and Health Act (OSHA) and state and local regulations for the

construction in that it is the “employer” within the meaning of those regulations. It is the expressed intent of the parties that the Contractor, not the Architect, nor the Owner are in charge of the Work. Any provision in the Contract Documents in conflict with this paragraph shall not be null and void.

10.2.2 In the first sentence, between the words "bearing on" and "safety", add the words "the health and".

After the last sentence, add the following:

Contractor shall provide for the marking of all underground utilities prior to any digging, excavation or other disturbance of earth and provide the Louisiana One Call reference number to the Architect and Owner.

10.2.9. SECURITY OF SITE

Contractor shall immediately make an oral report to the Architect and the Owner and promptly provide a written report to the Architect and Owner, about all accidents arising out of or in connection with the Work that cause death, injury, interrupts utility services or property damage.

10.3 HAZARDOUS MATERIALS

10.3.1 In the second sentence after "(PCB)" add "or lead"

After the last sentence, add the following:

Mold is not considered to be hazardous for the purposes of this Section; however, the Contractor shall notify the Owner and the Architect, in writing, of the presence of any suspected black mold on building components in any affected area of the Project.

10.3.2 After the first sentence, delete all remaining sentences. Add at the end "When the material or substance has been rendered harmless, Work in the affected area shall resume upon written agreement of the Owner and Contractor. If appropriate, by Change Order or Change Directive, the Contract Time may be extended accordingly and the Contract Sum may be adjusted to allow for the Contractor’s reasonable costs of shut-down, delay and start-up."

10.3.3 Delete Subparagraph 10.3.3.

10.4 EMERGENCIES

Delete Subparagraph 10.4 and substitute the following:

10.4 In an emergency affecting the safety of persons or property, the Contractor shall notify the Owner and Architect immediately of the emergency, simultaneously acting at his discretion to prevent damage, injury, or loss. Any additional compensation or extension of time claimed by the Contractor on account of emergency work shall be determined as provided in Article 15 and Article 7.

ARTICLE 11 INSURANCE AND BONDS

Add the following sentence to the end of 11.1.2: All policies and certificates of insurance of the Contractor/Subcontractor shall contain the following clauses:

11.1.2.1 The Contractor/Subcontractor's insurer will have no right of recovery or subrogation against the Owner, it being the intention of the parties that the insurance policies so affected shall protect both parties and the primary coverage for any and all losses covered by the below described insurance.

11.1.2.2 The Owner shall be named as an additional insured as regards negligence by the contractor (ISO Forms CG 20 10, Current form approved for use in Louisiana).

11.1.2.3 The insurance companies issuing the policy or policies shall have no direct recourse against the Owner for payment of any premiums or for assessments under any form of policy.

11.1.2.4 Any and all deductibles in the below described insurance policies shall be assumed by and be at the sole risk of the Contractor or Subcontractor.

Add the following behind section **11.1.3**:

The Contractor/Subcontractor, prior to commencing work, shall provide at his own expense, proof of the following insurance coverages required by the contract to the Owner in insurance companies authorized in the State of Louisiana. Operations to be performed by contract to be shown on the Certificate. Insurance is to be placed with insurers with an A. M. Best's rating of no less than "A" or above or be a qualified self-insured with "A" rated reinsurance; preference will be given to admitted (LIGA) insurers. This rating requirement will be waived for the workers' compensation coverage.

Thirty days prior notice of cancellation shall be given to the Owner by registered mail, return receipt requested, on all of the required coverage provided to the Owner. Ten day notice shall be required for cancellation due to non-payment. All notices will name the Contractor/ Subcontractor and identify the contract number.

Insurance coverage specified in the GENERAL CONDITIONS (AIA Document A201, 2007 Edition) to be provided by the Contractor, and any other insurance described below shall be furnished with the following minimum limits:

11.1.3.1 Workers' Compensation : \$1,000,000 limit required.

11.1.3.2 Commercial General Liability Insurance with a combined single limit per occurrence for bodily injury and property damage. This insurance shall include coverage for bodily injury and property damage, and indicate on the Certificate of Insurance which of the seven (7) coverages required below is not included in the policy, if any:

- 1 Premises - Operations;
- 2 Broad Form Contractual Liability;
- 3 Products and Completed Operations;
- 4 Use of Contractors and Subcontractors;
- 5 Personal Injury;
- 6 Broad Form Property Damage;
- 7 Explosion, Collapse and Underground (XCU) Coverage.

NOTE: On the certification of insurance, under the description of operations, the following wording is required: THE AGGREGATE LOSS LIMIT APPLIES TO EACH PROJECT, or a copy of ISO form CG2503 (Current form approved for use in Louisiana) shall be submitted.

Note: the Products and Completed Operations shall not have a sunset clause.

COMBINED SINGLE LIMIT (CSL) - AMOUNT OF INSURANCE REQUIRED

Type of Construction	Projects under \$1,000,000	Projects Over \$1,000,000
----------------------	----------------------------	---------------------------

New Buildings/Renovations:

-Each Occurrence/ Minimum Limit	\$1,000,000	\$3,000,000
-Aggregate (Applicable to this Contract ONLY)	\$2,000,000	\$6,000,000

Renovations: *The building(s) value for this Project will be identified in the Contract documents.*

11.1.3.3 Business Automobile Liability Insurance with a combined single limit of \$1,000,000 per occurrence for bodily injury and property damage, unless otherwise indicated. This insurance shall include for bodily injury and property damage the following coverages:

- 1 Owned automobiles;
- 2 Hired automobiles;
- 3 Non-owned automobiles.

11.1.3.4 An Umbrella Policy may be used to meet minimum requirements.

11.1.4 INSURANCE REQUIREMENTS FOR CONTRACTORS

Contractor shall procure and maintain for the duration of the contract insurance against claims for injuries to persons or damages to property which may arise from or in connection with the performance of the work hereunder by the Contractor, his agents, representatives, employees or subcontractors. It is the Contractor's responsibility to assure that all coverages required in this contract are obtained and maintained through the completion of the project. This also includes extended coverages for periods beyond the contract terms when appropriate. The cost of such insurance shall be included in the Contractor's bid.

11.1.4.1 MINIMUM SCOPE OF INSURANCE

Coverage shall be at least as broad as:

11.1.4.1.1 Insurance Services Office Commercial General Liability coverage ("occurrence") form CG 0001. (Current form approved for use in Louisiana.) "Claims Made" form is unacceptable. The "occurrence form" shall not have a "sunset clause".

11.1.4.1.2 Insurance Services Office form number CA 0001 (Current form approved for use in Louisiana.) covering Automobile Liability. The policy shall provide coverage for owned, hired, and non-owned coverage. If an automobile is to be utilized in the execution of this contract, and the vendor/contractor does not own a vehicle, then proof of hired and non-owned coverage is sufficient.

11.1.4.1.3 Workers' Compensation insurance as required by the Labor Code of the State of Louisiana, including Employers Liability insurance.

11.1.4.2 MINIMUM LIMITS OF INSURANCE

Contractor shall maintain limits no less than that provided in the previous subsections.

11.1.4.3 DEDUCTIBLES AND SELF-INSURED RETENTIONS

Any deductibles or self-insured retentions must be declared to and approved by the Owner. At the option of the Owner, either: the insurer shall reduce or eliminate such deductibles or self-insured retentions as respects the Owner, its officers, officials, employees and volunteers; or the Contractor shall procure a bond guaranteeing payment of losses and related investigations, claim administration and defense expenses.

11.1.4.4 OTHER INSURANCE PROVISIONS

The policies are to contain, or be endorsed to contain, the following provisions:

11.1.4.4.1 General Liability and Automobile Liability Coverages

11.1.4.4.1.1 The Owner, its officers, officials, employees, Boards and Commissions and volunteers are to be added as "additional insureds" as respects liability arising out of activities performed by or on behalf of the Contractor; products and completed operations of the Contractor, premises owned, occupied or used by the Contractor. The coverage shall contain no special limitations on the scope of protection afforded to the Owner, its officers, officials, employees or volunteers. It is understood that the business auto policy under "Who is an Insured" automatically provides liability coverage in favor of the owner.

11.1.4.4.1.2 Any failure to comply with reporting provisions of the policy shall not affect coverage provided to the Owner, its officers, officials, employees, or volunteers.

11.1.4.4.1.3 The Contractor's insurance shall apply separately to each insured against whom claim is made or suit is brought, except with respect to the limits of the insurer's liability.

11.1.4.4.2 All Coverages

Each insurance policy required by this clause shall be endorsed to state that coverage shall not be suspended, voided, canceled by either party, reduced in coverage or in limits except after thirty (30) days' prior written notice by certified mail, return receipt requested, has been given to the Owner.

11.1.4.5 VERIFICATION OF COVERAGE

Contractor shall furnish the Owner with certificates of insurance effecting coverage required. The certificates for each insurance policy are to be signed by a person authorized by that insurer to bind coverage on its behalf.

The certificates are to be received and reviewed by the Owner before work commences. The

Owner reserves the right to require complete, certified copies of all required insurance policies, at any time.

Delete section 11.2 – Owner’s Liability Insurance

Delete section 11.3 (and all sub-sections 11.3.1 through 11.3.10) – Property Insurance, and replace entire section with the following:

11.3.1 The Contractor shall purchase and maintain property insurance upon the entire work included in the contract for an amount equal to the greater of the full-completed value or the amount of the construction contract including any amendments thereto .
The general contractor’s policy shall provide “ALL RISK” Builder’s Risk insurance (extended to include the perils of wind, collapse, vandalism/malicious mischief, and theft, including theft of materials whether or not attached to any structure.) The “All Risk” Builder’s Risk Insurance must also cover architects’ and engineers’ fees that may be necessary to provide plans and specifications and supervision of work for the repair and/or replacement of property damage caused by a covered peril not to exceed 10% of the cost of those repair and/or replacements. The policy must include the interest of the Owner, Contractor and Subcontractors. All property losses shall be made payable to and adjusted with the Owner.

11.3.2 All policies of insurance shall be approved by the Owner and Owner Insurance advisor prior to the inception of any work.

11.3.3 Other insurance required is as follows:

11.3.3.1 Owner's Protective Liability Insurance shall be furnished by the Contractor and naming the Owner as the Insured.

	Projects Under	Projects Over
	\$1,000,000	\$1,000,000
CSL - Each Occurrence	\$1,000,000	\$3,000,000

11.3.3.2 Asbestos Abatement Liability-(required when asbestos abatement is included in the work) The contractor or subcontractor who will be doing the asbestos abatement as outlined in this contract shall obtain and maintain such liability coverage for the asbestos abatement hazard and exposure with minimum limits of \$1,000,000 per occurrence for the duration of the project. The policy shall name the State of Louisiana, all State departments, agencies, boards and commissions as an additional insured for the project. The policy shall be written on an "occurrence" form without a sunset clause. Claims-made coverage is unacceptable. The insurance company shall have an A.M. Best rating of at least A-:VI or better. (pertains to this section only)

11.3.3.3 If, at any time, any of the said policies shall be or become unsatisfactory to the Owner, as to form or substance, or if a company issuing any such policy shall be or become unsatisfactory to the Owner, the Contractor/Subcontractor shall promptly obtain a new policy, submit the same to the Owner for approval and submit a certificate thereof as hereinabove provided.

Upon failure of the Contractor/Subcontractor to furnish, deliver and maintain such insurance as above provided, this contract, at the election of the Owner, may be forthwith declared

suspended, discontinued or terminated.

Failure of the Contractor/Subcontractor to take out and/or to maintain or the taking out and/or maintenance of any required insurance, shall not relieve the Contractor/Subcontractor from any liability under the contract, nor shall the insurance requirements be construed to conflict with the obligations of the Contractor/Subcontractor concerning indemnification.

The Owner reserves the right to require complete, certified copies of all required insurance policies, at any time.

11.3.4 RISKS AND INDEMNIFICATIONS ASSUMED BY THE CONTRACTOR Neither the acceptance of the completed work nor payment therefore shall release the Contractor/Subcontractor from his obligations from the insurance requirements or indemnification agreement.

11.3.4.1 Additional insurance may be required on an individual basis for extra hazardous contracts and specific service agreements.
If such additional insurance is required for a specific contract, that requirement will be described in the "Special Conditions" of the contract specifications.

11.3.4.2 If any of the Property and Casualty insurance requirements are not complied with at their renewal dates, payments to the Contractor/Subcontractor will be withheld until those requirements have been met, or at the option of the Owner, the Owner may pay the Renewal Premium and withhold such payments from any monies due the Contractor/Subcontractor.

11.3.5 SUBCONTRACTORS

Contractor shall include all subcontractors as insureds under its policies or shall furnish separate certificates from each subcontractor. All coverages for subcontractors shall be subject to all of the requirements stated herein.

11.3.6 CERTIFICATE OF INSURANCE

Contractor shall furnish the Owner with certificates of insurance affecting coverage required by this clause. The certificates for each insurance policy are to be signed by a person authorized by that insurer to bind coverage on its behalf. The certificates of insurance must also contain the following in the "Description of Operations" section:

The certificates are to be provided to the Owner within 15 days of the award of the contract and prior to the signing of the contract.

The Owner reserves the right to require complete, certified copies of all required insurance policies, at any time.

11.4 PERFORMANCE AND PAYMENT BOND

11.4.1 Delete the phrase, "The Owner shall have the right to require the Contractor to" and replace with the phrase, "The Contractor shall".

Add the following Subparagraph **11.4.3**:

11.4.3 RECORDATION OF CONTRACT AND BOND [38:2241A(2)]

Within thirty (30) days of the execution of the Contract Between Owner and Contractor, the Contractor shall record the Contract and the Performance and Payment Bond with the Clerk of Court of St. Tammany Parish. The Contractor shall also provide the owner with a copy of the Standard Recorded contract.

11.5 OTHER INSURANCE or FAILURE TO OBTAIN REQUIRED INSURANCE

The contractor has the right to purchase coverage or self-insure any exposures not required by the bid specifications or contract documents, but shall be held liable for all losses, deductibles, self-insurance for coverages not required.

Contractor shall also be liable for any losses that occur where insurance is contractually required but not procured or purchased by the Contractor or permitted to lapse or be cancelled.

11.6 STATUS OF EMPLOYEES OF CONTRACTOR AND SUBCONTRACTORS - STATUTORY EMPLOYER STATUS

11.6 STATUTORY EMPLOYER STATUS

All Contractors must comply with the directives of Act 315 of the 1997 Louisiana Regular Session regarding guidelines for determining statutory employer status under La R.S. 23:1061, effective June 17, 1997, and in consideration thereof:

**ARTICLE 12
UNCOVERING AND CORRECTION OF WORK**

12.2.2 AFTER SUBSTANTIAL COMPLETION

12.2.2.1 At the end of the paragraph add the following sentences:

"If the Contractor fails to correct Work identified as defective and covered by warranties, the Owner may hold the Contractor in default. If the Owner finds the Contractor is in default, the Surety shall be notified.

Finding the Contractor in default shall constitute a reason for disqualification of the Contractor from bidding on future APSB contracts.

**ARTICLE 13
MISCELLANEOUS PROVISIONS**

13.1 GOVERNING LAW

Delete the remainder of the paragraph beginning after the word "located"

13.2 SUCCESSORS AND ASSIGNS

13.2.1 In the second sentence, Delete "Except as.....13.2.2,"

13.2.2 Delete paragraph.

13.4 RIGHTS AND REMEDIES

Add the following clause 13.4.3.

13.4.3 The 23rd Judicial District Court in and for the Parish of Ascension, State of Louisiana shall have sole and exclusive jurisdiction and venue in any action brought under or pertaining to this contract. All disputes between the parties shall be filed in the state court of Louisiana. In the event of diversity for purposes of federal court jurisdiction or any other cause of action that may allow for federal court jurisdiction or venue, the Contractor, its surety, its Subcontractors and suppliers specifically waive any right or cause of action to be filed, transferred, removed, or tried in any federal court.

13.5 TESTS AND INSPECTIONS

13.5.1 In Subparagraph 13.5.1 delete the second sentence and substitute the following: The Contractor shall make arrangements for such tests, inspections and approvals with the Testing Laboratory provided by the Owner, and the Owner shall bear all related costs of tests, inspections and approvals."

Delete the last sentence of Subparagraph 13.5.1.

13.6 INTEREST

Delete Paragraph 13.6.

13.7 TIME LIMITS ON CLAIMS

Delete paragraph 13.7. (See La. R.S. 38:2189)

13.8 Add 13.8 as follows:

13.8 PROGRESS AND COORDINATION MEETINGS

13.8.1 A Pre-Construction meeting shall be held prior to the start of the Work. The following shall be in attendance: Owner, Architect and Consultants, Contractor and Superintendent, major Sub-contractors and representatives of separate Contractors, when applicable. The Contractor shall submit to the Architect and Owner prior to or at the preconstruction meeting the following: (1) list of major Sub-contractors and their contact information, (2) a list of Sub-contractors' Superintendent and Project Manager with 24 hour phone numbers and (3) tentative (CPM) Construction Progress Schedule and submittal schedule. There will be no substitutions made to the Sub-Contractor List after submitting at the preconstruction meeting without written approval by Owner's Representative, after requested in writing by the Contractor.

13.8.2 Progress and coordination meetings will be held monthly on site or as charged in writing by the Owner or Architect. The Architect shall generate and distribute minutes of each meeting to all participants within seven (7) days of each meeting. The following are expected to attend: The Contractor represented by its Project Manager or principal, the Contractor's Project Superintendent, the Sub-contractors and material suppliers requested by the Owner or Architect.

**ARTICLE 14
TERMINATION OR SUSPENSION OF THE CONTRACT**

14.1 TERMINATION BY THE CONTRACTOR

Delete clause 14.1.1.4.

14.1.3 After the word "profit", add the following "for Work completed prior to stoppage". Add at the end of the sentence: The Contractor shall not be entitled to recover consequential damages or profit or overhead for any portion of the Work of the Contract that has not been performed.

14.2 TERMINATION BY THE OWNER FOR CAUSE

Add the following clause:

14.2.1.5 "Fails to complete the punch list within the lien period as provided in section 9.8."

14.2.3 Add the following sentence:

"Termination by the Owner shall not suspend assessment of liquidated damages against the surety."

14.2.3.1 Add the following:

Liquidated damages have been established and the termination by the Owner under this Article will not relieve the Contractor and/or Surety of their obligations under the liquidated damages provision of the Contract. The Contractor and/or Surety shall be liable to the Owner for per diem liquidated damages. Termination by the Owner shall not suspend assessment of liquidated damages against the Contractor or the Surety.

14.2.4 After the word "damages" in Line 2, add: "*, including, but not limited to, liquidated or stipulated damages*".

14.2.5 Add the following Subparagraph:

If an agreed sum of liquidated damages has been established, termination by the Owner under this Article will not relieve the Contractor and/or surety of his obligations under the liquidated damages provisions. The Contractor and/or surety shall be and remain liable to the Owner for per diem liquidated damages."

**ARTICLE 15
CLAIMS AND DISPUTES**

15.1 CLAIMS

15.1.1 In the first sentence of subparagraph 15.1.1, add the phrase "extension of time," after the word "money".

15.1.2 Add the following to the end of the paragraph:

The Initial Decision Maker (IDM) shall provide a written decision to the Contractor and the Owner within 21 days of receipt of the claim. The IDM may (1) approve the Claim or (2) reject the Claim in whole or part. The IDM's decision is final and binding on the parties but subject to litigation. A "Reservation of Rights" and similar stipulations shall not be recognized under this contract as having any effect. Any party making a claim must make a claim as defined herein within the time limits provided.

15.1.3 In the second sentence of the subparagraph, delete "the decisions of the Initial Decision Maker" and replace with "his/her decision".

15.1.5.1 Delete second sentence.

15.1.5.2 Delete paragraph 15.1.5.2 and substitute the following:

In planning the construction schedule within the agreed Contract Time, it shall be understood that the Contractor has anticipated the amount of adverse weather conditions normal to the Project site of the Work for the season or seasons of the year involved. Only those weather delays attributed to other than normal weather conditions will be considered by the Architect and Owner. If adverse weather conditions are the basis for a claim for additional time, the Contractor shall document that weather conditions had an adverse effect on the scheduled construction. Documentation must include National Weather Service reports, Daily Log Reports and general description of work planned, that could not be executed. Note that half days will be considered and the Contractor will be allowed consideration of time lost due cleaning the site. An increase in the contract time due to weather shall not be cause for an increase in the contract sum.

15.1.5.3 Add the following Subparagraph:

The following are considered reasonably anticipated days of adverse weather on a monthly basis:

January 11 days	May 5 days	September 4 days
February 10 days	June 6 days	October 3 days
March 8 days	July 6 days	November 5 days
April 7 days	August 5 days	December 8 days

Normal anticipated adverse rainfall as indicated above for the area of the Project site shall not be cause for an extension of the Contract Time. The Contractor shall anticipate the number of days specified above as a minimum number of days of rain per month with additional wet adverse work conditions following the above number of days of rainfall. The Contractor shall ask for total adverse weather days, the Contractor's request shall be considered only for days over the allowable number of days stated above.

Note: Contract is on a calendar day basis.

All Contractor requests and documentation for extension in Time for rain or wet conditions for a particular month shall be delivered to the Architect promptly prior to the second Tuesday of the following month. (For example, for a claim for rain days in July, if the first day of August is on a Tuesday, the second Tuesday is August 8, hence, all requests for rain days in July would be delivered to the Architect on or prior to August 8. No

consideration will be granted by the Owner for claims for rain days when the Contractor does not submit claims on time as specified above.

15.1.6 Claims for Consequential Damages

Delete this paragraph in its entirety.

15.2 INITIAL DECISION

Note that per this agreement, the ARCHITECT shall serve as the INITIAL DECISION MAKER.

15.2.1 In sentence two, delete the phrase, “unless otherwise indicated in the Agreement.”

15.2.3 Delete the last sentence.

15.2.5 From the second sentence, delete the phrase, “and the Architect, if the Architect is not serving as the Initial Decision Maker”

15.2.5 At the end of the third sentence, change “binding dispute resolution” to “litigation”.

15.2.6 Delete the phrase, “subject to the terms of Section 15.2.6.1.”

15.2.6.1 Delete this section in its entirety.

15.2.8 Delete this section in its entirety.

15.3 MEDIATION

Delete and replace with:

15.3.1 Claims, disputes, or other matters in controversy arising out of or related to the Contract, except those waived as provided for in Sections 9.10.4 and 9.10.5, may be subject to mediation as a condition precedent to filing a lawsuit.

15.3.2 The parties may endeavor to resolve their Claims by mediation [non-binding] which, unless the parties mutually agree otherwise, shall be administered by a Mediation Service with offices in the parish of the project. A request for mediation shall be made in writing, delivered to the other party to the Contract, and filed with the person or entity administering the mediation. The parties shall share the mediator’s fee and any filing fees equally. The mediation shall be held in the place where the Project is located, unless another location is mutually agreed upon.

15.4 ARBITRATION

15.4.1 Delete this section.

15.4.2 Delete this section.

15.4.3 Delete this section.

NOTE: Disputes arising under this contract are not subject to arbitration. The word arbitration in the contract documents is hereby deleted and revised/ changed to “litigation” wherever the word arbitration may be found.

15.4.4 CONSOLIDATION OR JOINDER

Delete sections 15.4.4.1 through 15.4.4.3 and replace with the following:

15.4.4.1 The Owner, Architect, and Contractor grant to each other and to any other interested party all rights to joinder and consolidation that exist in the fact or law.

Add the following as Article 16:

**ARTICLE 16
EQUAL OPPORTUNITY**

16.1 The Contractor and all Subcontractors shall not discriminate against any employee or applicant for employment because of race, religion, color, sex, national origin or for any other reason. The Contractor shall take affirmative action to insure that applicants are employed, and that employees are treated during employment without regard to their race, religion, color, sex, or national origin. Such action shall include, but not be limited to the following: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices setting forth the policies of nondiscrimination.

16.2 The Contractor and all Subcontractors shall, in all solicitations or advertisement for employees placed by them or on their behalf, state that all qualified applicants will receive consideration for employment without regard to race, religion, color, sex or national origin.

END OF DOCUMENT 007300

DIVISION 1

GENERAL REQUIREMENTS

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832

Email: info@dammonengineering.com
Website: dammonengineering.com



SECTION 010280

TAX EXEMPT STATUS - FILING PROCEDURES

PART 1 - GENERAL

1.1 PROCEDURES

- A. St. Tammany Fire Protection District is a tax-exempt entity. As such, St. Tammany Fire Protection District reserves their right to take advantage of their tax status on any or all purchases of material(s) being incorporated into this project. The Contractor and Subcontractors hereby agree to cooperate in providing information relating to the value of materials to be purchased for the purpose of the District's monitoring and documenting of all materials purchased free of sales tax.
- B. The Contractor and Subcontractors are to include all required state and local sales or use tax in their bid proposals as it will be the option of STPPFD to take advantage of their tax exempt status.
- C. All aspects of purchasing will be monitored by a "Construction Professional" employed by STPPFD. Prior to a notice to proceed order being issued, the Contractor and Subcontractors will meet with the monitor to establish dollar amounts included in their estimates for materials by Divisions, or Subdivisions thereof, of the specifications. Upon proceeding, as purchase order amounts are established and issued, the information shall be made available to the monitor to post against the established material values. As monthly payment requests are processed and payment made to the General Contractor, copies of actual paid invoice amounts expended toward the contractor's/subcontractors' material purchases shall be made available to the monitor with proper documentation. (All subject to an independent audit at the expense of the Owner if they so desire).
- D. The monitor will set up a "Sales Tax Savings Spread Sheet" using the material values as provided and documented by the Contractor and/or Subcontractors. Only the sales tax value will be deducted for material purchases and no Contractor's or Subcontractor's labor, insurance, equipment, overhead, mark-up or bonds will be deducted. The material's tax value will be accumulated as each monthly payment request is submitted by the Contractor.

Periodically deductive Change Orders will be issued for the tax savings with a final deductive Change Order being issued at the completion of the project, thereby reducing the total Contract amount due the Contractor by the value of the material's sales tax. The taxes which are included in the contract will be recouped through periodic deductive Change Orders throughout the life of the project.

- E. The Contractor and/or Subcontractors remain entirely responsible for establishing delivery dates, receiving, protecting and/or storing the materials from the vendor(s) and installing same. The Contractor shall at all times have the care, custody, and

control of the materials and maintain insurance sufficient to cover the value of the materials.

- F. It shall be stated on each purchase order "All materials furnished with this purchase order shall be shipped to the Contractor, and used exclusively on the St. Tammany Fire Protection District No. 1, Training Facility. Documentation will be provided to the Contractor and Subcontractors indicating the Owner's tax exempt status. A copy of the certificate is to be provided to material suppliers for their file and record.

1.2 INDEMNIFICATION

- A. St. Tammany Fire Protection District No. 1, as Owner, agrees to indemnify, defend and hold Contractor fully harmless from and with respect to any State or local sales or use tax liability claimed, alleged, or asserted by any State or local government agency with respect to the purchase, use, consumption or storage of materials and supplies and rental of equipment on which any said claim is based were made strictly in accordance herewith and further provided that the items in question were purchased or rented exclusively for this particular Project and delivered by the vendor or vendors in question directly to job site or to a bonded storage facility. Specifically, this agreement to indemnify, defend and hold harmless from and with respect to sales and/or use taxes shall not apply in the case of any materials or supplies purchased by Contractor or Subcontractors for their own inventory.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF DOCUMENT 010280

SECTION 011000

SUMMARY

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Work covered by the Contract Documents.
 - 2. Type of the Contract.
 - 3. Work phases.
 - 4. Work under other contracts.
 - 5. Products ordered in advance.
 - 6. Owner-furnished products.
 - 7. Use of premises.
 - 8. Owner's occupancy requirements.
 - 9. Work restrictions.
 - 10. Specification formats and conventions.

1.3 WORK COVERED BY CONTRACT DOCUMENTS

- A. Project Identification: St. Tammany Fire Protection Dist. No. 1 - New Training Facility
 - 1. Project Location: 34780 S. Range Road (Camp Villere), Slidell, Louisiana 70460
- B. Owner: St. Tammany Fire Protection District No. 1
 - 1. Owner's Representative: Mr. Chad Duffaut
- C. Architect: Dammon Engineering, Inc.
- D. Contractor: _____ has been engaged as Contractor for this Project.
- E. The Work consists of the following:

1. The Work includes a new metal building to house a Training Facility for St. Tammany Fire Protection Dist. No. 1.

1.4 TYPE OF CONTRACT

- A. Project will be constructed under a single prime contract.

1.5 OWNER-FURNISHED PRODUCTS

- A. Owner will furnish products indicated on the plans. The Work includes providing support systems to receive Owner's equipment and making plumbing, mechanical, and electrical connections.
 1. Contractor is responsible for receiving, unloading, and handling Owner-furnished items at Project site.
 2. Contractor is responsible for protecting Owner-furnished items from damage during storage and handling, including damage from exposure to the elements.
 3. If Owner-furnished items are damaged as a result of Contractor's operations, Contractor shall repair or replace them.
 4. Contractor shall install and otherwise incorporate Owner-furnished items into the Work.

1.6 USE OF PREMISES

- A. Use of Site: Limit use of premises to work in areas indicated. Do not disturb portions of Project site beyond areas in which the Work is indicated.
 1. Limits: Confine constructions operations to areas indicated on drawings.

1.7 WORK RESTRICTIONS

- A. On-Site Work Hours: Work shall be generally performed during normal business working hours, early morning hours, and weekend hours.

1.8 SPECIFICATION FORMATS AND CONVENTIONS

- A. Specification Format:
 1. Section Identification: The Specifications use Section numbers and titles to help cross-referencing in the Contract Documents. Sections in the Project Manual are in numeric sequence; however, the sequence is incomplete because all available Section numbers are not used. Consult the table of contents at

- the beginning of the Project Manual to determine numbers and names of Sections in the Contract Documents.
2. Division 1: Sections in Division 1 govern the execution of the Work of all Sections in the Specifications.
- B. Specification Content: The Specifications use certain conventions for the style of language and the intended meaning of certain terms, words, and phrases when used in particular situations. These conventions are as follows:
1. Abbreviated Language: Language used in the Specifications and other Contract Documents is abbreviated. Words and meanings shall be interpreted as appropriate. Words implied, but not stated, shall be inferred as the sense requires. Singular words shall be interpreted as plural, and plural words shall be interpreted as singular where applicable as the context of the Contract Documents indicates.
 2. Imperative mood and streamlined language are generally used in the Specifications. Requirements expressed in the imperative mood are to be performed by Contractor. Occasionally, the indicative or subjunctive mood may be used in the Section Text for clarity to describe responsibilities that must be fulfilled indirectly by Contractor or by others when so noted.
 - a. The words "shall," "shall be," or "shall comply with," depending on the context, are implied where a colon (:) is used within a sentence or phrase.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF DOCUMENT 011000

SECTION 012500

SUBSTITUTION PROCEDURES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes administrative and procedural requirements for substitutions.

1.2 DEFINITIONS

- A. Substitutions: Changes in products, materials, equipment, and methods of construction from those required by the Contract Documents and proposed by Contractor.

1.3 ACTION SUBMITTALS

- A. Substitution Requests: Submit three copies of each request for consideration. Identify product or fabrication or installation method to be replaced. Include Specification Section number and title and Drawing numbers and titles.
 - 1. Substitution Request Form: Use CSI Form 13.1A.
 - 2. Documentation: Show compliance with requirements for substitutions and the following, as applicable:
 - a. Coordination information, including a list of changes or revisions needed to other parts of the Work and to construction performed by Owner and separate contractors, that will be necessary to accommodate proposed substitution.
 - b. Detailed comparison of significant qualities of proposed substitution with those of the Work specified. Include annotated copy of applicable Specification Section. Significant qualities may include attributes such as performance, weight, size, durability, visual effect, sustainable design characteristics, warranties, and specific features and requirements indicated. Indicate deviations, if any, from the Work specified.
 - c. Product Data, including drawings and descriptions of products and fabrication and installation procedures.
 - d. Samples, where applicable or requested.
 - e. Certificates and qualification data, where applicable or requested.
 - f. Material test reports from a qualified testing agency indicating and interpreting test results for compliance with requirements indicated.
 - g. Research reports evidencing compliance with building code in effect for Project, from ICC-ES.
 - h. Detailed comparison of Contractor's construction schedule using proposed substitution with products specified for the Work, including effect on the

- overall Contract Time. If specified product or method of construction cannot be provided within the Contract Time, include letter from manufacturer, on manufacturer's letterhead, stating date of receipt of purchase order, lack of availability, or delays in delivery.
- i. Cost information, including a proposal of change, if any, in the Contract Sum.
 - j. Contractor's certification that proposed substitution complies with requirements in the Contract Documents except as indicated in substitution request, is compatible with related materials, and is appropriate for applications indicated.
 - k. Contractor's waiver of rights to additional payment or time that may subsequently become necessary because of failure of proposed substitution to produce indicated results.
3. Architect's Action: If necessary, Architect will request additional information or documentation for evaluation within seven calendar days of receipt of a request for substitution. Architect will notify Contractor of acceptance or rejection of proposed substitution within 15 business days of receipt of request, or seven calendar days of receipt of additional information or documentation, whichever is later.
- a. Forms of Acceptance: Change Order, Construction Change Directive, or Architect's Supplemental Instructions for minor changes in the Work.
 - b. Use product specified if Architect does not issue a decision on use of a proposed substitution within time allocated.

1.4 QUALITY ASSURANCE

- A. Compatibility of Substitutions: Investigate and document compatibility of proposed substitution with related products and materials. Engage a qualified testing agency to perform compatibility tests recommended by manufacturers.

PART 2 - PRODUCTS

2.1 SUBSTITUTIONS

- A. Substitutions for Cause: Submit requests for substitution immediately on discovery of need for change, but not later than 15 business days prior to time required for preparation and review of related submittals.
 1. Conditions: Architect will consider Contractor's request for substitution when the following conditions are satisfied:
 - a. Requested substitution is consistent with the Contract Documents and will produce indicated results.
 - b. Requested substitution will not adversely affect Contractor's construction schedule.

- c. Requested substitution has received necessary approvals of authorities having jurisdiction.
 - d. Requested substitution is compatible with other portions of the Work.
 - e. Requested substitution has been coordinated with other portions of the Work.
 - f. Requested substitution provides specified warranty.
 - g. If requested substitution involves more than one contractor, requested substitution has been coordinated with other portions of the Work, is uniform and consistent, is compatible with other products, and is acceptable to all contractors involved.
- B. Substitutions for Convenience: Architect will consider requests for substitution if received within 60 calendar days after the Notice of Award.
- 1. Conditions: Architect will consider Contractor's request for substitution when the following conditions are satisfied:
 - a. Requested substitution offers Owner a substantial advantage in cost, time, energy conservation, or other considerations, after deducting additional responsibilities Owner must assume. Owner's additional responsibilities may include compensation to Architect for redesign and evaluation services, increased cost of other construction by Owner, and similar considerations.
 - b. Requested substitution does not require extensive revisions to the Contract Documents.
 - c. Requested substitution is consistent with the Contract Documents and will produce indicated results.
 - d. Requested substitution will not adversely affect Contractor's construction schedule.
 - e. Requested substitution has received necessary approvals of authorities having jurisdiction.
 - f. Requested substitution is compatible with other portions of the Work.
 - g. Requested substitution has been coordinated with other portions of the Work.
 - h. Requested substitution provides specified warranty.
 - i. If requested substitution involves more than one contractor, requested substitution has been coordinated with other portions of the Work, is uniform and consistent, is compatible with other products, and is acceptable to all contractors involved.

PART 3 - EXECUTION (Not Used)

END OF SECTION 012500

SECTION 012600

CONTRACT MODIFICATION PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section specifies administrative and procedural requirements for handling and processing Contract modifications.

1.3 MINOR CHANGES IN THE WORK

- A. Architect will issue supplemental instructions authorizing Minor Changes in the Work, not involving adjustment to the Contract Sum or the Contract Time, on AIA Document G710, "Architect's Supplemental Instructions."

1.4 PROPOSAL REQUESTS

- A. Owner-Initiated Proposal Requests: Architect will issue a detailed description of proposed changes in the Work that may require adjustment to the Contract Sum or the Contract Time. If necessary, the description will include supplemental or revised Drawings and Specifications.
 - 1. Proposal Requests issued by Architect are for information only. Do not consider them instructions either to stop work in progress or to execute the proposed change.
 - 2. Within time specified in Proposal Request after receipt of Proposal Request, submit a quotation estimating cost adjustments to the Contract Sum and the Contract Time necessary to execute the change.
 - a. Include a list of quantities of products required or eliminated and unit costs, with total amount of purchases and credits to be made. If requested, furnish survey data to substantiate quantities.
 - b. Indicate applicable taxes, delivery charges, equipment rental, and amounts of trade discounts.
 - c. Include costs of labor and supervision directly attributable to the change.

- d. Include an updated Contractor's Construction Schedule that indicates the effect of the change, including, but not limited to, changes in activity duration, start and finish times, and activity relationship. Use available total float before requesting an extension of the Contract Time.
- B. Contractor-Initiated Proposals: If latent or unforeseen conditions require modifications to the Contract, Contractor may propose changes by submitting a request for a change to Architect.
1. Include a statement outlining reasons for the change and the effect of the change on the Work. Provide a complete description of the proposed change. Indicate the effect of the proposed change on the Contract Sum and the Contract Time.
 2. Include a list of quantities of products required or eliminated and unit costs, with total amount of purchases and credits to be made. If requested, furnish survey data to substantiate quantities.
 3. Indicate applicable taxes, delivery charges, equipment rental, and amounts of trade discounts.
 4. Include costs of labor and supervision directly attributable to the change.
 5. Include an updated Contractor's Construction Schedule that indicates the effect of the change, including, but not limited to, changes in activity duration, start and finish times, and activity relationship. Use available total float before requesting an extension of the Contract Time.
 6. Comply with requirements in Division 1 if the proposed change requires substitution of one product or system for product or system specified.

1.5 ALLOWANCES

- A. Allowance Adjustment: To adjust allowance amounts, base each Change Order proposal on the difference between purchase amount and the allowance, multiplied by final measurement of work-in-place. If applicable, include reasonable allowances for cutting losses, tolerances, mixing wastes, normal product imperfections, and similar margins.
1. Include installation costs in purchase amount only where indicated as part of the allowance.
 2. If requested, prepare explanation and documentation to substantiate distribution of overhead costs and other margins claimed.
 3. Submit substantiation of a change in scope of work, if any, claimed in Change Orders related to unit-cost allowances.
 4. Owner reserves the right to establish the quantity of work-in-place by independent quantity survey, measure, or count.
- B. Submit claims for increased costs because of a change in scope or nature of the allowance described in the Contract Documents, whether for the Purchase Order amount or Contractor's handling, labor, installation, overhead, and profit. Submit claims within 21 days of receipt of the Change Order or Construction Change

Directive authorizing work to proceed. Owner will reject claims submitted later than 21 days after such authorization.

1. Do not include Contractor's or subcontractor's indirect expense in the Change Order cost amount unless it is clearly shown that the nature or extent of work has changed from what could have been foreseen from information in the Contract Documents.
2. No change to Contractor's indirect expense is permitted for selection of higher- or lower-priced materials or systems of the same scope and nature as originally indicated.

1.6 CHANGE ORDER PROCEDURES

- A. On Owner's approval of a Proposal Request, Architect will issue a Change Order for signatures of Owner and Contractor on AIA Document G701. This form will be initiated by the Contractor using the proposed change form.

1.7 CONSTRUCTION CHANGE DIRECTIVE

- A. Construction Change Directive: Architect may issue a Construction Change Directive for time sensitive issues. Change Directive instructs Contractor to proceed with a change in the Work, for subsequent inclusion in a Change Order.
 1. Construction Change Directive contains a complete description of change in the Work. It also designates method to be followed to determine change in the Contract Sum or the Contract Time.
- B. Documentation: Maintain detailed records on a time and material basis of work required by the Construction Change Directive.
 1. After completion of change, submit an itemized account and supporting data necessary to substantiate cost and time adjustments to the Contract.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF DOCUMENT 012600

SECTION 012900
PAYMENT PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section specifies administrative and procedural requirements necessary to prepare and process Applications for Payment.

1.3 DEFINITIONS

- A. Schedule of Values: A statement furnished by Contractor allocating portions of the Contract Sum to various portions of the Work and used as the basis for reviewing Contractor's Applications for Payment.

1.4 SCHEDULE OF VALUES

- A. Coordination: Coordinate preparation of the Schedule of Values with preparation of Contractor's Construction Schedule.
 - 1. Correlate line items in the Schedule of Values with other required administrative forms and schedules, including the following:
 - a. Application for Payment forms with Continuation Sheets.
 - b. Submittals Schedule.
 - c. Contractor's Construction Schedule.
 - 2. Submit the Schedule of Values to Architect at earliest possible date but no later than seven days before the date scheduled for submittal of initial Applications for Payment.
 - 3. Sub-schedules: Where the Work is separated into phases requiring separately phased payments, provide sub-schedules showing values correlated with each phase of payment.

- B. Format and Content: Use the Project Manual table of contents as a guide to establish line items for the Schedule of Values. Provide at least one line item for each Specification Section.
1. Identification: Include the following Project identification on the Schedule of Values:
 - a. Project name and location.
 - b. Name of Architect.
 - c. Architect's project number.
 - d. Contractor's name and address.
 - e. Date of submittal.
 2. Submit draft of AIA Document G703 Continuation Sheets.
 3. Arrange the Schedule of Values in tabular form with separate columns to indicate the following for each item listed:
 - a. Related Specification Section or Division.
 - b. Description of the Work.
 - c. Name of subcontractor.
 - d. Name of manufacturer or fabricator.
 - e. Name of supplier.
 - f. Change Orders (numbers) that affect value.
 - g. Dollar value.
 - 1) Percentage of the Contract Sum to nearest one-hundredth percent, adjusted to total 100 percent.
 4. Provide a breakdown of the Contract Sum in enough detail to facilitate continued evaluation of Applications for Payment and progress reports. Coordinate with the Project Manual table of contents. Provide several line items for principal subcontract amounts, where appropriate.
 5. Round amounts to nearest whole dollar; total shall equal the Contract Sum.
 6. Provide a separate line item in the Schedule of Values for each part of the Work where Applications for Payment may include materials or equipment purchased or fabricated and stored, but not yet installed.
 - a. Differentiate between items stored on-site and items stored off-site. If specified, include evidence of insurance or bonded warehousing.
 7. Provide separate line items in the Schedule of Values for initial cost of materials, for each subsequent stage of completion, and for total installed value of that part of the Work.
 8. Allowances: Provide a separate line item in the Schedule of Values for each allowance. Show line-item value of unit-cost allowances, as a product of the unit cost, multiplied by measured quantity. Use information indicated in the Contract Documents to determine quantities.

9. Each item in the Schedule of Values and Applications for Payment shall be complete. Include total cost and proportionate share of general overhead and profit for each item.
 - a. Temporary facilities and other major cost items that are not direct cost of actual work-in-place may be shown either as separate line items in the Schedule of Values or distributed as general overhead expense, at Contractor's option.
10. Schedule Updating: Update and resubmit the Schedule of Values before the next Applications for Payment when Change Orders or Construction Change Directives result in a change in the Contract Sum.

1.5 APPLICATIONS FOR PAYMENT

- A. Each Application for Payment shall be consistent with previous applications and payments as certified by Architect and paid for by Owner.
 1. Initial Application for Payment, Application for Payment at time of Substantial Completion, and final Application for Payment involve additional requirements.
- B. Payment Application Times: The date for each progress payment is indicated in the Agreement between Owner and Contractor. The period of construction Work covered by each Application for Payment is the period indicated in the Agreement.
- C. Payment Application Forms: Use AIA Document G702 and AIA Document G703 Continuation Sheets as form for Applications for Payment.
- D. Payment Application Forms: Use forms provided by Owner for Applications for Payment. Sample copies are included at end of this Section.
- E. Application Preparation: Complete every entry on form. Notarize and execute by a person authorized to sign legal documents on behalf of Contractor. Architect will return incomplete applications without action.
 1. Entries shall match data on the Schedule of Values and Contractor's Construction Schedule. Use updated schedules if revisions were made.
 2. Include amounts of Change Orders and Construction Change Directives issued before last day of construction period covered by application.
- F. Transmittal: Submit 1 signed and notarized original copies of each Application for Payment to Architect by a method ensuring receipt within 24 hours. One copy shall include waivers of lien and similar attachments if required.
- G. Initial Application for Payment: Administrative actions and submittals that must precede or coincide with submittal of first Application for Payment include the following:

1. List of subcontractors.
 2. Schedule of Values.
 3. Contractor's Construction Schedule (preliminary if not final).
 4. Products list.
 5. Schedule of unit prices.
 6. Submittals Schedule (preliminary if not final).
 7. List of Contractor's staff assignments.
 8. List of Contractor's principal consultants.
 9. Copies of building permits.
 10. Copies of authorizations and licenses from authorities having jurisdiction for performance of the Work.
 11. Initial progress report.
 12. Report of preconstruction conference.
 13. Certificates of insurance and insurance policies.
 14. Performance and payment bonds.
 15. Data needed to acquire Owner's insurance.
 16. Initial settlement survey and damage report if required.
- H. Application for Payment at Substantial Completion: After issuing the Certificate of Substantial Completion, submit an Application for Payment showing 100 percent completion for portion of the Work claimed as substantially complete.
1. Include documentation supporting claim that the Work is substantially complete and a statement showing an accounting of changes to the Contract Sum.
 2. This application shall reflect Certificates of Partial Substantial Completion issued previously for Owner occupancy of designated portions of the Work.
- I. Final Payment Application: Submit final Application for Payment with releases and supporting documentation not previously submitted and accepted, including, but not limited, to the following:
1. Evidence of completion of Project closeout requirements.
 2. Insurance certificates for products and completed operations where required and proof that taxes, fees, and similar obligations were paid.
 3. Updated final statement, accounting for final changes to the Contract Sum.
 4. AIA Document G706, "Contractor's Affidavit of Payment of Debts and Claims."
 5. AIA Document G706A, "Contractor's Affidavit of Release of Liens."
 6. AIA Document G707, "Consent of Surety to Final Payment."
 7. Evidence that claims have been settled.
 8. Final meter readings for utilities, a measured record of stored fuel, and similar data as of date of Substantial Completion or when Owner took possession of and assumed responsibility for corresponding elements of the Work.
 9. Final, liquidated damages settlement statement.

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1
NEW TRAINING FACILITY
34780 S. RANGE ROAD
SLIDELL LA 70460

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION (Not Used)

END OF DOCUMENT 012900

SECTION 013100

PROJECT MANAGEMENT AND COORDINATION

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative provisions for coordinating construction operations on Project including, but not limited to, the following:
 - 1. Coordination Drawings.
 - 2. Administrative and supervisory personnel.
 - 3. Project meetings.
 - 4. Requests for Interpretation (RFIs).

- B. Each contractor shall participate in coordination requirements. Certain areas of responsibility will be assigned to a specific contractor.

1.3 DEFINITIONS

- A. RFI: Request from Contractor seeking interpretation or clarification of the Contract Documents.

1.4 COORDINATION

- A. Coordination: Coordinate construction operations included in different Sections of the Specifications to ensure efficient and orderly installation of each part of the Work. Coordinate construction operations, included in different Sections, that depend on each other for proper installation, connection, and operation.

- B. Coordination: Each contractor shall coordinate its construction operations with those of other contractors and entities to ensure efficient and orderly installation of each part of the Work. Each contractor shall coordinate its operations with operations, included in different Sections, that depend on each other for proper installation, connection, and operation.

1. Schedule construction operations in sequence required to obtain the best results where installation of one part of the Work depends on installation of other components, before or after its own installation.
 2. Coordinate installation of different components with other contractors to ensure maximum accessibility for required maintenance, service, and repair.
 3. Make adequate provisions to accommodate items scheduled for later installation.
 4. Where availability of space is limited, coordinate installation of different components to ensure maximum performance and accessibility for required maintenance, service, and repair of all components, including mechanical and electrical.
- C. Prepare memoranda for distribution to each party involved, outlining special procedures required for coordination. Include such items as required notices, reports, and list of attendees at meetings.
1. Prepare similar memoranda for Owner and separate contractors if coordination of their Work is required.
- D. Administrative Procedures: Coordinate scheduling and timing of required administrative procedures with other construction activities and activities of other contractors to avoid conflicts and to ensure orderly progress of the Work. Such administrative activities include, but are not limited to, the following:
1. Preparation of Contractor's Construction Schedule.
 2. Preparation of the Schedule of Values.
 3. Installation and removal of temporary facilities and controls.
 4. Delivery and processing of submittals.
 5. Progress meetings.
 6. Preinstallation conferences.
 7. Project closeout activities.
 8. Startup and adjustment of systems.
 9. Project closeout activities.
- E. Conservation: Coordinate construction activities to ensure that operations are carried out with consideration given to conservation of energy, water, and materials.
1. Salvage materials and equipment involved in performance of, but not actually incorporated into, the Work. Refer to other Sections for disposition of salvaged materials that are designated as Owner's property.
- 1.5 SUBMITTALS
- A. Coordination Drawings: Prepare Coordination Drawings if limited space availability necessitates maximum utilization of space for efficient installation of different components or if coordination is required for installation of products and materials fabricated by separate entities.

1. Content: Project-specific information, drawn accurately to scale. Do not base Coordination Drawings on reproductions of the Contract Documents or standard printed data. Include the following information, as applicable:
 - a. Indicate functional and spatial relationships of components of architectural, structural, civil, mechanical, and electrical systems.
 - b. Indicate required installation sequences.
 - c. Indicate dimensions shown on the Contract Drawings and make specific note of dimensions that appear to be in conflict with submitted equipment and minimum clearance requirements. Provide alternate sketches to Architect for resolution of such conflicts. Minor dimension changes and difficult installations will not be considered changes to the Contract.
2. Sheet Size: At least 8-1/2 by 11 inches but no larger than 24 by 36 inches.
3. Number of Copies: Submit an electronic copy.
4. Refer to individual Sections for Coordination Drawing requirements for Work in those Sections.

B. Key Personnel Names: Within 15 days of starting construction operations, submit a list of key personnel assignments, including superintendent and other personnel in attendance at Project site. Identify individuals and their duties and responsibilities; list addresses and telephone numbers, including home and office telephone numbers. Provide names, addresses, and telephone numbers of individuals assigned as standbys in the absence of individuals assigned to Project.

1. Post copies of list in Project meeting room, in temporary field office, and by each temporary telephone. Keep list current at all times.

1.6 ADMINISTRATIVE AND SUPERVISORY PERSONNEL

A. General: In addition to Project superintendent, provide other administrative and supervisory personnel as required for proper performance of the Work.

1. Include special personnel required for coordination of operations with other contractors.

1.7 PROJECT MEETINGS

A. General: Schedule and conduct meetings and conferences at Project site, unless otherwise indicated.

1. Attendees: Inform participants and others involved, and individuals whose presence is required, of date and time of each meeting. Notify Owner and Architect of scheduled meeting dates and times.
 2. Agenda: Prepare the meeting agenda. Distribute the agenda to all invited attendees.
 3. Minutes: Record significant discussions and agreements achieved. Distribute the meeting minutes to everyone concerned, including Owner and Architect, within three days of the meeting.
- B. Preconstruction Conference: Schedule a preconstruction conference before starting construction, at a time convenient to Owner and Architect, but no later than 15 days after execution of the Agreement. Hold the conference at Project site or another convenient location. Conduct the meeting to review responsibilities and personnel assignments.
1. Attendees: Authorized representatives of Owner, Architect, and their consultants; Contractor and its superintendent; major subcontractors; suppliers; and other concerned parties shall attend the conference. All participants at the conference shall be familiar with Project and authorized to conclude matters relating to the Work.
 2. Agenda: Discuss items of significance that could affect progress, including the following:
 - a. Tentative construction schedule.
 - b. Phasing.
 - c. Critical work sequencing and long-lead items.
 - d. Designation of key personnel and their duties.
 - e. Procedures for processing field decisions and Change Orders.
 - f. Procedures for RFIs.
 - g. Procedures for testing and inspecting.
 - h. Procedures for processing Applications for Payment.
 - i. Distribution of the Contract Documents.
 - j. Submittal procedures.
 - k. Preparation of Record Documents.
 - l. Use of the premises and existing building.
 - m. Work restrictions.
 - n. Owner's occupancy requirements.
 - o. Responsibility for temporary facilities and controls.
 - p. Construction waste management and recycling.
 - q. Parking availability.
 - r. Office, work, and storage areas.
 - s. Equipment deliveries and priorities.
 - t. First aid.
 - u. Security.
 - v. Progress cleaning.
 - w. Working hours.
 3. Minutes: Record and distribute meeting minutes.

- C. Preinstallation Conferences: Conduct a preinstallation conference at Project site before each construction activity that requires coordination with other construction.
1. Attendees: Installer and representatives of manufacturers and fabricators involved in or affected by the installation and its coordination or integration with other materials and installations that have preceded or will follow, shall attend the meeting. Advise Architect of scheduled meeting dates.
 2. Agenda: Review progress of other construction activities and preparations for the particular activity under consideration, including requirements for the following:
 - a. The Contract Documents.
 - b. Options.
 - c. Related RFIs.
 - d. Related Change Orders.
 - e. Purchases.
 - f. Deliveries.
 - g. Submittals.
 - h. Review of mockups.
 - i. Possible conflicts.
 - j. Compatibility problems.
 - k. Time schedules.
 - l. Weather limitations.
 - m. Manufacturer's written recommendations.
 - n. Warranty requirements.
 - o. Compatibility of materials.
 - p. Acceptability of substrates.
 - q. Temporary facilities and controls.
 - r. Space and access limitations.
 - s. Regulations of authorities having jurisdiction.
 - t. Testing and inspecting requirements.
 - u. Installation procedures.
 - v. Coordination with other work.
 - w. Required performance results.
 - x. Protection of adjacent work.
 - y. Protection of construction and personnel.
 3. Record significant conference discussions, agreements, and disagreements, including required corrective measures and actions.
 4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.
 5. Do not proceed with installation if the conference cannot be successfully concluded. Initiate whatever actions are necessary to resolve impediments to performance of the Work and reconvene the conference at earliest feasible date.
- D. Progress Meetings: Conduct progress meetings at minimum bimonthly intervals. Coordinate dates of meetings with preparation of payment requests.

1. Attendees: In addition to representatives of Owner and Architect, each contractor, subcontractor, supplier, and other entity concerned with current progress or involved in planning, coordination, or performance of future activities shall be represented at these meetings. All participants at the conference shall be familiar with Project and authorized to conclude matters relating to the Work.
2. Agenda: Review and correct or approve minutes of previous progress meeting. Review other items of significance that could affect progress. Include topics for discussion as appropriate to status of Project.
 - a. Contractor's Construction Schedule: Review progress since the last meeting. Determine whether each activity is on time, ahead of schedule, or behind schedule, in relation to Contractor's Construction Schedule. Determine how construction behind schedule will be expedited; secure commitments from parties involved to do so. Discuss whether schedule revisions are required to ensure that current and subsequent activities will be completed within the Contract Time.
 - 1) Review schedule for next period.
 - b. Review present and future needs of each entity present, including the following:
 - 1) Interface requirements.
 - 2) Sequence of operations.
 - 3) Status of submittals.
 - 4) Deliveries.
 - 5) Off-site fabrication.
 - 6) Access.
 - 7) Site utilization.
 - 8) Temporary facilities and controls.
 - 9) Work hours.
 - 10) Hazards and risks.
 - 11) Progress cleaning.
 - 12) Quality and work standards.
 - 13) Status of correction of deficient items.
 - 14) Field observations.
 - 15) RFIs.
 - 16) Status of proposal requests.
 - 17) Pending changes.
 - 18) Status of Change Orders.
 - 19) Pending claims and disputes.
 - 20) Documentation of information for payment requests.
3. Minutes: Record the meeting minutes.
4. Reporting: Distribute minutes of the meeting to each party present and to parties who should have been present.

- a. Schedule Updating: Revise Contractor's Construction Schedule after each progress meeting where revisions to the schedule have been made or recognized. Issue revised schedule concurrently with the report of each meeting.

1.8 REQUESTS FOR INTERPRETATION (RFI's)

A. Procedure: Immediately on discovery of the need for interpretation of the Contract Documents, and if not possible to request interpretation at Project meeting, prepare and submit an RFI in the form specified.

1. RFIs shall originate with Contractor. RFIs submitted by entities other than Contractor will be returned with no response.
2. Coordinate and submit RFIs in a prompt manner so as to avoid delays in Contractor's work or work of subcontractors.

B. Content of the RFI: Include a detailed, legible description of item needing interpretation and the following:

1. Project name.
2. Date.
3. Name of Contractor.
4. Name of Architect.
5. RFI number, numbered sequentially.
6. Specification Section number and title and related paragraphs, as appropriate.
7. Drawing number and detail references, as appropriate.
8. Field dimensions and conditions, as appropriate.
9. Contractor's suggested solution(s). If Contractor's solution(s) impact the Contract Time or the Contract Sum, Contractor shall state impact in the RFI.
10. Contractor's signature.
11. Attachments: Include drawings, descriptions, measurements, photos, Product Data, Shop Drawings, and other information necessary to fully describe items needing interpretation.
 - a. Supplementary drawings prepared by Contractor shall include dimensions, thicknesses, structural grid references, and details of affected materials, assemblies, and attachments.

C. Hard-Copy RFIs: AIA G716 - 2004, Request for Information (RFI).

1. Identify each page of attachments with the RFI number and sequential page number.

D. Software-Generated RFIs: Software-generated form with substantially the same content as indicated above.

1. Attachments shall be electronic files in Adobe Acrobat PDF format.

E. Architect's Action: Architect will review each RFI, determine action required, and return it. Allow Ten working days for Architect's response for each RFI. RFIs received after 1:00 p.m. will be considered as received the following working day.

1. The following RFIs will be returned without action:
 - a. Requests for approval of submittals.
 - b. Requests for approval of substitutions.
 - c. Requests for coordination information already indicated in the Contract Documents.
 - d. Requests for adjustments in the Contract Time or the Contract Sum.
 - e. Requests for interpretation of Architect's actions on submittals.
 - f. Incomplete RFIs or RFIs with numerous errors.
2. Architect's action may include a request for additional information, in which case Architect's time for response will start again.
3. Architect's action on RFIs that may result in a change to the Contract Time or the Contract Sum may be eligible for Contractor to submit Change Proposal according to Division 1 Section "Contract Modification Procedures."
 - a. If Contractor believes the RFI response warrants change in the Contract Time or the Contract Sum, notify Architect in writing within 10 days of receipt of the RFI response.

F. On receipt of Architect's action, update the RFI log and immediately distribute the RFI response to affected parties. Review response and notify Architect within seven days if Contractor disagrees with response.

G. RFI Log: Prepare, maintain, and submit a tabular log of RFIs organized by the RFI number. Submit log with not less than the following:

1. Project name.
2. Name and address of Contractor.
3. Name and address of Architect.
4. RFI number including RFIs that were dropped and not submitted.
5. RFI description.
6. Date the RFI was submitted.
7. Date Architect's response was received.
8. Identification of related Minor Change in the Work, Construction Change Directive, and Proposal Request, as appropriate.
9. Identification of related Field Order, Work Change Directive, and Proposal Request, as appropriate.

12. PRODUCTS (Not Used)

13. EXECUTION (Not Used)

END OF SECTION 013100

SECTION 013300

SUBMITTALS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for submitting Shop Drawings, Product Data, Samples, and other submittals.

1.3 DEFINITIONS

- A. Action Submittals: Written and graphic information that requires Architect's responsive action.
- B. Informational Submittals: Written information that does not require Architect's responsive action. Submittals may be rejected for not complying with requirements.

1.4 SUBMITTAL PROCEDURES

- A. General: Electronic copies of the Contract Drawings (in pdf format) will be provided by Architect for Contractor's use in preparing submittals.
- B. Coordination: Coordinate preparation and processing of submittals with performance of construction activities.
 - 1. Coordinate each submittal with fabrication, purchasing, testing, delivery, other submittals, and related activities that require sequential activity.
 - 2. Coordinate transmittal of different types of submittals for related parts of the Work so processing will not be delayed because of need to review submittals concurrently for coordination.
 - a. Architect reserves the right to withhold action on a submittal requiring coordination with other submittals until related submittals are received.

- C. Submittals Schedule: Comply with requirements in Division 1 Sections for list of submittals and time requirements for scheduled performance of related construction activities.

- D. Processing Time: Allow enough time for submittal review, including time for resubmittals, as follows. Time for review shall commence on Architect's receipt of submittal. No extension of the Contract Time will be authorized because of failure to transmit submittals enough in advance of the Work to permit processing, including resubmittals.
 - 1. Initial Review: Allow 15 business days for initial review of each submittal. Allow additional time if coordination with subsequent submittals is required. Architect will advise Contractor when a submittal being processed must be delayed for coordination.
 - 2. Intermediate Review: If intermediate submittal is necessary, process it in same manner as initial submittal.
 - 3. Resubmittal Review: Allow 15 business days for review of each resubmittal.
 - 4. Sequential Review: Where sequential review of submittals by Architect's consultants, Owner, or other parties is indicated, allow 21 calendar days for initial review of each submittal.
 - 5. Concurrent Consultant Review: Where the Contract Documents indicate that submittals may be transmitted simultaneously to Architect and to Architect's consultants, allow 15 business days for review of each submittal. Submittal will be returned to Architect before being returned to Contractor.

- E. Identification: Place a permanent label or title block on each submittal for identification.
 - 1. Indicate name of firm or entity that prepared each submittal on label or title block.
 - 2. Provide a space approximately 6 by 8 inches on label or beside title block to record Contractor's review and approval markings and action taken by Architect.
 - 3. Include the following information on label for processing and recording action taken:
 - a. Project name.
 - b. Date.
 - c. Name and address of Architect.
 - d. Name and address of Contractor.
 - e. Name and address of subcontractor.
 - f. Name and address of supplier.
 - g. Name of manufacturer.
 - h. Submittal number or other unique identifier, including revision identifier.

 - 1) Submittal number shall use Specification Section number followed by a decimal point and then a sequential number (e.g., 06100.01).

Resubmittals shall include an alphabetic suffix after another decimal point (e.g., 06100.01.A).

- i. Number and title of appropriate Specification Section.
 - j. Drawing number and detail references, as appropriate.
 - k. Location(s) where product is to be installed, as appropriate.
 - l. Other necessary identification.
 - F. Deviations: Highlight, encircle, or otherwise specifically identify deviations from the Contract Documents on submittals.
 - G. Additional Copies: Unless additional copies are required for final submittal, and unless Architect observes noncompliance with provisions in the Contract Documents, initial submittal may serve as final submittal.
 - 1. Submit one copy of submittal to concurrent reviewer in addition to specified number of copies to Architect.
 - 2. Additional copies submitted for maintenance manuals will be marked with action taken and will be returned.
 - H. Resubmittals: Make resubmittals in same form and number of copies as initial submittal.
 - 1. Note date and content of previous submittal.
 - 2. Note date and content of revision in label or title block and clearly indicate extent of revision.
 - I. Distribution: Furnish copies of final submittals to manufacturers, subcontractors, suppliers, fabricators, installers, authorities having jurisdiction, and others as necessary for performance of construction activities. Show distribution on transmittal forms.
- 1.5 CONTRACTOR'S USE OF ARCHITECT'S FILES
- A. General: At Contractor's written request, copies of Architect's electronic (pdf) files will be provided to Contractor for Contractor's use in connection with Project.

PART 2 - PRODUCTS

2.1 ACTION SUBMITTALS

- A. General: Prepare and submit Action Submittals required by individual Specification Sections.
 - 1. Submit electronic submittals directly to extranet specifically established for Project.

- B. Product Data: Collect information into a single submittal for each element of construction and type of product or equipment.
1. If information must be specially prepared for submittal because standard printed data are not suitable for use, submit as Shop Drawings, not as Product Data.
 2. Mark each copy of each submittal to show which products and options are applicable.
 3. Include the following information, as applicable:
 - a. Manufacturer's written recommendations.
 - b. Manufacturer's product specifications.
 - c. Manufacturer's installation instructions.
 - d. Standard color charts.
 - e. Manufacturer's catalog cuts.
 - f. Wiring diagrams showing factory-installed wiring.
 - g. Printed performance curves.
 - h. Operational range diagrams.
 - i. Mill reports.
 - j. Standard product operation and maintenance manuals.
 - k. Compliance with specified referenced standards.
 - l. Testing by recognized testing agency.
 - m. Application of testing agency labels and seals.
 - n. Notation of coordination requirements.
 4. Submit Product Data before or concurrent with Samples.
 5. Number of Copies: Submit five copies of Product Data, unless otherwise indicated. Architect will return three copies. Mark up and retain one returned copy as a Project Record Document.
- C. Shop Drawings: Prepare Project-specific information, drawn accurately to scale.
1. Preparation: Fully illustrate requirements in the Contract Documents. Include the following information, as applicable:
 - a. Dimensions.
 - b. Identification of products.
 - c. Fabrication and installation drawings.
 - d. Roughing-in and setting diagrams.
 - e. Wiring diagrams showing field-installed wiring, including power, signal, and control wiring.
 - f. Shopwork manufacturing instructions.
 - g. Templates and patterns.
 - h. Schedules.
 - i. Design calculations.
 - j. Compliance with specified standards.
 - k. Notation of coordination requirements.
 - l. Notation of dimensions established by field measurement.
 - m. Relationship to adjoining construction clearly indicated.

- n. Seal and signature of professional engineer if specified.
 - o. Wiring Diagrams: Differentiate between manufacturer-installed and field-installed wiring.
- 2. Sheet Size: Except for templates, patterns, and similar full-size drawings, submit Shop Drawings on sheets at least 8-1/2 by 11 inches but no larger than 24 by 36 inches.
 - 3. Number of Copies: Submit electronic copy (pdf).
- D. Samples: Submit Samples for review of kind, color, pattern, and texture for a check of these characteristics with other elements and for a comparison of these characteristics between submittal and actual component as delivered and installed.
- 1. Transmit Samples that contain multiple, related components such as accessories together in one submittal package.
 - 2. Identification: Attach label on unexposed side of Samples that includes the following:
 - a. Generic description of Sample.
 - b. Product name and name of manufacturer.
 - c. Sample source.
 - d. Number and title of appropriate Specification Section.
 - 3. Disposition: Maintain sets of approved Samples at Project site, available for quality-control comparisons throughout the course of construction activity. Sample sets may be used to determine final acceptance of construction associated with each set.
 - a. Samples that may be incorporated into the Work are indicated in individual Specification Sections. Such Samples must be in an undamaged condition at time of use.
 - b. Samples not incorporated into the Work, or otherwise designated as Owner's property, are the property of Contractor.
 - 4. Samples for Initial Selection: Submit manufacturer's color charts consisting of units or sections of units showing the full range of colors, textures, and patterns available.
 - a. Number of Samples: Submit two full set(s) of available choices where color, pattern, texture, or similar characteristics are required to be selected from manufacturer's product line. Architect will return submittal with options selected.
 - 5. Samples for Verification: Submit full-size units or Samples of size indicated, prepared from same material to be used for the Work, cured and finished in manner specified, and physically identical with material or product proposed for use, and that show full range of color and texture variations expected. Samples include, but are not limited to, the following: partial sections of manufactured or fabricated components; small cuts or containers of materials;

complete units of repetitively used materials; swatches showing color, texture, and pattern; color range sets; and components used for independent testing and inspection.

- a. Number of Samples: Submit three sets of Samples. Architect will retain two] Sample sets; remainder will be returned. Mark up and retain one returned Sample set as a Project Record Sample.
 - 1) Submit a single Sample where assembly details, workmanship, fabrication techniques, connections, operation, and other similar characteristics are to be demonstrated.
 - 2) If variation in color, pattern, texture, or other characteristic is inherent in material or product represented by a Sample, submit at least three sets of paired units that show approximate limits of variations.
- E. Product Schedule or List: As required in individual Specification Sections, prepare a written summary indicating types of products required for the Work and their intended location. Include the following information in tabular form:
 1. Type of product. Include unique identifier for each product.
 2. Number and name of room or space.
 3. Location within room or space.
 4. Number of Copies: Submit three copies of product schedule or list, unless otherwise indicated. Architect will return two copies.
 - a. Mark up and retain one returned copy as a Project Record Document.
- F. Contractor's Construction Schedule: Comply with requirements specified in Division 1 for Construction Manager's action.
- G. Submittals Schedule: Comply with requirements specified in Division 1.
- H. Application for Payment: Comply with requirements specified in Division 1 Section "Payment Procedures."
- I. Schedule of Values: Comply with requirements specified in Division 1 Section "Payment Procedures."
- J. Subcontract List: Prepare a written summary identifying individuals or firms proposed for each portion of the Work, including those who are to furnish products or equipment fabricated to a special design. Include the following information in tabular form:
 1. Name, address, and telephone number of entity performing subcontract or supplying products.
 2. Number and title of related Specification Section(s) covered by subcontract.
 3. Drawing number and detail references, as appropriate, covered by subcontract.

4. Number of Copies: Submit three copies of subcontractor list, unless otherwise indicated. Architect will return two copies.
 - a. Mark up and retain one returned copy as a Project Record Document.

2.2 INFORMATIONAL SUBMITTALS

- A. General: Prepare and submit Informational Submittals required by other Specification Sections.
 1. Number of Copies: Submit one electronic copy.
 2. Certificates and Certifications: Provide a notarized statement that includes signature of entity responsible for preparing certification. Certificates and certifications shall be signed by an officer or other individual authorized to sign documents on behalf of that entity.
 3. Test and Inspection Reports: Comply with requirements specified in Division 1 Sections.
- B. Coordination Drawings: Comply with requirements specified in Division 1 Section "Project Management and Coordination."
- C. Contractor's Construction Schedule: Comply with requirements specified in Division 1 Sections.
- D. Qualification Data: Prepare written information that demonstrates capabilities and experience of firm or person. Include lists of completed projects with project names and addresses, names and addresses of architects and owners, and other information specified.
- E. Welding Certificates: Prepare written certification that welding procedures and personnel comply with requirements in the Contract Documents. Submit record of Welding Procedure Specification (WPS) and Procedure Qualification Record (PQR) on AWS forms. Include names of firms and personnel certified.
- F. Installer Certificates: Prepare written statements on manufacturer's letterhead certifying that Installer complies with requirements in the Contract Documents and, where required, is authorized by manufacturer for this specific Project.
- G. Manufacturer Certificates: Prepare written statements on manufacturer's letterhead certifying that manufacturer complies with requirements in the Contract Documents. Include evidence of manufacturing experience where required.
- H. Product Certificates: Prepare written statements on manufacturer's letterhead certifying that product complies with requirements in the Contract Documents.
- I. Material Certificates: Prepare written statements on manufacturer's letterhead certifying that material complies with requirements in the Contract Documents.

- J. Material Test Reports: Prepare reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting test results of material for compliance with requirements in the Contract Documents.
- K. Product Test Reports: Prepare written reports indicating current product produced by manufacturer complies with requirements in the Contract Documents. Base reports on evaluation of tests performed by manufacturer and witnessed by a qualified testing agency, or on comprehensive tests performed by a qualified testing agency.
- L. Research/Evaluation Reports: Prepare written evidence, from a model code organization acceptable to authorities having jurisdiction, that product complies with building code in effect for Project. Include the following information:
 - 1. Name of evaluation organization.
 - 2. Date of evaluation.
 - 3. Time period when report is in effect.
 - 4. Product and manufacturers' names.
 - 5. Description of product.
 - 6. Test procedures and results.
 - 7. Limitations of use.
- M. Schedule of Tests and Inspections: Comply with requirements specified in Division 1 Sections.
- N. Preconstruction Test Reports: Prepare reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of tests performed before installation of product, for compliance with performance requirements in the Contract Documents.
- O. Compatibility Test Reports: Prepare reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of compatibility tests performed before installation of product. Include written recommendations for primers and substrate preparation needed for adhesion.
- P. Field Test Reports: Prepare reports written by a qualified testing agency, on testing agency's standard form, indicating and interpreting results of field tests performed either during installation of product or after product is installed in its final location, for compliance with requirements in the Contract Documents.
- Q. Maintenance Data: Prepare written and graphic instructions and procedures for operation and normal maintenance of products and equipment. Comply with requirements specified in Division 1 Section "Operation and Maintenance Data."
- R. Design Data: Prepare written and graphic information, including, but not limited to, performance and design criteria, list of applicable codes and regulations, and calculations. Include list of assumptions and other performance and design criteria and a summary of loads. Include load diagrams if applicable. Provide name and version of software, if any, used for calculations. Include page numbers.

- S. **Manufacturer's Instructions:** Prepare written or published information that documents manufacturer's recommendations, guidelines, and procedures for installing or operating a product or equipment. Include name of product and name, address, and telephone number of manufacturer. Include the following, as applicable:
1. Preparation of substrates.
 2. Required substrate tolerances.
 3. Sequence of installation or erection.
 4. Required installation tolerances.
 5. Required adjustments.
 6. Recommendations for cleaning and protection.
- T. **Manufacturer's Field Reports:** Prepare written information documenting factory-authorized service representative's tests and inspections. Include the following, as applicable:
1. Name, address, and telephone number of factory-authorized service representative making report.
 2. Statement on condition of substrates and their acceptability for installation of product.
 3. Statement that products at Project site comply with requirements.
 4. Summary of installation procedures being followed, whether they comply with requirements and, if not, what corrective action was taken.
 5. Results of operational and other tests and a statement of whether observed performance complies with requirements.
 6. Statement whether conditions, products, and installation will affect warranty.
 7. Other required items indicated in individual Specification Sections.
- U. **Insurance Certificates and Bonds:** Prepare written information indicating current status of insurance or bonding coverage. Include name of entity covered by insurance or bond, limits of coverage, amounts of deductibles, if any, and term of the coverage.
- V. **Construction Photographs or Videotapes:** Comply with requirements specified in Division 1 Sections.
- W. **Material Safety Data Sheets (MSDSs):** Submit information directly to Owner; do not submit to Architect.
1. Architect will not review submittals that include MSDSs and will return the entire submittal for resubmittal.

2.3 DELEGATED DESIGN

- A. **Performance and Design Criteria:** Where professional design services or certifications by a design professional are specifically required of Contractor by the Contract

Documents, provide products and systems complying with specific performance and design criteria indicated.

1. If criteria indicated are not sufficient to perform services or certification required, submit a written request for additional information to Architect.
- B. Delegated-Design Submittal: In addition to Shop Drawings, Product Data, and other required submittals, submit three copies of a statement, signed and sealed by the responsible design professional, for each product and system specifically assigned to Contractor to be designed or certified by a design professional.
1. Indicate that products and systems comply with performance and design criteria in the Contract Documents. Include list of codes, loads, and other factors used in performing these services.

PART 3 - EXECUTION

3.1 CONTRACTOR'S REVIEW

- A. Review each submittal and check for coordination with other Work of the Contract and for compliance with the Contract Documents. Note corrections and field dimensions. Mark with approval stamp before submitting to Architect.
- B. Approval Stamp: Stamp each submittal with a uniform, approval stamp. Include Project name and location, submittal number, Specification Section title and number, name of reviewer, date of Contractor's approval, and statement certifying that submittal has been reviewed, checked, and approved for compliance with the Contract Documents.

3.2 ARCHITECT'S ACTION

- A. General: Architect will not review submittals that do not bear Contractor's approval stamp and will return them without action.
- B. Action Submittals: Architect will review each submittal, make marks to indicate corrections or modifications required, and return it. Architect will stamp each submittal with an action stamp and will mark stamp appropriately to indicate action taken, as follows:
- C. Informational Submittals: Architect will review each submittal and will not return it, or will return it if it does not comply with requirements. Architect will forward each submittal to appropriate party.
- D. Partial submittals are not acceptable, will be considered nonresponsive, and will be returned without review.

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1
NEW TRAINING FACILITY
34780 S. RANGE ROAD
SLIDELL LA 70460

- E. Submittals not required by the Contract Documents may not be reviewed and may be discarded.

END OF DOCUMENT 013300

SECTION 0140000
QUALITY REQUIREMENTS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes administrative and procedural requirements for quality assurance and quality control.
- B. Testing and inspecting services are required to verify compliance with requirements specified or indicated. These services do not relieve Contractor of responsibility for compliance with the Contract Document requirements.
 - 1. Specified tests, inspections, and related actions do not limit Contractor's other quality-assurance and -control procedures that facilitate compliance with the Contract Document requirements.
 - 2. Requirements for Contractor to provide quality-assurance and -control services required by Architect, Owner, or authorities having jurisdiction are not limited by provisions of this Section.
 - 3. Specific test and inspection requirements are not specified in this Section.

1.2 DEFINITIONS

- A. Quality-Assurance Services: Activities, actions, and procedures performed before and during execution of the Work to guard against defects and deficiencies and substantiate that proposed construction will comply with requirements.
- B. Quality-Control Services: Tests, inspections, procedures, and related actions during and after execution of the Work to evaluate that actual products incorporated into the Work and completed construction comply with requirements. Services do not include contract enforcement activities performed by Architect.
- C. Mockups: Full-size physical assemblies that are constructed on-site. Mockups are constructed to verify selections made under Sample submittals; to demonstrate aesthetic effects and, where indicated, qualities of materials and execution; to review coordination, testing, or operation; to show interface between dissimilar materials; and to demonstrate compliance with specified installation tolerances. Mockups are not Samples. Unless otherwise indicated, approved mockups establish the standard by which the Work will be judged.
 - 1. Laboratory Mockups: Full-size physical assemblies constructed at testing facility to verify performance characteristics.

- D. Preconstruction Testing: Tests and inspections performed specifically for Project before products and materials are incorporated into the Work, to verify performance or compliance with specified criteria.
- E. Product Testing: Tests and inspections that are performed by an NRTL, an NVLAP, or a testing agency qualified to conduct product testing and acceptable to authorities having jurisdiction, to establish product performance and compliance with specified requirements.
- F. Source Quality-Control Testing: Tests and inspections that are performed at the source, e.g., plant, mill, factory, or shop.
- G. Field Quality-Control Testing: Tests and inspections that are performed on-site for installation of the Work and for completed Work.
- H. Testing Agency: An entity engaged to perform specific tests, inspections, or both. Testing laboratory shall mean the same as testing agency.
- I. Installer/Applicator/Erector: Contractor or another entity engaged by Contractor as an employee, Subcontractor, or Sub-subcontractor, to perform a particular construction operation, including installation, erection, application, and similar operations.
 - 1. Use of trade-specific terminology in referring to a trade or entity does not require that certain construction activities be performed by accredited or unionized individuals, or that requirements specified apply exclusively to specific trade(s).
- J. Experienced: When used with an entity or individual, "experienced" means having successfully completed a minimum of five previous projects similar in nature, size, and extent to this Project; being familiar with special requirements indicated; and having complied with requirements of authorities having jurisdiction.

1.3 CONFLICTING REQUIREMENTS

- A. Referenced Standards: If compliance with two or more standards is specified and the standards establish different or conflicting requirements for minimum quantities or quality levels, comply with the most stringent requirement. Refer conflicting requirements that are different, but apparently equal, to Architect for a decision before proceeding.
- B. Minimum Quantity or Quality Levels: The quantity or quality level shown or specified shall be the minimum provided or performed. The actual installation may comply exactly with the minimum quantity or quality specified, or it may exceed the minimum within reasonable limits. To comply with these requirements, indicated numeric values are minimum or maximum, as appropriate, for the context of requirements. Refer uncertainties to Architect for a decision before proceeding.

1.4 INFORMATIONAL SUBMITTALS

- A. Contractor's Statement of Responsibility: When required by authorities having jurisdiction, submit copy of written statement of responsibility sent to authorities having jurisdiction before starting work on the following systems:
1. Seismic-force-resisting system, designated seismic system, or component listed in the designated seismic system quality-assurance plan prepared by Architect.
 2. Main wind-force-resisting system or a wind-resisting component listed in the wind-force-resisting system quality-assurance plan prepared by Architect.
- B. Testing Agency Qualifications: For testing agencies specified in "Quality Assurance" Article to demonstrate their capabilities and experience. Include proof of qualifications in the form of a recent report on the inspection of the testing agency by a recognized authority.

1.5 REPORTS AND DOCUMENTS

- A. Test and Inspection Reports: Prepare and submit certified written reports specified in other Sections. Include the following:
1. Date of issue.
 2. Project title and number.
 3. Name, address, and telephone number of testing agency.
 4. Dates and locations of samples and tests or inspections.
 5. Names of individuals making tests and inspections.
 6. Description of the Work and test and inspection method.
 7. Identification of product and Specification Section.
 8. Complete test or inspection data.
 9. Test and inspection results and an interpretation of test results.
 10. Record of temperature and weather conditions at time of sample taking and testing and inspecting.
 11. Comments or professional opinion on whether tested or inspected Work complies with the Contract Document requirements.
 12. Name and signature of laboratory inspector.
 13. Recommendations on retesting and reinspecting.
- B. Manufacturer's Field Reports: Prepare written information documenting tests and inspections specified in other Sections. Include the following:
1. Name, address, and telephone number of representative making report.
 2. Statement on condition of substrates and their acceptability for installation of product.
 3. Summary of installation procedures being followed, whether they comply with requirements and, if not, what corrective action was taken.
 4. Results of operational and other tests and a statement of whether observed performance complies with requirements.
 5. Other required items indicated in individual Specification Sections.

- C. Permits, Licenses, and Certificates: For Owner's records, submit copies of permits, licenses, certifications, inspection reports, releases, jurisdictional settlements, notices, receipts for fee payments, judgments, correspondence, records, and similar documents, established for compliance with standards and regulations bearing on performance of the Work.

1.6 QUALITY ASSURANCE

- A. General: Qualifications paragraphs in this article establish the minimum qualification levels required; individual Specification Sections specify additional requirements.
- B. Manufacturer Qualifications: A firm experienced in manufacturing products or systems similar to those indicated for this Project and with a record of successful in-service performance, as well as sufficient production capacity to produce required units.
- C. Fabricator Qualifications: A firm experienced in producing products similar to those indicated for this Project and with a record of successful in-service performance, as well as sufficient production capacity to produce required units.
- D. Installer Qualifications: A firm or individual experienced in installing, erecting, or assembling work similar in material, design, and extent to that indicated for this Project, whose work has resulted in construction with a record of successful in-service performance.
- E. Professional Engineer Qualifications: A professional engineer who is legally qualified to practice in jurisdiction where Project is located and who is experienced in providing engineering services of the kind indicated. Engineering services are defined as those performed for installations of the system, assembly, or product that are similar in material, design, and extent to those indicated for this Project.
- F. Specialists: Certain Specification Sections require that specific construction activities shall be performed by entities who are recognized experts in those operations. Specialists shall satisfy qualification requirements indicated and shall be engaged for the activities indicated.
 - 1. Requirements of authorities having jurisdiction shall supersede requirements for specialists.
- G. Testing Agency Qualifications: An NRTL, an NVLAP, or an independent agency with the experience and capability to conduct testing and inspecting indicated, as documented according to ASTM E 329; and with additional qualifications specified in individual Sections; and, where required by authorities having jurisdiction, that is acceptable to authorities.
 - 1. NRTL: A nationally recognized testing laboratory according to 29 CFR 1910.7.
 - 2. NVLAP: A testing agency accredited according to NIST's National Voluntary Laboratory Accreditation Program.

- H. **Manufacturer's Representative Qualifications:** An authorized representative of manufacturer who is trained and approved by manufacturer to observe and inspect installation of manufacturer's products that are similar in material, design, and extent to those indicated for this Project.

- I. **Preconstruction Testing:** Where testing agency is indicated to perform preconstruction testing for compliance with specified requirements for performance and test methods, comply with the following:
 - 1. Contractor responsibilities include the following:
 - a. Provide test specimens representative of proposed products and construction.
 - b. Submit specimens in a timely manner with sufficient time for testing and analyzing results to prevent delaying the Work.
 - c. Build laboratory mockups at testing facility using personnel, products, and methods of construction indicated for the completed Work.
 - d. When testing is complete, remove test specimens, assemblies, and mockups; do not reuse products on Project.

 - 2. **Testing Agency Responsibilities:** Submit a certified written report of each test, inspection, and similar quality-assurance service to Architect, with copy to Contractor. Interpret tests and inspections and state in each report whether tested and inspected work complies with or deviates from the Contract Documents.

- J. **Mockups:** Before installing portions of the Work requiring mockups, build mockups for each form of construction and finish required to comply with the following requirements, using materials indicated for the completed Work:
 - 1. Build mockups in location and of size indicated or, if not indicated, as directed by Architect.
 - 2. Notify Architect seven days in advance of dates and times when mockups will be constructed.
 - 3. Demonstrate the proposed range of aesthetic effects and workmanship.
 - 4. Obtain Architect's approval of mockups before starting work, fabrication, or construction.
 - a. Allow seven days for initial review and each re-review of each mockup.

 - 5. Maintain mockups during construction in an undisturbed condition as a standard for judging the completed Work.
 - 6. Demolish and remove mockups when directed unless otherwise indicated.

- K. **Laboratory Mockups:** Comply with requirements of preconstruction testing and those specified in individual Specification Sections.

1.7 QUALITY CONTROL

- A. Owner Responsibilities: Where quality-control services are indicated as Owner's responsibility, Owner will engage a qualified testing agency to perform these services.
1. Owner will furnish Contractor with names, addresses, and telephone numbers of testing agencies engaged and a description of types of testing and inspecting they are engaged to perform.
 2. Costs for retesting and reinspecting construction that replaces or is necessitated by work that failed to comply with the Contract Documents will be charged to Contractor.
- B. Contractor Responsibilities: Tests and inspections not explicitly assigned to Owner are Contractor's responsibility. Perform additional quality-control activities required to verify that the Work complies with requirements, whether specified or not.
1. Where services are indicated as Contractor's responsibility, engage a qualified testing agency to perform these quality-control services.
 - a. Contractor shall not employ same entity engaged by Owner, unless agreed to in writing by Owner.
 2. Notify testing agencies at least 48 hours in advance of time when Work that requires testing or inspecting will be performed.
 3. Where quality-control services are indicated as Contractor's responsibility, submit a certified written report, in duplicate, of each quality-control service.
 4. Testing and inspecting requested by Contractor and not required by the Contract Documents are Contractor's responsibility.
 5. Submit additional copies of each written report directly to authorities having jurisdiction, when they so direct.
- C. Manufacturer's Field Services: Where indicated, engage a manufacturer's representative to observe and inspect the Work. Manufacturer's representative's services include examination of substrates and conditions, verification of materials, inspection of completed portions of the Work, and submittal of written reports.
- D. Retesting/Reinspecting: Regardless of whether original tests or inspections were Contractor's responsibility, provide quality-control services, including retesting and reinspecting, for construction that replaced Work that failed to comply with the Contract Documents.
- E. Testing Agency Responsibilities: Cooperate with Architect, Construction Manager, and Contractor in performance of duties. Provide qualified personnel to perform required tests and inspections.
1. Notify Architect and Contractor promptly of irregularities or deficiencies observed in the Work during performance of its services.

2. Determine the location from which test samples will be taken and in which in-situ tests are conducted.
3. Conduct and interpret tests and inspections and state in each report whether tested and inspected work complies with or deviates from requirements.
4. Submit a certified written report, in duplicate, of each test, inspection, and similar quality-control service through Contractor.
5. Do not release, revoke, alter, or increase the Contract Document requirements or approve or accept any portion of the Work.
6. Do not perform any duties of Contractor.

F. Associated Services: Cooperate with agencies performing required tests, inspections, and similar quality-control services, and provide reasonable auxiliary services as requested. Notify agency sufficiently in advance of operations to permit assignment of personnel. Provide the following:

1. Access to the Work.
2. Incidental labor and facilities necessary to facilitate tests and inspections.
3. Adequate quantities of representative samples of materials that require testing and inspecting. Assist agency in obtaining samples.
4. Facilities for storage and field curing of test samples.
5. Delivery of samples to testing agencies.
6. Preliminary design mix proposed for use for material mixes that require control by testing agency.
7. Security and protection for samples and for testing and inspecting equipment at Project site.

G. Coordination: Coordinate sequence of activities to accommodate required quality-assurance and -control services with a minimum of delay and to avoid necessity of removing and replacing construction to accommodate testing and inspecting.

1. Schedule times for tests, inspections, obtaining samples, and similar activities.

1.8 SPECIAL TESTS AND INSPECTIONS

A. Special Tests and Inspections: Conducted by a qualified testing agency as required by authorities having jurisdiction, as indicated in individual Specification Sections, and as follows:

1. Verifying that manufacturer maintains detailed fabrication and quality-control procedures and reviews the completeness and adequacy of those procedures to perform the Work.
2. Notifying Architect and Contractor promptly of irregularities and deficiencies observed in the Work during performance of its services.
3. Submitting a certified written report of each test, inspection, and similar quality-control service to Architect with copy to Contractor and to authorities having jurisdiction.
4. Submitting a final report of special tests and inspections at Substantial Completion, which includes a list of unresolved deficiencies.

5. Interpreting tests and inspections and stating in each report whether tested and inspected work complies with or deviates from the Contract Documents.
6. Retesting and reinspecting corrected work.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION

3.1 TEST AND INSPECTION LOG

- A. Test and Inspection Log: Prepare a record of tests and inspections. Include the following:
 1. Date test or inspection was conducted.
 2. Description of the Work tested or inspected.
 3. Date test or inspection results were transmitted to Architect.
 4. Identification of testing agency or special inspector conducting test or inspection.
- B. Maintain log at Project site. Post changes and revisions as they occur. Provide access to test and inspection log for Architect's and Construction Manager's reference during normal working hours.

3.2 REPAIR AND PROTECTION

- A. General: On completion of testing, inspecting, sample taking, and similar services, repair damaged construction and restore substrates and finishes.
 1. Provide materials and comply with installation requirements specified in other Specification Sections or matching existing substrates and finishes. Restore patched areas and extend restoration into adjoining areas with durable seams that are as invisible as possible. Comply with the Contract Document requirements for cutting and patching in Section 017300 "Execution."
- B. Protect construction exposed by or for quality-control service activities.
- C. Repair and protection are Contractor's responsibility, regardless of the assignment of responsibility for quality-control services.

END OF SECTION 014000

SECTION 015000

TEMPORARY FACILITIES AND CONTROLS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes requirements for temporary utilities, support facilities, and security and protection facilities.

1.3 DEFINITIONS

- A. Permanent Enclosure: As determined by Architect, permanent or temporary roofing is complete, insulated, and weathertight; exterior walls are insulated and weathertight; and all openings are closed with permanent construction or substantial temporary closures.

1.4 USE CHARGES

- A. General: Cost or use charges for temporary facilities shall be included in the Contract Sum. Allow other entities to use temporary services and facilities without cost, including, but not limited to, Owner's construction forces, Architect, testing agencies, and authorities having jurisdiction.

1.5 SUBMITTALS

- A. Site Plan: Show temporary facilities, utility hookups, staging areas, and parking areas for construction personnel.

1.6 QUALITY ASSURANCE

- A. Electric Service: Comply with NECA, NEMA, and UL standards and regulations for temporary electric service. Install service to comply with NFPA 70.
- B. Tests and Inspections: Arrange for authorities having jurisdiction to test and inspect each temporary utility before use. Obtain required certifications and permits.

1.7 PROJECT CONDITIONS

- A. Temporary Use of Permanent Facilities: Installer of each permanent service shall assume responsibility for operation, maintenance, and protection of each permanent service during its use as a construction facility before Owner's acceptance, regardless of previously assigned responsibilities.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Pavement: Comply with Division 2 Section "Cement Concrete Pavement."
- B. Chain-Link Fencing: Minimum 2-inch , 0.148-inch-thick, galvanized steel, chain-link fabric fencing; minimum 6 feet high with galvanized steel pipe posts; minimum 2-3/8-inch- OD line posts and 2-7/8-inch- OD corner and pull posts, with 1-5/8-inch-OD top rails.
- C. Portable Chain-Link Fencing: Minimum 2-inch , 9-gage, galvanized steel, chain-link fabric fencing; minimum 6 feet high with galvanized steel pipe posts; minimum 2-3/8-inch- OD line posts and 2-7/8-inch- OD corner and pull posts, with 1-5/8-inch-OD top and bottom rails. Provide concrete or galvanized steel bases for supporting posts.
- D. Lumber and Plywood: Comply with requirements in Division 6 Section "Rough Carpentry."

2.2 TEMPORARY FACILITIES

- A. Drinking water and portable toilet facility.
- B. Storage and Fabrication Sheds: Provide sheds sized, furnished, and equipped to accommodate materials and equipment for construction operations.
 - A. Store combustible materials apart from building.

2.3 EQUIPMENT

- A. Fire Extinguishers: Portable, UL rated; with class and extinguishing agent as required by locations and classes of fire exposures.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Locate facilities where they will serve Project adequately and result in minimum interference with performance of the Work. Relocate and modify facilities as required by progress of the Work.
 - A. Locate facilities to limit site disturbance as specified in Division 1 Section "Summary."
- B. Provide each facility ready for use when needed to avoid delay. Do not remove until facilities are no longer needed or are replaced by authorized use of completed permanent facilities.
- C. Electric Power Service: Provide electric power service and distribution system of sufficient size, capacity, and power characteristics required for construction operations.

3.2 SUPPORT FACILITIES INSTALLATION

- A. Parking: Provide temporary parking areas for construction personnel.
- B. Dewatering Facilities and Drains: Comply with requirements of authorities having jurisdiction. Maintain Project site, excavations, and construction free of water.
 - A. Dispose of rainwater in a lawful manner that will not result in flooding Project or adjoining properties nor endanger permanent Work or temporary facilities.
 - B. Remove snow and ice as required to minimize accumulations.
- C. Project Identification and Temporary Signs: Provide Project identification and other signs. Install signs where indicated to inform public and individuals seeking entrance to Project. Unauthorized signs are not permitted.
 - A. Provide temporary, directional signs for construction personnel and visitors.
 - B. Maintain and touchup signs so they are legible at all times.
- D. Waste Disposal Facilities: Provide waste-collection containers in sizes adequate to handle waste from construction operations. Comply with requirements of authorities having jurisdiction.
- E. Lifts and Hoists: Provide facilities necessary for hoisting materials and personnel.
 - A. Truck cranes and similar devices used for hoisting materials are considered "tools and equipment" and not temporary facilities.

- F. Temporary Stairs: Until permanent stairs are available, provide temporary stairs where ladders are not adequate.

3.3 SECURITY AND PROTECTION FACILITIES INSTALLATION

- A. Environmental Protection: Provide protection, operate temporary facilities, and conduct construction in ways and by methods that comply with environmental regulations and that minimize possible air, waterway, and subsoil contamination or pollution or other undesirable effects.
 - A. Comply with work restrictions specified in Division 1 Section "Summary."
- B. Temporary Erosion and Sedimentation Control: Comply with requirements specified in Division 2 Section "Site Clearing."
- C. Temporary Erosion and Sedimentation Control: Provide measures to prevent soil erosion and discharge of soil-bearing water runoff and airborne dust to adjacent properties and walkways, according to requirements of authorities having jurisdiction.
 - A. Inspect, repair, and maintain erosion- and sedimentation-control measures during construction until permanent vegetation has been established.
- D. Stormwater Control: Comply with authorities having jurisdiction. Provide barriers in and around excavations and subgrade construction to prevent flooding by runoff of stormwater from heavy rains.
- E. Pest Control: Engage pest-control service to recommend practices to minimize attraction and harboring of rodents, roaches, and other pests and to perform extermination and control procedures at regular intervals so Project will be free of pests and their residues at Substantial Completion. Obtain extended warranty for Owner. Perform control operations lawfully, using environmentally safe materials.
- F. Site Enclosure Fence: Before construction operations begin, furnish and install site enclosure fence in a manner that will prevent people and animals from easily entering site except by entrance gates.
 - A. Extent of Fence: As required to enclose entire Project site or portion determined sufficient to accommodate construction operations.
 - B. Maintain security by limiting number of keys and restricting distribution to authorized personnel. Provide Owner with one set of keys.
- G. Security Enclosure and Lockup: Install substantial temporary enclosure around partially completed areas of construction. Provide lockable entrances to prevent unauthorized entrance, vandalism, theft, and similar violations of security.

- H. Barricades, Warning Signs, and Lights: Comply with requirements of authorities having jurisdiction for erecting structurally adequate barricades, including warning signs and lighting.
- I. Temporary Enclosures: Provide temporary enclosures for protection of construction, in progress and completed, from exposure, foul weather, other construction operations, and similar activities. Provide temporary weathertight enclosure for building exterior.
 - A. Where heating or cooling is needed and permanent enclosure is not complete, insulate temporary enclosures.
- J. Temporary Fire Protection: Install and maintain temporary fire-protection facilities of types needed to protect against reasonably predictable and controllable fire losses. Comply with NFPA 241.
 - A. Prohibit smoking in hazardous fire-exposure areas.
 - B. Supervise welding operations, combustion-type temporary heating units, and similar sources of fire ignition according to requirements of authorities having jurisdiction.
 - C. Develop and supervise an overall fire-prevention and -protection program for personnel at Project site. Review needs with local fire department and establish procedures to be followed. Instruct personnel in methods and procedures. Post warnings and information.
 - D. Provide temporary standpipes and hoses for fire protection. Hang hoses with a warning sign stating that hoses are for fire-protection purposes only and are not to be removed. Match hose size with outlet size and equip with suitable nozzles.

3.4 OPERATION, TERMINATION, AND REMOVAL

- A. Supervision: Enforce strict discipline in use of temporary facilities. To minimize waste and abuse, limit availability of temporary facilities to essential and intended uses.
- B. Maintenance: Maintain facilities in good operating condition until removal.
- C. Operate Project-identification-sign lighting daily from dusk until 12:00 midnight.
- D. Temporary Facility Changeover: Do not change over from using temporary security and protection facilities to permanent facilities until Substantial Completion.
- E. Termination and Removal: Remove each temporary facility when need for its service has ended, when it has been replaced by authorized use of a permanent facility, or no later than Substantial Completion. Complete or, if necessary, restore permanent construction that may have been delayed because of interference with temporary facility. Repair damaged Work, clean exposed surfaces, and replace construction that cannot be satisfactorily repaired.

- A. Materials and facilities that constitute temporary facilities are property of Contractor. Owner reserves right to take possession of Project identification signs.
- B. At Substantial Completion, clean and renovate permanent facilities used during construction period. Comply with final cleaning requirements specified in Division 1 Section "Closeout Procedures."

END OF DOCUMENT 015000

SECTION 015813

PROJECT IDENTIFICATION SIGN

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes: Project Identification Sign

PART 2 - PRODUCTS

2.1 SIGN MATERIAL

- A. Graphic Design, Content, Colors, Lettering Style: See attached sketch.
- B. Sign Size: nominal 4 feet by 8 feet.
- C. Quantity: Provide 2 Project identification signs.
- D. Support Structure, Framing, and Trim: All pressure treated, sizes as specified on sign detail at end of this Section.
- E. Paint and Primers: Exterior quality, gloss alkyd enamel, two coats, paints shall be approved by Architect.
1. One coat primer: Exterior Alkyd Wood Primer:
 - a. Sherwin Williams: Exterior Oil Wood Primer, A-100.
 2. Two topcoats: Exterior Alkyd Enamel (Gloss): (Gloss Level 6).
 - a. Sherwin Williams; Seaguard 1000 Marine Enamel, Industrial & Marine.
 - b. Color shall be Sherwin Williams SW 6524 "Commodor" or approved equal.
- F. Concrete: Concrete for sign post footings shall be minimum 3,000 psi. Comply with ASTM C 94; ACI 301, "Specification for Structural Concrete"; ACI 117, "Specifications for Tolerances for Concrete Construction and Materials"; and CRSI's "Manual of Standard Practice."
- G. Fasteners: Fasten sign with stainless steel screws and stainless steel cup washers. All other fasteners and accessories shall be hot dip galvanized.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install Project identification signs within 30 days after date fixed by Notice to Proceed.
- B. Erect Project identification signs in locations as directed by Architect.
- C. Install signs plumb and level. Anchor securely.
- D. Paint all exposed surfaces of sign, supports, and framing according to manufacturer's and MPI's recommendations.


3.2 MAINTENANCE


- A. Maintain signs and supports and keep clean. Repair damage. Replace deteriorated signs during course of project as directed by Architect.

3.3 REMOVAL

- A. Remove signs, framing, supports and foundation at completion of Project and restore the area.

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1
 NEW TRAINING FACILITY
 34780 S. RANGE ROAD
 SLIDELL LA 70460

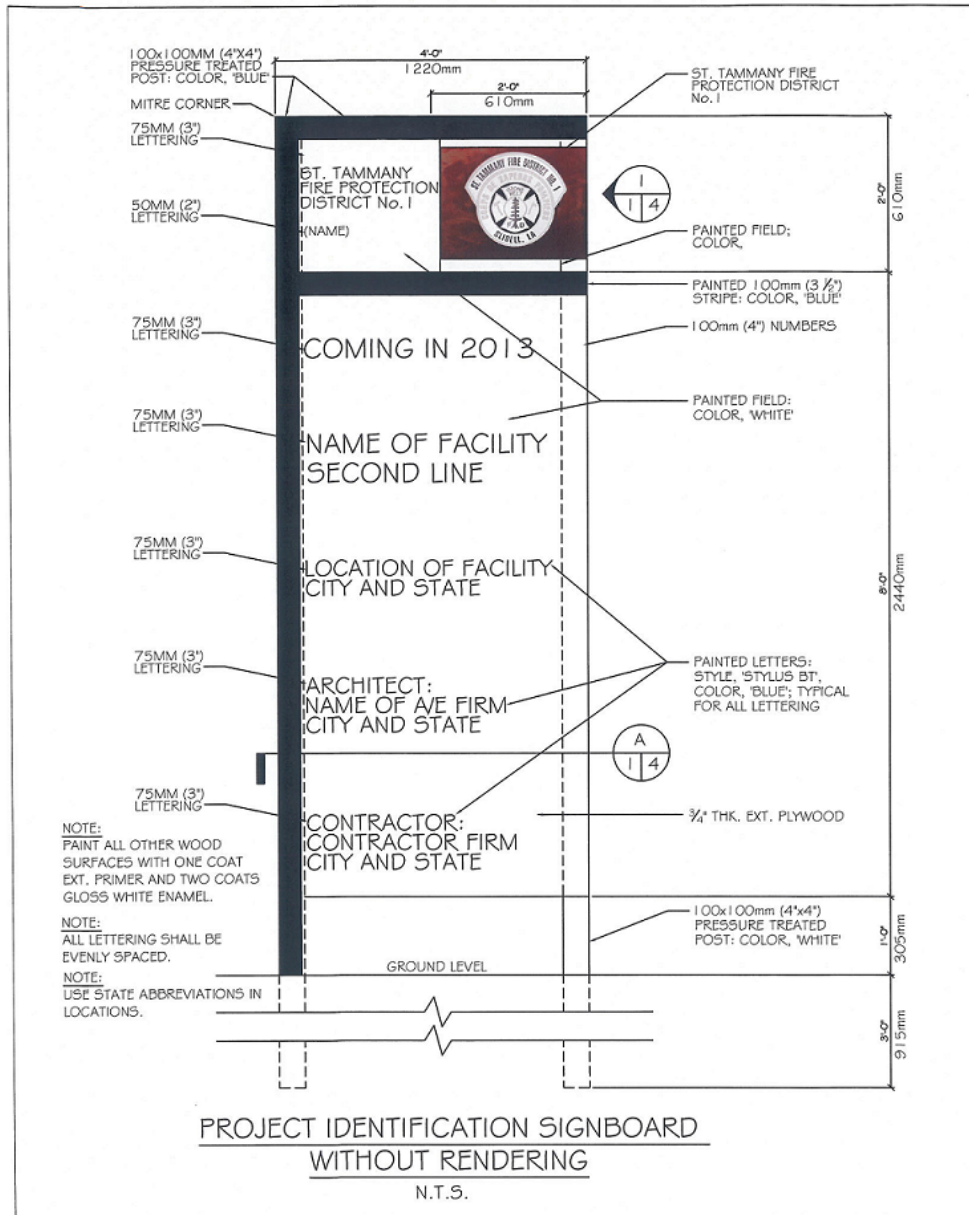

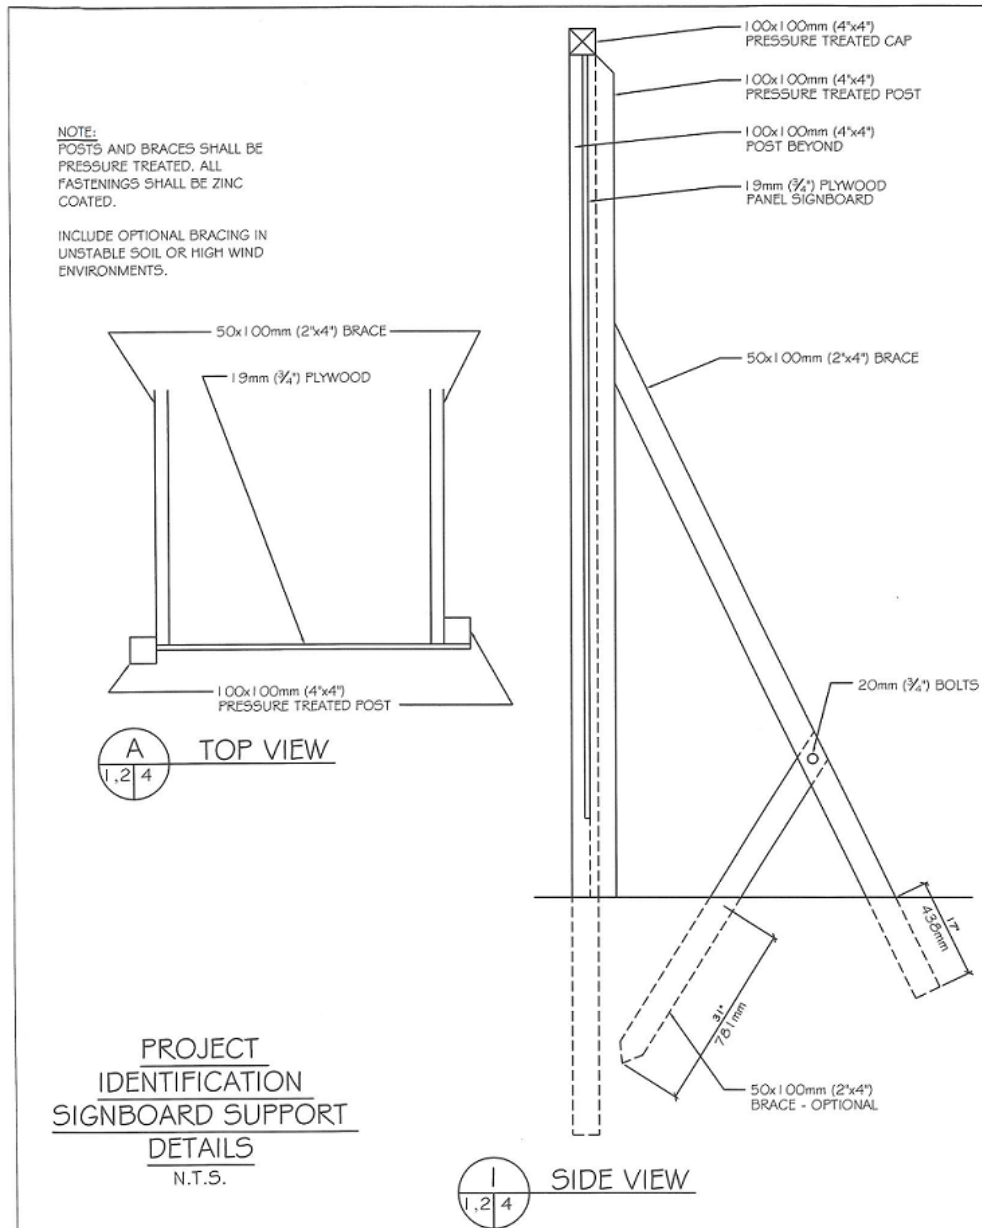

END OF DOCUMENT 015813

SECTION 016000
PRODUCT REQUIREMENTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for selection of products for use in Project; product delivery, storage, and handling; manufacturers' standard warranties on products; special warranties; product substitutions; and comparable products.

1.3 DEFINITIONS

- A. Products: Items purchased for incorporating into the Work, whether purchased for Project or taken from previously purchased stock. The term "product" includes the terms "material," "equipment," "system," and terms of similar intent.
 - 1. Named Products: Items identified by manufacturer's product name, including make or model number or other designation shown or listed in manufacturer's published product literature, that is current as of date of the Contract Documents.
 - 2. New Products: Items that have not previously been incorporated into another project or facility, except that products consisting of recycled-content materials are allowed, unless explicitly stated otherwise. Products salvaged or recycled from other projects are not considered new products.
 - 3. Comparable Product: Product that is demonstrated and approved through submittal process, or where indicated as a product substitution, to have the indicated qualities related to type, function, dimension, in-service performance, physical properties, appearance, and other characteristics that equal or exceed those of specified product.
- B. Substitutions: Changes in products, materials, equipment, and methods of construction from those required by the Contract Documents and proposed by Contractor.

- C. Basis-of-Design Product Specification: Where a specific manufacturer's product is named and accompanied by the words "basis of design," including make or model number or other designation, to establish the significant qualities related to type, function, dimension, in-service performance, physical properties, appearance, and other characteristics for purposes of evaluating comparable products of other named manufacturers.

1.4 SUBMITTALS

- A. Product List: Submit a list, in tabular form, showing specified products. Include generic names of products required. Include manufacturer's name and proprietary product names for each product.
1. Coordinate product list with Contractor's Construction Schedule and the Submittals Schedule.
 2. Form: Tabulate information for each product under the following column headings:
 - a. Specification Section number and title.
 - b. Generic name used in the Contract Documents.
 - c. Proprietary name, model number, and similar designations.
 - d. Manufacturer's name and address.
 - e. Supplier's name and address.
 - f. Installer's name and address.
 - g. Projected delivery date or time span of delivery period.
 - h. Identification of items that require early submittal approval for scheduled delivery date.
 3. Initial Submittal: Within 15 calendar days after date of commencement of the Work, submit 3 copies of initial product list. Include a written explanation for omissions of data and for variations from Contract requirements.
 - a. At Contractor's option, initial submittal may be limited to product selections and designations that must be established early in Contract period.
 4. Completed List: Within 30 calendar days after date of commencement of the Work, submit 3 copies of completed product list. Include a written explanation for omissions of data and for variations from Contract requirements.
 5. Architect's Action: Architect will respond in writing to Contractor within 14 business days of receipt of completed product list. Architect's response will include a list of unacceptable product selections and a brief explanation of reasons for this action. Architect's response, or lack of response, does not constitute a waiver of requirement to comply with the Contract Documents.
- B. Substitution Requests: Submit one electronic copy of each request for consideration. Identify product or fabrication or installation method to be replaced. Include Specification Section number and title and Drawing numbers and titles.

1. Substitution Request Form: Use CSI Form 13.1A.
2. Documentation: Show compliance with requirements for substitutions and the following, as applicable:
 - a. Statement indicating why specified material or product cannot be provided.
 - b. Coordination information, including a list of changes or modifications needed to other parts of the Work and to construction performed by Owner and separate contractors, that will be necessary to accommodate proposed substitution.
 - c. Detailed comparison of significant qualities of proposed substitution with those of the Work specified. Significant qualities may include attributes such as performance, weight, size, durability, visual effect, and specific features and requirements indicated.
 - d. Product Data, including drawings and descriptions of products and fabrication and installation procedures.
 - e. Samples, where applicable or requested.
 - f. List of similar installations for completed projects with project names and addresses and names and addresses of architects and owners.
 - g. Material test reports from a qualified testing agency indicating and interpreting test results for compliance with requirements indicated.
 - h. Research/evaluation reports evidencing compliance with building code in effect for Project, from a model code organization acceptable to authorities having jurisdiction.
 - i. Detailed comparison of Contractor's Construction Schedule using proposed substitution with products specified for the Work, including effect on the overall Contract Time. If specified product or method of construction cannot be provided within the Contract Time, include letter from manufacturer, on manufacturer's letterhead, stating lack of availability or delays in delivery.
 - j. Cost information, including a proposal of change, if any, in the Contract Sum.
 - k. Contractor's certification that proposed substitution complies with requirements in the Contract Documents and is appropriate for applications indicated.
 - l. Contractor's waiver of rights to additional payment or time that may subsequently become necessary because of failure of proposed substitution to produce indicated results.
3. Architect's Action: If necessary, Architect will request additional information or documentation for evaluation within 7 calendar days of receipt of a request for substitution. Architect will notify Contractor of acceptance or rejection of proposed substitution within 15 calendar days of receipt of request, or 7 calendar days of receipt of additional information or documentation, whichever is later.
 - a. Form of Acceptance: Change Order.
 - b. Use product specified if Architect cannot make a decision on use of a proposed substitution within time allocated.

- C. Comparable Product Requests: Submit one electronic copy of each request for consideration. Identify product or fabrication or installation method to be replaced. Include Specification Section number and title and Drawing numbers and titles.
 - 1. Architect's Action: If necessary, Architect will request additional information or documentation for evaluation within one week of receipt of a comparable product request. Architect will notify Contractor[through Construction Manager] of approval or rejection of proposed comparable product request within [15] <Insert time> days of receipt of request, or [7] <Insert time> days of receipt of additional information or documentation, whichever is later.
 - a. Form of Approval: As specified in Division 01 Section "Submittal Procedures."
 - b. Use product specified if Architect cannot make a decision on use of a comparable product request within time allocated.
- D. Basis-of-Design Product Specification Submittal: Comply with requirements in Division 01 Section "Submittal Procedures." Show compliance with requirements.

1.5 QUALITY ASSURANCE

- A. Compatibility of Options: If Contractor is given option of selecting between two or more products for use on Project, product selected shall be compatible with products previously selected, even if previously selected products were also options.
 - 1. Each contractor is responsible for providing products and construction methods compatible with products and construction methods of other contractors.
 - 2. If a dispute arises between contractors over concurrently selectable but incompatible products, Architect will determine which products shall be used.

1.6 PRODUCT DELIVERY, STORAGE, AND HANDLING

- A. Deliver, store, and handle products using means and methods that will prevent damage, deterioration, and loss, including theft. Comply with manufacturer's written instructions.
- B. Delivery and Handling:
 - 1. Schedule delivery to minimize long-term storage at Project site and to prevent overcrowding of construction spaces.
 - 2. Coordinate delivery with installation time to ensure minimum holding time for items that are flammable, hazardous, easily damaged, or sensitive to deterioration, theft, and other losses.
 - 3. Deliver products to Project site in an undamaged condition in manufacturer's original sealed container or other packaging system, complete with labels and instructions for handling, storing, unpacking, protecting, and installing.

4. Inspect products on delivery to ensure compliance with the Contract Documents and to ensure that products are undamaged and properly protected.

C. Storage:

1. Store products to allow for inspection and measurement of quantity or counting of units.
2. Store materials in a manner that will not endanger Project structure.
3. Store products that are subject to damage by the elements, under cover in a weathertight enclosure above ground, with ventilation adequate to prevent condensation.
4. Store cementitious products and materials on elevated platforms.
5. Store foam plastic from exposure to sunlight, except to extent necessary for period of installation and concealment.
6. Comply with product manufacturer's written instructions for temperature, humidity, ventilation, and weather-protection requirements for storage.
7. Protect stored products from damage and liquids from freezing.
8. Provide a secure location and enclosure at Project site for storage of materials and equipment by Owner's construction forces. Coordinate location with Owner.

1.7 PRODUCT WARRANTIES

- A. Warranties specified in other Sections shall be in addition to, and run concurrent with, other warranties required by the Contract Documents. Manufacturer's disclaimers and limitations on product warranties do not relieve Contractor of obligations under requirements of the Contract Documents.
1. Manufacturer's Warranty: Preprinted written warranty published by individual manufacturer for a particular product and specifically endorsed by manufacturer to Owner.
 2. Special Warranty: Written warranty required by or incorporated into the Contract Documents, either to extend time limit provided by manufacturer's warranty or to provide more rights for Owner.
- B. Special Warranties: Prepare a written document that contains appropriate terms and identification, ready for execution. Submit a draft for approval before final execution.
1. Manufacturer's Standard Form: Modified to include Project-specific information and properly executed.
 2. Specified Form: When specified forms are included with the Specifications, prepare a written document using appropriate form properly executed.
 3. Refer to Divisions 02 through 49 Sections for specific content requirements and particular requirements for submitting special warranties.
- C. Submittal Time: Comply with requirements in Division 01 Section "Closeout Procedures."

PART 2 - PRODUCTS

2.1 PRODUCT SELECTION PROCEDURES

- A. General Product Requirements: Provide products that comply with the Contract Documents, that are undamaged and, unless otherwise indicated, that are new at time of installation.
1. Provide products complete with accessories, trim, finish, fasteners, and other items needed for a complete installation and indicated use and effect.
 2. Standard Products: If available, and unless custom products or nonstandard options are specified, provide standard products of types that have been produced and used successfully in similar situations on other projects.
 3. Owner reserves the right to limit selection to products with warranties not in conflict with requirements of the Contract Documents.
 4. Where products are accompanied by the term "as selected," Architect will make selection.
 5. Where products are accompanied by the term "match sample," sample to be matched is Architect's.
 6. Descriptive, performance, and reference standard requirements in the Specifications establish "salient characteristics" of products.
 7. Or Equal: Where products are specified by name and accompanied by the term "or equal" or "or approved equal" or "or approved," comply with provisions in Part 2 "Comparable Products" Article to obtain approval for use of an unnamed product.
- B. Product Selection Procedures:
1. Product: Where Specifications name a single product and manufacturer, provide the named product that complies with requirements.
 2. Manufacturer/Source: Where Specifications name a single manufacturer or source, provide a product by the named manufacturer or source that complies with requirements.
 3. Products: Where Specifications include a list of names of both products and manufacturers, provide one of the products listed that complies with requirements.
 4. Manufacturers: Where Specifications include a list of manufacturers' names, provide a product by one of the manufacturers listed that complies with requirements.
 5. Available Products: Where Specifications include a list of names of both products and manufacturers, provide one of the products listed, or an unnamed product, that complies with requirements. Comply with provisions in Part 2 "Comparable Products" Article for consideration of an unnamed product.
 6. Available Manufacturers: Where Specifications include a list of manufacturers, provide a product by one of the manufacturers listed, or an unnamed manufacturer, that complies with requirements. Comply with provisions in Part 2 "Comparable Products" Article for consideration of an unnamed product.

7. Product Options: Where Specifications indicate that sizes, profiles, and dimensional requirements on Drawings are based on a specific product or system, provide the specified product or system. Comply with provisions in Part 2 "Product Substitutions" Article for consideration of an unnamed product or system.
8. Basis-of-Design Product: Where Specifications name a product and include a list of manufacturers, provide the specified product or a comparable product by one of the other named manufacturers. Drawings and Specifications indicate sizes, profiles, dimensions, and other characteristics that are based on the product named. Comply with provisions in Part 2 "Comparable Products" Article for consideration of an unnamed product by the other named manufacturers.
9. Visual Matching Specification: Where Specifications require matching an established Sample, select a product that complies with requirements and matches Architect's sample. Architect's decision will be final on whether a proposed product matches.
 - a. If no product available within specified category matches and complies with other specified requirements, comply with provisions in Part 2 "Product Substitutions" Article for proposal of product.
10. Visual Selection Specification: Where Specifications include the phrase "as selected from manufacturer's colors, patterns, textures" or a similar phrase, select a product that complies with other specified requirements.
 - a. Standard Range: Where Specifications include the phrase "standard range of colors, patterns, textures" or similar phrase, Architect will select color, pattern, density, or texture from manufacturer's product line that does not include premium items.
 - b. Full Range: Where Specifications include the phrase "full range of colors, patterns, textures" or similar phrase, Architect will select color, pattern, density, or texture from manufacturer's product line that includes both standard and premium items.

2.2 PRODUCT SUBSTITUTIONS

- A. Timing: Architect will consider requests for substitution if received within 60 calendar days after the Notice of Award. Requests received after that time will be rejected.
- B. Conditions: Architect will consider Contractor's request for substitution when the following conditions are satisfied. If the following conditions are not satisfied, Architect will return requests without action, except to record noncompliance with these requirements:
 1. Requested substitution offers Owner a substantial advantage in cost, time, energy conservation, or other considerations, after deducting additional responsibilities Owner must assume. Owner's additional responsibilities may

- include compensation to Architect for redesign and evaluation services, increased cost of other construction by Owner, and similar considerations.
2. Requested substitution does not require extensive revisions to the Contract Documents.
 3. Requested substitution is consistent with the Contract Documents and will produce indicated results.
 4. Substitution request is fully documented and properly submitted.
 5. Requested substitution will not adversely affect Contractor's Construction Schedule.
 6. Requested substitution has received necessary approvals of authorities having jurisdiction.
 7. Requested substitution is compatible with other portions of the Work.
 8. Requested substitution has been coordinated with other portions of the Work.
 9. Requested substitution provides specified warranty.
 10. If requested substitution involves more than one contractor, requested substitution has been coordinated with other portions of the Work, is uniform and consistent, is compatible with other products, and is acceptable to all contractors involved.

2.3 COMPARABLE PRODUCTS

- A. Conditions: Architect will consider Contractor's request for comparable product when the following conditions are satisfied. If the following conditions are not satisfied, Architect will return requests without action, except to record noncompliance with these requirements:
1. Evidence that the proposed product does not require extensive revisions to the Contract Documents, that it is consistent with the Contract Documents and will produce the indicated results, and that it is compatible with other portions of the Work.
 2. Detailed comparison of significant qualities of proposed product with those named in the Specifications. Significant qualities include attributes such as performance, weight, size, durability, visual effect, and specific features and requirements indicated.
 3. Evidence that proposed product provides specified warranty.
 4. List of similar installations for completed projects with project names and addresses and names and addresses of architects and owners, if requested.
 5. Samples, if requested.

PART 3 - EXECUTION (Not Used)

END OF SECTION 016000

SECTION 017300

EXECUTION

PART 1 - GENERAL

1. SUMMARY

A. Section includes general administrative and procedural requirements governing execution of the Work including, but not limited to, the following:

1. Construction layout.
2. Field engineering and surveying.
3. Installation of the Work.
4. Cutting and patching.
5. Coordination of Owner-installed products.
6. Progress cleaning.
7. Starting and adjusting.
8. Protection of installed construction.

B. Related Requirements:

1. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.
2. Section 01770 "Closeout Procedures" for submitting final property survey with Project Record Documents, recording of Owner-accepted deviations from indicated lines and levels, and final cleaning.
3. Section 07841 "Penetration Firestopping" for patching penetrations in fire-rated construction.

2. SUBMITTALS

A. Cutting and Patching Proposal: Submit a proposal describing procedures at least 10 days before the time cutting and patching will be performed, requesting approval to proceed. Include the following information:

1. Extent: Describe cutting and patching, show how they will be performed, and indicate why they cannot be avoided.
2. Changes to In-Place Construction: Describe anticipated results. Include changes to structural elements and operating components as well as changes in building's appearance and other significant visual elements
3. Products: List products to be used and firms or entities that will perform the Work.
4. Dates: Indicate when cutting and patching will be performed.
5. Utility Services and Mechanical/Electrical Systems: List services/systems that cutting and patching procedures will disturb or affect. List services/systems

that will be relocated and those that will be temporarily out of service. Indicate how long services/systems will be disrupted.

6. Structural Elements: Where cutting and patching involve adding reinforcement to structural elements, submit details and engineering calculations showing integration of reinforcement with original structure.
7. Architect's Approval: Obtain approval of cutting and patching proposal before cutting and patching. Approval does not waive right to later require removal and replacement of unsatisfactory work.

3. INFORMATIONAL SUBMITTALS

- A. Certificates: Submit certificate signed by land surveyor certifying that location and elevation of improvements comply with requirements.
- B. Landfill Receipts: Submit copy of receipts issued by a landfill facility, licensed to accept hazardous materials, for hazardous waste disposal.
- C. Certified Surveys: Submit two copies signed by land surveyor.
- D. Final Property Survey: Submit 10 copies showing the Work performed and record survey data.

4. QUALITY ASSURANCE

- A. Land Surveyor Qualifications: A professional land surveyor who is legally qualified to practice in jurisdiction where Project is located and who is experienced in providing land-surveying services of the kind indicated.
- B. Cutting and Patching: Comply with requirements for and limitations on cutting and patching of construction elements.
 1. Structural Elements: When cutting and patching structural elements, notify Architect of locations and details of cutting and await directions from Architect before proceeding. Shore, brace, and support structural element during cutting and patching. Do not cut and patch structural elements in a manner that could change their load-carrying capacity or increase deflection.
 2. Operational Elements: Do not cut and patch operating elements and related components in a manner that results in reducing their capacity to perform as intended or that results in increased maintenance or decreased operational life or safety.
 - a. Primary operational systems and equipment.
 - b. Air or smoke barriers.
 - c. Fire-suppression systems.
 - d. Mechanical systems piping and ducts.
 - e. Control systems.
 - f. Communication systems.
 - g. Conveying systems.
 - h. Electrical wiring systems.

- i. Operating systems of special construction in Division 13 Sections.
 - j. Security systems.
3. Other Construction Elements: Do not cut and patch other construction elements or components in a manner that could change their load-carrying capacity, that results in reducing their capacity to perform as intended, or that results in increased maintenance or decreased operational life or safety.
 - a. Water, moisture, or vapor barriers.
 - b. Membranes and flashings.
 - c. Exterior curtain-wall construction.
 - d. Equipment supports.
 - e. Piping, ductwork, vessels, and equipment.
 - f. Noise- and vibration-control elements and systems.
4. Visual Elements: Do not cut and patch construction in a manner that results in visual evidence of cutting and patching. Do not cut and patch exposed construction in a manner that would, in Architect's opinion, reduce the building's aesthetic qualities. Remove and replace construction that has been cut and patched in a visually unsatisfactory manner.
5. Cutting and Patching Conference: Before proceeding, meet at Project site with parties involved in cutting and patching, including mechanical and electrical trades. Review areas of potential interference and conflict. Coordinate procedures and resolve potential conflicts before proceeding.

PART 2 - PRODUCTS

1. MATERIALS

- A. General: Comply with requirements specified in other Sections.
- B. In-Place Materials: Use materials for patching identical to in-place materials. For exposed surfaces, use materials that visually match in-place adjacent surfaces to the fullest extent possible.
 1. If identical materials are unavailable or cannot be used, use materials that, when installed, will provide a match acceptable to Architect for the visual and functional performance of in-place materials.

PART 3 - EXECUTION

1. EXAMINATION

- A. Existing Conditions: The existence and location of underground and other utilities and construction indicated as existing are not guaranteed. Before beginning site-work, investigate and verify the existence and location of underground utilities, and other construction affecting the Work.

1. Before construction, verify the location and invert elevation at points of connection of sanitary sewer, storm sewer, and water-service piping; underground electrical services, natural gas and other utilities.
 2. Furnish location data for work related to Project that must be performed by public utilities serving Project site.
- B. Examine surfaces to be cut and patched and conditions under which cutting and patching are to be performed.
1. Compatibility: Before patching, verify compatibility with and suitability of substrates, including compatibility with in-place finishes or primers.
- C. Examination and Acceptance of Conditions: Before proceeding with each component of the Work, examine substrates, areas, and conditions, with Installer or Applicator present where indicated, for compliance with requirements for installation tolerances and other conditions affecting performance. Record observations.
1. Examine roughing-in for mechanical and electrical systems to verify actual locations of connections before equipment and fixture installation.
 2. Examine walls, floors, and roofs for suitable conditions where products and systems are to be installed.
 3. Verify compatibility with and suitability of substrates, including compatibility with existing finishes or primers.
- D. Proceed with installation only after unsatisfactory conditions have been corrected. Proceeding with the Work indicates acceptance of surfaces and conditions.
2. PREPARATION
- A. Existing Utility Information: Furnish information to Owner and Architect that is necessary to adjust, move, or relocate existing utility structures, utility poles, lines, services, or other utility appurtenances located in or affected by construction. Coordinate with authorities having jurisdiction.
- B. Field Measurements: Take field measurements as required to fit the Work properly. Recheck measurements before installing each product. Where portions of the Work are indicated to fit to other construction, verify dimensions of other construction by field measurements before fabrication. Coordinate fabrication schedule with construction progress to avoid delaying the Work.
- C. Space Requirements: Verify space requirements and dimensions of items shown diagrammatically on Drawings.
- D. Review of Contract Documents and Field Conditions: Immediately on discovery of the need for clarification of the Contract Documents caused by differing field conditions outside the control of Contractor, submit a request for information to Architect according to requirements in Section 01310 "Project Management and Coordination."

3. CONSTRUCTION LAYOUT

- A. Verification: Before proceeding to lay out the Work, verify layout information shown on Drawings, in relation to the property survey and existing benchmarks. If discrepancies are discovered, notify Architect promptly.
- B. General: Engage a land surveyor to lay out the Work using accepted surveying practices.
 - 1. Establish benchmarks and control points to set lines and levels at each story of construction and elsewhere as needed to locate each element of Project.
 - 2. Establish limits on use of Project site.
 - 3. Establish dimensions within tolerances indicated. Do not scale Drawings to obtain required dimensions.
 - 4. Inform installers of lines and levels to which they must comply.
 - 5. Check the location, level and plumb, of every major element as the Work progresses.
 - 6. Notify Architect when deviations from required lines and levels exceed allowable tolerances.
 - 7. Close site surveys with an error of closure equal to or less than the standard established by authorities having jurisdiction.
- C. Site Improvements: Locate and lay out site improvements, including pavements, grading, fill and topsoil placement, utility slopes, and rim and invert elevations.
- D. Building Lines and Levels: Locate and lay out control lines and levels for structures, building foundations, column grids, and floor levels, including those required for mechanical and electrical work. Transfer survey markings and elevations for use with control lines and levels. Level foundations and piers from two or more locations.
- E. Record Log: Maintain a log of layout control work. Record deviations from required lines and levels. Include beginning and ending dates and times of surveys, weather conditions, name and duty of each survey party member, and types of instruments and tapes used. Make the log available for reference by Architect.

4. FIELD ENGINEERING

- A. Reference Points: Locate existing permanent benchmarks, control points, and similar reference points before beginning the Work. Preserve and protect permanent benchmarks and control points during construction operations.
- B. Benchmarks: Establish and maintain a minimum of two permanent benchmarks on Project site, referenced to data established by survey control points. Comply with authorities having jurisdiction for type and size of benchmark.
 - 1. Record benchmark locations, with horizontal and vertical data, on Project Record Documents.

- C. Certified Survey: On completion of foundation walls, major site improvements, and other work requiring field-engineering services, prepare a certified survey showing dimensions, locations, angles, and elevations of construction and sitework.
- D. Final Property Survey: Engage a land surveyor to prepare a final property survey showing significant features (real property) for Project. Include on the survey a certification, signed by land surveyor, that principal metes, bounds, lines, and levels of Project are accurately positioned as shown on the survey.
 - 1. Recording: At Substantial Completion, have the final property survey recorded by or with authorities having jurisdiction as the official "property survey."

5. INSTALLATION

- A. General: Locate the Work and components of the Work accurately, in correct alignment and elevation, as indicated.
 - 1. Make vertical work plumb and make horizontal work level.
 - 2. Where space is limited, install components to maximize space available for maintenance and ease of removal for replacement.
 - 3. Conceal pipes, ducts, and wiring in finished areas unless otherwise indicated.
- B. Comply with manufacturer's written instructions and recommendations for installing products in applications indicated.
- C. Install products at the time and under conditions that will ensure the best possible results. Maintain conditions required for product performance until Substantial Completion.
- D. Conduct construction operations so no part of the Work is subjected to damaging operations or loading in excess of that expected during normal conditions of occupancy.
- E. Sequence the Work and allow adequate clearances to accommodate movement of construction items on site and placement in permanent locations.
- F. Tools and Equipment: Do not use tools or equipment that produce harmful noise levels.
- G. Templates: Obtain and distribute to the parties involved templates for work specified to be factory prepared and field installed. Check Shop Drawings of other work to confirm that adequate provisions are made for locating and installing products to comply with indicated requirements.
- H. Attachment: Provide blocking and attachment plates and anchors and fasteners of adequate size and number to securely anchor each component in place, accurately located and aligned with other portions of the Work. Where size and type of attachments are not indicated, verify size and type required for load conditions.

1. Mounting Heights: Where mounting heights are not indicated, mount components at heights directed by Architect.
 2. Allow for building movement, including thermal expansion and contraction.
 3. Coordinate installation of anchorages. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors, that are to be embedded in concrete or masonry. Deliver such items to Project site in time for installation.
- I. Joints: Make joints of uniform width. Where joint locations in exposed work are not indicated, arrange joints for the best visual effect. Fit exposed connections together to form hairline joints.
 - J. Hazardous Materials: Use products, cleaners, and installation materials that are not considered hazardous.
6. CUTTING AND PATCHING
- A. Cutting and Patching, General: Employ skilled workers to perform cutting and patching. Proceed with cutting and patching at the earliest feasible time, and complete without delay.
 1. Cut in-place construction to provide for installation of other components or performance of other construction, and subsequently patch as required to restore surfaces to their original condition.
 - B. Existing Warranties: Remove, replace, patch, and repair materials and surfaces cut or damaged during installation or cutting and patching operations, by methods and with materials so as not to void existing warranties.
 - C. Temporary Support: Provide temporary support of work to be cut.
 - D. Protection: Protect in-place construction during cutting and patching to prevent damage. Provide protection from adverse weather conditions for portions of Project that might be exposed during cutting and patching operations.
 - E. Adjacent Occupied Areas: Avoid interference with use of adjoining areas or interruption of free passage to adjoining areas.
 - F. Existing Utility Services and Mechanical/Electrical Systems: Where existing services/systems are required to be removed, relocated, or abandoned, bypass such services/systems before cutting to minimize or prevent interruption to occupied areas.
 - G. Cutting: Cut in-place construction by sawing, drilling, breaking, chipping, grinding, and similar operations, including excavation, using methods least likely to damage elements retained or adjoining construction. If possible, review proposed procedures with original Installer; comply with original Installer's written recommendations.

1. In general, use hand or small power tools designed for sawing and grinding, not hammering and chopping. Cut holes and slots neatly to minimum size required, and with minimum disturbance of adjacent surfaces. Temporarily cover openings when not in use.
 2. Finished Surfaces: Cut or drill from the exposed or finished side into concealed surfaces.
 3. Concrete and Masonry: Cut using a cutting machine, such as an abrasive saw or a diamond-core drill.
 4. Excavating and Backfilling: Comply with requirements in applicable Sections where required by cutting and patching operations.
 5. Mechanical and Electrical Services: Cut off pipe or conduit in walls or partitions to be removed. Cap, valve, or plug and seal remaining portion of pipe or conduit to prevent entrance of moisture or other foreign matter after cutting.
 6. Proceed with patching after construction operations requiring cutting are complete.
- H. Patching: Patch construction by filling, repairing, refinishing, closing up, and similar operations following performance of other work. Patch with durable seams that are as invisible as practicable. Provide materials and comply with installation requirements specified in other Sections, where applicable.
1. Inspection: Where feasible, test and inspect patched areas after completion to demonstrate physical integrity of installation.
 2. Exposed Finishes: Restore exposed finishes of patched areas and extend finish restoration into retained adjoining construction in a manner that will minimize evidence of patching and refinishing.
 3. Floors and Walls: Where walls or partitions that are removed extend one finished area into another, patch and repair floor and wall surfaces in the new space. Provide an even surface of uniform finish, color, texture, and appearance. Remove in-place floor and wall coverings and replace with new materials, if necessary, to achieve uniform color and appearance.
 4. Ceilings: Patch, repair, or rehang in-place ceilings as necessary to provide an even-plane surface of uniform appearance.
 5. Exterior Building Enclosure: Patch components in a manner that restores enclosure to a weathertight condition and ensures thermal and moisture integrity of building enclosure.
- I. Cleaning: Clean areas and spaces where cutting and patching are performed. Remove paint, mortar, oils, putty, and similar materials from adjacent finished surfaces.
7. PROGRESS CLEANING
- A. General: Clean Project site and work areas daily, including common areas. Enforce requirements strictly. Dispose of materials lawfully.
1. Comply with requirements in NFPA 241 for removal of combustible waste materials and debris.
 2. Do not hold waste materials more than seven days during normal weather or three days if the temperature is expected to rise above 80 deg F.

3. Containerize hazardous and unsanitary waste materials separately from other waste. Mark containers appropriately and dispose of legally, according to regulations.
 - B. Site: Maintain Project site free of waste materials and debris.
 - C. Work Areas: Clean areas where work is in progress to the level of cleanliness necessary for proper execution of the Work.
 1. Remove liquid spills promptly.
 2. Where dust would impair proper execution of the Work, broom-clean or vacuum the entire work area, as appropriate.
 - D. Installed Work: Keep installed work clean. Clean installed surfaces according to written instructions of manufacturer or fabricator of product installed, using only cleaning materials specifically recommended. If specific cleaning materials are not recommended, use cleaning materials that are not hazardous to health or property and that will not damage exposed surfaces.
 - E. Concealed Spaces: Remove debris from concealed spaces before enclosing the space.
 - F. Exposed Surfaces in Finished Areas: Clean exposed surfaces and protect as necessary to ensure freedom from damage and deterioration at time of Substantial Completion.
 - G. Waste Disposal: Do not bury or burn waste materials on-site. Do not wash waste materials down sewers or into waterways.
 - H. During handling and installation, clean and protect construction in progress and adjoining materials already in place. Apply protective covering where required to ensure protection from damage or deterioration at Substantial Completion.
 - I. Clean and provide maintenance on completed construction as frequently as necessary through the remainder of the construction period. Adjust and lubricate operable components to ensure operability without damaging effects.
 - J. Limiting Exposures: Supervise construction operations to assure that no part of the construction, completed or in progress, is subject to harmful, dangerous, damaging, or otherwise deleterious exposure during the construction period.
8. STARTING AND ADJUSTING
- A. Start equipment and operating components to confirm proper operation. Remove malfunctioning units, replace with new units, and retest.
 - B. Adjust equipment for proper operation. Adjust operating components for proper operation without binding.
 - C. Test each piece of equipment to verify proper operation. Test and adjust controls and safeties. Replace damaged and malfunctioning controls and equipment.

- D. Manufacturer's Field Service: Comply with qualification requirements in Section 014000 "Quality Requirements"

9. PROTECTION OF INSTALLED CONSTRUCTION

- A. Provide final protection and maintain conditions that ensure installed Work is without damage or deterioration at time of Substantial Completion.
- B. Comply with manufacturer's written instructions for temperature and relative humidity.

10. CORRECTION OF THE WORK

- A. Repair or remove and replace defective construction. Restore damaged substrates and finishes. Repairing includes replacing defective parts, refinishing damaged surfaces, touching up with matching materials, and properly adjusting operating equipment.
- B. Restore permanent facilities used during construction to their specified condition.
- C. Remove and replace damaged surfaces that are exposed to view if surfaces cannot be repaired without visible evidence of repair.
- D. Repair components that do not operate properly. Remove and replace operating components that cannot be repaired.
- E. Remove and replace chipped, scratched, and broken glass or reflective surfaces

END OF SECTION 017300

SECTION 017700

CLOSEOUT PROCEDURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for contract closeout, including, but not limited to, the following:
 - 1. Inspection procedures.
 - 2. Warranties.
 - 3. Final cleaning.

1.3 SUBSTANTIAL COMPLETION

- A. Preliminary Procedures: Before requesting inspection for determining date of Substantial Completion, complete the following. List items below that are incomplete in request.
 - 1. Prepare a list of items to be completed and corrected (punch list), the value of items on the list, and reasons why the Work is not complete.
 - 2. Advise Owner of pending insurance changeover requirements.
 - 3. Submit specific warranties, workmanship bonds, maintenance service agreements, final certifications, and similar documents.
 - 4. Obtain and submit releases permitting Owner unrestricted use of the Work and access to services and utilities. Include occupancy permits, operating certificates, and similar releases.
 - 5. Prepare and submit Project Record Documents, operation and maintenance manuals, Final Completion construction photographs, damage or settlement surveys, property surveys, and similar final record information.
 - 6. Deliver tools, spare parts, extra materials, and similar items to location designated by Owner. Label with manufacturer's name and model number where applicable.
 - 7. Make final changeover of permanent locks and deliver keys to Owner. Advise Owner's personnel of changeover in security provisions.
 - 8. Complete startup testing of systems.
 - 9. Submit test/adjust/balance records.

10. Terminate and remove temporary facilities from Project site, along with mockups, construction tools, and similar elements.
11. Advise Owner of changeover in heat and other utilities.
12. Submit changeover information related to Owner's occupancy, use, operation, and maintenance.
13. Complete final cleaning requirements, including touchup painting.
14. Touch up and otherwise repair and restore marred exposed finishes to eliminate visual defects.

B. Inspection: Submit a written request for inspection for Substantial Completion. On receipt of request, Architect will either proceed with inspection or notify Contractor of unfulfilled requirements. Architect will prepare the Certificate of Substantial Completion after inspection or will notify Contractor of items, either on Contractor's list or additional items identified by Architect, that must be completed or corrected before certificate will be issued.

1. Reinspection: Request reinspection when the Work identified in previous inspections as incomplete is completed or corrected.
2. Results of completed inspection will form the basis of requirements for Final Completion.

1.4 FINAL COMPLETION

A. Preliminary Procedures: Before requesting final inspection for determining date of Final Completion, complete the following:

1. Submit a final Application for Payment according to Division 1 Section "Payment Procedures."
2. Submit certified copy of Architect's Substantial Completion inspection list of items to be completed or corrected (punch list), endorsed and dated by Architect. The certified copy of the list shall state that each item has been completed or otherwise resolved for acceptance.
3. Submit evidence of final, continuing insurance coverage complying with insurance requirements.
4. Submit pest-control final inspection report and warranty.
5. Instruct Owner's personnel in operation, adjustment, and maintenance of products, equipment, and systems.

B. Inspection: Submit a written request for final inspection for acceptance. On receipt of request, Architect will either proceed with inspection or notify Contractor of unfulfilled requirements. Architect will prepare a final Certificate for Payment after inspection or will notify Contractor of construction that must be completed or corrected before certificate will be issued.

1. Reinspection: Request reinspection when the Work identified in previous inspections as incomplete is completed or corrected.

1.5 LIST OF INCOMPLETE ITEMS (PUNCH LIST)

- A. Preparation: Submit three copies of list. Include name and identification of each space and area affected by construction operations for incomplete items and items needing correction including, if necessary, areas disturbed by Contractor that are outside the limits of construction.
1. Organize list of spaces in sequential order, starting with exterior areas first.
 2. Organize items applying to each space by major element, including categories for ceiling, individual walls, floors, equipment, and building systems.
 3. Include the following information at the top of each page:
 - a. Project name.
 - b. Date.
 - c. Name of Architect.
 - d. Name of Contractor.
 - e. Page number.

1.6 WARRANTIES

- A. Submittal Time: Submit written warranties on request of Architect for designated portions of the Work where commencement of warranties other than date of Substantial Completion is indicated.
- B. Partial Occupancy: Submit properly executed warranties within 15 days of completion of designated portions of the Work that are completed and occupied or used by Owner during construction period by separate agreement with Contractor.
- C. Organize warranty documents into an orderly sequence based on the table of contents of the Project Manual.
1. Bind warranties and bonds in heavy-duty, 3-ring, vinyl-covered, loose-leaf binders, thickness as necessary to accommodate contents, and sized to receive 8-1/2-by-11-inch paper.
 2. Provide heavy paper dividers with plastic-covered tabs for each separate warranty. Mark tab to identify the product or installation. Provide a typed description of the product or installation, including the name of the product and the name, address, and telephone number of Installer.
 3. Identify each binder on the front and spine with the typed or printed title "WARRANTIES," Project name, and name of Contractor.
- D. Provide additional copies of each warranty to include in operation and maintenance manuals.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Cleaning Agents: Use cleaning materials and agents recommended by manufacturer or fabricator of the surface to be cleaned. Do not use cleaning agents that are potentially hazardous to health or property or that might damage finished surfaces.

PART 3 - EXECUTION

3.1 FINAL CLEANING

- A. General: Provide final cleaning. Conduct cleaning and waste-removal operations to comply with local laws and ordinances and Federal and local environmental and antipollution regulations.
- B. Cleaning: Employ experienced workers or professional cleaners for final cleaning. Clean each surface or unit to condition expected in an average commercial building cleaning and maintenance program. Comply with manufacturer's written instructions.
 - 1. Complete the following cleaning operations before requesting inspection for certification of Substantial Completion for entire Project or for a portion of Project:
 - a. Clean Project site, yard, and grounds, in areas disturbed by construction activities, including landscape development areas, of rubbish, waste material, litter, and other foreign substances.
 - b. Sweep paved areas broom clean. Remove petrochemical spills, stains, and other foreign deposits.
 - c. Rake grounds that are neither planted nor paved to a smooth, even-textured surface.
 - d. Remove tools, construction equipment, machinery, and surplus material from Project site.
 - e. Clean exposed exterior and interior hard-surfaced finishes to a dirt-free condition, free of stains, films, and similar foreign substances. Avoid disturbing natural weathering of exterior surfaces. Restore reflective surfaces to their original condition.
 - f. Remove debris and surface dust from limited access spaces, including roofs, plenums, shafts, trenches, equipment vaults, manholes, attics, and similar spaces.
 - g. Sweep concrete floors broom clean in unoccupied spaces.
 - h. Vacuum carpet and similar soft surfaces, removing debris and excess nap; shampoo if visible soil or stains remain.
 - i. Clean transparent materials, including mirrors and glass in doors and windows. Remove glazing compounds and other noticeable, vision-

- obscuring materials. Replace chipped or broken glass and other damaged transparent materials. Polish mirrors and glass, taking care not to scratch surfaces.
- j. Remove labels that are not permanent.
 - k. Touch up and otherwise repair and restore marred, exposed finishes and surfaces. Replace finishes and surfaces that cannot be satisfactorily repaired or restored or that already show evidence of repair or restoration.
 - 1) Do not paint over "UL" and similar labels, including mechanical and electrical nameplates.
 - l. Wipe surfaces of mechanical and electrical equipment and similar equipment. Remove excess lubrication, paint and mortar droppings, and other foreign substances.
 - m. Replace parts subject to unusual operating conditions.
 - n. Clean plumbing fixtures to a sanitary condition, free of stains, including stains resulting from water exposure.
 - o. Replace disposable air filters and clean permanent air filters. Clean exposed surfaces of diffusers, registers, and grills.
 - p. Clean ducts, blowers, and coils if units were operated without filters during construction.
 - q. Clean light fixtures, lamps, globes, and reflectors to function with full efficiency. Replace burned-out bulbs, and those noticeably dimmed by hours of use, and defective and noisy starters in fluorescent and mercury vapor fixtures to comply with requirements for new fixtures.
 - r. Leave Project clean and ready for occupancy.
- C. Pest Control: Engage an experienced, licensed exterminator to make a final inspection and rid Project of rodents, insects, and other pests. Prepare a report.
- D. Comply with safety standards for cleaning. Do not burn waste materials. Do not bury debris or excess materials on Owner's property. Do not discharge volatile, harmful, or dangerous materials into drainage systems. Remove waste materials from Project site and dispose of lawfully.

END OF DOCUMENT 017700

SECTION 017823

OPERATION AND MAINTENANCE DATA

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for preparing operation and maintenance manuals, including the following:
 - 1. Operation and maintenance documentation directory.
 - 2. Emergency manuals.
 - 3. Operation manuals for systems, subsystems, and equipment.
 - 4. Maintenance manuals for the care and maintenance of products, materials, finishes, systems and equipment.

1.3 DEFINITIONS

- A. System: An organized collection of parts, equipment, or subsystems united by regular interaction.
- B. Subsystem: A portion of a system with characteristics similar to a system.

1.4 SUBMITTALS

- A. Initial Submittal: Submit 2 draft copies of each manual at least 15 days before requesting inspection for Substantial Completion. Include a complete operation and maintenance directory. Architect will return one copy of draft and mark whether general scope and content of manual are acceptable.
- B. Final Submittal: Submit one copy of each manual in final form at least 15 days before final inspection. Architect will return copy with comments within 15 days after final inspection.
 - 1. Correct or modify each manual to comply with Architect's comments. Submit 3 copies of each corrected manual within 15 days of receipt of Architect's comments.

1.5 COORDINATION

- A. Where operation and maintenance documentation includes information on installations by more than one factory-authorized service representative, assemble and coordinate information furnished by representatives and prepare manuals.

PART 2 - PRODUCTS

2.1 OPERATION AND MAINTENANCE DOCUMENTATION DIRECTORY

- A. Organization: Include a section in the directory for each of the following:
 - 1. List of documents.
 - 2. List of systems.
 - 3. List of equipment.
 - 4. Table of contents.
- B. List of Systems and Subsystems: List systems alphabetically. Include references to operation and maintenance manuals that contain information about each system.
- C. List of Equipment: List equipment for each system, organized alphabetically by system. For pieces of equipment not part of system, list alphabetically in separate list.
- D. Tables of Contents: Include a table of contents for each emergency, operation, and maintenance manual.
- E. Identification: In the documentation directory and in each operation and maintenance manual, identify each system, subsystem, and piece of equipment with same designation used in the Contract Documents. If no designation exists, assign a designation according to ASHRAE Guideline 4, "Preparation of Operating and Maintenance Documentation for Building Systems."

2.2 MANUALS, GENERAL

- A. Organization: Unless otherwise indicated, organize each manual into a separate section for each system and subsystem, and a separate section for each piece of equipment not part of a system. Each manual shall contain the following materials, in the order listed:
 - 1. Title page.
 - 2. Table of contents.
 - 3. Manual contents.
- B. Title Page: Enclose title page in transparent plastic sleeve. Include the following information:
 - 1. Subject matter included in manual.
 - 2. Name and address of Project.

3. Name and address of Owner.
 4. Date of submittal.
 5. Name, address, and telephone number of Contractor.
 6. Name and address of Architect.
 7. Cross-reference to related systems in other operation and maintenance manuals.
- C. Table of Contents: List each product included in manual, identified by product name, indexed to the content of the volume, and cross-referenced to Specification Section number in Project Manual.
1. If operation or maintenance documentation requires more than one volume to accommodate data, include comprehensive table of contents for all volumes in each volume of the set.
- D. Manual Contents: Organize into sets of manageable size. Arrange contents alphabetically by system, subsystem, and equipment. If possible, assemble instructions for subsystems, equipment, and components of one system into a single binder.
1. Binders: Heavy-duty, 3-ring, vinyl-covered, loose-leaf binders, in thickness necessary to accommodate contents, sized to hold 8-1/2-by-11-inch paper; with clear plastic sleeve on spine to hold label describing contents and with pockets inside covers to hold folded oversize sheets.
 - a. If two or more binders are necessary to accommodate data of a system, organize data in each binder into groupings by subsystem and related components. Cross-reference other binders if necessary to provide essential information for proper operation or maintenance of equipment or system.
 - b. Identify each binder on front and spine, with printed title "OPERATION AND MAINTENANCE MANUAL," Project title or name, and subject matter of contents. Indicate volume number for multiple-volume sets.
 2. Dividers: Heavy-paper dividers with plastic-covered tabs for each section. Mark each tab to indicate contents. Include typed list of products and major components of equipment included in the section on each divider, cross-referenced to Specification Section number and title of Project Manual.
 3. Protective Plastic Sleeves: Transparent plastic sleeves designed to enclose diagnostic software diskettes for computerized electronic equipment.
 4. Supplementary Text: Prepared on 8-1/2-by-11-inch white bond paper.
 5. Drawings: Attach reinforced, punched binder tabs on drawings and bind with text.
 - a. If oversize drawings are necessary, fold drawings to same size as text pages and use as foldouts.
 - b. If drawings are too large to be used as foldouts, fold and place drawings in labeled envelopes and bind envelopes in rear of manual. At

appropriate locations in manual, insert typewritten pages indicating drawing titles, descriptions of contents, and drawing locations.

2.3 EMERGENCY MANUALS

- A. Content: Organize manual into a separate section for each of the following:
1. Type of emergency.
 2. Emergency instructions.
 3. Emergency procedures.
- B. Type of Emergency: Where applicable for each type of emergency indicated below, include instructions and procedures for each system, subsystem, piece of equipment, and component:
1. Fire.
 2. Flood.
 3. Gas leak.
 4. Water leak.
 5. Power failure.
 6. Water outage.
 7. System, subsystem, or equipment failure.
 8. Chemical release or spill.
- C. Emergency Instructions: Describe and explain warnings, trouble indications, error messages, and similar codes and signals. Include responsibilities of Owner's operating personnel for notification of Installer, supplier, and manufacturer to maintain warranties.
- D. Emergency Procedures: Include the following, as applicable:
1. Instructions on stopping.
 2. Shutdown instructions for each type of emergency.
 3. Operating instructions for conditions outside normal operating limits.
 4. Required sequences for electric or electronic systems.
 5. Special operating instructions and procedures.

2.4 OPERATION MANUALS

- A. Content: In addition to requirements in this Section, include operation data required in individual Specification Sections and the following information:
1. System, subsystem, and equipment descriptions.
 2. Performance and design criteria if Contractor is delegated design responsibility.
 3. Operating standards.
 4. Operating procedures.
 5. Operating logs.
 6. Wiring diagrams.

7. Control diagrams.
8. Piped system diagrams.
9. Precautions against improper use.
10. License requirements including inspection and renewal dates.

B. Descriptions: Include the following:

1. Product name and model number.
2. Manufacturer's name.
3. Equipment identification with serial number of each component.
4. Equipment function.
5. Operating characteristics.
6. Limiting conditions.
7. Performance curves.
8. Engineering data and tests.
9. Complete nomenclature and number of replacement parts.

C. Operating Procedures: Include the following, as applicable:

1. Startup procedures.
2. Equipment or system break-in procedures.
3. Routine and normal operating instructions.
4. Regulation and control procedures.
5. Instructions on stopping.
6. Normal shutdown instructions.
7. Seasonal and weekend operating instructions.
8. Required sequences for electric or electronic systems.
9. Special operating instructions and procedures.

D. Systems and Equipment Controls: Describe the sequence of operation, and diagram controls as installed.

E. Piped Systems: Diagram piping as installed, and identify color-coding where required for identification.

2.5 PRODUCT MAINTENANCE MANUAL

A. Content: Organize manual into a separate section for each product, material, and finish. Include source information, product information, maintenance procedures, repair materials and sources, and warranties and bonds, as described below.

B. Source Information: List each product included in manual, identified by product name and arranged to match manual's table of contents. For each product, list name, address, and telephone number of Installer or supplier and maintenance service agent, and cross-reference Specification Section number and title in Project Manual.

C. Product Information: Include the following, as applicable:

1. Product name and model number.
 2. Manufacturer's name.
 3. Color, pattern, and texture.
 4. Material and chemical composition.
 5. Reordering information for specially manufactured products.
- D. Maintenance Procedures: Include manufacturer's written recommendations and the following:
1. Inspection procedures.
 2. Types of cleaning agents to be used and methods of cleaning.
 3. List of cleaning agents and methods of cleaning detrimental to product.
 4. Schedule for routine cleaning and maintenance.
 5. Repair instructions.
- E. Repair Materials and Sources: Include lists of materials and local sources of materials and related services.
- F. Warranties and Bonds: Include copies of warranties and bonds and lists of circumstances and conditions that would affect validity of warranties or bonds.
1. Include procedures to follow and required notifications for warranty claims.

2.6 SYSTEMS AND EQUIPMENT MAINTENANCE MANUAL

- A. Content: For each system, subsystem, and piece of equipment not part of a system, include source information, manufacturers' maintenance documentation, maintenance procedures, maintenance and service schedules, spare parts list and source information, maintenance service contracts, and warranty and bond information, as described below.
- B. Source Information: List each system, subsystem, and piece of equipment included in manual, identified by product name and arranged to match manual's table of contents. For each product, list name, address, and telephone number of Installer or supplier and maintenance service agent, and cross-reference Specification Section number and title in Project Manual.
- C. Manufacturers' Maintenance Documentation: Manufacturers' maintenance documentation including the following information for each component part or piece of equipment:
1. Standard printed maintenance instructions and bulletins.
 2. Drawings, diagrams, and instructions required for maintenance, including disassembly and component removal, replacement, and assembly.
 3. Identification and nomenclature of parts and components.
 4. List of items recommended to be stocked as spare parts.
- D. Maintenance Procedures: Include the following information and items that detail essential maintenance procedures:

1. Test and inspection instructions.
 2. Troubleshooting guide.
 3. Precautions against improper maintenance.
 4. Disassembly; component removal, repair, and replacement; and reassembly instructions.
 5. Aligning, adjusting, and checking instructions.
 6. Demonstration and training videotape, if available.
- E. Maintenance and Service Schedules: Include service and lubrication requirements, list of required lubricants for equipment, and separate schedules for preventive and routine maintenance and service with standard time allotment.
1. Scheduled Maintenance and Service: Tabulate actions for daily, weekly, monthly, quarterly, semiannual, and annual frequencies.
 2. Maintenance and Service Record: Include manufacturers' forms for recording maintenance.
- F. Spare Parts List and Source Information: Include lists of replacement and repair parts, with parts identified and cross-referenced to manufacturers' maintenance documentation and local sources of maintenance materials and related services.
- G. Maintenance Service Contracts: Include copies of maintenance agreements with name and telephone number of service agent.
- H. Warranties and Bonds: Include copies of warranties and bonds and lists of circumstances and conditions that would affect validity of warranties or bonds.
1. Include procedures to follow and required notifications for warranty claims.

PART 3 - EXECUTION

3.1 MANUAL PREPARATION

- A. Operation and Maintenance Documentation Directory: Prepare a separate manual that provides an organized reference to emergency, operation, and maintenance manuals.
- B. Emergency Manual: Assemble a complete set of emergency information indicating procedures for use by emergency personnel and by Owner's operating personnel for types of emergencies indicated.
- C. Product Maintenance Manual: Assemble a complete set of maintenance data indicating care and maintenance of each product, material, and finish incorporated into the Work.
- D. Operation and Maintenance Manuals: Assemble a complete set of operation and maintenance data indicating operation and maintenance of each system, subsystem, and piece of equipment not part of a system.

1. Engage a factory-authorized service representative to assemble and prepare information for each system, subsystem, and piece of equipment not part of a system.
 2. Prepare a separate manual for each system and subsystem, in the form of an instructional manual for use by Owner's operating personnel.
- E. Manufacturers' Data: Where manuals contain manufacturers' standard printed data, include only sheets pertinent to product or component installed. Mark each sheet to identify each product or component incorporated into the Work. If data include more than one item in a tabular format, identify each item using appropriate references from the Contract Documents. Identify data applicable to the Work and delete references to information not applicable.
1. Prepare supplementary text if manufacturers' standard printed data are not available and where the information is necessary for proper operation and maintenance of equipment or systems.
- F. Drawings: Prepare drawings supplementing manufacturers' printed data to illustrate the relationship of component parts of equipment and systems and to illustrate control sequence and flow diagrams. Coordinate these drawings with information contained in Record Drawings to ensure correct illustration of completed installation.
1. Do not use original Project Record Documents as part of operation and maintenance manuals.
 2. Comply with requirements of newly prepared Record Drawings in Division 1 Section "Project Record Documents."
- G. Comply with Division 1 Section "Closeout Procedures" for schedule for submitting operation and maintenance documentation.

END OF DOCUMENT 017823

SECTION 017839

PROJECT RECORD DOCUMENTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and other Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes administrative and procedural requirements for Project Record Documents, including the following:
 - 1. Record Drawings.
 - 2. Record Specifications.
 - 3. Record Product Data.

1.3 SUBMITTALS

- A. Record Drawings: Comply with the following:
 - 1. Number of Copies: Submit one set(s) of marked-up Record Prints.
 - 2. Number of Copies: Submit copies of Record Drawings as follows:
 - a. Initial Submittal: Submit one set(s) of plots from corrected Record CAD Drawings and one set(s) of marked-up Record Prints. Architect will initial and date each plot and mark whether general scope of changes, additional information recorded, and quality of drafting are acceptable. Architect will return plots and prints for organizing into sets, printing, binding, and final submittal.
 - b. Final Submittal: Submit one set(s) of marked-up Record Prints, one set(s) of Record CAD Drawing files, one set(s) of Record CAD Drawing plots, and three copies printed from record plots. Plot and print each Drawing, whether or not changes and additional information were recorded.
 - 1) Electronic Media: USB drive.

- B. Record Specifications: Submit one copy of Project's Specifications, including addenda and contract modifications.
- C. Record Product Data: Submit one copy of each Product Data submittal.
 - 1. Where Record Product Data is required as part of operation and maintenance manuals, submit marked-up Product Data as an insert in manual instead of submittal as Record Product Data.

PART 2 - PRODUCTS

2.1 RECORD DRAWINGS

- A. Record Prints: Maintain one set of blue- or black-line white prints of the Contract Drawings and Shop Drawings.
 - 1. Preparation: Mark Record Prints to show the actual installation where installation varies from that shown originally. Require individual or entity who obtained record data, whether individual or entity is Installer, subcontractor, or similar entity, to prepare the marked-up Record Prints.
 - a. Give particular attention to information on concealed elements that would be difficult to identify or measure and record later.
 - b. Accurately record information in an understandable drawing technique.
 - c. Record data as soon as possible after obtaining it. Record and check the markup before enclosing concealed installations.
 - 2. Content: Types of items requiring marking include, but are not limited to, the following:
 - a. Dimensional changes to Drawings.
 - b. Revisions to details shown on Drawings.
 - c. Depths of foundations below first floor.
 - d. Locations and depths of underground utilities.
 - e. Revisions to routing of piping and conduits.
 - f. Revisions to electrical circuitry.
 - g. Actual equipment locations.
 - h. Duct size and routing.
 - i. Locations of concealed internal utilities.
 - j. Changes made by Change Order or Construction Change Directive.
 - k. Changes made following Architect's written orders.
 - l. Details not on the original Contract Drawings.
 - m. Field records for variable and concealed conditions.
 - n. Record information on the Work that is shown only schematically.

3. Mark the Contract Drawings or Shop Drawings, whichever is most capable of showing actual physical conditions, completely and accurately. If Shop Drawings are marked, show cross-reference on the Contract Drawings.
 4. Mark record sets with erasable, red-colored pencil. Use other colors to distinguish between changes for different categories of the Work at same location.
 5. Mark important additional information that was either shown schematically or omitted from original Drawings.
 6. Note Construction Change Directive numbers, alternate numbers, Change Order numbers, and similar identification, where applicable.
- B. Record Transparencies: Immediately before inspection for Certificate of Substantial Completion, review marked-up Record Prints with Architect. When authorized, prepare a full set of corrected transparencies of the Contract Drawings and Shop Drawings.
1. Incorporate changes and additional information previously marked on Record Prints. Erase, redraw, and add details and notations where applicable.
 2. Refer instances of uncertainty to Architect for resolution.
 3. Owner will furnish Contractor one set of transparencies of the Contract Drawings for use in recording information.
 4. Print the Contract Drawings and Shop Drawings for use as Record Transparencies. Architect will make the Contract Drawings available to Contractor's print shop.
- C. Record CAD Drawings: Immediately before inspection for Certificate of Substantial Completion, review marked-up Record Prints with Architect. When authorized, prepare a full set of corrected CAD Drawings of the Contract Drawings, as follows:
1. Format: Same CAD program, version, and operating system as the original Contract Drawings.
 2. Format: DWG, AutoCAD Version 2004, operating in Microsoft Windows operating system.
 3. Incorporate changes and additional information previously marked on Record Prints. Delete, redraw, and add details and notations where applicable.
 4. Refer instances of uncertainty to Architect for resolution.
 5. Architect will furnish Contractor one set of CAD Drawings of the Contract Drawings for use in recording information.
 - a. Architect makes no representations as to the accuracy or completeness of CAD Drawings as they relate to the Contract Drawings.
 - b. CAD Software Program: The Contract Drawings are available in AutoCAD Version 2004.
- D. Newly Prepared Record Drawings: Prepare new Drawings instead of preparing Record Drawings where Architect determines that neither the original Contract Drawings nor Shop Drawings are suitable to show actual installation.

1. New Drawings may be required when a Change Order is issued as a result of accepting an alternate, substitution, or other modification.
 2. Consult Architect for proper scale and scope of detailing and notations required to record the actual physical installation and its relation to other construction. Integrate newly prepared Record Drawings into Record Drawing sets; comply with procedures for formatting, organizing, copying, binding, and submitting.
- E. Format: Identify and date each Record Drawing; include the designation "PROJECT RECORD DRAWING" in a prominent location.
1. Record Prints: Organize Record Prints and newly prepared Record Drawings into manageable sets. Bind each set with durable paper cover sheets. Include identification on cover sheets.
 2. Record Transparencies: Organize into unbound sets matching Record Prints. Place transparencies in durable tube-type drawing containers with end caps. Mark end cap of each container with identification. If container does not include a complete set, identify Drawings included.
 3. Record CAD Drawings: Organize CAD information into separate electronic files that correspond to each sheet of the Contract Drawings. Name each file with the sheet identification. Include identification in each CAD file.
 4. Identification: As follows:
 - a. Project name.
 - b. Date.
 - c. Designation "PROJECT RECORD DRAWINGS."
 - d. Name of Architect.
 - e. Name of Contractor.

2.2 RECORD SPECIFICATIONS

- A. Preparation: Mark Specifications to indicate the actual product installation where installation varies from that indicated in Specifications, addenda, and contract modifications.
1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
 2. Mark copy with the proprietary name and model number of products, materials, and equipment furnished, including substitutions and product options selected.
 3. Record the name of manufacturer, supplier, Installer, and other information necessary to provide a record of selections made.
 4. For each principal product, indicate whether Record Product Data has been submitted in operation and maintenance manuals instead of submitted as Record Product Data.
 5. Note related Change Orders, Record Product Data, and Record Drawings where applicable.

2.3 RECORD PRODUCT DATA

- A. Preparation: Mark Product Data to indicate the actual product installation where installation varies substantially from that indicated in Product Data submittal.
 - 1. Give particular attention to information on concealed products and installations that cannot be readily identified and recorded later.
 - 2. Include significant changes in the product delivered to Project site and changes in manufacturer's written instructions for installation.
 - 3. Note related Change Orders, Record Specifications, and Record Drawings where applicable.

2.4 MISCELLANEOUS RECORD SUBMITTALS

- A. Assemble miscellaneous records required by other Specification Sections for miscellaneous record keeping and submittal in connection with actual performance of the Work. Bind or file miscellaneous records and identify each, ready for continued use and reference.

PART 3 - EXECUTION

3.1 RECORDING AND MAINTENANCE

- A. Recording: Maintain one copy of each submittal during the construction period for Project Record Document purposes. Post changes and modifications to Project Record Documents as they occur; do not wait until the end of Project.
- B. Maintenance of Record Documents and Samples: Store Record Documents and Samples in the field office apart from the Contract Documents used for construction. Do not use Project Record Documents for construction purposes. Maintain Record Documents in good order and in a clean, dry, legible condition, protected from deterioration and loss. Provide access to Project Record Documents for Architect's reference during normal working hours.

END OF DOCUMENT 017839

DIVISION 3

CONCRETE

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: dammonengineering.com



SECTION 033000
CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes cast-in-place concrete, including formwork, reinforcement, concrete materials, mixture design, placement procedures, and finishes.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Design Mixtures: For each concrete mixture. Submit alternate design mixtures when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.
 - 1. Indicate amounts of mixing water to be withheld for later addition at Project Site.
- C. Steel Reinforcement Shop Drawings: Placing drawings that detail fabrication, bending, and placement. Include bar sizes, lengths, material, grade, bar schedules, stirrups spacing, bent bar diagrams, bar arrangement, splices and laps, mechanical connections, tie spacing, hoop spacing, and supports for concrete reinforcements.

1.3 INFORMATIONAL SUBMITTALS

- A. Welding certificates.
- B. Material certificates. For each of the following, signed by manufacturers:
 - 1. Cementitious materials
 - 2. Admixtures.
 - 3. Form materials and form-release agents.
 - 4. Steel reinforcements and accessories.
 - 5. Waterstops.
 - 6. Curing compounds.
 - 7. Floor and slab treatments.
 - 8. Bonding agents.
 - 9. Adhesives.
 - 10. Vapor retarders.
 - 11. Semi-rigid joint filler.
 - 12. Joint-filler strips.
 - 13. Repair materials.

- C. Material test reports for Aggregates from a qualified testing agency, indicating compliance with requirements.
- D. Floor surface flatness and levelness measurements.
- E. Field quality-control test and inspection reports.
- F. Minutes of pre-installation conference.

1.4 QUALITY ASSURANCE

- A. Installer Qualifications: A qualified installer who employs on Project personnel qualified as ACI-certified Concrete Flatwork Technician and Finisher and a supervisor who is an ACI-certified Concrete Flatwork Technician.
- B. Manufacturer Qualifications: A firm experienced in manufacturing ready-mixed concrete products and that complies with ASTM C 94/C 94M requirements for production facilities and equipment.
 - 1. Manufacturer certified according to NRMCA's "Certification of Ready Mixed Concrete Production Facilities."
- C. Testing Agency Qualifications: An independent agency, qualified according to ASTM C 1077 and ASTM E 329 for testing indicated as documented according to ASTM E 548.
- D. Source Limitations: Obtain each type or class of cementitious material of the same brand from the same manufacturer's plant, obtain aggregate from one source, and obtain admixtures through one source from a single manufacturer.
- E. Welding Qualifications: Qualify procedures and personnel according to AWS D1.4, "Structural Welding Code - Reinforcing Steel."
- F. ACI Publications: Comply with the following unless modified by requirements in the Contract Documents:
 - 1. ACI 301, "Specifications for Structural Concrete.
 - 2. ACI 117, "Specifications for Tolerances for Concrete Construction and Materials."
- G. Concrete Testing Service: Engage a qualified independent testing agency to perform material evaluation tests and to design concrete mixtures.
- H. Concrete Flatness and Levelness Testing Service: Engage a qualified independent testing agency to perform F_F Floor Flatness and F_L Floor Levelness.
- I. Pre-installation Conference: Conduct conference at Project site.

1. Before submitting design mixtures, review concrete design mixture and examine procedures for ensuring quality of concrete materials. Require representatives of each entity directly concerned with cast-in-place concrete to attend, including the following:
 - a. Contractor's superintendent.
 - b. Independent testing agency responsible for concrete design mixtures.
 - c. Ready-mix concrete manufacturer.
 - d. Concrete subcontractor.
2. Review special inspection and testing and inspecting agency procedures for field quality control, concrete finishes and finishing, curing procedures, vapor barrier installation, steel reinforcement installation, floor and slab flatness and levelness measurement, and concrete protection.

1.5 DELIVERY, STORAGE AND HANDLING

- A. Steel Reinforcement: Deliver, store, and handle steel reinforcement to prevent bending and damage.
- B. Waterstops: Store waterstops under cover to protect from moisture, sunlight, dirt, oil, and other contaminants.

PART 2 - PRODUCTS

2.1 FORM-FACING MATERIALS

- A. Smooth-Formed Finished Concrete: Form-facing panels that will provide continuous, true, and smooth concrete surfaces. Furnish in largest practicable sizes to minimize number of joints.
- B. Rough-Formed Finished Concrete: Plywood, lumber, metal, or another approved material. Provide lumber dressed on at least two edges and one side for tight fit.

2.2 STEEL REINFORCEMENT

- A. Reinforcing Bars: ASTM A 615, Grade 60, deformed.
- B. Plain-Steel Welded Wire Reinforcement: ASTM A 185, plain, fabricated from as-drawn steel wire into flat sheets.
- C. Deformed-Steel Welded Wire Reinforcement: ASTM A 497, flat sheet.
- D. Galvanized-Steel Welded Wire Reinforcement: ASTM A 185, plain, fabricated from galvanized-steel wire into flat sheets.
- E. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars and welded wire reinforcement in place. Manufacture

bar supports from steel wire, plastic, or precast concrete according to CRSI's "Manual of Standard Practice of greater compressive strength than concrete and as follows:

1. For concrete surfaces exposed to view where legs of wire bar supports contact forms, use CRSI Class 1 plastic-protected steel wire or CRSI Class 2 stainless-steel bar supports.

2.3 CONCRETE MATERIALS

- A. Cementitious Material: Use the following cementitious materials, of the same type, brand, and source, throughout Project:
 1. Portland Cement: ASTM C 150, Type II white. Supplement with the following:
 - a. Fly Ash: ASTM C 618, Class F or C.
 - b. Ground Granulated Blast-Furnace Slag: ASTM C 989, Grade 100 or 120.
 2. Blended Hydraulic Cement: ASTM C 595, Type IS, portland blast-furnace slag cement.
- B. Normal-Weight Aggregates: ASTM C 33, graded.
 1. Maximum Coarse-Aggregate Size: 1 inch nominal.
 2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
- C. Water: ASTM C 94 and potable.

2.4 ADMIXTURES

- A. Air-Entraining Admixture: ASTM C 260.
- B. Chemical Admixtures: Provide admixtures certified by manufacturer to be compatible with other admixtures and that will not contribute water-soluble chloride ions exceeding those permitted in hardened concrete. Do not use calcium chloride or admixtures containing calcium chloride.
 1. Water-Reducing Admixture: ASTM C 494, Type A.
 2. Retarding Admixture: ASTM C 494, Type B.
 3. Water-Reducing and Retarding Admixture: ASTM C 494, Type D.
 4. High-Range, Water-Reducing Admixture: ASTM C 494, Type F.
 5. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494, Type G.
 6. Plasticizing and Retarding Admixture: ASTM C 1017, Type II.
- C. Set-Accelerating Corrosion-Inhibiting Admixture: Commercially formulated, anodic inhibitor or mixed cathodic and anodic inhibitor; capable of forming a protective barrier and minimizing chloride reactions with steel reinforcement in concrete and complying with ASTM C 494, Type C.

- D. Non-Set-Accelerating Corrosion-Inhibiting Admixture: Commercially formulated, non-set-accelerating, anodic inhibitor or mixed cathodic and anodic inhibitor; capable of forming a protective barrier and minimizing chloride reactions with steel reinforcement in concrete.
- E. Color Pigment: ASTM C 979, synthetic mineral-oxide pigments or colored water-reducing admixtures; color stable, free of carbon black, nonfading, and resistant to lime and other alkalis.
 - 1. Color: As selected by Architect from manufacturer's full range.

2.5 VAPOR RETARDERS

- A. Sheet Vapor Retarder: ASTM E 1745, Class A. Include manufacturer's recommended adhesive or pressure-sensitive tape.
- B. Sheet Vapor Retarder: Polyethylene sheet, ASTM D 4397, not less than 15 mils thick.

2.6 FLOOR AND SLAB TREATMENTS

- A. Penetrating Liquid Floor Treatment: Clear, chemically reactive, waterborne solution of inorganic silicate or silicate materials and proprietary components; odorless; colorless, that penetrates, hardens, and densifies concrete surfaces.

2.7 CURING MATERIALS

- A. Evaporation Retarder: Waterborne, monomolecular film forming, manufactured for application to fresh concrete.
- B. Absorptive Cover: AASHTO M 182, Class 2, burlap cloth made from jute or kenaf, weighing approximately 9 oz./sq. yd. when dry.
- C. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.
- D. Water: Potable.
- E. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, dissipating.
- F. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, nondissipating, certified by curing compound manufacturer to not interfere with bonding of floor covering.
- G. Clear, Waterborne, Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B, 18 to 25 percent solids, nondissipating, certified by curing compound manufacturer to not interfere with bonding of floor covering

- H. Clear, Solvent-Borne, Membrane-Forming Curing and Sealing Compound: ASTM C 1315, Type 1, Class A.
- I. Clear, Waterborne, Membrane-Forming Curing and Sealing Compound: ASTM C 1315, Type 1, Class A.

2.7 RELATED MATERIALS

- A. Expansion- and Isolation-Joint-Filler Strips: ASTM D 1751, asphalt-saturated cellulosic fiber or ASTM D 1752, cork or self-expanding cork.

2.8 REPAIR MATERIALS

- A. Repair Underlayment: Cement-based, polymer-modified, self-leveling product that can be applied in thicknesses from 1/8 inch and that can be feathered at edges to match adjacent floor elevations.
 - 1. Cement Binder: ASTM C 150, portland cement or hydraulic or blended hydraulic cement as defined in ASTM C 219.
 - 2. Primer: Product of underlayment manufacturer recommended for substrate, conditions, and application.
 - 3. Aggregate: Well-graded, washed gravel, 1/8 to 1/4 inch or coarse sand as recommended by underlayment manufacturer.
 - 4. Compressive Strength: Not less than 4100 psi at 28 days when tested according to ASTM C 109/C 109M.
- B. Repair Overlayment: Cement-based, polymer-modified, self-leveling product that can be applied in thicknesses from 1/8 inch and that can be feathered at edges to match adjacent floor elevations.
 - 1. Cement Binder: ASTM C 150, portland cement or hydraulic or blended hydraulic cement as defined in ASTM C 219.
 - 2. Primer: Product of topping manufacturer recommended for substrate, conditions, and application.
 - 3. Aggregate: Well-graded, washed gravel, 1/8 to 1/4 inch or coarse sand as recommended by topping manufacturer.
 - 4. Compressive Strength: Not less than 5000 psi at 28 days when tested according to ASTM C 109.

2.9 CONCRETE MIXTURES

- A. Prepare design mixtures for each type and strength of concrete, proportioned on the basis of laboratory trial mixture or field test data, or both, according to ACI 301.
 - 1. Use a qualified independent testing agency for preparing and reporting proposed mixture designs based on laboratory trial mixtures.

- B. Cementitious Materials: Use fly ash, pozzolan, ground granulated blast-furnace slag, and silica fume as needed to reduce the total amount of portland cement, which would otherwise be used, by not less than 40 percent.
- C. Limit water-soluble, chloride-ion content in hardened concrete to 0.30 percent by weight of cement.
- D. Admixtures: Use admixtures according to manufacturer's written instructions.
 - 1. Use water-reducing, high-range water-reducing or plasticizing admixture in concrete, as required, for placement and workability.
 - 2. Use water-reducing and retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.
 - 3. Use water-reducing admixture in pumped concrete, concrete for heavy-use industrial slabs and parking structure slabs, concrete required to be watertight, and concrete with a water-cementitious materials ratio below 0.50.
 - 4. Use corrosion-inhibiting admixture in concrete mixtures where indicated.
- E. Proportion normal-weight concrete mixture as follows:
 - 1. Minimum Compressive Strength: As shown on Plans at 28 days.
 - 2. Minimum Cementitious Materials Content: 520 lb/cu. Yd.
 - 3. Maximum Water-Cementitious Materials Ratio: 0.40.
 - 4. Slump Limit: 4 inches for concrete with verified slump of 2 to 4 inches before adding high-range water-reducing admixture or plasticizing admixture, plus or minus 1 inch.
 - 5. Air Content: 5.5 percent, plus or minus 1.5 percent at point of delivery for 1-1/2-inch nominal maximum aggregate size.

2.10 FABRICATING REINFORCEMENT

- A. Fabricate steel reinforcement according to CRSI's "Manual of Standard Practice."

2.11 CONCRETE MIXING

- A. Ready-Mixed Concrete: Measure, batch, mix, and deliver concrete according to ASTM C 94, and furnish batch ticket information.
 - 1. When air temperature is between 85 and 90 deg F, reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F, reduce mixing and delivery time to 55 minutes.

PART 3 - EXECUTION

3.1 FORMWORK

- A. Design, erect, shore, brace, and maintain formwork, according to ACI 301, to support vertical, lateral, static, and dynamic loads, and construction loads that might be applied, until structure can support such loads.
- B. Construct formwork so concrete members and structures are of size, shape, alignment, elevation, and position indicated, within tolerance limits of ACI 117.
- C. Chamfer exterior corners and edges of permanently exposed concrete.

3.2 EMBEDDED ITEMS

- A. Place and secure anchorage devices and other embedded items required for adjoining work that is attached to or supported by cast-in-place concrete. Use setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.

3.3 VAPOR RETARDERS

- A. Sheet Vapor Retarders: Place, protect, and repair sheet vapor retarder according to ASTM E 1643 and manufacturer's written instructions.
 - 1. Lap joints 6 inches and seal with manufacturer's recommended tape.

3.4 STEEL REINFORCEMENT

- A. General: Comply with CRSI's "Manual of Standard Practice" for placing reinforcement.
 - 1. Do not cut or puncture vapor retarder. Repair damage and reseal vapor retarder before placing concrete.

3.5 JOINTS

- A. General: Construct joints true to line with faces perpendicular to surface plane of concrete.
- B. Construction Joints: Install so strength and appearance of concrete are not impaired, at locations indicated or as approved by Architect.
- C. Contraction Joints in Slabs-on-Grade: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of concrete thickness as follows:
 - 1. Grooved Joints: Form contraction joints after initial floating by grooving and finishing each edge of joint to a radius of 1/8 inch. Repeat grooving of contraction joints after applying surface finishes. Eliminate groover tool marks on concrete surfaces.

2. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch- wide joints into concrete when cutting action will not tear, abrade, or otherwise damage surface and before concrete develops random contraction cracks.
- D. Isolation Joints in Slabs-on-Grade: After removing formwork, install joint-filler strips at slab junctions with vertical surfaces, such as column pedestals, foundation walls, grade beams, and other locations, as indicated.
- E. Doweled Joints: Install dowel bars and support assemblies at joints where indicated. Lubricate or asphalt coat one-half of dowel length to prevent concrete bonding to one side of joint.

3.6 CONCRETE PLACEMENT

- A. Before placing concrete, verify that installation of formwork, reinforcement, and embedded items is complete and that required inspections have been performed.
- B. Deposit concrete continuously in one layer or in horizontal layers of such thickness that no new concrete will be placed on concrete that has hardened enough to cause seams or planes of weakness. If a section cannot be placed continuously, provide construction joints as indicated. Deposit concrete to avoid segregation.
 1. Consolidate placed concrete with mechanical vibrating equipment according to ACI 301.
- C. Cold-Weather Placement: Comply with ACI 306.1.
- D. Hot-Weather Placement: Comply with ACI 301.

3.7 FINISHING FORMED SURFACES

- A. Rough-Formed Finish: As-cast concrete texture imparted by form-facing material with tie holes and defects repaired and patched. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
- B. Smooth-Formed Finish: As-cast concrete texture imparted by form-facing material, arranged in an orderly and symmetrical manner with a minimum of seams. Repair and patch tie holes and defects. Remove fins and other projections that exceed specified limits on formed-surface irregularities.
- C. Rubbed Finish: Apply the following to smooth-formed finished as-cast concrete where indicated:
 1. Smooth-Rubbed Finish: Not later than one day after form removal, moisten concrete surfaces and rub with carborundum brick or another abrasive until

- producing a uniform color and texture. Do not apply cement grout other than that created by the rubbing process.
2. Grout-Cleaned Finish: Wet concrete surfaces and apply grout of a consistency of thick paint to coat surfaces and fill small holes. Mix one part portland cement to one and one-half parts fine sand with a 1:1 mixture of bonding admixture and water. Add white portland cement in amounts determined by trial patches so color of dry grout will match adjacent surfaces. Scrub grout into voids and remove excess grout. When grout whitens, rub surface with clean burlap and keep surface damp by fog spray for at least 36 hours.
 3. Cork-Floated Finish: Wet concrete surfaces and apply a stiff grout. Mix one part portland cement and one part fine sand with a 1:1 mixture of bonding agent and water. Add white portland cement in amounts determined by trial patches so color of dry grout will match adjacent surfaces. Compress grout into voids by grinding surface. In a swirling motion, finish surface with a cork float.
- D. Related Unformed Surfaces: At tops of walls, horizontal offsets, and similar unformed surfaces adjacent to formed surfaces, strike off smooth and finish with a texture matching adjacent formed surfaces. Continue final surface treatment of formed surfaces uniformly across adjacent unformed surfaces unless otherwise indicated.

3.8 FINISHING FLOORS AND SLABS

- A. General: Comply with ACI 302.1R recommendations for screeding, restraighening, and finishing operations for concrete surfaces. Do not wet concrete surfaces.
- B. Scratch Finish: While still plastic, texture concrete surface that has been screeded and bull-floated or darbied. Use stiff brushes, brooms, or rakes to produce a profile amplitude of 1/4 inch in one direction.
1. Apply scratch finish to surfaces indicated and to receive concrete floor toppings to receive mortar setting beds for bonded cementitious floor finishes.
- C. Float Finish: Consolidate surface with power-driven floats or by hand floating if area is small or inaccessible to power driven floats. Restraighten, cut down high spots, and fill low spots. Repeat float passes and restraighening until surface is left with a uniform, smooth, granular texture.
1. Apply float finish to surfaces indicated to receive trowel finish and to be covered with fluid-applied or sheet waterproofing, built-up or membrane roofing, or sand-bed terrazzo.
- D. Trowel Finish: After applying float finish, apply first troweling and consolidate concrete by hand or power-driven trowel. Continue troweling passes and restraighten until surface is free of trowel marks and uniform in texture and appearance. Grind smooth any surface defects that would telegraph through applied coatings or floor coverings.

1. Apply a trowel finish to surfaces indicated, exposed to view or to be covered with resilient flooring, carpet, ceramic or quarry tile set over a cleavage membrane, paint, or another thin-film-finish coating system.
 2. Finish and measure surface so gap at any point between concrete surface and an unlevelled, freestanding, 10-ft.- long straightedge resting on two high spots and placed anywhere on the surface does not exceed 1/8 inch.
- E. Trowel and Fine-Broom Finish: Apply a first trowel finish to surfaces indicated or where ceramic or quarry tile is to be installed by either thickset or thin-set method. While concrete is still plastic, slightly scarify surface with a fine broom.
1. Comply with flatness and levelness tolerances for trowel-finished floor surfaces.
- F. Broom Finish: Apply a broom finish to exterior concrete platforms, steps, ramps, and elsewhere as indicated.
- G. Polished Concrete: See Specification Section 03363 for Method and Process. Comply with flatness and levelness tolerances for polished concrete as recommended by the Concrete Polishing Association of America (CPAA).
1. Testing shall be conducted within 8 hours after completion of the final troweling and in accordance with the latest edition of ASTM E1155 Standard Test Method for Determining F_F Floor Flatness and F_L Floor Levelness Numbers by an independent testing agency experience with the testing procedure and possessing the necessary equipment.

	Specified Overall Value	Minimum Local Value
F_F Floor Flatness	50	35
F_L Floor Levelness	30	20

2. Slab shall be saw cut as soon as possible after finishing using a saw blade that has a triangular arbor configuration to reduce edge raveling or dislodging aggregates at the following spacing to minimize flab curling and cracking:

Slab thickness, inches	Spacing, feet on centers each way
4	10
6	12
8	15

3. The concrete slab shall comply with the damage and stain prevention provisions as recommended by CPAA.

3.9 CONCRETE PROTECTING AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures. Comply with ACI 306.1 for cold-weather protection and ACI 301 for hot-weather protection during curing.

- B. Evaporation Retarder: Apply evaporation retarder to unformed concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete, but before float finishing.
- C. Cure concrete according to ACI 308.1, by one or a combination of the following methods:
 - 1. Moisture Curing: Keep surfaces continuously moist for not less than seven days.
 - 2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive. Cure for not less than seven days. Immediately repair any holes or tears during curing period using cover material and waterproof tape.
 - 3. Curing Compound: Apply uniformly in continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Maintain continuity of coating and repair damage during curing period.
 - a. Removal: After curing period has elapsed, remove curing compound without damaging concrete surfaces by method recommended by curing compound manufacturer.
 - 4. Curing and Sealing Compound: Apply uniformly to floors and slabs indicated in a continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Repeat process 24 hours later and apply a second coat. Maintain continuity of coating and repair damage during curing period.

3.10 CONCRETE SURFACE REPAIRS

- A. Defective Concrete: Repair and patch defective areas when approved by Architect. Remove and replace concrete that cannot be repaired and patched to Architect's approval.

3.11 FIELD QUALITY CONTROL

- A. Testing and Inspecting: Owner will engage a qualified testing and inspecting agency to perform field tests and inspections and prepare test reports.

END OF SECTION 033000

DIVISION 5

METALS

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: dammonengineering.com



SECTION 051200

STRUCTURAL STEEL

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Structural steel.
 - 2. Architecturally exposed structural steel.
 - 3. Prefabricated building columns.
 - 4. Grout.

1.3 DEFINITIONS

- A. Structural Steel: Elements of structural-steel frame, as classified by AISC's "Code of Standard Practice for Steel Buildings and Bridges," that support design loads.
- B. Architecturally Exposed Structural Steel: Structural steel designated as architecturally exposed structural steel in the Contract Documents.

1.4 PERFORMANCE REQUIREMENTS

- A. Connections: Provide details of connections required by the Contract Documents to be selected or completed by structural-steel fabricator to withstand loads indicated and comply with other information and restrictions indicated.
 - 1. Select and complete connections using schematic details indicated and AISC's "Manual of Steel Construction, Load and Resistance Factor Design,"
 - 2. Engineering Responsibility: Fabricator's responsibilities include using a qualified professional engineer to prepare structural analysis data for structural-steel connections.

1.5 SUBMITTALS

- A. Product Data: For each type of product indicated.

- B. Shop Drawings: Show fabrication of structural-steel components.
 - 1. Include details of cuts, connections, splices, camber, holes, and other pertinent data.
 - 2. Include embedment drawings.
 - 3. Indicate welds by standard AWS symbols, distinguishing between shop and field welds, and show size, length, and type of each weld.
 - 4. Indicate type, size, and length of bolts, distinguishing between shop and field bolts. Identify pretensioned and slip-critical high-strength bolted connections.
 - 5. For structural-steel connections indicated to comply with design loads, include structural analysis data prepared by the qualified professional engineer responsible for their preparation.
- C. Welding certificates.
- D. Mill Test Reports: Signed by manufacturers certifying that the following products comply with requirements:
 - 1. Structural steel including chemical and physical properties.
 - 2. Bolts, nuts, and washers including mechanical properties and chemical analysis.
 - 3. Direct-tension indicators.
 - 4. Tension-control, high-strength bolt-nut-washer assemblies.
 - 5. Shear stud connectors.
 - 6. Shop primers.
 - 7. Non-shrink grout.
- E. Source quality-control test reports.

1.6 QUALITY ASSURANCE

- A. Installer Qualifications: A qualified installer who participates in the AISC Quality Certification Program and is designated an AISC-Certified Erector.
- B. Fabricator Qualifications: A qualified fabricator who participates in the AISC Quality Certification Program and is designated an AISC-Certified Plant.
- C. Shop-Painting Applicators: Qualified according to "Standard Procedure for Evaluating Qualifications of Shop Painting Applicators."
- D. Welding: Qualify procedures and personnel according to AWS D1.1, "Structural Welding Code--Steel."
- E. Comply with applicable provisions of the following specifications and documents:
 - 1. AISC's "Code of Standard Practice for Steel Buildings and Bridges."
 - 2. AISC's "Seismic Provisions for Structural Steel Buildings" and "Supplement No. 2."

3. AISC's "Specification for Structural Steel Buildings--Allowable Stress Design and Plastic Design or Load and Resistance Factor Design Specification for Structural Steel Buildings."
 4. AISC's "Specification for the Design of Steel Hollow Structural Sections."
 5. AISC's "Specification for Allowable Stress Design of Single-Angle Members or Specification for Load and Resistance Factor Design of Single-Angle Members."
 6. RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."
- F. Mockups: Build mockups of architecturally exposed structural steel to set quality standards for fabrication and installation.
1. Coordinate finish painting requirements with Division 9 painting Sections.
 2. Approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.
- G. Preinstallation Conference: Conduct conference at Project site to comply with requirements in Division 1 Section "Project Management and Coordination."

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Store materials to permit easy access for inspection and identification. Keep steel members off ground and spaced by using pallets, dunnage, or other supports and spacers. Protect steel members and packaged materials from erosion and deterioration.
1. Store fasteners in a protected place. Clean and relubricate bolts and nuts that become dry or rusty before use.
 2. Do not store materials on structure in a manner that might cause distortion, damage, or overload to members or supporting structures. Repair or replace damaged materials or structures as directed.

1.8 COORDINATION

- A. Furnish anchorage items to be embedded in or attached to other construction without delaying the Work. Provide setting diagrams, sheet metal templates, instructions, and directions for installation.

PART 2 - PRODUCTS

2.1 STRUCTURAL-STEEL MATERIALS

- A. W-Shapes: ASTM A 992/A 992M, Grade 50.
- B. Channels, Angles, M or , S-Shapes: ASTM A 36/A 36M.

- C. Plate and Bar: ASTM A 36/A 36M.
- D. Corrosion-Resisting Structural Steel: ASTM A 588/A 588M, Grade 50.
- E. Cold-Formed Hollow Structural Sections: ASTM A 500, Grade B or C, structural tubing.
- F. Corrosion-Resisting Cold-Formed Hollow Structural Sections: ASTM A 847, structural tubing.
- G. Steel Pipe: ASTM A 53/A 53M, Type E or S, Grade B.
 - 1. Weight Class: Standard.
 - 2. Finish: Black, except where indicated to be galvanized.
- H. Medium-Strength Steel Castings: ASTM A 27/A 27M, Grade 65-35, carbon steel.
- I. High-Strength Steel Castings: ASTM A 148/A 148M, Grade 80-50, carbon or alloy steel.
- J. Welding Electrodes: Comply with AWS requirements.

2.2 BOLTS, CONNECTORS, AND ANCHORS

- A. High-Strength Bolts, Nuts, and Washers: ASTM A 325, Type 1, heavy hex steel structural bolts; ASTM A 563 heavy hex carbon-steel nuts; and ASTM F 436 hardened carbon-steel washers.
 - 1. Finish: Mechanically deposited zinc coating, ASTM B 695, Class 50.
 - 2. Direct-Tension Indicators: ASTM F 959, Type 325 compressible-washer type.
 - a. Finish: Plain Mechanically deposited zinc coating, ASTM B 695, Class 50.
- B. High-Strength Bolts, Nuts, and Washers: ASTM A 490, Type 1, heavy hex steel structural bolts; ASTM A 563 heavy hex carbon-steel nuts; and ASTM F 436 hardened carbon-steel washers, plain.
 - 1. Direct-Tension Indicators: ASTM F 959, Type 490 compressible-washer type, plain.
- C. Tension-Control, High-Strength Bolt-Nut-Washer Assemblies: ASTM F 1852, Type 1, [heavy hex] [round] head steel structural bolts with splined ends; ASTM A 563 heavy hex carbon-steel nuts; and ASTM F 436 hardened carbon-steel washers.
 - 1. Finish: Plain Mechanically deposited zinc coating, ASTM B 695, Class 50.
- D. Shear Connectors: ASTM A 108, Grades 1015 through 1020, headed-stud type, cold-finished carbon steel; AWS D1.1, Type B.

- E. Unheaded Anchor Rods: ASTM F 1554, Grade 36 ASTM F 1554, Grade 55, weldable ASTM A 354 ASTM A 449 ASTM A 572/A 572M, Grade 50.
 - 1. Configuration: Hooked.
 - 2. Nuts: ASTM A 563 [heavy]hex carbon steel.
 - 3. Plate Washers: ASTM A 36/A 36M carbon steel.
 - 4. Washers: ASTM F 436 hardened carbon steel.
 - 5. Finish: Hot-dip zinc coating, ASTM A 153/A 153M, Class C Mechanically deposited zinc coating, ASTM B 695, Class 50.

- F. Headed Anchor Rods: ASTM F 1554, Grade 36 ASTM F 1554, Grade 55, weldable ASTM A 307, Grade A , straight.
 - 1. Nuts: ASTM A 563 heavy hex carbon steel.
 - 2. Plate Washers: ASTM A 36/A 36M carbon steel.
 - 3. Washers: ASTM F 436 hardened carbon steel.
 - 4. Finish: Hot-dip zinc coating, ASTM A 153/A 153M, Class C.

- G. Threaded Rods: ASTM A 307, Grade A .
 - 1. Nuts: ASTM A 563 heavy hex carbon steel.
 - 2. Washers: ASTM A 36/A 36M carbon steel.
 - 3. Finish: Hot-dip zinc coating, ASTM A 153/A 153M, Class C.

- H. Clevises Turnbuckles: ASTM A 108, Grade 1035, cold-finished carbon steel.

- I. Eye Bolts and Nuts: ASTM A 108, Grade 1030, cold-finished carbon steel.

- J. Sleeve Nuts: ASTM A 108, Grade 1018, cold-finished carbon steel.

2.3 PRIMER

- A. Primer: Fabricator's standard lead- and chromate-free, non-asphaltic, rust-inhibiting primer.

- B. Galvanizing Repair Paint: MPI#18, MPI#19, or SSPC-Paint 20.

2.4 GROUT

- A. Cement Grout: Portland cement, ASTM C 150, Type I; and clean, natural sand, ASTM C 404, Size No. 2. Mix at ratio of 1 part cement to 2-1/2 parts sand, by volume, with minimum water required for placement and hydration.

- B. Metallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, metallic aggregate grout, mixed with water to consistency suitable for application and a 30-minute working time.

- C. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive, nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

2.5 FABRICATION

- A. Structural Steel: Fabricate and assemble in shop to greatest extent possible. Fabricate according to AISC's "Code of Standard Practice for Steel Buildings and Bridges" and AISC's "Specification for Structural Steel Buildings--Allowable Stress Design and Plastic Design or Load and Resistance Factor Design Specification for Structural Steel Buildings."
 - 1. Camber structural-steel members where indicated.
 - 2. Identify high-strength structural steel according to ASTM A 6/ A 6M and maintain markings until structural steel has been erected.
 - 3. Mark and match-mark materials for field assembly.
 - 4. Complete structural-steel assemblies, including welding of units, before starting shop-priming operations.
- B. Architecturally Exposed Structural Steel: Comply with fabrication requirements, including tolerance limits, of AISC's "Code of Standard Practice for Steel Buildings and Bridges" for structural steel identified as architecturally exposed structural steel.
 - 1. Fabricate with exposed surfaces smooth, square, and free of surface blemishes including pitting, rust, scale, seam marks, roller marks, rolled trade names, and roughness.
 - 2. Remove blemishes by filling or grinding or by welding and grinding, before cleaning, treating, and shop priming.
- C. Thermal Cutting: Perform thermal cutting by machine to greatest extent possible.
 - 1. Plane thermally cut edges to be welded to comply with requirements in AWS D1.1.
- D. Bolt Holes: Cut, drill, mechanically thermal cut, or punch standard bolt holes perpendicular to metal surfaces.
- E. Finishing: Accurately finish ends of columns and other members transmitting bearing loads.
- F. Cleaning: Clean and prepare steel surfaces that are to remain unpainted.
- G. Shear Connectors: Prepare steel surfaces as recommended by manufacturer of shear connectors. Use automatic end welding of headed-stud shear connectors according to AWS D1.1 and manufacturer's written instructions.

- H. Steel Wall-Opening Framing: Select true and straight members for fabricating steel wall-opening framing to be attached to structural steel. Straighten as required to provide uniform, square, and true members in completed wall framing.
- I. Welded Door Frames: Build up welded door frames attached to structural steel. Weld exposed joints continuously and grind smooth. Plug-weld fixed steel bar stops to frames. Secure removable stops to frames with countersunk, cross-recessed head machine screws, uniformly spaced not more than 10 inches o.c., unless otherwise indicated.
- J. Holes: Provide holes required for securing other work to structural steel and for passage of other work through steel framing members.
 - 1. Cut, drill, or punch holes perpendicular to steel surfaces. Do not thermally cut bolt holes or enlarge holes by burning.
 - 2. Base-Plate Holes: Cut, drill, mechanically thermal cut, or punch holes perpendicular to steel surfaces.
 - 3. Weld threaded nuts to framing and other specialty items indicated to receive other work.

2.6 SHOP CONNECTIONS

- A. High-Strength Bolts: Shop install high-strength bolts according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for type of bolt and type of joint specified.
 - 1. Joint Type: Snug tightened.
- B. Weld Connections: Comply with AWS D1.1 for welding procedure specifications, tolerances, appearance, and quality of welds and for methods used in correcting welding work.
 - 1. Remove backing bars or runoff tabs, back gouge, and grind steel smooth.
 - 2. Assemble and weld built-up sections by methods that will maintain true alignment of axes without exceeding tolerances of AISC's "Code of Standard Practice for Steel Buildings and Bridges" for mill material.
 - 3. Verify that weld sizes, fabrication sequence, and equipment used for architecturally exposed structural steel will limit distortions to allowable tolerances. Prevent weld show-through on exposed steel surfaces.
 - a. Grind butt welds flush.
 - b. Grind or fill exposed fillet welds to smooth profile. Dress exposed welds.

2.7 SHOP PRIMING

- A. Shop prime steel surfaces except the following:

1. Surfaces embedded in concrete or mortar. Extend priming of partially embedded members to a depth of 2 inches.
 2. Surfaces to be field welded.
 3. Surfaces to be high-strength bolted with slip-critical connections.
 4. Surfaces to receive sprayed fire-resistive materials.
 5. Galvanized surfaces.
- B. Surface Preparation: Clean surfaces to be painted. Remove loose rust and mill scale and spatter, slag, or flux deposits. Prepare surfaces according to the following specifications and standards:
1. SSPC-SP 2, "Hand Tool Cleaning."
 2. SSPC-SP 3, "Power Tool Cleaning."
 3. SSPC-SP 5/NACE No. 1, "White Metal Blast Cleaning."
 4. SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning."
 5. SSPC-SP 7/NACE No. 4, "Brush-Off Blast Cleaning."
 6. SSPC-SP 8, "Pickling."
 7. SSPC-SP 10/NACE No. 2, "Near-White Blast Cleaning."
 8. SSPC-SP 11, "Power Tool Cleaning to Bare Metal."
 9. SSPC-SP 14/NACE No. 8, "Industrial Blast Cleaning."
- C. Priming: Immediately after surface preparation, apply primer according to manufacturer's written instructions and at rate recommended by SSPC to provide a dry film thickness of not less than 1.5 mils. Use priming methods that result in full coverage of joints, corners, edges, and exposed surfaces.
1. Stripe paint corners, crevices, bolts, welds, and sharp edges.
 2. Apply two coats of shop paint to inaccessible surfaces after assembly or erection. Change color of second coat to distinguish it from first.
- D. Painting: Apply a 1-coat, non-asphaltic primer complying with SSPC-PS Guide 7.00, "Painting System Guide 7.00: Guide for Selecting One-Coat Shop Painting Systems," to provide a dry film thickness of not less than 1.5 mils.

2.8 GALVANIZING

- A. Hot-Dip Galvanized Finish: Apply zinc coating by the hot-dip process to structural steel according to ASTM A 123/ A 123M.
1. Fill vent holes and grind smooth after galvanizing.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify elevations of concrete- and masonry-bearing surfaces and locations of anchor rods, bearing plates, and other embedments, with steel erector present, for compliance with requirements.
- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Provide temporary shores, guys, braces, and other supports during erection to keep structural steel secure, plumb, and in alignment against temporary construction loads and loads equal in intensity to design loads. Remove temporary supports when permanent structural steel, connections, and bracing are in place, unless otherwise indicated.
 - 1. Do not remove temporary shoring supporting composite deck construction until cast-in-place concrete has attained its design compressive strength.

3.3 ERECTION

- A. Set structural steel accurately in locations and to elevations indicated and according to AISC's "Code of Standard Practice for Steel Buildings and Bridges" and "Specification for Structural Steel Buildings--Allowable Stress Design and Plastic Design or Load and Resistance Factor Design Specification for Structural Steel Buildings."
- B. Base and Bearing Plates: Clean concrete- and masonry-bearing surfaces of bond-reducing materials, and roughen surfaces prior to setting base and bearing plates. Clean bottom surface of base and bearing plates.
 - 1. Set base and bearing plates for structural members on wedges, shims, or setting nuts as required.
 - 2. Weld plate washers to top of base plate.
 - 3. Snug-tighten anchor rods after supported members have been positioned and plumbed. Do not remove wedges or shims but, if protruding, cut off flush with edge of base or bearing plate before packing with grout.
 - 4. Promptly pack grout solidly between bearing surfaces and base or bearing plates so no voids remain. Neatly finish exposed surfaces; protect grout and allow to cure. Comply with manufacturer's written installation instructions for shrinkage-resistant grouts.

- C. Maintain erection tolerances of structural steel and architecturally exposed structural steel within AISC's "Code of Standard Practice for Steel Buildings and Bridges."
- D. Align and adjust various members forming part of complete frame or structure before permanently fastening. Before assembly, clean bearing surfaces and other surfaces that will be in permanent contact with members. Perform necessary adjustments to compensate for discrepancies in elevations and alignment.
 - 1. Level and plumb individual members of structure.
 - 2. Make allowances for difference between temperature at time of erection and mean temperature when structure is completed and in service.
- E. Splice members only where indicated.
- F. Remove erection bolts on welded, architecturally exposed structural steel; fill holes with plug welds; and grind smooth at exposed surfaces.
- G. Do not use thermal cutting during erection.
- H. Do not enlarge unfair holes in members by burning or using drift pins. Ream holes that must be enlarged to admit bolts.
- I. Shear Connectors: Prepare steel surfaces as recommended by manufacturer of shear connectors. Use automatic end welding of headed-stud shear connectors according to AWS D1.1 and manufacturer's written instructions.

3.4 FIELD CONNECTIONS

- A. High-Strength Bolts: Install high-strength bolts according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for type of bolt and type of joint specified.
 - 1. Joint Type: Snug tightened.
- B. Weld Connections: Comply with AWS D1.1 for welding procedure specifications, tolerances, appearance, and quality of welds and for methods used in correcting welding work.
 - 1. Comply with AISC's "Code of Standard Practice for Steel Buildings and Bridges" and "Specification for Structural Steel Buildings--Allowable Stress Design and Plastic Design or Load and Resistance Factor Design Specification for Structural Steel Buildings" for bearing, adequacy of temporary connections, alignment, and removal of paint on surfaces adjacent to field welds.
 - 2. Remove backing bars or runoff tabs, back gouge, and grind steel smooth.
 - 3. Assemble and weld built-up sections by methods that will maintain true alignment of axes without exceeding tolerances of AISC's "Code of Standard Practice for Steel Buildings and Bridges" for mill material.

4. Verify that weld sizes, fabrication sequence, and equipment used for architecturally exposed structural steel will limit distortions to allowable tolerances. Prevent weld show-through on exposed steel surfaces.
 - a. Grind butt welds flush.
 - b. Grind or fill exposed fillet welds to smooth profile. Dress exposed welds.

3.5 PREFABRICATED BUILDING COLUMNS

- A. Install prefabricated building columns to comply with AISC's "Specification for Structural Steel Buildings--Allowable Stress Design and Plastic Design or Load and Resistance Factor Design Specification for Structural Steel Buildings," manufacturer's written recommendations, and requirements of testing and inspecting agency that apply to the fire-resistance rating indicated.

3.6 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified independent testing and inspecting agency to inspect field welds and high-strength bolted connections.
- B. Bolted Connections: Shop-bolted connections will be tested and inspected according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."
- C. Welded Connections: Field welds will be visually inspected according to AWS D1.1.
 1. In addition to visual inspection, field welds will be tested according to AWS D1.1 and the following inspection procedures, at testing agency's option:
 - a. Liquid Penetrant Inspection: ASTM E 165.
 - b. Magnetic Particle Inspection: ASTM E 709; performed on root pass and on finished weld. Cracks or zones of incomplete fusion or penetration will not be accepted.
 - c. Ultrasonic Inspection: ASTM E 164.
 - d. Radiographic Inspection: ASTM E 94.
- D. In addition to visual inspection, test and inspect field-welded shear connectors according to requirements in AWS D1.1 for stud welding and as follows:
 1. Perform bend tests if visual inspections reveal either a less-than- continuous 360-degree flash or welding repairs to any shear connector.
 2. Conduct tests on additional shear connectors if weld fracture occurs on shear connectors already tested, according to requirements in AWS D1.1.
- E. Correct deficiencies in Work that test reports and inspections indicate does not comply with the Contract Documents.

3.7 REPAIRS AND PROTECTION

- A. Repair damaged galvanized coatings on galvanized items with galvanized repair paint according to ASTM A 780 and manufacturer's written instructions.
- B. Touchup Painting: After installation, promptly clean, prepare, and prime or reprime field connections, rust spots, and abraded surfaces of prime-painted joists and accessories, bearing plates, and abutting structural steel.
 - 1. Clean and prepare surfaces by SSPC-SP 2 hand-tool cleaning or SSPC-SP 3 power-tool cleaning.
 - 2. Apply a compatible primer of same type as shop primer used on adjacent surfaces.
- C. Touchup Painting: Cleaning and touchup painting are specified in Division 9 painting Sections.

END OF DOCUMENT 051200

SECTION 054000

COLD-FORMED METAL FRAMING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
1. Exterior load-bearing wall framing.
 2. Interior load-bearing wall framing.
 3. Exterior non-load-bearing wall framing.
 4. Roof rafter framing.
 5. Ceiling joist framing.

1.3 PERFORMANCE REQUIREMENTS

- A. Structural Performance: Provide cold-formed metal framing capable of withstanding design loads within limits and under conditions indicated.
1. Design Loads: As indicated.
 2. Deflection Limits: Design framing systems to withstand design loads without deflections greater than the following:
 - a. Exterior Load-Bearing Wall Framing: Horizontal deflection of 1/240 of the wall height.
 - b. Interior Load-Bearing Wall Framing: Horizontal deflection of 1/240 of the wall height under a horizontal load of 5 lbf/sq. ft.
 - c. Exterior Non-Load-Bearing Framing: Horizontal deflection of 1/240 of the wall height.
 - d. Floor Joist Framing: Vertical deflection of 1/480 for live loads and 1/360 for total loads of the span.
 - e. Roof Rafter Framing: Horizontal deflection of 1/240 of the horizontally projected span.
 - f. Ceiling Joist Framing: Vertical deflection of 1/240 of the span.
 3. Design framing systems to provide for movement of framing members without damage or overstressing, sheathing failure, connection failure, undue strain on

- fasteners and anchors, or other detrimental effects when subject to a maximum ambient temperature change of 120 deg F.
4. Design framing system to maintain clearances at openings, to allow for construction tolerances, and to accommodate live load deflection of primary building structure as follows:
 - a. Upward and downward movement of 1/2 inch.
- B. Cold-Formed Steel Framing, General: Design according to AISI's "Standard for Cold-Formed Steel Framing - General Provisions."
1. Headers: Design according to AISI's "Standard for Cold-Formed Steel Framing - Header Design."
 2. Design exterior non-load-bearing wall framing to accommodate horizontal deflection without regard for contribution of sheathing materials.
 3. Roof Trusses: Design according to AISI's "Standard for Cold-Formed Steel Framing - Truss Design."
- 1.4 SUBMITTALS
- A. Product Data: For each type of cold-formed metal framing product and accessory indicated.
 - B. Shop Drawings: Show layout, spacings, sizes, thicknesses, and types of cold-formed metal framing; fabrication; and fastening and anchorage details, including mechanical fasteners. Show reinforcing channels, opening framing, supplemental framing, strapping, bracing, bridging, splices, accessories, connection details, and attachment to adjoining work.
 1. For cold-formed metal framing indicated to comply with design loads, include structural analysis data signed and sealed by the qualified professional engineer responsible for their preparation.
 - C. Welding certificates.
 - D. Product Test Reports: From a qualified testing agency, unless otherwise stated, indicating that each of the following complies with requirements, based on evaluation of comprehensive tests for current products:
 1. Steel sheet.
 2. Expansion anchors.
 3. Power-actuated anchors.
 4. Mechanical fasteners.
 5. Vertical deflection clips.
 6. Horizontal drift deflection clips
 7. Miscellaneous structural clips and accessories.
 - E. Research/Evaluation Reports: For cold-formed metal framing.

1.5 QUALITY ASSURANCE

- A. Engineering Responsibility: Preparation of Shop Drawings, design calculations, and other structural data by a qualified professional engineer.
- B. Professional Engineer Qualifications: A professional engineer who is legally qualified to practice in jurisdiction where Project is located and who is experienced in providing engineering services of the kind indicated. Engineering services are defined as those performed for installations of cold-formed metal framing that are similar to those indicated for this Project in material, design, and extent.
- C. Testing Agency Qualifications: An independent testing agency, acceptable to authorities having jurisdiction, qualified according to ASTM E 329 to conduct the testing indicated.
- D. Product Tests: Mill certificates or data from a qualified independent testing agency, or in-house testing with calibrated test equipment indicating steel sheet complies with requirements, including base-metal thickness, yield strength, tensile strength, total elongation, chemical requirements, ductility, and metallic-coating thickness.
- E. Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code--Steel," and AWS D1.3, "Structural Welding Code--Sheet Steel."
- F. Fire-Test-Response Characteristics: Where indicated, provide cold-formed metal framing identical to that of assemblies tested for fire resistance per ASTM E 119 by a testing and inspecting agency acceptable to authorities having jurisdiction.
- G. AISI Specifications and Standards: Comply with AISI's "North American Specification for the Design of Cold-Formed Steel Structural Members" and its "Standard for Cold-Formed Steel Framing - General Provisions."
 - 1. Comply with AISI's "Standard for Cold-Formed Steel Framing - Truss Design."
 - 2. Comply with AISI's "Standard for Cold-Formed Steel Framing - Header Design."
- H. Comply with AISI's "Standard for Cold-Formed Steel Framing - Prescriptive Method for One and Two Family Dwellings."
- I. Preinstallation Conference: Conduct conference at Project site to comply with requirements in Division 1 Section "Project Management and Coordination."

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Protect cold-formed metal framing from corrosion, deformation, and other damage during delivery, storage, and handling.
- B. Store cold-formed metal framing, protect with a waterproof covering, and ventilate to avoid condensation.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering cold-formed metal framing that may be incorporated into the Work include, but are not limited to, the following:
- B. Manufacturers: Subject to compliance with requirements, provide cold-formed metal framing by one of the following:
 - 1. Allied Studco.
 - 2. AllSteel Products, Inc.
 - 3. California Expanded Metal Products Company.
 - 4. Clark Steel Framing.
 - 5. Consolidated Fabricators Corp.; Building Products Division.
 - 6. Craco Metals Manufacturing, LLC.
 - 7. Custom Stud, Inc.
 - 8. Dale/Incor.
 - 9. Design Shapes in Steel.
 - 10. Dietrich Metal Framing; a Worthington Industries Company.
 - 11. Formetal Co. Inc. (The).
 - 12. Innovative Steel Systems.
 - 13. MarinoWare; a division of Ware Industries.
 - 14. Quail Run Building Materials, Inc.
 - 15. SCAFCO Corporation.
 - 16. Southeastern Stud & Components, Inc.
 - 17. Steel Construction Systems.
 - 18. Steeler, Inc.
 - 19. Super Stud Building Products, Inc.
 - 20. United Metal Products, Inc.

2.2 MATERIALS

- A. Steel Sheet: ASTM A 1003/A 1003M, Structural Grade, Type H, metallic coated, of grade and coating weight as follows:
 - 1. Grade: As required by structural performance.
 - 2. Coating: G60, A60, AZ50, or GF30.
- B. Steel Sheet for Vertical Deflection Clips: ASTM A 653/A 653M, structural steel, zinc coated, of grade and coating as follows:
 - 1. Grade: As required by structural performance.
 - 2. Coating: G90.

2.3 LOAD-BEARING WALL FRAMING

- A. Steel Studs: Manufacturer's standard C-shaped steel studs, of web depths indicated, punched, with stiffened flanges.
- B. Steel Track: Manufacturer's standard U-shaped steel track, of web depths indicated, unpunched, with straight flanges.
- C. Steel Box or Back-to-Back Headers: Manufacturer's standard C-shapes used to form header beams, of web depths indicated, punched, with stiffened flanges.
- D. Steel Double-L Headers: Manufacturer's standard L-shapes used to form header beams, of web depths indicated.

2.4 EXTERIOR NON-LOAD-BEARING WALL FRAMING

- A. Steel Studs: Manufacturer's standard C-shaped steel studs, of web depths indicated, punched, with stiffened flanges.
- B. Steel Track: Manufacturer's standard U-shaped steel track, of web depths indicated, unpunched, with unstiffened flanges.
- C. Vertical Deflection Clips: Manufacturer's standard clips, capable of accommodating upward and downward vertical displacement of primary structure through positive mechanical attachment to stud web.
 - 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Dietrich Metal Framing; a Worthington Industries Company.
 - b. MarinoWare, a division of Ware Industries.
 - c. SCAFCO Corporation
 - d. The Steel Network, Inc.
- D. Single Deflection Track: Manufacturer's single, deep-leg, U-shaped steel track; unpunched, with unstiffened flanges, of web depth to contain studs while allowing free vertical movement, with flanges designed to support horizontal and lateral loads and transfer them to the primary structure.
- E. Double Deflection Tracks: Manufacturer's double, deep-leg, U-shaped steel tracks, consisting of nested inner and outer tracks; unpunched, with unstiffened flanges.
 - 1. Outer Track: Of web depth to allow free vertical movement of inner track, with flanges designed to support horizontal and lateral loads and transfer them to the primary structure.

2. Inner Track: Of web depth indicated.

- F. Drift Clips: Manufacturer's standard bypass or head clips, capable of isolating wall stud from upward and downward vertical displacement and lateral drift of primary structure.

2.5 ROOF-RAFTER FRAMING

- A. Steel Rafters: Manufacturer's standard C-shaped steel sections, of web depths indicated, unpunched, with stiffened flanges.
- B. Built-up Members: Built-up members of manufacturer's standard C-shaped steel section, with stiffened flanges, nested into a U-shaped steel section joist track, with unstiffened flanges; unpunched; of web depths indicated.

2.6 CEILING JOIST FRAMING

- A. Steel Ceiling Joists: Manufacturer's standard C-shaped steel sections, of web depths indicated, with stiffened flanges.

2.7 FRAMING ACCESSORIES

- A. Fabricate steel-framing accessories from steel sheet, ASTM A 1003/A 1003M, Structural Grade, Type H, metallic coated, of same grade and coating weight used for framing members.
- B. Provide accessories of manufacturer's standard thickness and configuration, unless otherwise indicated, as follows:
1. Supplementary framing.
 2. Bracing, bridging, and solid blocking.
 3. Web stiffeners.
 4. Anchor clips.
 5. End clips.
 6. Foundation clips.
 7. Gusset plates.
 8. Stud kickers, knee braces, and girts.
 9. Joist hangers and end closures.
 10. Hole reinforcing plates.
 11. Backer plates.

2.8 ANCHORS, CLIPS, AND FASTENERS

- A. Steel Shapes and Clips: ASTM A 36/A 36M, zinc coated by hot-dip process according to ASTM A 123/A 123M.

- B. Anchor Bolts: ASTM F 1554, Grade 36, threaded carbon-steel hex-headed bolts, headless, hooked bolts and carbon-steel nuts; and flat, hardened-steel washers; zinc coated by hot-dip process according to ASTM A 153/A 153M, Class C.
- C. Expansion Anchors: Fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 5 times design load, as determined by testing per ASTM E 488 conducted by a qualified independent testing agency.
- D. Power-Actuated Anchors: Fastener system of type suitable for application indicated, fabricated from corrosion-resistant materials, with capability to sustain, without failure, a load equal to 10 times design load, as determined by testing per ASTM E 1190 conducted by a qualified independent testing agency.
- E. Mechanical Fasteners: ASTM C 1513, corrosion-resistant-coated, self-drilling, self-tapping steel drill screws.
 - 1. Head Type: Low-profile head beneath sheathing, manufacturer's standard elsewhere.
- F. Welding Electrodes: Comply with AWS standards.

2.9 MISCELLANEOUS MATERIALS

- A. Galvanizing Repair Paint: ASTM A 780.
- B. Cement Grout: Portland cement, ASTM C 150, Type I; and clean, natural sand, ASTM C 404. Mix at ratio of 1 part cement to 2-1/2 parts sand, by volume, with minimum water required for placement and hydration.
- C. Nonmetallic, Nonshrink Grout: Premixed, nonmetallic, noncorrosive, nonstaining grout containing selected silica sands, portland cement, shrinkage-compensating agents, and plasticizing and water-reducing agents, complying with ASTM C 1107, with fluid consistency and 30-minute working time.
- D. Shims: Load bearing, high-density multimonomer plastic, nonleaching.
- E. Sealer Gaskets: Closed-cell neoprene foam, 1/4 inch thick, selected from manufacturer's standard widths to match width of bottom track or rim track members.

2.10 FABRICATION

- A. Fabricate cold-formed metal framing and accessories plumb, square, and true to line, and with connections securely fastened, according to referenced AISI's specifications and standards, manufacturer's written instructions, and requirements in this Section.

1. Fabricate framing assemblies using jigs or templates.
 2. Cut framing members by sawing or shearing; do not torch cut.
 3. Fasten cold-formed metal framing members by welding, screw fastening, clinch fastening, or riveting as standard with fabricator. Wire tying of framing members is not permitted.
 - a. Comply with AWS D1.3 requirements and procedures for welding, appearance and quality of welds, and methods used in correcting welding work.
 - b. Locate mechanical fasteners and install according to Shop Drawings, with screw penetrating joined members by not less than three exposed screw threads.
 4. Fasten other materials to cold-formed metal framing by welding, bolting, or screw fastening, according to Shop Drawings.
- B. Reinforce, stiffen, and brace framing assemblies to withstand handling, delivery, and erection stresses. Lift fabricated assemblies to prevent damage or permanent distortion.
- C. Fabrication Tolerances: Fabricate assemblies level, plumb, and true to line to a maximum allowable tolerance variation of 1/8 inch in 10 feet and as follows:
1. Spacing: Space individual framing members no more than plus or minus 1/8 inch from plan location. Cumulative error shall not exceed minimum fastening requirements of sheathing or other finishing materials.
 2. Squareness: Fabricate each cold-formed metal framing assembly to a maximum out-of-square tolerance of 1/8 inch.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine supporting substrates and abutting structural framing for compliance with requirements for installation tolerances and other conditions affecting performance.
1. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Before sprayed fire-resistive materials are applied, attach continuous angles, supplementary framing, or tracks to structural members indicated to receive sprayed fire-resistive materials.

- B. After applying sprayed fire-resistive materials, remove only as much of these materials as needed to complete installation of cold-formed framing without reducing thickness of fire-resistive materials below that are required to obtain fire-resistance rating indicated. Protect remaining fire-resistive materials from damage.
- C. Install load bearing shims or grout between the underside of wall bottom track or rim track and the top of foundation wall or slab at stud or joist locations to ensure a uniform bearing surface on supporting concrete or masonry construction.
- D. Install sealer gaskets to isolate the underside of wall bottom track or rim track and the top of foundation wall or slab at stud or joist locations.

3.3 INSTALLATION, GENERAL

- A. Cold-formed metal framing may be shop or field fabricated for installation, or it may be field assembled.
- B. Install cold-formed metal framing according to AISI's "Standard for Cold-Formed Steel Framing - General Provisions" and to manufacturer's written instructions unless more stringent requirements are indicated.
- C. Install shop- or field-fabricated, cold-formed framing and securely anchor to supporting structure.
 - 1. Screw, bolt, or weld wall panels at horizontal and vertical junctures to produce flush, even, true-to-line joints with maximum variation in plane and true position between fabricated panels not exceeding 1/16 inch.
- D. Install cold-formed metal framing and accessories plumb, square, and true to line, and with connections securely fastened.
 - 1. Cut framing members by sawing or shearing; do not torch cut.
 - 2. Fasten cold-formed metal framing members by welding, screw fastening, clinch fastening, or riveting. Wire tying of framing members is not permitted.
 - a. Comply with AWS D1.3 requirements and procedures for welding, appearance and quality of welds, and methods used in correcting welding work.
 - b. Locate mechanical fasteners and install according to Shop Drawings, and complying with requirements for spacing, edge distances, and screw penetration.
- E. Install framing members in one-piece lengths unless splice connections are indicated for track or tension members.
- F. Install temporary bracing and supports to secure framing and support loads comparable in intensity to those for which structure was designed. Maintain braces

and supports in place, undisturbed, until entire integrated supporting structure has been completed and permanent connections to framing are secured.

- G. Do not bridge building expansion and control joints with cold-formed metal framing. Independently frame both sides of joints.
- H. Install insulation, specified in Division 7 Section "Building Insulation," in built-up exterior framing members, such as headers, sills, boxed joists, and multiple studs at openings, that are inaccessible on completion of framing work.
- I. Fasten hole reinforcing plate over web penetrations that exceed size of manufacturer's standard punched openings.
- J. Erection Tolerances: Install cold-formed metal framing level, plumb, and true to line to a maximum allowable tolerance variation of 1/8 inch in 10 feet and as follows:
 - 1. Space individual framing members no more than plus or minus 1/8 inch from plan location. Cumulative error shall not exceed minimum fastening requirements of sheathing or other finishing materials.

3.4 LOAD-BEARING WALL INSTALLATION

- A. Install continuous top and bottom tracks sized to match studs. Align tracks accurately and securely anchor at corners and ends.
- B. Squarely seat studs against top and bottom tracks with gap not exceeding of 1/8 inch studs to top and bottom tracks.
 - 1. Stud Spacing: As indicated.
- C. Set studs plumb, except as needed for diagonal bracing or required for nonplumb walls or warped surfaces and similar configurations.
- D. Align studs vertically where floor framing interrupts wall-framing continuity. Where studs cannot be aligned, continuously reinforce track to transfer loads.
- E. Align floor and roof framing over studs. Where framing cannot be aligned, continuously reinforce track to transfer loads.
- F. Anchor studs abutting structural columns or walls, including masonry walls, to supporting structure as indicated.
- G. Install headers over wall openings wider than stud spacing. Locate headers above openings as indicated. Fabricate headers of compound shapes indicated or required to transfer load to supporting studs, complete with clip-angle connectors, web stiffeners, or gusset plates.

1. Frame wall openings with not less than a double stud at each jamb of frame as indicated on Shop Drawings. Fasten jamb members together to uniformly distribute loads.
 2. Install runner tracks and jack studs above and below wall openings. Anchor tracks to jamb studs with clip angles or by welding, and space jack studs same as full-height wall studs.
- H. Install supplementary framing, blocking, and bracing in stud framing indicated to support fixtures, equipment, services, casework, heavy trim, furnishings, and similar work requiring attachment to framing.
1. If type of supplementary support is not indicated, comply with stud manufacturer's written recommendations and industry standards in each case, considering weight or load resulting from item supported.
- I. Install horizontal bridging in stud system. Fasten at each stud intersection.
1. Bridging: Cold-rolled steel channel, welded or mechanically fastened to webs of punched studs with a minimum of 2 screws into each flange of the clip angle for framing members up to 6 inches deep.
 2. Bridging: Combination of flat, taut, steel sheet straps of width and thickness indicated and stud-track solid blocking of width and thickness to match studs. Fasten flat straps to stud flanges and secure solid blocking to stud webs or flanges.
 3. Bridging: Proprietary bridging bars installed according to manufacturer's written instructions.
- J. Install steel sheet diagonal bracing straps to both stud flanges, terminate at and fasten to reinforced top and bottom tracks. Fasten clip-angle connectors to multiple studs at ends of bracing and anchor to structure.
- K. Install miscellaneous framing and connections, including supplementary framing, web stiffeners, clip angles, continuous angles, anchors, and fasteners, to provide a complete and stable wall-framing system.
- 3.5 EXTERIOR NON-LOAD-BEARING WALL INSTALLATION
- A. Install continuous tracks sized to match studs. Align tracks accurately and securely anchor to supporting structure as indicated.
- B. Fasten both flanges of studs to top and bottom track, unless otherwise indicated. Space studs as follows:
1. Stud Spacing: As indicated.
- C. Set studs plumb, except as needed for diagonal bracing or required for nonplumb walls or warped surfaces and similar requirements.

- D. Isolate non-load-bearing steel framing from building structure to prevent transfer of vertical loads while providing lateral support.
 - 1. Install single-leg deflection tracks and anchor to building structure.
 - 2. Install double deep-leg deflection tracks and anchor outer track to building structure.
 - 3. Connect vertical deflection clips to studs and anchor to building structure.
 - 4. Connect drift clips to cold formed metal framing and anchor to building structure.

- E. Install horizontal bridging in wall studs, spaced in rows indicated on Shop Drawings but not more than 48 inches apart. Fasten at each stud intersection.
 - 1. Top Bridging for Single Deflection Track: Install a combination of flat, taut, steel sheet straps of width and thickness indicated and stud or stud-track solid blocking of width and thickness matching studs. Fasten flat straps to stud flanges and secure solid blocking to stud webs or flanges.
 - 2. Bridging: Cold-rolled steel channel, welded or mechanically fastened to webs of punched studs.
 - 3. Bridging: Combination of flat, taut, steel sheet straps of width and thickness indicated and stud-track solid blocking of width and thickness to match studs. Fasten flat straps to stud flanges and secure solid blocking to stud webs or flanges.
 - 4. Bridging: Proprietary bridging bars installed according to manufacturer's written instructions.

- F. Install miscellaneous framing and connections, including stud kickers, web stiffeners, clip angles, continuous angles, anchors, fasteners, and stud girts, to provide a complete and stable wall-framing system.

3.6 JOIST INSTALLATION

- A. Install perimeter joist track sized to match joists. Align and securely anchor or fasten track to supporting structure at corners, ends, and spacings indicated on Shop Drawings.

- B. Install joists bearing on supporting frame, level, straight, and plumb; adjust to final position, brace, and reinforce. Fasten joists to both flanges of joist track.
 - 1. Install joists over supporting frame with a minimum end bearing of 1-1/2 inches.
 - 2. Reinforce ends and bearing points of joists with web stiffeners, end clips, joist hangers, steel clip angles, or steel-stud sections as indicated on Shop Drawings.

- C. Space joists not more than 2 inches from abutting walls, and as follows:

1. Joist Spacing: As indicated.
- D. Frame openings with built-up joist headers consisting of joist and joist track, nesting joists, or another combination of connected joists if indicated.
- E. Install joist reinforcement at interior supports with single, short length of joist section located directly over interior support, with lapped joists of equal length to joist reinforcement, or as indicated on Shop Drawings.
 1. Install web stiffeners to transfer axial loads of walls above.
- F. Install bridging at intervals indicated on Shop Drawings. Fasten bridging at each joist intersection as follows:
 1. Bridging: Joist-track solid blocking of width and thickness indicated, secured to joist webs.
 2. Bridging: Combination of flat, taut, steel sheet straps of width and thickness indicated and joist-track solid blocking of width and thickness indicated. Fasten flat straps to bottom flange of joists and secure solid blocking to joist webs.
- G. Secure joists to load-bearing interior walls to prevent lateral movement of bottom flange.
- H. Install miscellaneous joist framing and connections, including web stiffeners, closure pieces, clip angles, continuous angles, hold-down angles, anchors, and fasteners, to provide a complete and stable joist-framing assembly.

3.7 FIELD QUALITY CONTROL

- A. Testing: Owner will engage a qualified independent testing and inspecting agency to perform field tests and inspections and prepare test reports.
- B. Field and shop welds will be subject to testing and inspecting.
- C. Testing agency will report test results promptly and in writing to Contractor and Architect.
- D. Remove and replace work where test results indicate that it does not comply with specified requirements.
- E. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.

3.8 REPAIRS AND PROTECTION

- A. Galvanizing Repairs: Prepare and repair damaged galvanized coatings on fabricated and installed cold-formed metal framing with galvanized repair paint according to ASTM A 780 and manufacturer's written instructions.
- B. Provide final protection and maintain conditions, in a manner acceptable to manufacturer and Installer, that ensure that cold-formed metal framing is without damage or deterioration at time of Substantial Completion.

END OF DOCUMENT 054000

SECTION 055000
METAL FABRICATIONS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Miscellaneous steel framing and supports.
2. Prefabricated building columns.
3. Metal ladders.
4. Miscellaneous steel trim.
5. Metal bollards.
6. Abrasive metal nosing treads.

B. Products furnished, but not installed, under this Section include the following:

1. Anchor bolts, steel pipe sleeves, slotted-channel inserts, and wedge-type inserts indicated to be cast into concrete or built into unit masonry.
2. Steel weld plates and angles for casting into concrete for applications where they are not specified in other Sections.

1.2 ACTION SUBMITTALS

A. Product Data: For the following:

1. Prefabricated building columns.
2. Metal nosings and treads.
3. Paint products.
4. Grout.

B. Shop Drawings: Show fabrication and installation details. Include plans, elevations, sections, and details of metal fabrications and their connections. Show anchorage and accessory items.

C. Samples for Verification: For each type and finish of extruded nosing and tread.

D. Delegated-Design Submittal: For ladders, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Engage a qualified professional engineer to design ladders.
- B. Structural Performance of Aluminum Ladders: Aluminum ladders, including landings, shall withstand the effects of loads and stresses within limits and under conditions specified in ANSI A14.3.
- C. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes acting on exterior metal fabrications by preventing buckling, opening of joints, overstressing of components, failure of connections, and other detrimental effects.
 - 1. Temperature Change: 120 deg F, ambient; 180 deg F, material surfaces.

2.2 METALS

- A. Metal Surfaces, General: Provide materials with smooth, flat surfaces unless otherwise indicated. For metal fabrications exposed to view in the completed Work, provide materials without seam marks, roller marks, rolled trade names, or blemishes.
- B. Steel Plates, Shapes, and Bars: ASTM A 36/A 36M.
- C. Stainless-Steel Bars and Shapes: ASTM A 276, Type 304.
- D. Rolled-Steel Floor Plate: ASTM A 786/A 786M, rolled from plate complying with ASTM A 36/A 36M or ASTM A 283/A 283M, Grade C or D.
- E. Rolled-Stainless-Steel Floor Plate: ASTM A 793.
- F. Abrasive-Surface Floor Plate: Steel plate with abrasive granules rolled into surface or with abrasive material metallurgically bonded to steel.
 - 1. Products: Subject to compliance with requirements, provide one of the following:
 - a. IKG Industries, a division of Harsco Corporation; Mebac.
 - b. SlipNOT Metal Safety Flooring; SlipNOT.
- G. Steel Tubing: ASTM A 500/A 500M, cold-formed steel tubing.
- H. Steel Pipe: ASTM A 53/A 53M, Standard Weight (Schedule 40) unless otherwise indicated.
- I. Zinc-Coated Steel Wire Rope: ASTM A 741.

1. Wire-Rope Fittings: Hot-dip galvanized-steel connectors with capability to sustain, without failure, a load equal to minimum breaking strength of wire rope with which they are used.
- J. Slotted Channel Framing: Cold-formed metal box channels (struts) complying with MFMA-4.
 1. Size of Channels: As indicated.
 2. Material: Galvanized steel, ASTM A 653/A 653M, commercial steel, Type B, with G90 coating; 0.108-inch nominal thickness.
 3. Material: Cold-rolled steel, ASTM A 1008/A 1008M, commercial steel, Type B structural steel, Grade 33; 0.0966-inch minimum thickness; hot-dip galvanized after fabrication.
- K. Cast Iron: Either gray iron, ASTM A 48/A 48M, or malleable iron, ASTM A 47/A 47M, unless otherwise indicated.
- L. Aluminum Extrusions: ASTM B 221, Alloy 6063-T6.
- M. Aluminum-Alloy Rolled Tread Plate: ASTM B 632/B 632M, Alloy 6061-T6.
- N. Aluminum Castings: ASTM B 26/B 26M, Alloy 443.0-F.
- O. Bronze Extrusions: ASTM B 455, Alloy UNS No. C38500 (extruded architectural bronze).
- P. Bronze Castings: ASTM B 584, Alloy UNS No. C83600 (leaded red brass) or No. C84400 (leaded semired brass).
- Q. Nickel Silver Castings: ASTM B 584, Alloy UNS No. C97600 (20 percent leaded nickel bronze).

2.3 FASTENERS

- A. General: Unless otherwise indicated, provide Type 316 stainless-steel fasteners for exterior use and hot-dip galvanized fasteners with coating complying with ASTM B 633 or ASTM F 1941, Class Fe/Zn 5, at exterior walls. Select fasteners for type, grade, and class required.
 1. Provide stainless-steel fasteners for fastening aluminum.
 2. Provide stainless-steel fasteners for fastening stainless steel.
 3. Provide stainless-steel fasteners for fastening nickel silver.
 4. Provide bronze fasteners for fastening bronze.
- B. Cast-in-Place Anchors in Concrete: Either threaded type or wedge type unless otherwise indicated; galvanized ferrous castings, either ASTM A 47/A 47M malleable iron or ASTM A 27/A 27M cast steel. Provide bolts, washers, and shims as needed, all hot-dip galvanized per ASTM F 2329.

- C. Post-Installed Anchors: Torque-controlled expansion anchors or chemical anchors.
 - 1. Material for Interior Locations: Carbon-steel components zinc plated to comply with ASTM B 633 or ASTM F 1941, Class Fe/Zn 5, unless otherwise indicated.
 - 2. Material for Exterior Locations and Where Stainless Steel Is Indicated: Alloy Group 1 stainless-steel bolts, ASTM F 593, and nuts, ASTM F 594.

- D. Slotted-Channel Inserts: Cold-formed, hot-dip galvanized-steel box channels (struts) complying with MFMA-4, 1-5/8 by 7/8 inches by length indicated with anchor straps or studs not less than 3 inches long at not more than 8 inches o.c. Provide with temporary filler and tee-head bolts, complete with washers and nuts, all zinc-plated to comply with ASTM B 633, Class Fe/Zn 5, as needed for fastening to inserts.

2.4 MISCELLANEOUS MATERIALS

- A. Low-Emitting Materials: Paints and coatings shall comply with the testing and product requirements of the California Department of Public Health's (formerly, the California Department of Health Services) "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."

- B. Shop Primers: as recommended by finish coat manufacturer.

- C. Universal Shop Primer: Fast-curing, lead- and chromate-free, universal modified-alkyd primer complying with MPI#79 and compatible with topcoat.
 - 1. Use primer containing pigments that make it easily distinguishable from zinc-rich primer.

- D. Galvanizing Repair Paint: High-zinc-dust-content paint complying with SSPC-Paint 20 and compatible with paints specified to be used over it.

- E. Bituminous Paint: Cold-applied asphalt emulsion complying with ASTM D 1187/D 1187M.

- F. Nonshrink, Nonmetallic Grout: Factory-packaged, nonstaining, noncorrosive, nongaseous grout complying with ASTM C 1107/C 1107M. Provide grout specifically recommended by manufacturer for interior and exterior applications.

- G. Concrete: Comply with requirements in Section 03300 "Cast-in-Place Concrete" for normal-weight, air-entrained, concrete with a minimum 28-day compressive strength of 3000 psi.

2.5 FABRICATION, GENERAL

- A. Shop Assembly: Preassemble items in the shop to greatest extent possible. Use connections that maintain structural value of joined pieces.

- B. Cut, drill, and punch metals cleanly and accurately. Remove burrs and ease edges. Remove sharp or rough areas on exposed surfaces.
- C. Weld corners and seams continuously to comply with the following:
 - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
 - 2. Obtain fusion without undercut or overlap.
 - 3. Remove welding flux immediately.
 - 4. At exposed connections, finish exposed welds and surfaces smooth and blended.
- D. Form exposed connections with hairline joints, flush and smooth, using concealed fasteners or welds where possible. Locate joints where least conspicuous.
- E. Fabricate seams and other connections that are exposed to weather in a manner to exclude water. Provide weep holes where water may accumulate.
- F. Where units are indicated to be cast into concrete or built into masonry, equip with integrally welded steel strap anchors not less than 8 inches from ends and corners of units and 24 inches o.c.

2.6 MISCELLANEOUS FRAMING AND SUPPORTS

- A. General: Provide steel framing and supports not specified in other Sections as needed to complete the Work.
- B. Fabricate units from steel shapes, plates, and bars of welded construction unless otherwise indicated. Fabricate to sizes, shapes, and profiles indicated and as necessary to receive adjacent construction.
- C. Fabricate steel girders for wood frame construction from continuous steel shapes of sizes indicated.
 - 1. Where wood nailers are attached to girders with bolts or lag screws, drill or punch holes at 24 inches o.c.
- D. Fabricate steel pipe columns for supporting wood frame construction from steel pipe with steel baseplates and top plates as indicated. Drill or punch baseplates and top plates for anchor and connection bolts and weld to pipe with fillet welds all around. Make welds the same size as pipe wall thickness unless otherwise indicated.

2.7 MISCELLANEOUS STEEL TRIM

- A. Unless otherwise indicated, fabricate units from steel shapes, plates, and bars of profiles shown with continuously welded joints and smooth exposed edges. Miter corners and use concealed field splices where possible.

- B. Provide cutouts, fittings, and anchorages as needed to coordinate assembly and installation with other work.
- C. Galvanize exterior miscellaneous steel trim.
- D. Prime exterior miscellaneous steel trim with zinc-rich primer.

2.8 METAL BOLLARDS

- A. Fabricate metal bollard from 3/16-inch wall-thickness round steel tubing.
- B. Prime bollards with zinc-rich primer and paint safety yellow.

2.9 ABRASIVE METAL NOSINGS AND TREADS

- A. Cast-Metal Units: Cast aluminum, with an integral-abrasive, as-cast finish consisting of aluminum oxide, silicon carbide, or a combination of both.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by the following:
 - a. American Safety Tread Co., Inc.
 - b. Balco, Inc.
 - c. Barry Pattern & Foundry Co., Inc.
 - d. Granite State Casting Co.
 - e. Safe-T-Metal Company, Inc.
 - f. Wooster Products Inc.

2.10 STEEL WELD PLATES AND ANGLES

- A. Provide steel weld plates and angles not specified in other Sections, for items supported from concrete construction as needed to complete the Work. Provide each unit with no fewer than two integrally welded steel strap anchors for embedding in concrete.

2.11 FINISHES, GENERAL

- A. Finish metal fabrications after assembly.

2.12 STEEL AND IRON FINISHES

- A. Galvanizing: Hot-dip galvanize items as indicated to comply with ASTM A 153/A 153M for steel and iron hardware and with ASTM A 123/A 123M for other steel and iron products.

- B. Shop prime iron and steel items not indicated to be galvanized unless they are to be embedded in concrete, sprayed-on fireproofing, or masonry, or unless otherwise indicated.
 - 1. Shop prime with universal shop primer unless zinc-rich primer is indicated.
- C. Preparation for Shop Priming: Prepare surfaces to comply with requirements indicated below:
 - 1. Exterior Items: SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning."
 - 2. Items Indicated to Receive Zinc-Rich Primer: SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning."
 - 3. Items Indicated to Receive Primers Specified in Section 09960 "High-Performance Coatings": SSPC-SP 6/NACE No. 3, "Commercial Blast Cleaning."
 - 4. Other Items: SSPC-SP 3, "Power Tool Cleaning."
- D. Shop Priming: Apply shop primer to comply with SSPC-PA 1, "Paint Application Specification No. 1: Shop, Field, and Maintenance Painting of Steel," for shop painting.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Cutting, Fitting, and Placement: Perform cutting, drilling, and fitting required for installing metal fabrications. Set metal fabrications accurately in location, alignment, and elevation; with edges and surfaces level, plumb, true, and free of rack; and measured from established lines and levels.
- B. Fit exposed connections accurately together to form hairline joints. Weld connections that are not to be left as exposed joints but cannot be shop welded because of shipping size limitations. Do not weld, cut, or abrade surfaces of exterior units that have been hot-dip galvanized after fabrication and are for bolted or screwed field connections.
- C. Field Welding: Comply with the following requirements:
 - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
 - 2. Obtain fusion without undercut or overlap.
 - 3. Remove welding flux immediately.
 - 4. At exposed connections, finish exposed welds and surfaces smooth and blended so no roughness shows after finishing and contour of welded surface matches that of adjacent surface.
- D. Fastening to In-Place Construction: Provide anchorage devices and fasteners where metal fabrications are required to be fastened to in-place construction.

- E. Provide temporary bracing or anchors in formwork for items that are to be built into concrete, masonry, or similar construction.

3.2 INSTALLING METAL BOLLARDS

- A. Anchor bollards in concrete with pipe sleeves preset and anchored into concrete. Fill annular space around bollard solidly with non-shrink grout.
- B. Anchor bollards in place with concrete footings. Place concrete and vibrate or tamp for consolidation. Support and brace bollards in position until concrete has cured.
- C. Fill bollards solidly with concrete, mounding top surface, trowel smooth, to shed water.

3.3 INSTALLING BEARING AND LEVELING PLATES

- A. Clean concrete and masonry bearing surfaces of bond-reducing materials, and roughen to improve bond to surfaces. Clean bottom surface of plates.
- B. Set bearing and leveling plates on wedges, shims, or leveling nuts. After bearing members have been positioned and plumbed, tighten anchor bolts. Do not remove wedges or shims but, if protruding, cut off flush with edge of bearing plate before packing with nonshrink grout. Pack grout solidly between bearing surfaces and plates to ensure that no voids remain.

3.4 ADJUSTING AND CLEANING

- A. Touchup Painting: Immediately after erection, clean field welds, bolted connections, and abraded areas. Paint uncoated and abraded areas with the same material as used for shop painting to comply with SSPC-PA 1 for touching up shop-painted surfaces.
- B. Galvanized Surfaces: Clean field welds, bolted connections, and abraded areas and repair galvanizing to comply with ASTM A 780/A 780M.

END OF SECTION 055000

DIVISION 7

THERMAL AND MOISTURE PROTECTION

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: dammonengineering.com



Section 072000

Interior Partition Acoustical Insulation

Part 1 General

1.01 Summary

- A. Provide glass fiber acoustical insulation for interior partitions as indicated in building plans.

1.02 References

- A. American Society for Testing and Materials (ASTM).
 1. C 665 Specification for Mineral Fiber Blanket Thermal Insulation for Light Frame Construction and Manufactured Housing.
 2. E 84 Test Method for Surface Burning Characteristics of Building Materials.
 3. E 136 Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C.
 4. C 518 Test Method for Steady-State Thermal Transmission Properties by Means of the Heat Flow Meter.
 5. C423 Test Method for Sound Absorption Coefficient by the Reverberation Room Method

1.03 Submittals

- A. Product Data: Submit Owens-Corning product literature, samples and installation instructions for specified insulation.

1.04 Delivery, Storage and Handling

- A. Protect insulation from physical damage and from becoming wet, soiled, or covered with ice or snow. Comply with manufacturer's recommendations for handling, storage and protection during installation.
- B. Label insulation packages to include material name, production date and/or product code.
- C. Deliver and store materials under provision of Section 1700.

1.05 Limitations

- A. Do not use unfaced insulation in exposed applications where there is potential for skin contact and irritation.
- B. Kraft and standard foil facings will burn and must not be left exposed. The facing must be installed in substantial contact with the unexposed surface of the ceiling, wall or floor finish. Protect facing from any open flame or heat source.

Part 2 Products

2.01 Manufacturer

- A. Owens-Corning.

B. Or Approved Manufacturer

2.02 Sound Attenuation Batts

- A. Type: Unfaced glass fiber acoustical insulation complying with ASTM C 665, Type I.
- B. Size:
Thickness 3" Width
- C. Surface Burning Characteristics:
 - 1. Maximum flame spread: 10
 - 2. Maximum smoke developed: 10When tested in accordance with ASTM E 84.
- D. Combustion Characteristics:
Passes ASTM E 136.
- E. Fire Resistance Ratings:
Passes ASTM E 119 as part of a complete fire tested wall assembly.
- G. Dimensional Stability:
Linear Shrinkage less than 0.1%

Part 3 Execution

3.01 Inspection and Preparation

- A. Examine substrates and conditions under which insulation work is to be performed. A satisfactory substrate is one that complies with requirements of the section in which substrate and related work is specified.
- B. Verify mechanical and electrical services within the shaftwall have been tested and inspected.
- B. Obtain installer's written report listing conditions detrimental to performance of work in this section. Do not proceed with installation of insulation until unsatisfactory conditions have been corrected.
- C. Clean substrates of substances harmful to insulation.

3.02 Installation - General

- A. Comply with manufacturer's instructions for particular conditions of installation in each case.
- B. Batts may be friction-fit in place until the interior finish is applied. Install batts to fill entire stud cavity. If stud cavity is less than 96" in height, cut lengths to friction-fit against floor and ceiling tracks. Walls with penetrations require that insulation be carefully cut to fit around outlets, junction boxes and other irregularities.
- C. Where walls are not finished on both sides or insulation does not fill the cavity depth, supplementary support must be provided to hold product in place.
- D. Where insulation must extend higher than 8 feet, temporary support can be provided to hold product in place until the finish material is applied.

3.03 Gypsum Board Installation

- A. Refer to Relevant Sections and Manufacturer's Recommendations for proper installation of gypsum board.

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1
NEW TRAINING FACILITY
34780 S. RANGE ROAD
SLIDELL LA 70460

3.04 Protection

- A. Protect installed insulation as recommended by manufacturer.

END OF SECTION 072000

SECTION 072100
THERMAL INSULATION

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes:
1. Foal Plastic Board Insulation
 2. Glass-fiber board insulation.
 3. Mineral-wool board insulation.
 4. Glass-fiber blanket insulation.
 5. Vapor retarders.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.

1.3 INFORMATIONAL SUBMITTALS

- A. Product test reports.
- B. Research/evaluation reports.

PART 2 - PRODUCTS

2.1 FOAM-PLASTIC BOARD INSULATION

- A. Extruded-Polystyrene Board Insulation: ASTM C 578, with maximum flame-spread and smoke-developed indexes of 75 and 450, respectively, per ASTM E 84.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. DiversiFoam Products.
 - b. Dow Chemical Company (The).
 - c. Owens Corning.
 - d. Pactiv Building Products.
 2. Type X, 15 psi (104 kPa).
 3. Type IV, 25 psi (173 kPa).
 4. Type VI, 40 psi (276 kPa).

5. Type VII, 60 psi (414 kPa).
6. Type V, 100 psi (690 kPa).

B. Molded-Polystyrene Board Insulation: ASTM C 578, with maximum flame-spread and smoke-developed indexes of 75 and 450, respectively, per ASTM E 84.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. DiversiFoam Products.
 - b. Plymouth Foam, Inc.
2. Type I, 10 psi (69 kPa).
3. Type II, 15 psi (104 kPa).
4. Type VIII, 20 psi (138 kPa).

2.2 GLASS-FIBER BOARD INSULATION

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. CertainTeed Corporation.
2. Johns Manville.
3. Knauf Insulation.
4. Owens Corning.

B. plus one-half of preconsumer recycled content not less than <Insert number> percent.

C. Glass-Fiber Board Insulation: ASTM C 612, Type IA; paper faced with maximum flame-spread and smoke-developed indexes of 25 and 50, respectively, per ASTM E 84.

1. Nominal density of 2.25 lb/cu. ft. (36 kg/cu. m), thermal resistivity of 4.3 deg F x h x sq. ft./Btu x in. at 75 deg F (29.8 K x m/W at 24 deg C).
2. Nominal density of 3 lb/cu. ft. (48 kg/cu. m), thermal resistivity of 4.3 deg F x h x sq. ft./Btu x in. at 75 deg F (29.8 K x m/W at 24 deg C).
3. Nominal density of 4.25 lb/cu. ft. (68 kg/cu. m), thermal resistivity of 4.3 deg F x h x sq. ft./Btu x in. at 75 deg F (29.8 K x m/W at 24 deg C).
4. Nominal density of 6 lb/cu. ft. (96 kg/cu. m), thermal resistivity of 4.4 deg F x h x sq. ft./Btu x in. at 75 deg F (30.5 K x m/W at 24 deg C).

2.3 MINERAL-WOOL BOARD INSULATION

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. Fibrex Insulations Inc.

2. Isolatek International.
3. Owens Corning.
4. Roxul Inc.
5. Thermafiber.

B. Unfaced, Mineral-Wool Board Insulation: ASTM C 612; with maximum flame-spread and smoke-developed indexes of 15 and zero, respectively, per ASTM E 84; passing ASTM E 136 for combustion characteristics.

1. Nominal density of 4 lb/cu. ft. (64 kg/cu. m), Types IA and IB, thermal resistivity of 4 deg F x h x sq. ft./Btu x in. at 75 deg F (27.7 K x m/W at 24 deg C).
2. Nominal density of 6 lb/cu. ft. (96 kg/cu. m), Type II, thermal resistivity of 4.16 deg F x h x sq. ft./Btu x in. at 75 deg F (28.8 K x m/W at 24 deg C).
3. Nominal density of 8 lb/cu. ft. (128 kg/cu. m), Type III, thermal resistivity of 4.35 deg F x h x sq. ft./Btu x in. at 75 deg F (30.2 K x m/W at 24 deg C).
4. Fiber Color: Darkened, where indicated.

2.4 GLASS-FIBER BLANKET INSULATION

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. CertainTeed Corporation.
2. Guardian Building Products, Inc.
3. Johns Manville.
4. Knauf Insulation.
5. Owens Corning.

B. Kraft-Faced, Glass-Fiber Blanket Insulation: ASTM C 665, Type II (non-reflective faced), Class C (faced surface not rated for flame propagation); Category 1 (membrane is a vapor barrier).

2.5 SPRAY POLYURETHANE FOAM INSULATION

A. Closed-Cell Polyurethane Foam Insulation: ASTM C 1029, Type II, with maximum flame-spread and smoke-developed indexes of 75 and 450, respectively, per ASTM E 84.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. BASF Corporation.
 - b. BaySystems NorthAmerica, LLC.
 - c. Dow Chemical Company (The).
 - d. ERSystems, Inc.
 - e. Gaco Western Inc.

- f. Henry Company.
 - g. NCFI; Division of Barnhardt Mfg. Co.
 - h. SWD Urethane Company.
 - i. Volatile Free, Inc.
2. Minimum density of 1.5 lb/cu. ft. (24 kg/cu. m), thermal resistivity of 6.2 deg F x h x sq. ft./Btu x in. at 75 deg F (43 K x m/W at 24 deg C).

2.6 VAPOR RETARDERS

- A. Polyethylene Vapor Retarders: ASTM D 4397, 10 mils (0.25 mm) thick, with maximum permeance rating of 0.13 perm (7.5 ng/Pa x s x sq. m).
- B. Vapor-Retarder Tape: Pressure-sensitive tape of type recommended by vapor-retarder manufacturer for sealing joints and penetrations in vapor retarder.

PART 3 - EXECUTION

3.1 INSTALLATION, GENERAL

- A. Comply with insulation manufacturer's written instructions applicable to products and applications indicated.
- B. Install insulation that is undamaged, dry, and unsoiled and that has not been left exposed to ice, rain, or snow at any time.
- C. Extend insulation to envelop entire area to be insulated. Cut and fit tightly around obstructions and fill voids with insulation. Remove projections that interfere with placement.
- D. Provide sizes to fit applications indicated and selected from manufacturer's standard thicknesses, widths, and lengths. Apply single layer of insulation units to produce thickness indicated unless multiple layers are otherwise shown or required to make up total thickness.

3.2 INSTALLATION OF INSULATION FOR FRAMED CONSTRUCTION

- A. Apply insulation units to substrates by method indicated, complying with manufacturer's written instructions. If no specific method is indicated, bond units to substrate with adhesive or use mechanical anchorage to provide permanent placement and support of units.
- B. Glass-Fiber or Mineral-Wool Blanket Insulation: Install in cavities formed by framing members according to the following requirements:

1. Use insulation widths and lengths that fill the cavities formed by framing members. If more than one length is required to fill the cavities, provide lengths that will produce a snug fit between ends.
 2. Place insulation in cavities formed by framing members to produce a friction fit between edges of insulation and adjoining framing members.
 3. Maintain 3-inch (76-mm) clearance of insulation around recessed lighting fixtures not rated for or protected from contact with insulation.
 4. Install eave ventilation troughs between roof framing members in insulated attic spaces at vented eaves.
 5. For metal-framed wall cavities where cavity heights exceed 96 inches (2438 mm), support unfaced blankets mechanically and support faced blankets by taping flanges of insulation to flanges of metal studs.
 6. For wood-framed construction, install blankets according to ASTM C 1320 and as follows:
 - a. With faced blankets having stapling flanges, secure insulation by inset, stapling flanges to sides of framing members.
 - b. With faced blankets having stapling flanges, lap blanket flange over flange of adjacent blanket to maintain continuity of vapor retarder once finish material is installed over it.
 7. Vapor-Retarder-Faced Blankets: Tape joints and ruptures in vapor-retarder facings, and seal each continuous area of insulation to ensure airtight installation.
 - a. Exterior Walls: Set units with facing placed toward exterior of construction.
 - b. Interior Walls: Set units with facing placed toward areas of high humidity.
- C. Spray-Applied Insulation: Apply spray-applied insulation according to manufacturer's written instructions. Do not apply insulation until installation of pipes, ducts, conduits, wiring, and electrical outlets in walls is completed and windows, electrical boxes, and other items not indicated to receive insulation are masked. After insulation is applied, make flush with face of studs by using method recommended by insulation manufacturer.
- D. Miscellaneous Voids: Install insulation in miscellaneous voids and cavity spaces where required to prevent gaps in insulation using the following materials:
1. Loose-Fill Insulation: Compact to approximately 40 percent of normal maximum volume equaling a density of approximately 2.5 lb/cu. ft. (40 kg/cu. m).
 2. Spray Polyurethane Insulation: Apply according to manufacturer's written instructions.

3.3 INSTALLATION OF VAPOR RETARDERS

- A. Place vapor retarders on side of construction indicated on Drawings. Extend vapor retarders to extremities of areas to protect from vapor transmission. Secure vapor

retarders in place with adhesives or other anchorage system as indicated. Extend vapor retarders to cover miscellaneous voids in insulated substrates, including those filled with loose-fiber insulation.

- B. Seal vertical joints in vapor retarders over framing by lapping no fewer than two studs.
 - 1. Fasten vapor retarders to wood framing at top, end, and bottom edges; at perimeter of wall openings; and at lap joints. Space fasteners 16 inches (406 mm) o.c.
 - 2. Before installing vapor retarders, apply urethane sealant to flanges of metal framing including runner tracks, metal studs, and framing around door and window openings. Seal overlapping joints in vapor retarders with vapor-retarder tape according to vapor-retarder manufacturer's written instructions. Seal butt joints with vapor-retarder tape. Locate all joints over framing members or other solid substrates.
 - 3. Firmly attach vapor retarders to metal framing and solid substrates with vapor-retarder fasteners as recommended by vapor-retarder manufacturer.
- C. Seal joints caused by pipes, conduits, electrical boxes, and similar items penetrating vapor retarders with vapor-retarder tape to create an airtight seal between penetrating objects and vapor retarders.
- D. Repair tears or punctures in vapor retarders immediately before concealment by other work. Cover with vapor-retarder tape or another layer of vapor retarders.

END OF SECTION 072100

SECTION 072500
WEATHER BARRIERS

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Weather barrier membrane
- B. Seam Tape
- C. Flashing
- D. Fasteners

1.2 REFERENCES

- A. ASTM International
 - 1. ASTM C920; Standard Specification for Elastomeric Joint Sealants
 - 2. ASTM C1193; Standard Guide for Use of Joint Sealants
 - 3. ASTM D882; Test Method for Tensile Properties of Thin Plastic Sheeting
 - 4. ASTM D1117; Standard Guide for Evaluating Non-woven Fabrics
 - 5. ASTM E84; Test Method for Surface Burning Characteristics of Building Materials
 - 6. ASTM E96; Test Method for Water Vapor Transmission of Materials
 - 7. ASTM E1677; Specification for Air Retarder Material or System for Framed Building Walls
 - 8. ASTM E2178; Test Method for Air Permeance of Building Materials
 - 9. ASTM E2357; Standard Test Method for Determining Air Leakage of Air Barrier Assemblies
- B. AATCC - American Association of Textile Chemists and Colorists
 - 1. Test Method 127 Water Resistance: Hydrostatic Pressure Test
- C. TAPPI
 - 1. Test Method T-410; Grams of Paper and Paperboard (Weight per Unit Area)
 - 2. Test Method T-460; Air Resistance (Gurley Hill Method)

1.3 SUBMITTALS

- A. Refer to Section [01 33 00 Submittal Procedures] [insert section number and title].
- B. Product Data: Submit manufacturer current technical literature for each component.
- C. Samples: Weather Barrier Membrane, minimum 8-1/2 inches by 11 inch.
- D. Quality Assurance Submittals
 - 1. Design Data, Test Reports: Provide manufacturer test reports indicating product compliance with indicated requirements.
 - 2. Manufacturer Instructions: Provide manufacturer's written installation instructions.
 - 3. Manufacturer's Field Service Reports: Provide site reports from authorized field service representative, indicating observation of weather barrier assembly installation.
- E. Closeout Submittals
 - 1. Refer to Section [01 78 00 Closeout Submittals] [insert section number and title].
 - 2. Weather Barrier Warranty: Manufacturer's executed warranty form with authorized signatures

and endorsements indicating date of Substantial Completion.

1.4 QUALITY ASSURANCE

A. Qualifications

1. Installer shall have experience with installation of weather barrier assemblies under similar conditions.
2. Installation shall be in accordance with weather barrier manufacturer's installation guidelines and recommendations.
3. Source Limitations: Provide weather barrier and accessory materials produced by single manufacturer.

B. Mock-up

1. Install mock-up using approved weather barrier assembly including fasteners, flashing, tape and related accessories per manufacturer's current printed instructions and recommendations.
 - a. Mock-up size: 10 feet by 10 feet.
 - b. Mock-up Substrate: Match wall assembly construction, including window opening.
 - c. Mock-up may remain as part of the work.
2. Contact manufacturer's designated representative prior to weather barrier assembly installation, to perform required mock-up visual inspection and analysis as required for warranty.

C. Pre-installation Meeting

1. Hold a pre-installation conference, two weeks prior to start of weather barrier installation. Attendees shall include Contractor, Architect, Installer, and Weather Barrier Manufacturer's Designated Representative.
2. Review all related project requirements and submittals, status of substrate work and preparation, areas of potential conflict and interface, availability of weather barrier assembly materials and components, installer's training requirements, equipment, facilities and scaffolding, and coordinate methods, procedures and sequencing requirements for full and proper installation, integration and protection.

1.5 DELIVERY, STORAGE AND HANDLING

- A. Deliver weather barrier materials and components in manufacturer's original, unopened, undamaged containers with identification labels intact.
- B. Store weather barrier materials as recommended by weather barrier manufacturer.

1.6 SCHEDULING

- A. Review requirements for sequencing of installation of weather barrier assembly with installation of windows, doors, louvers and flashings to provide a weather-tight barrier assembly.
- B. Schedule installation of weather barrier materials and exterior cladding within nine months of weather barrier assembly installation.

1.7 WARRANTY

- A. Refer to AIA Document A201 - General Conditions.
- B. Special Warranty
 - 1. Special weather-barrier manufacturer's warranty for weather barrier for a period of ten (10) years from date of final weather barrier installation.
 - 2. Pre-installation meetings and jobsite observations by weather barrier manufacturer for warranty is required prior to assembly installation.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Basis of Design: spunbonded polyolefin, non-woven, non-perforated, weather barrier is based upon DuPont™ Tyvek® CommercialWrap® and related assembly components.
- B. Performance Characteristics:
 - 1. Air Penetration: 0.001 cfm/ft² at 75 Pa, when tested in accordance with ASTM E2178. Type I per ASTM E1677. ≤0.04 cfm/ft² at 75 Pa, when tested in accordance with ASTM E2357.
 - 2. Water Vapor Transmission: 28 perms, when tested in accordance with ASTM E96, Method B.
 - 3. Water Penetration Resistance: Minimum 280 cm when tested in accordance with AATCC Test Method 127.
 - 4. Basis Weight: Minimum 2.7 oz/yd², when tested in accordance with TAPPI Test Method T-410.
 - 5. Air Resistance: Air infiltration at >1500 seconds, when tested in accordance with TAPPI Test Method T-460.
 - 6. Tensile Strength: Minimum 38/35 lbs/in., when tested in accordance with ASTM D882, Method A.
 - 7. Tear Resistance: 12/10 lbs., when tested in accordance with ASTM D1117.
 - 8. Surface Burning Characteristics: Class A, when tested in accordance with ASTM E84. Flame Spread: 10, Smoke Developed: 10.

2.2 ACCESSORIES

- A. Seam Tape: As recommended by the weather barrier manufacturer.
- B. Fasteners:
 - 1. 1-5/8 inch rust resistant screw with 2-inch diameter plastic cap or manufacturer approved 1-1/4" or 2" metal gasketed washer

AND/OR

- 2. Nail Caps: #4 nails with large 1-inch plastic cap fasteners, or 1-inch plastic cap staples with leg length sufficient to achieve a minimum penetration of 5/8-inch into the wood stud.

AND/OR

3. Masonry tap-con fasteners with Caps: 2-inch diameter plastic cap fasteners.
- C. Sealants
1. Refer to Section 07920 Joint Sealants.
 2. Products: Sealants recommended by the weather barrier manufacturer.
- D. Adhesives:
1. Provide adhesive recommended by weather barrier manufacturer.
 2. Products: Adhesives recommend by the weather barrier manufacturer.
- E. Primers:
1. Provide flashing manufacturer recommended primer to assist in adhesion between substrate and flashing.
 2. Products: Primers recommended by the flashing manufacturer.
- F. Flashing
1. Flexible membrane flashing materials for window openings and penetrations recommended by manufacturer.
 2. Straight flashing membrane materials for flashing windows and doors and sealing penetrations such as masonry ties, etc. recommended by manufacturer.
 3. Thru-Wall flashing membrane materials for flashing at changes in direction or elevation (shelf angles, foundations, etc.) and at transitions between different assembly materials.
 4. Preformed Inside and Outside Corners and End Dams: Preformed three-dimensional shapes to complete the flashing system used in conjunction with Thru-Wall Flashing.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Verify substrate and surface conditions are in accordance with weather barrier manufacturer recommended tolerances prior to installation of weather barrier and accessories.

3.2 INSTALLATION - WEATHER BARRIER

- A. Install weather barrier over exterior face of exterior wall substrate in accordance with manufacturer recommendations.
- B. Install weather barrier prior to installation of windows and doors.
- C. Start weather barrier installation at a building corner, leaving 6-12 inches of weather barrier extended beyond corner to overlap.
- D. Install weather barrier in a horizontal manner starting at the lower portion of the wall surface with subsequent layers installed in a shingling manner to overlap lower layers. Maintain weather barrier plumb and level.
- E. Sill Plate Interface: Extend lower edge of weather barrier over sill plate interface 3-6 inches. Secure to foundation with elastomeric sealant as recommended by weather barrier manufacturer.
- F. Window and Door Openings: Extend weather barrier completely over openings.
- G. Overlap weather barrier
 1. Exterior corners: minimum 12 inches.

2. Seams: minimum 6 inches.

H. Weather Barrier Attachment:

1. Attach weather barrier to studs through exterior sheathing. Secure using weather barrier manufacturer recommend fasteners, space 12-18 inches vertically on center along stud line, and 24 inch on center, maximum horizontally.

I. Apply flashing to weather barrier membrane prior to installing cladding anchors.

3.3 SEAMING

A. Seal seams of weather barrier with seam tape at all vertical and horizontal overlapping seams.

B. Seal any tears or cuts as recommended by weather barrier manufacturer.

3.4 OPENING PREPARATION

A. Flush cut weather barrier at edge of sheathing around full perimeter of opening.

B. Cut a head flap at 45-degree angle in the weather barrier at window head to expose 8 inches of sheathing. Temporarily secure weather barrier flap away from sheathing with tape.

3.5 FLASHING

A. Cut flexible flashing a minimum of 12 inches longer than width of sill rough opening.

B. Cover horizontal sill by aligning flexible flashing edge with inside edge of sill. Adhere to rough opening across sill and up jambs a minimum of 6 inches. Secure flashing tightly into corners by working in along the sill before adhering up the jambs.

C. Fan flexible flashing at bottom corners onto face of wall. Firmly press in place. Mechanically fasten fanned edges.

D. Apply 9-inch wide strips of flashing at jambs. Align flashing with interior edge of jamb framing. Start flashing at head of opening and lap sill flashing down to the sill.

E. Spray-apply primer to top 6 inches of jambs and exposed sheathing.

F. Install flexible flashing at opening head using same installation procedures used at sill. Overlap jamb flashing a minimum of 2 inches.

G. Coordinate flashing with window installation.

H. On exterior, install backer-rod in joint between window frame and flashed rough framing. Apply sealant at jambs and head, leaving sill unsealed. Apply sealants in accordance with sealant manufacturer's instructions and ASTM C1193.

I. Position weather barrier head flap across head flashing. Adhere using flashing over the 45-degree seams.

J. Tape top of window in accordance with manufacturer recommendations.

K. On interior, install backer rod in joint between frame of window and flashed rough framing. Apply sealant around entire window to create air seal. Apply sealant in accordance with sealant manufacturer's instructions and ASTM C1193.

3.6 THRU-WALL FLASHING INSTALLATION

- A. Apply primer per manufacturer's written instructions.
- B. Install preformed corners and end dams bedded in sealant in appropriate locations along wall.
- C. Starting at a corner, remove release sheet and apply membrane to primed surfaces in lengths of 8 to 10 feet.
- D. Extend membrane through wall and leave ¼ inch minimum exposed to form drip edge.
- E. Roll flashing into place. Ensure continuous and direct contact with substrate.
- F. Lap ends and overlap preformed corners 4 inches minimum. Seal all laps with sealant.
- G. Trim exterior edge of membrane 1-inch and secure metal drip edge per manufacturer's written instructions.
- H. Terminate membrane on vertical wall. [Terminate into reglet, counterflashing or with termination bar.]
- I. Apply sealant bead at each termination.

3.7 THRU-WALL FLASHING / WEATHER BARRIER INTERFACE AT BASE OF WALL

- A. Overlap thru-wall flashing with weather barrier by 6-inches.
- B. Mechanically fasten bottom of weather barrier through top of thru-wall flashing.
- C. Seal vertical and horizontal seams with tape or sealing membrane.

3.8 THRU-WALL FLASHING / WEATHER BARRIER INTERFACE AT SHELF ANGLE

- A. Seal weather barrier to bottom of shelf angle with sealing membrane.
- B. Apply thru-wall flashing to top of shelf angle. Overlap thru-wall flashing with weather barrier by 6-inches.
- C. Seal bottom of weather barrier to thru-wall flashing with tape or sealing membrane.

3.9 THRU-WALL FLASHING / WEATHER BARRIER INTERFACE AT WINDOW HEAD

- A. Cut flap in weather barrier at window head.
- B. Prime exposed sheathing.
- C. Install lintel as required. Verify end dams extend 4 inches minimum beyond opening.
- D. Install end dams bedded in sealant.
- E. Adhere 2 inches minimum thru-wall flashing to wall sheathing. Overlap lintel with thru-wall flashing and extend ¼ inch minimum beyond outside edge of lintel to form drip edge.
- F. Apply sealant along thru-wall flashing edges.
- G. Fold weather barrier flap back into place and tape bottom edge to thru-wall flashing.
- H. Tape diagonal cuts of weather barrier.
- I. Secure weather barrier flap with fasteners.

3.10 FIELD QUALITY CONTROL

- A. Notify manufacturer's designated representative to obtain [required] periodic observations of weather barrier assembly installation.

3.11 PROTECTION

- A. Protect installed weather barrier from damage.

END OF SECTION 072500

SECTION 076100

PREFORMED METAL ROOFING

PART 1 GENERAL

1.01 SECTION INCLUDES

- A. Preformed, prefinished metal roofing and flashings.
- B. Miscellaneous trim, flashing, closures, drip flashing, and accessories.
- C. Sealant
- D. Fastening devices.

1.02 REFERENCES

- A. American Iron & Steel Institute (AISI) Specification for the Design of Coldformed Steel Structural Members.
- B. ASTM A-525 Steel Sheet, Zinc-Coated (Galvanized)
- C. ASTM E-1680
- D. ASTM E-1646
- E. ASTM E-1592
- E. Spec Data Sheet - Aluminum Zinc Alloy Coated Steel (Galvalume) Sheet Metal by Bethlehem Corp.
- F. SMACNA - Architectural Sheet Metal Manual.
- G. Building Materials Directory - Underwriter's Laboratories, Test Procedure 580.

1.03 ASSEMBLY DESCRIPTION

- A. The roofing assembly includes preformed sheet metal panels, related accessories, valleys, hips, ridges, eaves, corners, rakes, miscellaneous flashing and attaching devices.

1.04 SUBMITTALS

- A. Submit detailed drawings showing layout of panels, anchoring details, joint details, trim, flashing, and accessories. Show details of weatherproofing, terminations, and penetrations of metal work.
- B. Submit a sample of each type of roof panel, complete with factory finish.
- C. Submit results indicating compliance with minimum requirements of the following performance tests:
 - 1. Air Infiltration ASTM E 1680
 - 2. Water Infiltration ASTM E 1646
 - 3. Wind Uplift - U.L.90

- D. Submit calculations with registered engineer seal, verifying roof panel and attachment method resists wind pressures imposed on it pursuant to applicable building codes.

1.05 QUALITY ASSURANCE

- A. Manufacturer: Company specializing in Architectural Sheet Metal Products with ten (10) years minimum experience.
- B. No product substitutions shall be permitted without meeting specifications.
- C. Substitutions shall be submitted 10 Days prior to Bid Date and acceptance put forth in an addendum.
- D. No substitutions shall be made after the Bid Date.

1.06 DELIVERY, STORAGE AND HANDLING

- A. Upon receipt of panels and other materials, installer shall examine the shipment for damage and completeness.
- B. Panels should be stored in a clean, dry place. One end should be elevated to allow moisture to run off.
- C. Panels with strippable film must not be stored in the open, exposed to the sun.
- D. Stack all materials to prevent damage and to allow for adequate ventilation.

1.07 WARRANTY

- A. Paint finish shall have a twenty year guarantee against cracking, peeling and fade (not to exceed 5 N.B.S. units).
- B. Galvalume material shall have a twenty year guarantee against failure due to corrosion, rupture or perforation.
- C. Applicator shall furnish guarantee covering watertightness of the roofing system for the period of two (2) years from the date of substantial completion.

PART 2 PRODUCT

2.01 ACCEPTABLE MANUFACTURERS

Basis of Design:

- A. Berridge Manufacturing Company, Houston, Texas.
- B. Substitutions shall fully comply with specified requirements.

2.02 SHEET MATERIALS

- A. Prefinished Metal shall be [Hot-Dipped Galvanized - ASTM A653-07 Grade C G90 Coating A924-08 24 Gauge core steel] or [prefinished Galvalume 24 Gauge core steel - ASTM 792-86 AZ-55].
- B. Unfinished Metal shall be Grade C Aluminum Zinc Alloy Coated Steel ASTM 792-86, AZ 55, "Satin Finish".
- C. Finish shall be [full strength Kynar 500® PVDF resin-based coating] [Copper-Cote][Antique Copper-Cote] [Lead-Cote][Zinc-Cote][Prewathered

Galvalume][Champagne] coating, applied by the manufacturer on a continuous coil coating line, with a top side dry film thickness of 0.70 to 0.80 mil over 0.20 to 0.30 mil prime coat, to provide a total topside dry film thickness of 1.0 plus or minus 0.10 mil. Reverse side shall be coated with primer and wash coat of 0.30 mil plus or minus 0.05 mil. Finish shall conform to all tests for adhesion, flexibility, and longevity as specified by the Kynar 500® PVDF resin-based coating supplier.

- D. Strippable film shall be applied to the top side of the painted coil to protect the finish during fabrication, shipping and field handling. This strippable film must be removed immediately before installation.

2.03 ACCESSORY MATERIALS

- A. Fasteners: Galvanized Steel with washers where required.
B. Sealant: Sealant must be a ultra low modulus, high performance, one-part, moisture curing silicone joint sealant. (do not use a clear sealant or sealants which release a solvent or acid during curing).

Sealant must be resistant to environmental conditions such as wind loading, wind driven rain, snow, sleet, acid rain, ozone, ultraviolet light and extreme temperature variations.

Features must include joint movement capabilities of +100% & -50% ASTM C-719, capable of taking expansion, compression, transverse and longitudinal movement, service temperature range -65°F to 300°F (-54°C to 149°C), Flow, sag or slump: ASTM C-639; Nil, Hardness (Shore A): ASTM C-661; 15, Tensile strength at maximum elongation: ASTM D-412; 200 psi, Tensile strength at 100% elongation: ASTM D-412; 35 psi, Tear strength, (die "C"); ASTM D-624; 40 pli, Peel strength (Aluminum, Glass, Concrete): ASTM C-794; 30 pli

- C. Vinyl Weatherseal Insert.

2.04 FABRICATION

- A. All exposed adjacent flashing shall be of the same material and finish as the roof panels.
B. Hem all exposed edges of flashing on underside, 1/2 inch.

2.05 PREFORMED METAL PANELS, SHINGLES, ETC. (PICK APPROPRIATE STYLE)

A. BERRIDGE STANDING SEAM TEE-PANEL

1. Panels shall have 12 3/4" on-center seam spacing with a seam height of 1" and shall have no exposed fasteners.
2. Panels shall be site-formed with the Berridge Model SS-14 Portable Roll Former in continuous lengths from eave to ridge or factory fabricated to 40' max.
3. Snap-on seams shall be 1" in height and shall contain the Berridge factory-applied Extruded Vinyl Weather Seal Insert (Patent No. 4641475) to prevent siphoning of moisture through the standing seam.

4. Concealed anchor clips shall be spaced as required to meet uplift loads (maximum of 24" on center).
5. When required, Panel assembly shall bear Underwriter's Laboratories Label UL90, pursuant to Construction Number 296 and applicable Fire Ratings.
6. Certification shall be submitted, based on independent testing laboratory, indicating no measurable water penetration or air leakage beyond allowable tolerances through the system when tested in accordance with ASTM E-1680 and E-1646.

G. BERRIDGE ZEE-LOCK STANDING SEAM PANEL

1. 2" high vertical legs shall be spaced at 16" on-center and shall have no exposed fasteners.
2. Panels shall be site-formed with the Berridge Model SP-21-X Portable Roll Former in continuous lengths from ridge to eave or factory-formed to 40' max.
3. Continuous Zee Rib shall be 1-3/8" wide and 2-1/8" in height. Rib shall be connected to purlin with two #12-14 x 1" self-drilling/tapping fasteners [Zee Clips spaced at 3'-0"].
4. Optional Vinyl Weatherseal (U.S. Patent 5134825) to be factory-installed over Continuous Zee Rib.
5. Sidelap to be mechanically seamed with a powered seamer.
6. When required, panel assembly to bear Underwriters Laboratories Label UL90, pursuant to Construction Number 312 for open framing conditions, either uninsulated or with blanket insulation; 335 or 335 (mod.) with rigid board insulation or 403 over solid substrate and applicable Fire Ratings.
7. Certification shall be submitted, based on independent testing laboratory, indicating no measurable water penetration or air leakage through the system when tested in accordance with ASTM E-1680 and E-1646.

STANDING SEAM PANEL

1. 2" high vertical legs shall be spaced at 16" on-center and shall have no exposed fasteners.
2. Panels shall be site-formed with the Berridge Model SP-21-X Portable Roll Former in continuous lengths from ridge to eave or factory-formed to 40' max.
3. Continuous Zee Rib shall be 1-3/8" wide and 2-1/8" in height. Rib shall be connected to purlin with two #12-14 x 1" self-drilling/tapping fasteners [Zee Clips spaced at 3'-0"].
4. Optional Vinyl Weatherseal - N.A.
5. Sidelap to be mechanically seamed with a powered double-lock seamer.
6. When required, panel assembly to bear Underwriters Laboratories Label UL90, pursuant to Construction Number 312 for open framing conditions, either uninsulated or with blanket insulation; 335 or 335 (mod.) with rigid board insulation or 403 over solid substrate and applicable Fire Ratings. Also available: FM 1-60 & FM 1-120.
7. Certification shall be submitted, based on independent testing laboratory, indicating no measurable water penetration or air leakage through the system when tested in accordance with ASTM E-1646 and E-1680.

T. BERRIDGE VEE-PANEL

1. Panels shall have 10-7/8" exposure, 3/8" deep vee grooves at 3-5/8" on center, with concealed fasteners and interlocking sidelap.
2. Panels shall be formed in continuous lengths per [wall][fascia] (or) [soffit] length (40' max) and shall have no exposed fasteners.
3. Attachment to metal supports with #8 x 12" TEKS screws at maximum spacing of 2'-0" on center or per local code, whichever is greater.
4. Optional Vented Vee-Panel shall have a Net Free Vent Area (NFVA) of 10.5 square inches per lineal foot of panel (11.59 square inches for square foot of panel).

Note: Berridge Manufacturing Company does not recommend this product in applications subject to aggressive atmospheres, marine environments or high humidity due to the corrosive nature of these environments on raw edges of steel.

PART 3 EXECUTION

3.01 INSPECTION

A. Substrate:

1. Examine plywood or metal deck to ensure proper attachment to framing.
2. Inspect roof deck to verify deck is clean and smooth, free of depressions, waves or projections, level to 1/4" in 20', and properly sloped to [valleys] (or) [eaves].
3. Verify roof openings, curbs, pipes, sleeves, ducts or vents through roof are solidly set, cant strips and reglets in place, and nailing strips located.
4. Verify deck is dry and free of snow or ice. [Flutes in steel deck to be clean and dry] or [joints in wood deck to be solidly supported and nailed].

3.02 INSTALLATION

- A. Comply with manufacturers standard instructions and conform to standards set forth in the Architectural Sheet Metal Manual published by SMACNA, in order to achieve a watertight installation.
- B. Install panels in such a manner that horizontal lines are true and level and vertical lines are plumb.
- C. Install starter and edge trim before installing roof panels.
- D. Remove protective strippable film prior to installation of roof panels.
- E. Attach panels using manufacturer's standard clips and fasteners, spaced in accordance with approved shop drawings.
- F. Install sealants for preformed roofing panels as approved on shop drawings.
- G. Do not allow panels or trim to come into contact with dissimilar materials.
- H. Do not allow traffic on completed roof. If required, provide cushioned walk boards.
- I. Protect installed roof panels and trim from damage caused by adjacent construction until completion of installation.

J. Remove and replace any panels or components which are damaged beyond successful repair.

3.03 CLEANING

- A. Clean any grease, finger marks or stains from the panels per manufacturer's recommendations.
- B. Remove all scrap and construction debris from the site.

END OF SECTION 076100

SECTION 076200

SHEET METAL FLASHING AND TRIM

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Manufactured reglets with counterflashing.
2. Formed roof-drainage sheet metal fabrications.
3. Formed low-slope roof sheet metal fabrications.
4. Formed steep-slope roof sheet metal fabrications.
5. Formed wall sheet metal fabrications.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product.

B. Shop Drawings: For sheet metal flashing and trim.

1. Include plans, elevations, sections, and attachment details.
2. Distinguish between shop- and field-assembled work.
3. Include identification of finish for each item.
4. Include pattern of seams and details of termination points, expansion joints and expansion-joint covers, direction of expansion, roof-penetration flashing, and connections to adjoining work.

C. Samples: For each exposed product and for each color and texture specified.

1.3 QUALITY ASSURANCE

A. Fabricator Qualifications: Employs skilled workers who custom fabricate sheet metal flashing and trim similar to that required for this Project and whose products have a record of successful in-service performance.

1. For copings and roof edge flashings that are SPRI ES-1 tested, shop shall be listed as able to fabricate required details as tested and approved.

1.4 WARRANTY

- A. Special Warranty on Finishes: Manufacturer agrees to repair finish or replace sheet metal flashing and trim that shows evidence of deterioration of factory-applied finishes within specified warranty period.
 - 1. Finish Warranty Period: 10 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. General: Sheet metal flashing and trim assemblies shall withstand wind loads, structural movement, thermally induced movement, and exposure to weather without failure due to defective manufacture, fabrication, installation, or other defects in construction. Completed sheet metal flashing and trim shall not rattle, leak, or loosen, and shall remain watertight.
- B. Sheet Metal Standard for Flashing and Trim: Comply with NRCA's "The NRCA Roofing Manual" and SMACNA's "Architectural Sheet Metal Manual" requirements for dimensions and profiles shown unless more stringent requirements are indicated.
- C. Sheet Metal Standard for Copper: Comply with CDA's "Copper in Architecture Handbook." Conform to dimensions and profiles shown unless more stringent requirements are indicated.
- D. SPRI Wind Design Standard: Manufacture and install [copings] [roof edge flashings] tested according to SPRI ES-1 and capable of resisting the following design pressure:
 - 1. Design Pressure: As indicated on Drawings.
- E. Thermal Movements: Allow for thermal movements from ambient and surface temperature changes.
 - 1. Temperature Change: 120 deg F (67 deg C), ambient; material surfaces.

2.2 SHEET METALS

- A. General: Protect mechanical and other finishes on exposed surfaces from damage by applying strippable, temporary protective film before shipping.
- B. Aluminum Sheet: ASTM B 209 (ASTM B 209M), alloy as standard with manufacturer for finish required, with temper as required to suit forming operations and performance required.
 - 1. As-Milled Finish: One-side bright mill.

2. Alclad Finish: Metallurgically bonded surfacing alloy on both sides, forming aluminum sheet with reflective luster.
 3. Factory Prime Coating: Where painting after installation is required, pretreat metal with white or light-colored, factory-applied, baked-on epoxy primer coat; minimum dry film thickness of 0.2 mil (0.005 mm).
 4. Clear Anodic Finish, Coil Coated: AAMA 611, AA-M12C22A41, Class I, 0.018 mm or thicker.
 5. Color Anodic Finish, Coil Coated: AAMA 611, AA-M12C22A42/A44, Class I, 0.018 mm or thicker.
 - a. Color: Color to be selected by Architect from Manufacturer's full range.
 6. Exposed Coil-Coated Finish:
 - a. Two-Coat Fluoropolymer: AAMA 620. Fluoropolymer finish containing not less than 70 percent PVDF resin by weight in color coat. Prepare, pretreat, and apply coating to exposed metal surfaces to comply with coating and resin manufacturers' written instructions.
 - b. Three-Coat Fluoropolymer: AAMA 620. Fluoropolymer finish containing not less than 70 percent PVDF resin by weight in both color coat and clear topcoat. Prepare, pretreat, and apply coating to exposed metal surfaces to comply with coating and resin manufacturers' written instructions.
 - c. Siliconized Polyester: Epoxy primer and silicone-modified, polyester-enamel topcoat; with dry film thickness of not less than 0.2 mil (0.005 mm) for primer and 0.8 mil (0.02 mm) for topcoat.
 7. Color: As selected by Architect from manufacturer's full range.
- C. Metallic-Coated Steel Sheet: Provide zinc-coated (galvanized) steel sheet according to ASTM A 653/A 653M, G90 (Z275) coating designation or aluminum-zinc alloy-coated steel sheet according to ASTM A 792/A 792M, Class AZ50 (Class AZM150) coating designation, Grade 40 (Grade 275); prepainted by coil-coating process to comply with ASTM A 755/A 755M.
1. Surface: Manufacturer's standard clear acrylic coating on both sides.
 2. Exposed Coil-Coated Finish:
 - a. Two-Coat Fluoropolymer: AAMA 621. Fluoropolymer finish containing not less than 70 percent PVDF resin by weight in color coat. Prepare, pretreat, and apply coating to exposed metal surfaces to comply with coating and resin manufacturers' written instructions.
 - b. Three-Coat Fluoropolymer: AAMA 621. Fluoropolymer finish containing not less than 70 percent PVDF resin by weight in both color coat and clear topcoat. Prepare, pretreat, and apply coating to exposed metal surfaces to comply with coating and resin manufacturers' written instructions.
 - c. Siliconized Polyester: Epoxy primer and silicone-modified, polyester-enamel topcoat; with dry film thickness of not less than 0.2 mil (0.005 mm) for primer and 0.8 mil (0.02 mm) for topcoat.

3. Color: As selected by Architect from manufacturer's full range.

2.3 UNDERLAYMENT MATERIALS

- A. Felt: ASTM D 226/D 226M, Type II (No. 30), asphalt-saturated organic felt; nonperforated.
- B. Synthetic Underlayment: Laminated or reinforced, woven polyethylene or polypropylene, synthetic roofing underlayment; bitumen free; slip resistant; suitable for high temperatures over 220 deg F (111 deg C); and complying with physical requirements of ASTM D 226/D 226M for Type I and Type II felts.
 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Atlas Roofing Corporation; Summit.
 - b. Engineered Coated Products; Nova-Seal II.
 - c. SDP Advanced Polymer Products Inc; Palisade.
- C. Self-Adhering, High-Temperature Sheet: Minimum 30 mils (0.76 mm) thick, consisting of a slip-resistant polyethylene- or polypropylene-film top surface laminated to a layer of butyl- or SBS-modified asphalt adhesive, with release-paper backing; specifically designed to withstand high metal temperatures beneath metal roofing. Provide primer according to written recommendations of underlayment manufacturer.
 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Carlisle Residential, a division of Carlisle Construction Materials; WIP 300HT.
 - b. Grace Construction Products, a unit of W. R. Grace & Co.-Conn.; Grace Ice and Water Shield HT.
 - c. Henry Company; Blueskin PE200 HT.
 - d. Kirsch Building Products, LLC; Sharkskin Ultra SA.
 - e. Metal-Fab Manufacturing, LLC; MetShield.
 - f. Owens Corning; WeatherLock Specialty Tile & Metal Underlayment.
 - g. Polyguard Products, Inc.; Deck Guard HT.
 - h. Protecto Wrap Company; Protecto Jiffy Seal Ice & Water Guard HT.
 - i. SDP Advanced Polymer Products Inc; Palisade SA-HT.
 2. Thermal Stability: ASTM D 1970; stable after testing at 240 deg F (116 deg C) or higher.
 3. Low-Temperature Flexibility: ASTM D 1970; passes after testing at minus 20 deg F (29 deg C) or lower.

- D. Slip Sheet: Rosin-sized building paper, 3 lb/100 sq. ft. (0.16 kg/sq. m) minimum.

2.4 MISCELLANEOUS MATERIALS

- A. General: Provide materials and types of fasteners, solder, protective coatings, sealants, and other miscellaneous items as required for complete sheet metal flashing and trim installation and as recommended by manufacturer of primary sheet metal or manufactured item unless otherwise indicated.
- B. Fasteners: Wood screws, annular threaded nails, self-tapping screws, self-locking rivets and bolts, and other suitable fasteners designed to withstand design loads and recommended by manufacturer of primary sheet metal or manufactured item.
 - 1. General: Blind fasteners or self-drilling screws, gasketed, with hex-washer head.
 - a. Exposed Fasteners: Heads matching color of sheet metal using plastic caps or factory-applied coating. Provide metal-backed EPDM or PVC sealing washers under heads of exposed fasteners bearing on weather side of metal.
 - b. Blind Fasteners: High-strength aluminum or stainless-steel rivets suitable for metal being fastened.
 - c. Spikes and Ferrules: Same material as gutter; with spike with ferrule matching internal gutter width.
 - 2. Fasteners for Copper Sheet: Copper, hardware bronze or passivated Series 300 stainless steel.
 - 3. Fasteners for Aluminum Sheet: Aluminum or Series 300 stainless steel.
 - 4. Fasteners for Stainless-Steel Sheet: Series 300 stainless steel.
 - 5. Fasteners for Zinc-Coated (Galvanized) Steel Sheet: Series 300 stainless steel or hot-dip galvanized steel according to ASTM A 153/A 153M or ASTM F 2329.
- C. Solder:
 - 1. For Copper: ASTM B 32, with maximum lead content of 0.2 percent.
 - 2. For Stainless Steel: ASTM B 32, with acid flux of type recommended by stainless-steel sheet manufacturer.
 - 3. For Zinc-Coated (Galvanized) Steel: ASTM B 32, with maximum lead content of 0.2 percent.
- D. Sealant Tape: Pressure-sensitive, 100 percent solids, polyisobutylene compound sealant tape with release-paper backing. Provide permanently elastic, nonsag, nontoxic, nonstaining tape 1/2 inch (13 mm) wide and 1/8 inch (3 mm) thick.
- E. Elastomeric Sealant: ASTM C 920, elastomeric silicone polymer sealant; of type, grade, class, and use classifications required to seal joints in sheet metal flashing and trim and remain watertight.

- F. Butyl Sealant: ASTM C 1311, single-component, solvent-release butyl rubber sealant; polyisobutylene plasticized; heavy bodied for hooked-type expansion joints with limited movement.
- G. Epoxy Seam Sealer: Two-part, noncorrosive, aluminum seam-cementing compound, recommended by aluminum manufacturer for exterior nonmoving joints, including riveted joints.
- H. Bituminous Coating: Cold-applied asphalt emulsion according to ASTM D 1187.
- I. Asphalt Roofing Cement: ASTM D 4586, asbestos free, of consistency required for application.

2.5 MANUFACTURED REGLETS

- A. Reglets: Units of type, material, and profile required, formed to provide secure interlocking of separate reglet and counterflashing pieces, and compatible with flashing indicated with factory-mitered and -welded corners and junctions and with interlocking counterflashing on exterior face, of same metal as reglet.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cheney Flashing Company.
 - b. Fry Reglet Corporation.
 - c. Heckmann Building Products, Inc.
 - d. Hickman, W. P. Company.
 - e. Hohmann & Barnard, Inc.
 - f. Keystone Flashing Company, Inc.
 - g. National Sheet Metal Systems, Inc.
 - h. Sandell Manufacturing.
 - 2. Material: Aluminum, 0.024 inch (0.61 mm) thick Galvanized steel, 0.022 inch (0.56 mm) thick.
 - 3. Finish: With manufacturer's standard color coating.

2.6 FABRICATION, GENERAL

- A. General: Custom fabricate sheet metal flashing and trim to comply with details shown and recommendations in cited sheet metal standard that apply to design, dimensions, geometry, metal thickness, and other characteristics of item required. Fabricate sheet metal flashing and trim in shop to greatest extent possible.
 - 1. Obtain field measurements for accurate fit before shop fabrication.

2. Form sheet metal flashing and trim to fit substrates without excessive oil canning, buckling, and tool marks; true to line, levels, and slopes; and with exposed edges folded back to form hems.
 3. Conceal fasteners and expansion provisions where possible. Do not use exposed fasteners on faces exposed to view.
- B. Expansion Provisions: Form metal for thermal expansion of exposed flashing and trim.
1. Form expansion joints of intermeshing hooked flanges, not less than 1 inch (25 mm) deep, filled with butyl sealant concealed within joints.
 2. Use lapped expansion joints only where indicated on Drawings.
- C. Sealant Joints: Where movable, nonexpansion-type joints are required, form metal to provide for proper installation of elastomeric sealant according to cited sheet metal standard.
- D. Fabricate cleats and attachment devices from same material as accessory being anchored or from compatible, noncorrosive metal.
- E. Fabricate cleats and attachment devices of sizes as recommended by cited sheet metal standard for application, but not less than thickness of metal being secured.
- F. Seams: Fabricate nonmoving seams with flat-lock seams. Tin edges to be seamed, form seams, and solder.
- G. Seams: Fabricate nonmoving seams with flat-lock seams. Form seams and seal with elastomeric sealant unless otherwise recommended by sealant manufacturer for intended use. Rivet joints where necessary for strength.
- H. Seams for Aluminum: Fabricate nonmoving seams with flat-lock seams. Form seams and seal with epoxy seam sealer. Rivet joints where necessary for strength.

2.7 ROOF-DRAINAGE SHEET METAL FABRICATIONS

- A. Hanging Gutters: Fabricate to cross section required, complete with end pieces, outlet tubes, and other accessories as required. Fabricate in minimum 96-inch (2400-mm-) long sections. Furnish flat-stock gutter brackets and gutter spacers and straps fabricated from same metal as gutters, of size recommended by cited sheet metal standard but with thickness not less than twice the gutter thickness. Fabricate expansion joints, expansion-joint covers, and gutter accessories from same metal as gutters. Shop fabricate interior and exterior corners.
- B. Downspouts: Fabricate rectangular downspouts to dimensions indicated, complete with mitered elbows. Furnish with metal hangers from same material as downspouts and anchors. Shop fabricate elbows.
1. Hanger Style: Fla 1- 35a & 1-35H, SMACNA Architectural Sheet Metal Manual.

2. Fabricate from the following materials:
 - a. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch (0.56 mm) thick.
- C. Parapet Scuppers: Fabricate scuppers to dimensions required, with closure flange trim to exterior, 4-inch- (100-mm-) wide wall flanges to interior, and base extending 4 inches (100 mm) beyond cant or tapered strip into field of roof. Fabricate from the following materials:
 1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch (0.71 mm) thick.
- D. Conductor Heads: Fabricate conductor heads with flanged back and stiffened top edge and of dimensions and shape required, complete with outlet tubes. Fabricate from the following materials:
 1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch (0.71 mm) thick.
- E. Base Flashing: Shop fabricate interior and exterior corners. Fabricate from the following materials:
 1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch (0.71 mm) thick.
- F. Counterflashing and Flashing Receivers: Fabricate from the following materials:
 1. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch (0.56 mm) thick.
- G. Roof-Penetration Flashing: Fabricate from the following materials:
 1. Aluminum-Zinc Alloy-Coated Steel: 0.028 inch (0.71 mm) thick.

2.8 STEEP-SLOPE ROOF SHEET METAL FABRICATIONS

- A. Apron, Step, Cricket, and Backer Flashing: Fabricate from the following materials:
 1. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch (0.56 mm) thick.
- B. Valley Flashing: Fabricate from the following materials:
 1. Galvanized Steel: 0.028 inch (0.71 mm) thick.
- C. Drip Edges: Fabricate from the following materials:
 1. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch (0.56 mm) thick.
- D. Eave, Rake Flashing: Fabricate from the following materials:
 1. Aluminum-Zinc Alloy-Coated Steel: 0.022 inch (0.56 mm) thick.

PART 3 - EXECUTION

3.1 UNDERLAYMENT INSTALLATION

- A. Felt Underlayment: Install felt underlayment, wrinkle free, using adhesive to minimize use of mechanical fasteners under sheet metal flashing and trim. Apply in shingle fashion to shed water, with lapped joints of not less than 2 inches (50 mm).

- B. Synthetic Underlayment: Install synthetic underlayment, wrinkle free, according to manufacturers' written instructions, and using adhesive where possible to minimize use of mechanical fasteners under sheet metal.
- C. Self-Adhering Sheet Underlayment: Install self-adhering sheet underlayment, wrinkle free. Prime substrate if recommended by underlayment manufacturer. Comply with temperature restrictions of underlayment manufacturer for installation; use primer for installing underlayment at low temperatures. Apply in shingle fashion to shed water, with end laps of not less than 6 inches (150 mm) staggered 24 inches (600 mm) between courses. Overlap side edges not less than 3-1/2 inches (90 mm). Roll laps and edges with roller. Cover underlayment within 14 days.

3.2 INSTALLATION, GENERAL

- A. General: Anchor sheet metal flashing and trim and other components of the Work securely in place, with provisions for thermal and structural movement. Use fasteners, solder, protective coatings, separators, sealants, and other miscellaneous items as required to complete sheet metal flashing and trim system.
 - 1. Install sheet metal flashing and trim true to line, levels, and slopes. Provide uniform, neat seams with minimum exposure of solder, welds, and sealant.
 - 2. Install sheet metal flashing and trim to fit substrates and to result in watertight performance. Verify shapes and dimensions of surfaces to be covered before fabricating sheet metal.
 - 3. Space cleats not more than 12 inches (300 mm) apart. Attach each cleat with at least two fasteners. Bend tabs over fasteners.
 - 4. Install exposed sheet metal flashing and trim with limited oil canning, and free of buckling and tool marks.
 - 5. Torch cutting of sheet metal flashing and trim is not permitted.
- B. Metal Protection: Where dissimilar metals contact each other, or where metal contacts pressure-treated wood or other corrosive substrates, protect against galvanic action or corrosion by painting contact surfaces with bituminous coating or by other permanent separation as recommended by sheet metal manufacturer or cited sheet metal standard.
 - 1. Coat concealed side of uncoated-aluminum and stainless-steel sheet metal flashing and trim with bituminous coating where flashing and trim contact wood, ferrous metal, or cementitious construction.
 - 2. Underlayment: Where installing sheet metal flashing and trim directly on cementitious or wood substrates, install underlayment and cover with slip sheet.
- C. Expansion Provisions: Provide for thermal expansion of exposed flashing and trim. Space movement joints at maximum of 10 feet (3 m) with no joints within 24 inches (600 mm) of corner or intersection.

1. Form expansion joints of intermeshing hooked flanges, not less than 1 inch (25 mm) deep, filled with sealant concealed within joints.
 2. Use lapped expansion joints only where indicated on Drawings.
- D. Fasteners: Use fastener sizes that penetrate substrate not less than recommended by fastener manufacturer to achieve maximum pull-out resistance.
- E. Conceal fasteners and expansion provisions where possible in exposed work and locate to minimize possibility of leakage. Cover and seal fasteners and anchors as required for a tight installation.
- F. Seal joints as required for watertight construction. Prepare joints and apply sealants to comply with requirements in Section 079200 "Joint Sealants."
- G. Soldered Joints: Clean surfaces to be soldered, removing oils and foreign matter. Pre-tin edges of sheets with solder to width of 1-1/2 inches (38 mm); however, reduce pre-tinning where pre-tinned surface would show in completed Work.
1. Do not solder metallic-coated steel and aluminum sheet.
 2. Do not use torches for soldering.
 3. Heat surfaces to receive solder, and flow solder into joint. Fill joint completely. Completely remove flux and spatter from exposed surfaces.
 4. Stainless-Steel Soldering: Tin edges of uncoated sheets, using solder for stainless steel and acid flux. Promptly remove acid flux residue from metal after tinning and soldering. Comply with solder manufacturer's recommended methods for cleaning and neutralization.
 5. Copper Soldering: Tin edges of uncoated sheets, using solder for copper.
- H. Rivets: Rivet joints in uncoated aluminum where necessary for strength.

3.3 ROOF-DRAINAGE SYSTEM INSTALLATION

- A. General: Install sheet metal roof-drainage items to produce complete roof-drainage system according to cited sheet metal standard unless otherwise indicated. Coordinate installation of roof perimeter flashing with installation of roof-drainage system.
- B. Hanging Gutters: Join sections with riveted and soldered joints or joints sealed with sealant. Provide for thermal expansion. Attach gutters at eave or fascia to firmly anchor them in position. Provide end closures and seal watertight with sealant. Slope to downspouts.
1. Install gutter with expansion joints at locations indicated, but not exceeding, 50 feet (15.24 m) apart. Install expansion-joint caps.
 2. Install continuous gutter screens on gutters with noncorrosive fasteners, removable or hinged to swing open for cleaning gutters.

- C. Built-in Gutters: Join sections with riveted and soldered joints or joints sealed with sealant. Provide for thermal expansion. Slope to downspouts. Provide end closures and seal watertight with sealant.
 - 1. Install underlayment layer in built-in gutter trough and extend to drip edge at eaves and under underlayment on roof sheathing. Lap sides minimum of 2 inches (50 mm) over underlying course. Lap ends minimum of 4 inches (100 mm). Stagger end laps between succeeding courses at least 72 inches (1830 mm). Fasten with roofing nails. Install slip sheet over underlayment.
 - 2. Install gutter with expansion joints at locations indicated, but not exceeding, 50 feet (15.24 m) apart. Install expansion-joint caps.
- D. Downspouts: Join sections with 1-1/2-inch (38-mm) telescoping joints. Provide hangers with fasteners designed to hold downspouts securely to walls. Locate hangers at top and bottom and at approximately 60 inches (1500 mm) o.c.
- E. Splash Pans: Install where downspouts discharge on low-slope roofs. Set in asphalt roofing cement or elastomeric sealant compatible with the substrate.
- F. Parapet Scuppers: Continuously support scupper, set to correct elevation, and seal flanges to interior wall face, over cants or tapered edge strips, and under roofing membrane.
- G. Conductor Heads: Anchor securely to wall, with elevation of conductor head rim at minimum of 1 inch (25 mm) below scupper or gutter discharge.
- H. Expansion-Joint Covers: Install expansion-joint covers at locations and of configuration indicated. Lap joints minimum of 4 inches (100 mm) in direction of water flow.

3.4 ROOF FLASHING INSTALLATION

- A. General: Install sheet metal flashing and trim to comply with performance requirements, sheet metal manufacturer's written installation instructions, and cited sheet metal standard. Provide concealed fasteners where possible, and set units true to line, levels, and slopes. Install work with laps, joints, and seams that are permanently watertight and weather resistant.
- B. Roof Edge Flashing: Anchor to resist uplift and outward forces according to recommendations in cited sheet metal standard unless otherwise indicated. Interlock bottom edge of roof edge flashing with continuous cleat anchored to substrate.
- C. Copings: Anchor to resist uplift and outward forces according to recommendations in cited sheet metal standard unless otherwise indicated.
- D. Pipe or Post Counterflashing: Install counterflashing umbrella with close-fitting collar with top edge flared for elastomeric sealant, extending minimum of 4 inches (100 mm) over base flashing. Install stainless-steel draw band and tighten.

- E. Counterflashing: Coordinate installation of counterflashing with installation of base flashing. Insert counterflashing in reglets or receivers and fit tightly to base flashing. Extend counterflashing 4 inches (100 mm) over base flashing. Lap counterflashing joints minimum of 4 inches (100 mm).
- F. Roof-Penetration Flashing: Coordinate installation of roof-penetration flashing with installation of roofing and other items penetrating roof. Seal with elastomeric or butyl sealant and clamp flashing to pipes that penetrate roof.

3.5 WALL FLASHING INSTALLATION

- A. General: Install sheet metal wall flashing to intercept and exclude penetrating moisture according to cited sheet metal standard unless otherwise indicated. Coordinate installation of wall flashing with installation of wall-opening components such as windows, doors, and louvers.
- B. Through-Wall Flashing: Installation of through-wall flashing is specified in Section 04200 "Unit Masonry."
- C. Reglets: Installation of reglets is specified in Section 04200 "Unit Masonry."
- D. Opening Flashings in Frame Construction: Install continuous head, sill, and similar flashings to extend 4 inches (100 mm) beyond wall openings.

3.6 CLEANING AND PROTECTION

- A. Clean exposed metal surfaces of substances that interfere with uniform oxidation and weathering.
- B. Clean and neutralize flux materials. Clean off excess solder.
- C. Clean off excess sealants.
- D. Remove temporary protective coverings and strippable films as sheet metal flashing and trim are installed unless otherwise indicated in manufacturer's written installation instructions.

END OF SECTION 076200

SECTION 079200

JOINT SEALANTS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes joint sealants for the following applications, including those specified by reference to this Section:
 1. Exterior joints in the following vertical surfaces and horizontal nontraffic surfaces:
 - a. Construction joints in cast-in-place concrete.
 - b. Joints in glass unit masonry assemblies.
 - c. Joints between metal panels.
 - d. Joints between different materials listed above.
 - e. Perimeter joints between materials listed above and frames of doors, windows and louvers.
 - f. Control and expansion joints.
 - g. Other joints as indicated.
 2. Exterior joints in the following horizontal traffic surfaces:
 - a. Isolation and contraction joints in cast-in-place concrete slabs.
 - b. Tile control and expansion joints.
 - c. Joints between different materials listed above.
 - d. Other joints as indicated.
 3. Interior joints in the following vertical surfaces and horizontal nontraffic surfaces:
 - a. Control and expansion joints on exposed interior surfaces of exterior walls.
 - b. Perimeter joints of exterior openings where indicated.
 - c. Tile control and expansion joints.
 - d. Vertical joints on exposed surfaces of walls and partitions.

- e. Perimeter joints between interior wall surfaces and frames of interior doors, windows.
 - f. Joints between plumbing fixtures and adjoining walls, floors, and counters.
 - g. Other joints as indicated.
4. Interior joints in the following horizontal traffic surfaces:
- a. Isolation joints in cast-in-place concrete slabs.
 - b. Control and expansion joints in tile flooring.
 - c. Other joints as indicated.

1.3 PERFORMANCE REQUIREMENTS

- A. Provide elastomeric joint sealants that establish and maintain watertight and airtight continuous joint seals without staining or deteriorating joint substrates.
- B. Provide joint sealants for interior applications that establish and maintain airtight and water-resistant continuous joint seals without staining or deteriorating joint substrates.

1.4 SUBMITTALS

- A. Product Data: For each joint-sealant product indicated.
- B. Samples for Initial Selection: Manufacturer's color charts consisting of strips of cured sealants showing the full range of colors available for each product exposed to view.
- C. Samples for Verification: For each type and color of joint sealant required, provide Samples with joint sealants in 1/2-inch- wide joints formed between two 6-inch- long strips of material matching the appearance of exposed surfaces adjacent to joint sealants.
- D. Product Certificates: For each type of joint sealant and accessory, signed by product manufacturer.
- E. SWRI Validation Certificate: For each elastomeric sealant specified to be validated by SWRI's Sealant Validation Program.
- F. Preconstruction Field Test Reports: Indicate which sealants and joint preparation methods resulted in optimum adhesion to joint substrates based on preconstruction testing specified in "Quality Assurance" Article.
- G. Compatibility and Adhesion Test Reports: From sealant manufacturer, indicating the following:

1. Materials forming joint substrates and joint-sealant backings have been tested for compatibility and adhesion with joint sealants.
2. Interpretation of test results and written recommendations for primers and substrate preparation needed for adhesion.

H. Field Test Report Log: For each elastomeric sealant application.

I. Product Test Reports: Based on comprehensive testing of product formulations performed by a qualified testing agency, indicating that sealants comply with requirements.

J. Warranties: Special warranties specified in this Section.

1.5 QUALITY ASSURANCE

A. Installer Qualifications: Manufacturer's authorized Installer who is approved or licensed for installation of elastomeric sealants required for this Project.

B. Source Limitations: Obtain each type of joint sealant through one source from a single manufacturer.

C. Preconstruction Compatibility and Adhesion Testing: Submit to joint-sealant manufacturers, for testing indicated below, samples of materials that will contact or affect joint sealants.

1. Use ASTM C 1087 or manufacturer's standard test method to determine whether priming and other specific joint preparation techniques are required to obtain rapid, optimum adhesion of joint sealants to joint substrates.
2. Submit pieces of each type of material, including joint substrates, shims, joint-sealant backings, secondary seals, and miscellaneous materials.
3. Schedule sufficient time for testing and analyzing results to prevent delaying the Work.
4. For materials failing tests, obtain joint-sealant manufacturer's written instructions for corrective measures including use of specially formulated primers.
5. Testing will not be required if joint-sealant manufacturers submit joint preparation data that are based on previous testing of current sealant products for adhesion to, and compatibility with, joint substrates and other materials matching those submitted.

D. Product Testing: Obtain test results for "Product Test Reports" Paragraph in "Submittals" Article from a qualified testing agency based on testing current sealant formulations within a 36-month period preceding the commencement of the Work.

1. Testing Agency Qualifications: An independent testing agency qualified according to ASTM C 1021 to conduct the testing indicated, as documented according to ASTM E 548.

2. Test elastomeric joint sealants for compliance with requirements specified by reference to ASTM C 920, and where applicable, to other standard test methods.
 3. Test elastomeric joint sealants according to SWRI's Sealant Validation Program for compliance with requirements specified by reference to ASTM C 920 for adhesion and cohesion under cyclic movement, adhesion-in-peel, and indentation hardness.
 4. Test other joint sealants for compliance with requirements indicated by referencing standard specifications and test methods.
- E. Preconstruction Field-Adhesion Testing: Before installing elastomeric sealants, field test their adhesion to Project joint substrates as follows:
1. Locate test joints where indicated on Project or, if not indicated, as directed by Architect.
 2. Conduct field tests for each application indicated below:
 - a. Each type of elastomeric sealant and joint substrate indicated.
 - b. Each type of nonelastomeric sealant and joint substrate indicated.
 3. Notify Architect seven days in advance of dates and times when test joints will be erected.
 4. Arrange for tests to take place with joint-sealant manufacturer's technical representative present.
 - a. Test Method: Test joint sealants according to Method A, Field-Applied Sealant Joint Hand Pull Tab, in Appendix X1 in ASTM C 1193.
 - 1) For joints with dissimilar substrates, verify adhesion to each substrate separately; extend cut along one side, verifying adhesion to opposite side. Repeat procedure for opposite side.
 5. Report whether sealant in joint connected to pulled-out portion failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each type of product and joint substrate. For sealants that fail adhesively, retest until satisfactory adhesion is obtained.
 6. Evaluation of Preconstruction Field-Adhesion-Test Results: Sealants not evidencing adhesive failure from testing, in absence of other indications of noncompliance with requirements, will be considered satisfactory. Do not use sealants that fail to adhere to joint substrates during testing.
- F. Mockups: Build mockups incorporating sealant joints, as follows, to verify selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution:
1. Joints in mockups of assemblies specified in other Sections that are indicated to receive elastomeric joint sealants, which are specified by reference to this Section.

- G. Preinstallation Conference: Conduct conference at Project site to comply with requirements in Division 1 Section "Project Management and Coordination."

1.6 PROJECT CONDITIONS

- A. Do not proceed with installation of joint sealants under the following conditions:
 1. When ambient and substrate temperature conditions are outside limits permitted by joint-sealant manufacturer or are below 40 deg F.
 2. When joint substrates are wet.
 3. Where joint widths are less than those allowed by joint-sealant manufacturer for applications indicated.
 4. Contaminants capable of interfering with adhesion have not yet been removed from joint substrates.

1.7 WARRANTY

- A. Special Installer's Warranty: Installer's standard form in which Installer agrees to repair or replace elastomeric joint sealants that do not comply with performance and other requirements specified in this Section within specified warranty period.
 1. Warranty Period: Two years from date of Substantial Completion.
- B. Special Manufacturer's Warranty: Manufacturer's standard form in which elastomeric sealant manufacturer agrees to furnish elastomeric joint sealants to repair or replace those that do not comply with performance and other requirements specified in this Section within specified warranty period.
 1. Warranty Period: Two years from date of Substantial Completion.
- C. Special warranties specified in this Article exclude deterioration or failure of elastomeric joint sealants from the following:
 1. Movement of the structure resulting in stresses on the sealant exceeding sealant manufacturer's written specifications for sealant elongation and compression caused by structural settlement or errors attributable to design or construction.
 2. Disintegration of joint substrates from natural causes exceeding design specifications.
 3. Mechanical damage caused by individuals, tools, or other outside agents.
 4. Changes in sealant appearance caused by accumulation of dirt or other atmospheric contaminants.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, products listed in other Part 2 articles.

2.2 MATERIALS, GENERAL

- A. Compatibility: Provide joint sealants, backings, and other related materials that are compatible with one another and with joint substrates under conditions of service and application, as demonstrated by sealant manufacturer, based on testing and field experience.
- B. VOC Content of Interior Sealants: Provide sealants and sealant primers for use inside the weatherproofing system that comply with the following limits for VOC content when calculated according to 40 CFR 59, Subpart D (EPA Method 24):
 - 1. Architectural Sealants: 250 g/L.
 - 2. Nonmembrane Roof Sealants: 300 g/L.
 - 3. Single-Ply Roof Membrane Sealants: 450 g/L.
 - 4. Sealant Primers for Nonporous Substrates: 250 g/L.
 - 5. Sealant Primers for Porous Substrates: 775 g/L.
 - 6. Modified Bituminous Sealant Primers: 500 g/L.
- C. Colors of Exposed Joint Sealants: As selected by Architect from manufacturer's full range.

2.3 ELASTOMERIC JOINT SEALANTS

- A. Elastomeric Sealants: Comply with ASTM C 920 and other requirements indicated for each liquid-applied chemically curing sealant specified, including those referencing ASTM C 920 classifications for type, grade, class, and uses related to exposure and joint substrates.
- B. Stain-Test-Response Characteristics: Where elastomeric sealants are specified to be nonstaining to porous substrates, provide products that have undergone testing according to ASTM C 1248 and have not stained porous joint substrates indicated for Project.
- C. Suitability for Immersion in Liquids. Where elastomeric sealants are indicated for Use I for joints that will be continuously immersed in liquids, provide products that have undergone testing according to ASTM C 1247 and qualify for the length of exposure indicated by reference to ASTM C 920 for Class 1 or 2. Liquid used for testing sealants is deionized water, unless otherwise indicated.

- D. Suitability for Contact with Food: Where elastomeric sealants are indicated for joints that will come in repeated contact with food, provide products that comply with 21 CFR 177.2600.
- E. Preformed Foam Sealant: Manufacturer's standard preformed, precompressed, open-cell foam sealant that is manufactured from high-density urethane foam impregnated with a nondrying, water-repellent agent; is factory produced in precompressed sizes in roll or stick form to fit joint widths indicated; is coated on one side with a pressure-sensitive adhesive and covered with protective wrapping; develops a watertight and airtight seal when compressed to the degree specified by manufacturer; and complies with the following:
 - 1. Available Products:
 - a. EMSEAL Joint Systems, Ltd.; Emseal 25V.
 - b. illbruck Sealant Systems, Inc.; Wilseal 600.
 - c. Polytite Manufacturing Corporation; Polytite B.
 - d. Polytite Manufacturing Corporation; Polytite Standard.
 - e. Sandell Manufacturing Co., Inc.; Polyseal.
 - 2. Properties: Permanently elastic, mildew resistant, nonmigratory, nonstaining, and compatible with joint substrates and other joint sealants.

2.4 PREFORMED TAPE SEALANTS

- A. Back-Bedding Mastic Tape Sealant: Preformed, butyl-based elastomeric tape sealant with a solids content of 100 percent; nonstaining and nonmigrating in contact with nonporous surfaces; with or without spacer rod as recommended in writing by tape manufacturers for application indicated; packaged on rolls with a release paper backing; and complying with ASTM C 1281 and AAMA 800 for products indicated below:
 - 1. AAMA 804.3 tape, where indicated.
 - 2. AAMA 806.3 tape, for applications in which tape is subject to continuous pressure.
 - 3. AAMA 807.3 tape, for applications in which tape is not subject to continuous pressure.
- B. Expanded Cellular Tape Sealant: Closed-cell, PVC foam tape sealant; factory coated with adhesive on both surfaces; packaged on rolls with release liner protecting adhesive; and complying with AAMA 800 for the following types:
 - 1. Type 1, for applications in which tape acts as the primary sealant.
 - 2. Type 2, for applications in which tape is used in combination with a full bead of liquid sealant.

2.5 JOINT-SEALANT BACKING

- A. General: Provide sealant backings of material and type that are nonstaining; are compatible with joint substrates, sealants, primers, and other joint fillers; and are approved for applications indicated by sealant manufacturer based on field experience and laboratory testing.
- B. Cylindrical Sealant Backings: ASTM C 1330, Type C (closed-cell material with a surface skin) or any of the preceding types, as approved in writing by joint-sealant manufacturer for joint application indicated, and of size and density to control sealant depth and otherwise contribute to producing optimum sealant performance:
- C. Elastomeric Tubing Sealant Backings: Neoprene, butyl, EPDM, or silicone tubing complying with ASTM D 1056, nonabsorbent to water and gas, and capable of remaining resilient at temperatures down to minus 26 deg F. Provide products with low compression set and of size and shape to provide a secondary seal, to control sealant depth, and to otherwise contribute to optimum sealant performance.
- D. Bond-Breaker Tape: Polyethylene tape or other plastic tape recommended by sealant manufacturer for preventing sealant from adhering to rigid, inflexible joint-filler materials or joint surfaces at back of joint where such adhesion would result in sealant failure. Provide self-adhesive tape where applicable.

2.6 MISCELLANEOUS MATERIALS

- A. Primer: Material recommended by joint-sealant manufacturer where required for adhesion of sealant to joint substrates indicated, as determined from preconstruction joint-sealant-substrate tests and field tests.
- B. Cleaners for Nonporous Surfaces: Chemical cleaners acceptable to manufacturers of sealants and sealant backing materials, free of oily residues or other substances capable of staining or harming joint substrates and adjacent nonporous surfaces in any way, and formulated to promote optimum adhesion of sealants to joint substrates.
- C. Masking Tape: Nonstaining, nonabsorbent material compatible with joint sealants and surfaces adjacent to joints.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine joints indicated to receive joint sealants, with Installer present, for compliance with requirements for joint configuration, installation tolerances, and other conditions affecting joint-sealant performance.

- B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Surface Cleaning of Joints: Clean out joints immediately before installing joint sealants to comply with joint-sealant manufacturer's written instructions and the following requirements:
 - 1. Remove all foreign material from joint substrates that could interfere with adhesion of joint sealant, including dust, paints (except for permanent, protective coatings tested and approved for sealant adhesion and compatibility by sealant manufacturer), old joint sealants, oil, grease, waterproofing, water repellents, water, surface dirt, and frost.
 - 2. Clean porous joint substrate surfaces by brushing, grinding, blast cleaning, mechanical abrading, or a combination of these methods to produce a clean, sound substrate capable of developing optimum bond with joint sealants. Remove loose particles remaining after cleaning operations above by vacuuming or blowing out joints with oil-free compressed air. Porous joint substrates include the following:
 - a. Concrete.
 - b. Masonry.
 - c. Unglazed surfaces of ceramic tile.
 - 3. Remove laitance and form-release agents from concrete.
 - 4. Clean nonporous surfaces with chemical cleaners or other means that do not stain, harm substrates, or leave residues capable of interfering with adhesion of joint sealants. Nonporous joint substrates include the following:
 - a. Metal.
 - b. Glass.
 - c. Porcelain enamel.
 - d. Glazed surfaces of ceramic tile.
- B. Joint Priming: Prime joint substrates , where recommended in writing by joint-sealant manufacturer, based on preconstruction joint-sealant-substrate tests or prior experience. Apply primer to comply with joint-sealant manufacturer's written instructions. Confine primers to areas of joint-sealant bond; do not allow spillage or migration onto adjoining surfaces.
- C. Masking Tape: Use masking tape where required to prevent contact of sealant with adjoining surfaces that otherwise would be permanently stained or damaged by such contact or by cleaning methods required to remove sealant smears. Remove tape immediately after tooling without disturbing joint seal.

3.3 INSTALLATION OF JOINT SEALANTS

- A. General: Comply with joint-sealant manufacturer's written installation instructions for products and applications indicated, unless more stringent requirements apply.
- B. Sealant Installation Standard: Comply with recommendations in ASTM C 1193 for use of joint sealants as applicable to materials, applications, and conditions indicated.
- C. Acoustical Sealant Application Standard: Comply with recommendations in ASTM C 919 for use of joint sealants in acoustical applications as applicable to materials, applications, and conditions indicated.
- D. Install sealant backings of type indicated to support sealants during application and at position required to produce cross-sectional shapes and depths of installed sealants relative to joint widths that allow optimum sealant movement capability.
 - 1. Do not leave gaps between ends of sealant backings.
 - 2. Do not stretch, twist, puncture, or tear sealant backings.
 - 3. Remove absorbent sealant backings that have become wet before sealant application and replace them with dry materials.
- E. Install bond-breaker tape behind sealants where sealant backings are not used between sealants and backs of joints.
- F. Install sealants using proven techniques that comply with the following and at the same time backings are installed:
 - 1. Place sealants so they directly contact and fully wet joint substrates.
 - 2. Completely fill recesses in each joint configuration.
 - 3. Produce uniform, cross-sectional shapes and depths relative to joint widths that allow optimum sealant movement capability.
- G. Tooling of Nonsag Sealants: Immediately after sealant application and before skinning or curing begins, tool sealants according to requirements specified below to form smooth, uniform beads of configuration indicated; to eliminate air pockets; and to ensure contact and adhesion of sealant with sides of joint.
 - 1. Remove excess sealant from surfaces adjacent to joints.
 - 2. Use tooling agents that are approved in writing by sealant manufacturer and that do not discolor sealants or adjacent surfaces.
 - 3. Provide concave joint configuration per Figure 5A in ASTM C 1193, unless otherwise indicated.
 - 4. Provide flush joint configuration where indicated per Figure 5B in ASTM C 1193.
 - 5. Provide recessed joint configuration of recess depth and at locations indicated per Figure 5C in ASTM C 1193.
 - a. Use masking tape to protect surfaces adjacent to recessed tooled joints.

- H. Installation of Preformed Tapes: Install according to manufacturer's written instructions.
- I. Installation of Preformed Silicone-Sealant System: Comply with the following requirements:
 - 1. Apply masking tape to each side of joint, outside of area to be covered by sealant system.
 - 2. Apply silicone sealant to each side of joint to produce a bead of size complying with preformed silicone-sealant system manufacturer's written instructions and covering a bonding area of not less than 3/8 inch. Hold edge of sealant bead 1/4 inch inside masking tape.
 - 3. Within 10 minutes of sealant application, press silicone extrusion into sealant to wet extrusion and substrate. Use a roller to apply consistent pressure and ensure uniform contact between sealant and both extrusion and substrate.
 - 4. Complete installation of sealant system in horizontal joints before installing in vertical joints. Lap vertical joints over horizontal joints. At ends of joints, cut silicone extrusion with a razor knife.
- J. Installation of Preformed Foam Sealants: Install each length of sealant immediately after removing protective wrapping, taking care not to pull or stretch material, producing seal continuity at ends, turns, and intersections of joints. For applications at low ambient temperatures where expansion of sealant requires acceleration to produce seal, apply heat to sealant in compliance with sealant manufacturer's written instructions.

3.4 FIELD QUALITY CONTROL

- A. Field-Adhesion Testing: Field test joint-sealant adhesion to joint substrates as follows:
 - 1. Extent of Testing: Test completed elastomeric sealant joints as follows:
 - a. Perform 1 test for each 1000 feet of joint length thereafter or 1 test per each floor per elevation.
 - 2. Test Method: Test joint sealants according to as appropriate for type of joint-sealant application indicated.
 - a. For joints with dissimilar substrates, verify adhesion to each substrate separately; do this by extending cut along one side, verifying adhesion to opposite side. Repeat procedure for opposite side.
 - 3. Inspect joints for complete fill, for absence of voids, and for joint configuration complying with specified requirements. Record results in a field-adhesion-test log.
 - 4. Inspect tested joints and report on the following:

- a. Whether sealants in joints connected to pulled-out portion failed to adhere to joint substrates or tore cohesively. Include data on pull distance used to test each type of product and joint substrate. Compare these results to determine if adhesion passes sealant manufacturer's field-adhesion hand-pull test criteria.
 - b. Whether sealants filled joint cavities and are free of voids.
 - c. Whether sealant dimensions and configurations comply with specified requirements.
5. Record test results in a field-adhesion-test log. Include dates when sealants were installed, names of persons who installed sealants, test dates, test locations, whether joints were primed, adhesion results and percent elongations, sealant fill, sealant configuration, and sealant dimensions.
 6. Repair sealants pulled from test area by applying new sealants following same procedures used originally to seal joints. Ensure that original sealant surfaces are clean and that new sealant contacts original sealant.
- B. Evaluation of Field Test Results: Sealants not evidencing adhesive failure from testing or noncompliance with other indicated requirements will be considered satisfactory. Remove sealants that fail to adhere to joint substrates during testing or to comply with other requirements. Retest failed applications until test results prove sealants comply with indicated requirements.

3.5 CLEANING

- A. Clean off excess sealant or sealant smears adjacent to joints as the Work progresses by methods and with cleaning materials approved in writing by manufacturers of joint sealants and of products in which joints occur.

3.6 PROTECTION

- A. Protect joint sealants during and after curing period from contact with contaminating substances and from damage resulting from construction operations or other causes so sealants are without deterioration or damage at time of Substantial Completion. If, despite such protection, damage or deterioration occurs, cut out and remove damaged or deteriorated joint sealants immediately so installations with repaired areas are indistinguishable from original work.

END OF SECTION 079200

DIVISION 8

DOORS AND WINDOWS

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: www.dammonengineering.com



SECTION 081300

STEEL DOORS AND FRAMES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Standard hollow metal doors and frames.

1.3 DEFINITIONS

- A. Minimum Thickness: Minimum thickness of base metal without coatings.
- B. Standard Hollow Metal Work: Hollow metal work fabricated according to ANSI/SDI A250.8.

1.4 SUBMITTALS

- A. Product Data: For each type of product indicated. Include construction details, material descriptions, core descriptions, fire-resistance rating, and finishes.
- B. Shop Drawings: Include the following:
 - 1. Elevations of each door design.
 - 2. Details of doors, including vertical and horizontal edge details and metal thicknesses.
 - 3. Frame details for each frame type, including dimensioned profiles and metal thicknesses.
 - 4. Locations of reinforcement and preparations for hardware.
 - 5. Details of each different wall opening condition.
 - 6. Details of anchorages, joints, field splices, and connections.
 - 7. Details of accessories.
 - 8. Details of moldings, removable stops, and glazing.
 - 9. Details of conduit and preparations for power, signal, and control systems.
- C. Samples for Initial Selection: For units with factory-applied color finishes.

D. Samples for Verification:

1. For each type of exposed finish required, prepared on Samples of not less than 3 by 5 inches.
2. For the following items, prepared on Samples about 12 by 12 inches of materials and construction:
 - a. Doors: Show vertical-edge, top, and bottom construction; core construction; and hinge and other applied hardware reinforcement. Include separate section showing glazing if applicable.
 - b. Frames: Show profile, corner joint, floor and wall anchors, and silencers. Include separate section showing fixed hollow metal panels and glazing if applicable.

E. Other Action Submittals:

1. Schedule: Provide a schedule of hollow metal work prepared by or under the supervision of supplier, using same reference numbers for details and openings as those on Drawings. Coordinate with door hardware schedule.

F. Oversize Construction Certification: For assemblies required to be fire rated and exceeding limitations of labeled assemblies.

G. Product Test Reports: Based on evaluation of comprehensive tests performed by a qualified testing agency, for each type of hollow metal door and frame assembly.

1.5 QUALITY ASSURANCE

A. Source Limitations: Obtain hollow metal work from single source from single manufacturer.

B. Fire-Rated Door Assemblies: Assemblies complying with NFPA 80 that are listed and labeled by a qualified testing agency, for fire-protection ratings indicated, according to NFPA 252 or UL 10B or UL 10C.

1. Oversize Fire-Rated Door Assemblies: For units exceeding sizes of tested assemblies, provide certification by a qualified testing agency that doors comply with standard construction requirements for tested and labeled fire-rated door assemblies except for size.

C. Fire-Rated, Borrowed-Light Frame Assemblies: Assemblies complying with NFPA 80 that are listed and labeled, by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire-protection ratings indicated, based on testing according to NFPA 257 or UL 9. Label each individual glazed lite.

D. Smoke-Control Door Assemblies: Comply with NFPA 105 or UL 1784.

E. Preinstallation Conference: Conduct conference at Project site.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver hollow metal work palletized, wrapped, or crated to provide protection during transit and Project-site storage. Do not use nonvented plastic.
 - 1. Provide additional protection to prevent damage to finish of factory-finished units.
- B. Deliver welded frames with two removable spreader bars across bottom of frames, tack welded to jambs and mullions.
- C. Store hollow metal work under cover at Project site. Place in stacks of five units maximum in a vertical position with heads up, spaced by blocking, on minimum 4-inch high wood blocking. Do not store in a manner that traps excess humidity.
 - 1. Provide minimum 1/4-inch space between each stacked door to permit air circulation.

1.7 PROJECT CONDITIONS

- A. Field Measurements: Verify actual dimensions of openings by field measurements before fabrication.

1.8 COORDINATION

- A. Coordinate installation of anchorages for hollow metal frames. Furnish setting drawings, templates, and directions for installing anchorages, including sleeves, concrete inserts, anchor bolts, and items with integral anchors. Deliver such items to Project site in time for installation.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1. Amweld Building Products, LLC.
 - 2. Benchmark; a division of Therma-Tru Corporation.
 - 3. Ceco Door Products; an Assa Abloy Group company.
 - 4. Curries Company; an Assa Abloy Group company.
 - 5. Deansteel Manufacturing Company, Inc.
 - 6. Firedoor Corporation.
 - 7. Fleming Door Products Ltd.; an Assa Abloy Group company.
 - 8. Habersham Metal Products Company.

9. Karpen Steel Custom Doors & Frames.
10. Kewanee Corporation (The).
11. Mesker Door Inc.
12. Pioneer Industries, Inc.
13. Security Metal Products Corp.
14. Steelcraft; an Ingersoll-Rand company.
15. Windsor Republic Doors.

2.2 MATERIALS

- A. Cold-Rolled Steel Sheet: ASTM A 1008/A 1008M, Commercial Steel (CS), Type B; suitable for exposed applications.
- B. Hot-Rolled Steel Sheet: ASTM A 1011/A 1011M, Commercial Steel (CS), Type B; free of scale, pitting, or surface defects; pickled and oiled.
- C. Metallic-Coated Steel Sheet: ASTM A 653/A 653M, Commercial Steel (CS), Type B; with minimum G60 metallic coating.
- D. Frame Anchors: ASTM A 591/A 591M, Commercial Steel (CS), 40Z coating designation; mill phosphatized.
 1. For anchors built into exterior walls, steel sheet complying with ASTM A 1008/A 1008M or ASTM A 1011/A 1011M, hot-dip galvanized according to ASTM A 153/A 153M, Class B.
- E. Inserts, Bolts, and Fasteners: Hot-dip galvanized according to ASTM A 153/A 153M.
- F. Powder-Actuated Fasteners in Concrete: Fastener system of type suitable for application indicated, fabricated from corrosion-resistant materials, with clips or other accessory devices for attaching hollow metal frames of type indicated.
- G. Grout: ASTM C 476, except with a maximum slump of 4 inches, as measured according to ASTM C 143/C 143M.
- H. Mineral-Fiber Insulation: ASTM C 665, Type I (blankets without membrane facing); consisting of fibers manufactured from slag or rock wool with 6- to 12-lb/cu. ft. density; with maximum flame-spread and smoke-development indexes of 25 and 50, respectively; passing ASTM E 136 for combustion characteristics.
- I. Glazing: Comply with requirements in Division 8 Section "Glazing."
- J. Bituminous Coating: Cold-applied asphalt mastic, SSPC-Paint 12, compounded for 15-mil dry film thickness per coat. Provide inert-type noncorrosive compound free of asbestos fibers, sulfur components, and other deleterious impurities.

2.3 STANDARD HOLLOW METAL DOORS

- A. General: Provide doors of design indicated, not less than thickness indicated; fabricated with smooth surfaces, without visible joints or seams on exposed faces unless otherwise indicated. Comply with ANSI/SDI A250.8.
1. Design: Flush panel.
 2. Core Construction: Manufacturer's standard kraft-paper honeycomb, polystyrene, polyurethane, polyisocyanurate, mineral-board, or vertical steel-stiffener core.
 - a. Fire Door Core: As required to provide fire-protection.
 - 1) Locations: Interior doors where indicated.
 3. Vertical Edges for Single-Acting Doors: Manufacturer's standard.
 - a. Beveled Edge: 1/8 inch in 2 inches.
 4. Top and Bottom Edges: Closed with flush or inverted 0.042-inch thick, end closures or channels of same material as face sheets.
 5. Tolerances: Comply with SDI 117, "Manufacturing Tolerances for Standard Steel Doors and Frames."
- B. Exterior Doors: Face sheets fabricated from metallic-coated steel sheet. Provide doors complying with requirements indicated below by referencing ANSI/SDI A250.8 for level and model and ANSI/SDI A250.4 for physical performance level:
1. Level 1 and Physical Performance Level C (Standard Duty), Model 1 (Full Flush).
 - a. Width: 1-3/4 inches.
- C. Interior Doors: Face sheets fabricated from cold-rolled steel sheet. Provide doors complying with requirements indicated below by referencing ANSI/SDI A250.8 for level and model and ANSI/SDI A250.4 for physical performance level:
1. Level 1 and Physical Performance Level C (Standard Duty), Model 1 (Full Flush).
 - a. Width: 1-3/4 inches.
- D. Hardware Reinforcement: Fabricate according to ANSI/SDI A250.6 with reinforcing plates from same material as door face sheets.
- E. Fabricate concealed stiffeners and hardware reinforcement from either cold- or hot-rolled steel sheet.

2.4 STANDARD HOLLOW METAL FRAMES

- A. General: Comply with ANSI/SDI A250.8 and with details indicated for type and profile.

- B. Exterior Frames: Fabricated from metallic-coated steel sheet.
 - 1. Fabricate frames with mitered or coped corners.
 - 2. Fabricate frames as full profile welded unless otherwise indicated.
- C. Interior Frames: Fabricated from cold-rolled steel sheet.
 - 1. Fabricate frames with mitered or coped corners.
 - 2. Fabricate frames as full profile welded unless otherwise indicated.
 - 3. Frames for Borrowed Lights: Same as adjacent door frame].
- D. Hardware Reinforcement: Fabricate according to ANSI/SDI A250.6 with reinforcement plates from same material as frames.

2.5 FRAME ANCHORS

- A. Jamb Anchors:
 - 1. Stud-Wall Type: Designed to engage stud, welded to back of frames; not less than 0.042 inch thick.
 - 2. Compression Type for Drywall Slip-on Frames: Adjustable compression anchors.
- B. Floor Anchors: Formed from same material as frames, not less than 0.042 inch thick, and as follows:
 - 1. Monolithic Concrete Slabs: Clip-type anchors, with two holes to receive fasteners.
 - 2. Separate Topping Concrete Slabs: Adjustable-type anchors with extension clips, allowing not less than 2-inch height adjustment. Terminate bottom of frames at finish floor surface.

2.6 HOLLOW METAL PANELS

- A. Provide hollow metal panels of same materials, construction, and finish as specified for adjoining hollow metal work.

2.7 STOPS AND MOLDINGS

- A. Moldings for Glazed Lites in Doors: Minimum 0.032 inch thick, fabricated from same material as door face sheet in which they are installed.
- B. Fixed Frame Moldings: Formed integral with hollow metal frames, a minimum of 5/8 inch high unless otherwise indicated.
- C. Loose Stops for Glazed Lites in Frames: Minimum 0.032 inch.

2.8 ACCESSORIES

- A. Mullions and Transom Bars: Join to adjacent members by welding or rigid mechanical anchors.
- B. Ceiling Struts: Minimum 1/4-inch-thick by 1-inch wide steel.
- C. Grout Guards: Formed from same material as frames, not less than 0.016 inch thick.

2.9 FABRICATION

- A. Fabricate hollow metal work to be rigid and free of defects, warp, or buckle. Accurately form metal to required sizes and profiles, with minimum radius for thickness of metal. Where practical, fit and assemble units in manufacturer's plant. To ensure proper assembly at Project site, clearly identify work that cannot be permanently factory assembled before shipment.
- B. Tolerances: Fabricate hollow metal work to tolerances indicated in SDI 117 or ANSI/NAAMM-HMMA 861.
- C. Hollow Metal Doors:
 - 1. Exterior Doors: Provide weep-hole openings in bottom of exterior doors to permit moisture to escape. Seal joints in top edges of doors against water penetration.
 - 2. Glazed Lites: Factory cut openings in doors.
 - 3. Astragals: Provide overlapping astragal on one leaf of pairs of doors where required by NFPA 80 for fire-performance rating or where indicated. Extend minimum 3/4 inch beyond edge of door on which astragal is mounted.
- D. Hollow Metal Frames: Where frames are fabricated in sections due to shipping or handling limitations, provide alignment plates or angles at each joint, fabricated of same thickness metal as frames.
 - 1. Welded Frames: Weld flush face joints continuously; grind, fill, dress, and make smooth, flush, and invisible.
 - 2. Sidelight Frames: Provide closed tubular members with no visible face seams or joints, fabricated from same material as door frame. Fasten members at crossings and to jambs by butt welding.
 - 3. Provide countersunk, flat- or oval-head exposed screws and bolts for exposed fasteners unless otherwise indicated.
 - 4. Grout Guards: Weld guards to frame at back of hardware mortises in frames to be grouted.
 - 5. Floor Anchors: Weld anchors to bottom of jambs and mullions with at least four spot welds per anchor.
 - 6. Jamb Anchors: Provide number and spacing of anchors as follows:

- a. Stud-Wall Type: Locate anchors not more than 18 inches (457 mm) from top and bottom of frame. Space anchors not more than 32 inches (813 mm) o.c. and as follows:
 - 1) Three anchors per jamb up to 60 inches (1524 mm) high.
 - 2) Four anchors per jamb from 60 to 90 inches (1524 to 2286 mm) high.
 - 3) Five anchors per jamb from 90 to 96 inches (2286 to 2438 mm) high.
 - 4) Five anchors per jamb plus 1 additional anchor per jamb for each 24 inches (610 mm) or fraction thereof above 96 inches (2438 mm) high.
 - 5) Two anchors per head for frames above 42 inches (1066 mm) wide and mounted in metal-stud partitions.
 - b. Compression Type: Not less than two anchors in each jamb.
7. Door Silencers: Except on weather-stripped doors, drill stops to receive door silencers as follows. Keep holes clear during construction.
- a. Single-Door Frames: Drill stop in strike jamb to receive three door silencers.
 - b. Double-Door Frames: Drill stop in head jamb to receive two door silencers.
- E. Fabricate concealed stiffeners, edge channels, and hardware reinforcement from either cold- or hot-rolled steel sheet.
- F. Hardware Preparation: Factory prepare hollow metal work to receive templated mortised hardware; include cutouts, reinforcement, mortising, drilling, and tapping according to the Door Hardware Schedule and templates furnished as specified in Division 8 Section "Door Hardware."
- 1. Locate hardware as indicated, or if not indicated, according to ANSI/SDI A250.8 or ANSI/NAAMM-HMMA 861.
 - 2. Reinforce doors and frames to receive nontemplated, mortised and surface-mounted door hardware.
 - 3. Comply with applicable requirements in ANSI/SDI A250.6 and ANSI/DHI A115 Series specifications for preparation of hollow metal work for hardware.
 - 4. Coordinate locations of conduit and wiring boxes for electrical connections with Division 16 Sections.
- G. Stops and Moldings: Provide stops and moldings around glazed lites where indicated. Form corners of stops and moldings with butted or mitered hairline joints.
- 1. Single Glazed Lites: Provide fixed stops and moldings welded on secure side of hollow metal work.
 - 2. Multiple Glazed Lites: Provide fixed and removable stops and moldings so that each glazed lite is capable of being removed independently.

3. Provide fixed frame moldings on outside of exterior and on secure side of interior doors and frames.
4. Provide loose stops and moldings on inside of hollow metal work.
5. Coordinate rabbet width between fixed and removable stops with type of glazing and type of installation indicated.

2.10 STEEL FINISHES

- A. Prime Finish: Apply manufacturer's standard primer immediately after cleaning and pretreating.
 1. Shop Primer: Manufacturer's standard, fast-curing, lead- and chromate-free primer complying with ANSI/SDI A250.10 acceptance criteria; recommended by primer manufacturer for substrate; compatible with substrate and field-applied coatings despite prolonged exposure.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.
- B. Examine roughing-in for embedded and built-in anchors to verify actual locations before frame installation.
- C. For the record, prepare written report, endorsed by Installer, listing conditions detrimental to performance of the Work.
- D. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Remove welded-in shipping spreaders installed at factory. Restore exposed finish by grinding, filling, and dressing, as required to make repaired area smooth, flush, and invisible on exposed faces.
- B. Prior to installation, adjust and securely brace welded hollow metal frames for squareness, alignment, twist, and plumbness to the following tolerances:
 1. Squareness: Plus or minus 1/16 inch, measured at door rabbet on a line 90 degrees from jamb perpendicular to frame head.
 2. Alignment: Plus or minus 1/16 inch, measured at jambs on a horizontal line parallel to plane of wall.

3. Twist: Plus or minus 1/16 inch, measured at opposite face corners of jambs on parallel lines, and perpendicular to plane of wall.
 4. Plumbness: Plus or minus 1/16 inch, measured at jambs on a perpendicular line from head to floor.
- C. Drill and tap doors and frames to receive nontemplated, mortised, and surface-mounted door hardware.

3.3 INSTALLATION

- A. General: Install hollow metal work plumb, rigid, properly aligned, and securely fastened in place; comply with Drawings and manufacturer's written instructions.
- B. Hollow Metal Frames: Install hollow metal frames of size and profile indicated. Comply with ANSI/SDI A250.11 or HMMA 840.
1. Set frames accurately in position, plumbed, aligned, and braced securely until permanent anchors are set. After wall construction is complete, remove temporary braces, leaving surfaces smooth and undamaged.
 - a. At fire-protection-rated openings, install frames according to NFPA 80.
 - b. Where frames are fabricated in sections because of shipping or handling limitations, field splice at approved locations by welding face joint continuously; grind, fill, dress, and make splice smooth, flush, and invisible on exposed faces.
 - c. Install frames with removable glazing stops located on secure side of opening.
 - d. Install door silencers in frames before grouting.
 - e. Remove temporary braces necessary for installation only after frames have been properly set and secured.
 - f. Check plumbness, squareness, and twist of frames as walls are constructed. Shim as necessary to comply with installation tolerances.
 - g. Field apply bituminous coating to backs of frames that are filled with grout containing antifreezing agents.
 2. Floor Anchors: Provide floor anchors for each jamb and mullion that extends to floor, and secure with postinstalled expansion anchors.
 - a. Floor anchors may be set with powder-actuated fasteners instead of postinstalled expansion anchors if so indicated and approved on Shop Drawings.
 3. Metal-Stud Partitions: Solidly pack mineral-fiber insulation behind frames.
 4. Ceiling Struts: Extend struts vertically from top of frame at each jamb to overhead structural supports or substrates above frame unless frame is anchored to masonry or to other structural support at each jamb. Bend top of struts to provide flush contact for securing to supporting construction. Provide adjustable wedged or bolted anchorage to frame jamb members.

5. Installation Tolerances: Adjust hollow metal door frames for squareness, alignment, twist, and plumb to the following tolerances:
 - a. Squareness: Plus or minus 1/16 inch, measured at door rabbet on a line 90 degrees from jamb perpendicular to frame head.
 - b. Alignment: Plus or minus 1/16 inch, measured at jambs on a horizontal line parallel to plane of wall.
 - c. Twist: Plus or minus 1/16 inch, measured at opposite face corners of jambs on parallel lines, and perpendicular to plane of wall.
 - d. Plumbness: Plus or minus 1/16 inch, measured at jambs at floor.
- C. Hollow Metal Doors: Fit hollow metal doors accurately in frames, within clearances specified below. Shim as necessary.
 1. Non-Fire-Rated Standard Steel Doors:
 - a. Jambs and Head: 1/8 inch plus or minus 1/16 inch.
 - b. Between Edges of Pairs of Doors: 1/8 inch plus or minus 1/16 inch.
 - c. Between Bottom of Door and Top of Threshold: Maximum 3/8 inch.
 - d. Between Bottom of Door and Top of Finish Floor (No Threshold): Maximum 3/4 inch.
 2. Fire-Rated Doors: Install doors with clearances according to NFPA 80.
 3. Smoke-Control Doors: Install doors according to NFPA 105 or UBC Standard 7-2.
- D. Glazing: Comply with installation requirements in Division 8 Section "Glazing" and with hollow metal manufacturer's written instructions.
 1. Secure stops with countersunk flat- or oval-head machine screws spaced uniformly not more than 9 inches o.c. and not more than 2 inches o.c. from each corner.

3.4 ADJUSTING AND CLEANING

- A. Final Adjustments: Check and readjust operating hardware items immediately before final inspection. Leave work in complete and proper operating condition. Remove and replace defective work, including hollow metal work that is warped, bowed, or otherwise unacceptable.
- B. Remove grout and other bonding material from hollow metal work immediately after installation.
- C. Prime-Coat Touchup: Immediately after erection, sand smooth rusted or damaged areas of prime coat and apply touchup of compatible air-drying, rust-inhibitive primer.
- D. Metallic-Coated Surfaces: Clean abraded areas and repair with galvanizing repair paint according to manufacturer's written instructions.

END OF SECTION 081300

SECTION 081313
HOLLOW METAL FRAMES

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes hollow-metal frames.

1.2 DEFINITIONS

- A. **Minimum Thickness:** Minimum thickness of base metal without coatings according to NAAMM-HMMA 803 or SDI A250.8.

1.3 ACTION SUBMITTALS

- A. **Product Data:** For each type of product.
- B. **Shop Drawings:** Include elevations, frame profiles, metal thicknesses, preparations for hardware, and other details.
- C. **Schedule:** Prepared by or under the supervision of supplier, using same reference numbers for details and openings as those on Drawings.

1.4 INFORMATIONAL SUBMITTALS

- A. Product test reports.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. **Manufacturers:** Subject to compliance with requirements, provide products by one of the following:

1. Amweld International, LLC.
2. Apex Industries, Inc.
3. Ceco Door Products; an Assa Abloy Group company.
4. Commercial Door & Hardware Inc.
5. Concept Frames, Inc.

6. Curries Company; an Assa Abloy Group company.
7. Custom Metal Products.
8. Daybar.
9. Deansteel.
10. de La Fontaine Industries.
11. DKS Steel Door & Frame Sys. Inc.
12. Door Components, Inc.
13. Fleming-Baron Door Products.
14. Gensteel Doors Inc.
15. Greensteel Industries, Ltd.
16. HMF Express.
17. Hollow Metal Inc.
18. Hollow Metal Xpress.
19. J/R Metal Frames Manufacturing, Inc.
20. Karpen Steel Custom Doors & Frames.
21. L.I.F. Industries, Inc.
22. LaForce, Inc.
23. Megamet Industries, Inc.
24. Mesker Door Inc.
25. Michbi Doors Inc.
26. MPI Group, LLC (The).
27. National Custom Hollow Metal.
28. North American Door Corp.
29. Philipp Manufacturing Co (The).
30. Pioneer Industries, Inc.
31. Premier Products, Inc.
32. Republic Doors and Frames.
33. Rocky Mountain Metals, Inc.
34. Security Metal Products Corp.
35. Shanahans Manufacturing Ltd.
36. Steelcraft; an Ingersoll-Rand company.
37. Steward Steel; Door Division.
38. Stiles Custom Metal, Inc.
39. Titan Metal Products, Inc.
40. Trillium Steel Doors Limited.
41. West Central Mfg. Inc.

2.2 REGULATORY REQUIREMENTS

- A. Fire-Rated Assemblies: Complying with NFPA 80 and listed and labeled by a qualified testing agency acceptable to authorities having jurisdiction for fire-protection ratings indicated, based on testing at positive pressure according to NFPA 252 or UL 10C.
 1. Smoke- and Draft-Control Assemblies: Provide an assembly with gaskets listed and labeled for smoke and draft control by a qualified testing agency acceptable to authorities having jurisdiction, based on testing according to UL 1784 and installed in compliance with NFPA 105.

- B. Fire-Rated, Borrowed-Light Assemblies: Complying with NFPA 80 and listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction for fire-protection ratings indicated, based on testing according to NFPA 257 or UL 9.

2.3 INTERIOR FRAMES

- A. Standard-Duty Frames: SDI A250.8, Level 1.
 - 1. Physical Performance: Level C according to SDI A250.4.
 - 2. Materials: Uncoated, cold-rolled steel sheet, minimum thickness of 0.042 inch (1.0 mm).
 - 3. Construction: Knocked down.
 - 4. Exposed Finish: Prime.

2.4 EXTERIOR HOLLOW-METAL FRAMES

- A. Heavy-Duty Frames: SDI A250.8, Level 2 at exterior walls.
 - 1. Physical Performance: Level B according to SDI A250.4.
 - 2. Materials: Metallic-coated steel sheet, minimum thickness of 0.053 inch (1.3 mm), with minimum A40 (ZF120) coating.
 - 3. Construction: Full profile welded.
 - 4. Exposed Finish: Prime Factory.

2.5 FRAME ANCHORS

- A. Jamb Anchors:
 - 1. Masonry Type: Adjustable strap-and-stirrup or T-shaped anchors to suit frame size, not less than 0.042 inch (1.0 mm) thick, with corrugated or perforated straps not less than 2 inches (51 mm) wide by 10 inches (254 mm) long; or wire anchors not less than 0.177 inch (4.5 mm) thick.
 - 2. Stud-Wall Type: Designed to engage stud, welded to back of frames; not less than 0.042 inch (1.0 mm) thick.
 - 3. Compression Type for Drywall Slip-on Frames: Adjustable compression anchors.
 - 4. Postinstalled Expansion Type for In-Place Concrete or Masonry: Minimum 3/8-inch- (9.5-mm-) diameter bolts with expansion shields or inserts. Provide pipe spacer from frame to wall, with throat reinforcement plate, welded to frame at each anchor location.
- B. Floor Anchors: Formed from same material as frames, minimum thickness of 0.042 inch (1.0 mm), and as follows:

2.6 MATERIALS

- A. Cold-Rolled Steel Sheet: ASTM A 1008/A 1008M, Commercial Steel (CS), Type B.
- B. Hot-Rolled Steel Sheet: ASTM A 1011/A 1011M, Commercial Steel (CS), Type B.
- C. Metallic-Coated Steel Sheet: ASTM A 653/A 653M, Commercial Steel (CS), Type B.
- D. Frame Anchors: ASTM A 879/A 879M, Commercial Steel (CS), 04Z (12G) coating designation; mill phosphatized.
 - 1. For anchors built into exterior walls, steel sheet complying with ASTM A 1008/A 1008M or ASTM A 1011/A 1011M, hot-dip galvanized according to ASTM A 153/A 153M, Class B.
- E. Inserts, Bolts, and Fasteners: Hot-dip galvanized according to ASTM A 153/A 153M.
- F. Power-Actuated Fasteners in Concrete: From corrosion-resistant materials.
- G. Grout: ASTM C 476, except with a maximum slump of 4 inches (102 mm), as measured according to ASTM C 143/C 143M.
- H. Mineral-Fiber Insulation: ASTM C 665, Type I (blankets without membrane facing).
- I. Glazing: Comply with requirements in Section 08800 "Glazing."
- J. Bituminous Coating: Cold-applied asphalt mastic, compounded for 15-mil (0.4-mm) dry film thickness per coat.

2.7 FABRICATION

- A. Fabricate hollow-metal work to be rigid and free of defects, warp, or buckle. Accurately form metal to required sizes and profiles, with minimum radius for metal thickness. Where practical, fit and assemble units in manufacturer's plant. To ensure proper assembly at Project site, clearly identify work that cannot be permanently factory assembled before shipment.
- B. Hollow-Metal Frames: Where frames are fabricated in sections due to shipping or handling limitations, provide alignment plates or angles at each joint, fabricated of same thickness metal as frames.
 - 1. [Sidelight] [and] [Transom Bar] Frames: Provide closed tubular members with no visible face seams or joints, fabricated from same material as door frame. Fasten members at crossings and to jambs by butt welding.
 - 2. Provide countersunk, flat- or oval-head exposed screws and bolts for exposed fasteners unless otherwise indicated.

3. Grout Guards: Weld guards to frame at back of hardware mortises in frames to be grouted.
 4. Floor Anchors: Weld anchors to bottoms of jambs with at least four spot welds per anchor; however, for slip-on drywall frames, provide anchor clips or countersunk holes at bottoms of jambs.
 5. Jamb Anchors: Provide number and spacing of anchors as follows:
 - a. Masonry Type: Locate anchors not more than 16 inches (406 mm) from top and bottom of frame. Space anchors not more than 32 inches (813 mm) o.c., to match coursing.
 - b. Stud-Wall Type: Locate anchors not more than 18 inches (457 mm) from top and bottom of frame. Space anchors not more than 32 inches (813 mm) o.c.
 - c. Compression Type: Not less than two anchors in each frame.
 - d. Postinstalled Expansion Type: Locate anchors not more than 6 inches (152 mm) from top and bottom of frame. Space anchors not more than 26 inches (660 mm) o.c.
 6. Door Silencers: Except on weather-stripped frames, drill stops to receive door silencers.
- C. Hardware Preparation: Factory prepare hollow-metal work to receive templated mortised hardware; include cutouts, reinforcement, mortising, drilling, and tapping according to SDI A250.6, the Door Hardware Schedule, and templates.
1. Reinforce frames to receive nontemplated, mortised, and surface-mounted hardware.
 2. Comply with applicable requirements in SDI A250.6 and BHMA A156.115 for preparation of hollow-metal work for hardware.
- D. Stops and Moldings: Provide stops and moldings around glazed lites and louvers where indicated. Form corners of stops and moldings with butted or mitered hairline joints.
1. Single Glazed Lites: Provide fixed stops and moldings welded on secure side of hollow-metal work.
 2. Multiple Glazed Lites: Provide fixed and removable stops and moldings so that each glazed lite is capable of being removed independently.
 3. Provide fixed frame moldings on outside of exterior and on secure side of interior frames.
 4. Provide loose stops and moldings on inside of hollow-metal work.
 5. Coordinate rabbet width between fixed and removable stops with glazing and installation types indicated.

2.8 STEEL FINISHES

- A. Prime Finish: Clean, pretreat, and apply manufacturer's standard primer.

1. Shop Primer: SDI A250.10.
- B. Factory Finish: SDI A250.3.
 1. Color and Gloss: As selected by Architect from manufacturer's full range.

2.9 ACCESSORIES

- A. Mullions and Transom Bars: Join to adjacent members by welding or rigid mechanical anchors.
- B. Grout Guards: Formed from same material as frames, not less than 0.016 inch (0.4 mm) thick.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Hollow-Metal Frames: Install hollow-metal frames of size and profile indicated. Comply with SDI A250.11 or NAAMM-HMMA 840 as required by standards specified.
 1. Set frames accurately in position; plumbed, aligned, and braced securely until permanent anchors are set. After wall construction is complete, remove temporary braces, leaving surfaces smooth and undamaged.
 - a. At fire-rated openings, install frames according to NFPA 80.
 - b. Where frames are fabricated in sections because of shipping or handling limitations, field splice at approved locations by welding face joint continuously; grind, fill, dress, and make splice smooth, flush, and invisible on exposed faces.
 - c. Install frames with removable stops located on secure side of opening.
 - d. Install door silencers in frames before grouting.
 - e. Remove temporary braces necessary for installation only after frames have been properly set and secured.
 - f. Check plumb, square, and twist of frames as walls are constructed. Shim as necessary to comply with installation tolerances.
 - g. Field apply bituminous coating to backs of frames that will be filled with grout containing antifreezing agents.
 2. Floor Anchors: Provide floor anchors for each jamb and mullion that extends to floor, and secure with postinstalled expansion anchors.
 - a. Floor anchors may be set with power-actuated fasteners instead of postinstalled expansion anchors if so indicated and approved on Shop Drawings.

3. Metal-Stud Partitions: Solidly pack mineral-fiber insulation inside frames.
4. Masonry Walls: Coordinate installation of frames to allow for solidly filling space between frames and masonry with grout.
5. Concrete Walls: Solidly fill space between frames and concrete with mineral-fiber insulation.
6. In-Place Concrete or Masonry Construction: Secure frames in place with postinstalled expansion anchors. Countersink anchors, and fill and make smooth, flush, and invisible on exposed faces.
7. In-Place Metal or Wood-Stud Partitions: Secure slip-on drywall frames in place according to manufacturer's written instructions.
8. Installation Tolerances: Adjust hollow-metal door frames for squareness, alignment, twist, and plumb to the following tolerances:
 - a. Squareness: Plus or minus 1/16 inch (1.6 mm), measured at door rabbet on a line 90 degrees from jamb perpendicular to frame head.
 - b. Alignment: Plus or minus 1/16 inch (1.6 mm), measured at jambs on a horizontal line parallel to plane of wall.
 - c. Twist: Plus or minus 1/16 inch (1.6 mm), measured at opposite face corners of jambs on parallel lines, and perpendicular to plane of wall.
 - d. Plumbness: Plus or minus 1/16 inch (1.6 mm), measured at jambs at floor.

- B. Glazing: Comply with installation requirements in Section 08800 "Glazing" and with hollow-metal manufacturer's written instructions.
 1. Secure stops with countersunk flat- or oval-head machine screws spaced uniformly not more than 9 inches (230 mm) o.c. and not more than 2 inches (51 mm) o.c. from each corner.

3.2 ADJUSTING AND CLEANING

- A. Final Adjustments: Remove and replace defective work, including hollow-metal work that is warped, bowed, or otherwise unacceptable.
- B. Remove grout and other bonding material from hollow-metal work immediately after installation.
- C. Prime-Coat Touchup: Immediately after erection, sand smooth rusted or damaged areas of prime coat and apply touchup of compatible air-drying, rust-inhibitive primer.
- D. Metallic-Coated Surface Touchup: Clean abraded areas and repair with galvanizing repair paint according to manufacturer's written instructions.
- E. Touchup Painting: Cleaning and touchup painting of abraded areas of paint are specified in painting Sections.

END OF SECTION 081313

SECTION 081416
FLUSH WOOD DOORS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Solid-core doors with wood-veneer faces.
2. Factory finishing flush wood doors.
3. Factory fitting flush wood doors to frames and factory machining for hardware.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of door. Include factory-finishing specifications.

B. Shop Drawings: Indicate location, size, and hand of each door; elevation of each kind of door; construction details not covered in Product Data; and the following:

1. Dimensions and locations of blocking.
2. Dimensions and locations of mortises and holes for hardware.
3. Dimensions and locations of cutouts.
4. Undercuts.
5. Requirements for veneer matching.
6. Doors to be factory finished and finish requirements.
7. Fire-protection ratings for fire-rated doors.

C. Samples: For factory-finished doors.

1. Provide factory finishes applied to actual door face materials for each material and finish. For each wood species and transparent finish, produce set of three samples showing typical examples of color and grain to be expected in finished work.
2. Louver blade and frame section minimum 6 inches long for each material and finish specified.

1.3 INFORMATIONAL SUBMITTALS

A. Quality Standard Compliance Certificates: AWI Quality Certification Program certificates.

1.4 QUALITY ASSURANCE

- A. **Manufacturer Qualifications:** A qualified manufacturer that is a certified participant in AWI's Quality Certification Program.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. **Manufacturers:** Subject to compliance with requirements, provide products by one of the following:
 - 1. Algoma Hardwoods, Inc.
 - 2. Ampco.
 - 3. Chappell Door Co.
 - 4. Eggers Industries.
 - 5. General Veneer Manufacturing Co.
 - 6. Graham Wood Doors; an Assa Abloy Group company.
 - 7. Haley Brothers, Inc.
 - 8. Ipik Door Company.
 - 9. Lambton Doors.
 - 10. Marlite.
 - 11. Marshfield Door Systems, Inc.
 - 12. Mohawk Doors; a Masonite company.
 - 13. Oshkosh Door Company.
 - 14. Poncraft Door Company.
 - 15. Vancouver Door Company.
 - 16. VT Industries, Inc.

2.2 FLUSH WOOD DOORS, GENERAL

- A. **Quality Standard:** In addition to requirements specified, comply with AWI's, AWMAC's, and WI's "Architectural Woodwork Standards, WDMA I.S.1-A, "Architectural Wood Flush Doors."
 - 1. Provide AWI Quality Certification Labels indicating that doors comply with requirements of grades specified.
- B. **WDMA I.S.1-A Performance Grade:**
 - 1. Heavy Duty unless otherwise indicated.
- C. **Fire-Rated Wood Doors:** Doors complying with NFPA 80 that are listed and labeled by a qualified testing agency, for fire-protection ratings indicated, based on testing at positive pressure according to UL 10C.

1. Cores: Provide core specified or mineral core as needed to provide fire-protection rating indicated.
 2. Edge Construction: Provide edge construction with intumescent seals concealed by outer stile. Comply with specified requirements for exposed edges.
 3. Pairs: Provide fire-retardant stiles that are listed and labeled for applications indicated without formed-steel edges and astragals. Provide stiles with concealed intumescent seals. Comply with specified requirements for exposed edges.
- D. Smoke- and Draft-Control Door Assemblies: Listed and labeled for smoke and draft control, based on testing according to UL 1784.
- E. Particleboard-Core Doors:
1. Particleboard: ANSI A208.1, Grade LD-1 or Grade LD-2, made with binder containing no urea-formaldehyde.
 2. Blocking: Provide wood blocking in particleboard-core doors as needed to eliminate through-bolting hardware.
 3. Provide doors with glued-wood-stave or structural-composite-lumber cores instead of particleboard cores for doors indicated to receive exit devices.
- F. Structural-Composite-Lumber-Core Doors:
1. Structural Composite Lumber: WDMA I.S.10.
 - a. Screw Withdrawal, Face: 700 lbf (3100 N).
 - b. Screw Withdrawal, Edge: 400 lbf (1780 N).
- G. Mineral-Core Doors:
1. Core: Noncombustible mineral product complying with requirements of referenced quality standard and testing and inspecting agency for fire-protection rating indicated.
 2. Blocking: Provide composite blocking with improved screw-holding capability approved for use in doors of fire-protection ratings indicated as needed to eliminate through-bolting hardware.
 3. Edge Construction: At hinge stiles, provide laminated-edge construction with improved screw-holding capability and split resistance. Comply with specified requirements for exposed edges.
- 2.3 VENEER-FACED DOORS FOR TRANSPARENT FINISH
- A. Interior Solid-Core Doors <Insert drawing designation>:
1. Grade: Premium, with Grade AA faces.
 2. Species: Select white birch.
 3. Cut: Quarter sliced.
 4. Match between Veneer Leaves: Pleasing match.

5. Assembly of Veneer Leaves on Door Faces: Balance match.
6. Pair and Set Match: Provide for doors hung in same opening.
7. Core: Particleboard Glued wood stave Either glued wood stave or structural composite lumber.
8. Construction: Seven plies. Stiles and rails are bonded to core, then entire unit is abrasive planed before veneering. Faces are bonded to core using a hot press.
9. Construction: Seven plies, either bonded or nonbonded construction.

2.4 LIGHT FRAMES AND LOUVERS

A. Metal Louvers:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Air Louvers, Inc.
 - b. Anemostat; a Mestek company.
 - c. L & L Louvers, Inc.
 - d. Louvers & Dampers, Inc.; a division of Mestek, Inc.
 - e. McGill Architectural Products.
2. Metal and Finish: Hot-dip galvanized steel, 0.040 inch (1.0 mm) thick, with baked-enamel- or powder-coated finish.
3. Metal and Finish: Extruded aluminum with Class II, clear anodic finish, AA-M12C22A31.

2.5 FABRICATION

- A. Factory fit doors to suit frame-opening sizes indicated. Comply with clearance requirements of referenced quality standard for fitting unless otherwise indicated.
 1. Comply with NFPA 80 requirements for fire-rated doors.
- B. Factory machine doors for hardware that is not surface applied.
- C. Openings: Factory cut and trim openings through doors.
 1. Light Openings: Trim openings with moldings of material and profile indicated.
 2. Glazing: Factory install glazing in doors indicated to be factory finished. Comply with applicable requirements in Section 08800 "Glazing."
 3. Louvers: Factory install louvers in prepared openings.

2.6 SHOP PRIMING

- A. Doors for Opaque Finish: Shop prime faces, all four edges, edges of cutouts, and mortises with one coat of wood primer specified in Section "Interior Painting."

2.7 FACTORY FINISHING

- A. General: Comply with referenced quality standard for factory finishing. Complete fabrication, including fitting doors for openings and machining for hardware that is not surface applied, before finishing.
 - 1. Finish faces, all four edges, edges of cutouts, and mortises. Stains and fillers may be omitted on top and bottom edges, edges of cutouts, and mortises.
- B. Factory finish doors that are indicated to receive transparent finish.
- C. Use only paints and coatings that comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- D. Transparent Finish:
 - 1. Grade: Premium.
 - 2. Finish: AWI's, AWMAC's, and WI's "Architectural Woodwork Standards" System 5, conversion varnish or System 9, UV curable, acrylated epoxy, polyester, or urethane or System 10, UV curable, water based or System 11, catalyzed polyurethane.
 - 3. Finish: WDMA TR-4 conversion varnish or WDMA TR-6 catalyzed polyurethane.
 - 4. Staining: As selected by Architect from manufacturer's full range.
 - 5. Effect: Open-grain finish.
 - 6. Sheen: Satin.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Hardware: For installation, see Section "Door Hardware."
- B. Installation Instructions: Install doors to comply with manufacturer's written instructions and referenced quality standard, and as indicated.
 - 1. Install fire-rated doors according to NFPA 80.
 - 2. Install smoke- and draft-control doors according to NFPA 105.
- C. Job-Fitted Doors: Align and fit doors in frames with uniform clearances and bevels as indicated below; do not trim stiles and rails in excess of limits set by manufacturer

or permitted for fire-rated doors. Machine doors for hardware. Seal edges of doors, edges of cutouts, and mortises after fitting and machining.

1. Clearances: Provide 1/8 inch (3.2 mm) at heads, jambs, and between pairs of doors. Provide 1/8 inch (3.2 mm) from bottom of door to top of decorative floor finish or covering unless otherwise indicated. Where threshold is shown or scheduled, provide 1/4 inch (6.4 mm) from bottom of door to top of threshold unless otherwise indicated.
 - a. Comply with NFPA 80 for fire-rated doors.
- D. Factory-Fitted Doors: Align in frames for uniform clearance at each edge.
- E. Factory-Finished Doors: Restore finish before installation if fitting or machining is required at Project site.

END OF SECTION 081416

SECTION 085000

WINDOWS

Part 1 General

1.1 Section Includes

All Fixed windows complete with hardware, glazing, weather strip, grilles-between-the-glass, jamb extension, sheet rock return, j-channel, and standard or specified anchors, trim and attachments.

1.2 References

American Society for Testing and Materials (ASTM):

1. C1036: Standard Specification for Flat Glass
2. E90-09: Standard Test Method for Laboratory Measurement of airborne Sound Transmission Loss of Building Partitions and Elements.
3. E 283: Standard Test Method for Rate of Air Leakage Through Exterior Windows, Curtain Walls and Doors.
4. E 330: Standard Test Method for Structural Performance of Exterior Windows, Curtain Walls, and Door by Uniform Static Air Pressure Difference.
5. E 547: Standard Test Method for Water Penetration of Exterior Windows, Curtain Walls, and Doors by Cyclic Static Air Pressure Differential.
6. E 2190: Standard Specification for Insulating Glass Unit Performance Evaluation.
7. F2090-10: Standard Specification for Window Fall Prevention Devices with Emergency Escape (Egress) Release Mechanisms.
8. E 2068: Standard Test Method to Determine the Operating and Breakaway Forces of Sliding Windows and Doors.

Insulating Glass Manufacturer's Alliance/Insulating Glass Certification Council
(IGMA/IGCC)

American Architectural Manufacturer's Association/Window and Door Manufacturer's Association/Canadian Standards Association (AAMA/WDMA/CSA):

1. AAMA/WDMA/CSA 101/I.S.2/A440-11: North American Fenestration Standard/Specification for windows, doors, and skylights.

2. AAMA/WDMA/CSA 101/I.S.2/A440-08: North American Fenestration Standard/Specification for windows, doors, and skylights.

Window and Door Manufacturer's Association (WDMA): Hallmark Certification Program.

American Architectural Manufacturer's Association (AAMA): 624-10: Voluntary Specification, Performance Requirements and Test Procedures for Organic Coatings on Fiber Reinforced Thermoset Profiles.

National Fenestration Rating Council (NFRC):

1. 100: Procedures for Determining Fenestration Product U-factors
2. 200: Procedure for Determining Fenestration Product Solar Heat Gain Coefficient and Visible Transmittance at Normal Incidence

1.3 Submittals

Shop Drawings: Submit shop drawings.

Product Data: Submit catalog data.

Samples:

1. Submit corner section.
2. Specified performance and design requirements.

Quality Control Submittals: Certificates: submit manufacturer's certification indicating compliance with specified performance and design requirement.

1.4 Delivery

Comply with provisions of this specification

Deliver in original packaging and protect from weather

1.5 Storage and Handling

Store window units in an upright position in a clean and dry storage area above ground to protect from weather under provisions of this specification.

1.6 Warranty

The following limited warranty is subject to conditions and exclusions. There are certain conditions or applications over which Integrity has no control. Defect or problems as a result of such conditions or applications are not the responsibility of Integrity. For a more complete description of the Integrity limited warranty, refer to the Complete and current warranty information is available at Integritywindows.com/warranty.

Clear insulating glass with stainless steel spacers is warranted against seal failure caused by manufacturing defects and resulting in visible obstruction through the glass for twenty (20) years from the original date of purchase. Glass is warranted against stress cracks caused by manufacturing defects from ten (10) years from the original date of purchase.

Hardware another non-glass components are warranted to be free from manufacturing defects for ten (10) years from the original date of purchase.

Part 2 Products

1.7 Manufacturers

A. Subject to compliance with requirements, provide products by MGM Industries or comparable product by one of the following:

1. Pella Impervia
2. Marvin
3. Anderson Fibrex

1.8 Frame Description

Material : Aluminium

Frame width: 3 3/32 inch (79mm)

Jamb depth: 2 inch (51mm)

1.9 Glazing

Select quality complying with ASTM C 1036. Insulating glass SIGMA/IGCC when tested in accordance with ASTM E 2190. STC/OITC ratings are tested to the stated performance level in accordance with ASTM E 90-09.

Glazing Method: 11/16 inch (17mm) insulating glass

Glass Type: Low E1, E2, E3, or E3/ERS air or Argon gas

Glass Type Option: Obscure Glass or California Fire Glass (Annealed exterior and tempered interior glazing configuration)

Glazing Seal: Silicone bedding at exterior, interior has glazing boot

Glazing Option: STC/OITC upgrade

1.10 Mulling

1.10.1 Standard Mulling

Directional mull limits: 6 wide by 1 unit high; 114 by 78 (2896mm x 1981mm) inches

Directional mull limits: 5 wide by 5 units high; 96 by 96 (2438mm x 2438mm) inches

1.10.2 Reinforced Mulling

Directional mull limits: 6 wide by 1 unit high; 114 by 78 (2896mm x 1981mm) inches

Directional mull limits: 5 wide by 5 units high; 96 by 96 (2438mm x 2438mm) inches

1.11 Finish

Exterior: with a cross-head extruded acrylic organic coating system. Meets AAMA 624-10 requirements.

Interior: with a cross-head extruded acrylic organic coating system. Meets AAMA 624-10 and 00022716 requirements.

Color: Black exterior with Black interior.

1.12 Weather Strip

Frame weather strip: combination hollow vinyl bulb and flexible wand

1. Color: Beige

Top Sash interlock: Rigid ABS with flexible Alcryn seals

1. Color: Beige

Stationary sash seal: foam tape

1. Color: Gray

1.13 Jamb Extension

Standard 2 inch jambs. Optional factory-installed jamb extension: 4 9/16 inch (116mm) and 6 9/16 inch (167mm)

1.14 Aluminum frame

1. Color: Stone White, Pebble Gray, Bronze, Evergreen, Cashmere, Ebony

Optional full screen available

1.15 Accessories and Trim

Exterior Casing:

1. Non-integral to the unit. Fastened to the exterior wall with barb and kerf.
1. 2 inch Brick Mould available as a full surround or with sill nosing.
2. 3 ½ inch Flat Casing available as a full surround or with sill nosing. Also available with 1 inch Ranch Style header and sill overhang.
3. Colors: Stone White, Evergreen, Bronze, Pebble Gray, Cashmere, Ebony.

Installation Accessories:

1. Factory-installed vinyl nailing fin/drip cap at head, sill and side jambs.
1. Installation brackets for masonry applications.
2. Mullion kit: standard mullion kit for filed assembly of related units available in horizontal, vertical and 2-wide and/or 2-high configurations. Kit includes: Instruction, interior and exterior mull covers, mull plugs and brackets.
3. Sheet rock return
4. J-channel
5. Flush Fin
6. $\frac{3}{4}$ inch Receiver
7. Frame Expander (1inch or 3 inch option available)

Part 3 Execution

1.16 Examination

Verification of Condition: Before installation, verify openings are plumb, square and of proper dimensions as required. Report frame defects or unsuitable conditions to the General Contractor before proceeding,

Acceptance of Condition: Beginning installation confirms acceptance of existing conditions.

1.17 Installation

Comply with provisions of this specification.

Assemble and install window/door unit(s) according to manufacturer's instruction and reviewed shop drawing.

Install sealant and related backing materials at perimeter of unit or assembly in accordance with Section 07920 Joint Sealants. Do not use expansive foam sealant.

Install accessory items as required.

Use finish nails to apply wood trim and mouldings.

1.18 Cleaning

Remove visible labels and adhesive residue according to manufacturer's instruction.

Leave windows and glass in a clean condition. Final cleaning as required under provisions of this specification.

1.19 Protecting Installed Construction

Protecting windows from damage by chemicals, solvents, paint or other construction operations that may cause damage.

End of Section 085000

SECTION 088000

GLAZING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes glazing for the following products and applications, including those specified in other Sections where glazing requirements are specified by reference to this Section:
 - 1. Windows.
 - 2. Storefront framing.

1.3 DEFINITIONS

- A. Manufacturers of Glass Products: Firms that produce primary glass, fabricated glass, or both, as defined in referenced glazing publications.
- B. Glass Thicknesses: Indicated by thickness designations in millimeters according to ASTM C 1036.
- C. Interspace: Space between lites of an insulating-glass unit that contains dehydrated air or a specified gas.
- D. Deterioration of Coated Glass: Defects developed from normal use that are attributed to the manufacturing process and not to causes other than glass breakage and practices for maintaining and cleaning coated glass contrary to manufacturer's written instructions. Defects include peeling, cracking, and other indications of deterioration in metallic coating.
- E. Deterioration of Insulating Glass: Failure of hermetic seal under normal use that is attributed to the manufacturing process and not to causes other than glass breakage and practices for maintaining and cleaning insulating glass contrary to manufacturer's written instructions. Evidence of failure is the obstruction of vision by dust, moisture, or film on interior surfaces of glass.

- F. Deterioration of Laminated Glass: Defects developed from normal use that are attributed to the manufacturing process and not to causes other than glass breakage and practices for maintaining and cleaning laminated glass contrary to manufacturer's written instructions. Defects include edge separation, delamination materially obstructing vision through glass, and blemishes exceeding those allowed by referenced laminated-glass standard.

1.4 PERFORMANCE REQUIREMENTS

- A. General: Provide glazing systems capable of withstanding normal thermal movement and wind and impact loads (where applicable) without failure, including loss or glass breakage attributable to the following: defective manufacture, fabrication, and installation; failure of sealants or gaskets to remain watertight and airtight; deterioration of glazing materials; or other defects in construction.
- B. Glass Design: Glass thickness designations indicated are minimums and are for detailing only. Confirm glass thicknesses by analyzing Project loads and in-service conditions. Provide glass lites in the thickness designations indicated for various size openings, but not less than thicknesses and in strengths (annealed or heat treated) required to meet or exceed the following criteria:
 - 1. Glass Thicknesses: Select minimum glass thicknesses to comply with ASTM E 1300, according to the following requirements:
 - a. Design Wind Loads: Determine design wind loads applicable to Project from basic wind speed indicated in miles per hour at 33 feet above grade, according to ASCE 7, "Minimum Design Loads for Buildings and Other Structures": Section 6.5, "Method 2-Analytical Procedure," based on mean roof heights above grade indicated on Drawings.
 - 1) See Project information sheet.
 - b. Probability of Breakage for Vertical Glazing: 8 lites per 1000 for lites set vertically or not more than 15 degrees off vertical and under wind action.
 - c. Maximum Lateral Deflection: For the following types of glass supported on all 4 edges, provide thickness required that limits center deflection at design wind pressure to 1/50 times the short side length or 1 inch, whichever is less.
 - 1) For monolithic-glass lites heat treated to resist wind loads.
 - 2) For insulating glass.
 - 3) For laminated-glass lites.
 - d. Minimum Glass Thickness for Exterior Lites: Not less than 6.0 mm.
 - e. Thickness of Tinted and Heat-Absorbing Glass: Provide the same thickness for each tint color indicated throughout Project.

- C. Thermal Movements: Provide glazing that allows for thermal movements resulting from the following maximum change (range) in ambient and surface temperatures acting on glass framing members and glazing components. Base engineering calculation on surface temperatures of materials due to both solar heat gain and nighttime-sky heat loss.
 - 1. Temperature Change (Range): 120 deg F, ambient; 180 deg F, material surfaces.

- D. Thermal and Optical Performance Properties: Provide glass with performance properties specified based on manufacturer's published test data, as determined according to procedures indicated below:
 - 1. For monolithic-glass lites, properties are based on units with lites 6.0 mm thick.
 - 2. For laminated-glass lites, properties are based on products of construction indicated.
 - 3. For insulating-glass units, properties are based on units of thickness indicated for overall unit and for each lite.
 - 4. Center-of-Glass Values: Based on using LBL-44789 WINDOW 5.0 computer program for the following methodologies:
 - a. U-Factors: NFRC 100 expressed as Btu/ sq. ft. x h x deg F.
 - b. Solar Heat Gain Coefficient: NFRC 200.
 - c. Solar Optical Properties: NFRC 300.

1.5 SUBMITTALS

- A. Product Data: For each glass product and glazing material indicated.
- B. Product Certificates: Signed by manufacturers of glass and glazing products certifying that products furnished comply with requirements.
 - 1. For solar-control low-e-coated glass, provide documentation demonstrating that manufacturer of coated glass is certified by coating manufacturer.
- C. Qualification Data: For installers.
- D. Preconstruction Adhesion and Compatibility Test Report: From glazing sealant manufacturer indicating glazing sealants were tested for adhesion to glass and glazing channel substrates and for compatibility with glass and other glazing materials.
- E. Warranties: Special warranties specified in this Section.

1.6 QUALITY ASSURANCE

- A. **Installer Qualifications:** An experienced installer who has completed glazing similar in material, design, and extent to that indicated for this Project; whose work has resulted in glass installations with a record of successful in-service performance; and who employs glass installers for this Project who are certified under the National Glass Association's Certified Glass Installer Program.
- B. **Source Limitations for Glass:** Obtain the following through one source from a single manufacturer for each glass type: glass-clad polycarbonate and insulating glass.
- C. **Source Limitations for Glazing Accessories:** Obtain glazing accessories through one source from a single manufacturer for each product and installation method indicated.
- D. **Glass Product Testing:** Obtain glass test results for product test reports in "Submittals" Article from a qualified testing agency based on testing glass products.
 - 1. **Glass Testing Agency Qualifications:** An independent testing agency with the experience and capability to conduct the testing indicated, as documented according to ASTM E 548.
 - 2. **Glass Testing Agency Qualifications:** An independent testing agency accredited according to the NFRC CAP 1 Certification Agency Program.
- E. **Elastomeric Glazing Sealant Product Testing:** Obtain sealant test results for product test reports in "Submittals" Article from a qualified testing agency based on testing current sealant formulations within a 36-month period.
 - 1. **Sealant Testing Agency Qualifications:** An independent testing agency qualified according to ASTM C 1021 to conduct the testing indicated, as documented according to ASTM E 548.
 - 2. **Test elastomeric glazing sealants for compliance with requirements specified by reference to ASTM C 920, and where applicable, to other standard test methods.**
- F. **Preconstruction Adhesion and Compatibility Testing:** Submit to elastomeric glazing sealant manufacturers, for testing indicated below, samples of each glazing material type, tape sealant, gasket, glazing accessory, and glass-framing member that will contact or affect elastomeric glazing sealants:
 - 1. **Use ASTM C 1087 to determine whether priming and other specific joint preparation techniques are required to obtain rapid, optimum adhesion of glazing sealants to glass, tape sealants, gaskets, and glazing channel substrates.**
 - 2. **Schedule sufficient time for testing and analyzing results to prevent delaying the Work.**
 - 3. **For materials failing tests, obtain sealant manufacturer's written instructions for corrective measures, including the use of specially formulated primers.**

4. Testing will not be required if elastomeric glazing sealant manufacturers submit data based on previous testing of current sealant products for adhesion to, and compatibility with, glazing materials matching those submitted.
 - G. Glazing for Fire-Rated Door Assemblies: Glazing for assemblies that comply with NFPA 80 and that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire-protection ratings indicated, based on testing according to NFPA 252, where applicable.
 - H. Glazing for Fire-Rated Window Assemblies: Glazing for assemblies that comply with NFPA 80 and that are listed and labeled by a testing and inspecting agency acceptable to authorities having jurisdiction, for fire ratings indicated, based on testing according to NFPA 257, where applicable.
 - I. Safety Glazing Products: Comply with testing requirements in 16 CFR 1201 and, for wired glass, ANSI Z97.1.
 1. Subject to compliance with requirements, obtain safety glazing products permanently marked with certification label of the Safety Glazing Certification Council or another certification agency acceptable to authorities having jurisdiction.
 2. Where glazing units, including Kind FT glass and laminated glass, are specified in Part 2 articles for glazing lites more than 9 sq. ft. in exposed surface area of one side, provide glazing products that comply with Category II materials, for lites 9 sq. ft. or less in exposed surface area of one side, provide glazing products that comply with Category I or II materials, except for hazardous locations where Category II materials are required by 16 CFR 1201 and regulations of authorities having jurisdiction.
 - J. Insulating-Glass Certification Program: Permanently marked either on spacers or on at least one component lite of units with appropriate certification label of the following testing and inspecting agency:
 1. Insulating Glass Certification Council.
 2. Associated Laboratories, Inc.
 - K. Preinstallation Conference: Conduct conference at Project site to comply with requirements in Division 01 Section "Project Management and Coordination."
- 1.7 DELIVERY, STORAGE, AND HANDLING
- A. Protect glazing materials according to manufacturer's written instructions and as needed to prevent damage to glass and glazing materials from condensation, temperature changes, direct exposure to sun, or other causes.
 - B. For insulating-glass units that will be exposed to substantial altitude changes, comply with insulating-glass manufacturer's written recommendations for venting and sealing to avoid hermetic seal ruptures.

1.8 PROJECT CONDITIONS

- A. Environmental Limitations: Do not proceed with glazing when ambient and substrate temperature conditions are outside limits permitted by glazing material manufacturers and when glazing channel substrates are wet from rain, frost, condensation, or other causes.
 - 1. Do not install liquid glazing sealants when ambient and substrate temperature conditions are outside limits permitted by glazing sealant manufacturer or below 40 deg F .

1.9 WARRANTY

- A. Manufacturer's Special Warranty for Coated-Glass Products: Manufacturer's standard form, made out to Owner and signed by coated-glass manufacturer agreeing to replace coated-glass units that deteriorate as defined in "Definitions" Article, f.o.b. the nearest shipping point to Project site, within specified warranty period indicated below.
 - 1. Warranty Period: 10 years from date of Substantial Completion.
- B. Manufacturer's Special Warranty on Laminated Glass: Manufacturer's standard form, made out to Owner and signed by laminated-glass manufacturer agreeing to replace laminated-glass units that deteriorate as defined in "Definitions" Article, f.o.b. the nearest shipping point to Project site, within specified warranty period indicated below.
 - 1. Warranty Period: 5 years from date of Substantial Completion.
- C. Manufacturer's Special Warranty on Insulating Glass: Manufacturer's standard form, made out to Owner and signed by insulating-glass manufacturer agreeing to replace insulating-glass units that deteriorate as defined in "Definitions" Article, f.o.b. the nearest shipping point to Project site, within specified warranty period indicated below.
 - 1. Warranty Period: 10 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 GLASS PRODUCTS

- A. Annealed Float Glass: ASTM C 1036, Type I (transparent flat glass), Quality-Q3; of class indicated.
 - 1. Low-E Float Glass: Class I (clear); with a minimum 36 percent visible light transmission and a minimum solar heat gain coefficient of 0.40.

- a. Basis of Design Product Pilkington Building Products North America; Grey.
 - 1) AFG Industries Inc..
 - 2) PPG Industries, Inc..

- B. Insulating-Glass Units, General: Factory-assembled units consisting of sealed lites of glass separated by a dehydrated interspace, and complying with ASTM E 774 for Class CBA units and with requirements specified in this Article and in Part 2 "Insulating-Glass Units" Article.
 - 1. Provide Kind HS (heat-strengthened) float glass in place of annealed glass where needed to resist thermal stresses induced by differential shading of individual glass lites and to comply with glass design requirements specified in Part 1 "Performance Requirements" Article.
 - 2. Overall Unit Thickness and Thickness of Each Lite: Dimensions indicated for insulating-glass units are nominal and the overall thicknesses of units are measured perpendicularly from outer surfaces of glass lites at unit's edge.
 - 3. Sealing System: Dual seal, with primary and secondary sealants as follows:
 - a. Manufacturer's standard sealants.
 - b. Polyisobutylene and polysulfide.
 - c. Polyisobutylene and silicone.
 - d. Polyisobutylene and hot-melt butyl.
 - e. Polyisobutylene and polyurethane.
 - 4. Spacer Specifications: Manufacturer's standard spacer material and construction.
 - 5. Spacer Specifications: Manufacturer's standard spacer material and construction complying with the following requirements:
 - a. Spacer Material: Aluminum with mill or clear anodic finish Aluminum with powdered metal paint finish in color selected by Architect.
 - b. Desiccant: Molecular sieve or silica gel, or blend of both.
 - c. Corner Construction: Manufacturer's standard corner construction.

2.2 LAMINATED GLASS

- A. Windborne-Debris-Impact-Resistant Laminated Glass: ASTM C 1172, and complying with testing requirements in 16 CFR 1201 for Category II materials, with "Windborne-Debris-Impact Resistance" Paragraph in "Glass Products, General" Article, and with other requirements specified. Use materials that have a proven record of no tendency to bubble, discolor, or lose physical and mechanical properties after fabrication and installation.
 - 1. Construction: Laminate glass with one of the following to comply with interlayer manufacturer's written recommendations:

- a. Polyvinyl butyral interlayer.
 - b. Polyvinyl butyral interlayers reinforced with polyethylene terephthalate film.
 - c. Ionoplast interlayer.
 - d. Cast-in-place and cured-transparent-resin interlayer.
 - e. Cast-in-place and cured-transparent-resin interlayer reinforced with polyethylene terephthalate film.
2. Interlayer Thickness: Provide thickness not less than that indicated and as needed to comply with requirements.
 3. Interlayer Color: Clear unless otherwise indicated.

2.3 GLAZING GASKETS

- A. Dense Compression Gaskets: Molded or extruded gaskets of material indicated below, complying with standards referenced with name of elastomer indicated below, and of profile and hardness required to maintain watertight seal:
 1. Neoprene, ASTM C 864.
 2. EPDM, ASTM C 864.
 3. Silicone, ASTM C 1115.
 4. Thermoplastic polyolefin rubber, ASTM C 1115.
 5. Any material indicated above.
- B. Soft Compression Gaskets: Extruded or molded, closed-cell, integral-skinned gaskets of material indicated below; complying with ASTM C 509, Type II, black; and of profile and hardness required to maintain watertight seal:
 1. Neoprene.
 2. EPDM.
 3. Silicone.
 4. Thermoplastic polyolefin rubber.
 5. Any material indicated above.
- C. Lock-Strip Gaskets: Neoprene extrusions in size and shape indicated, fabricated into frames with molded corner units and zipper lock-strips, complying with ASTM C 542, black.

2.4 GLAZING SEALANTS

- A. General: Provide products of type indicated, complying with the following requirements:
 1. Compatibility: Select glazing sealants that are compatible with one another and with other materials they will contact, including glass products, seals of insulating-glass units, and glazing channel substrates, under conditions of

- service and application, as demonstrated by sealant manufacturer based on testing and field experience.
2. Suitability: Comply with sealant and glass manufacturers' written instructions for selecting glazing sealants suitable for applications indicated and for conditions existing at time of installation.
 3. Colors of Exposed Glazing Sealants: As selected by Architect from manufacturer's full range.
- B. Elastomeric Glazing Sealants: Comply with ASTM C 920 and other requirements indicated for each liquid-applied chemically curing sealant specified, including those referencing ASTM C 920 classifications for type, grade, class, and uses related to exposure and joint substrates.
1. Single-Component Neutral- and Basic-Curing Silicone Glazing Sealants GS-<#>:
 - a. Products:
 - 1) Dow Corning Corporation; 790.
 - 2) GE Silicones; SilPruf LM SCS2700.
 - 3) Tremco; Spectrem 1 (Basic).
 - 4) GE Silicones; SilPruf SCS2000.
 - 5) Pecora Corporation; 864.
 - 6) Pecora Corporation; 890.
 - 7) Polymeric Systems Inc.; PSI-641.
 - 8) Sonneborn, Div. of ChemRex, Inc.; Omniseal.
 - 9) Tremco; Spectrem 3.
 - b. Type and Grade: S (single component) and NS (nonsag).
 - c. Use Related to Exposure: NT (nontraffic).

2.5 MISCELLANEOUS GLAZING MATERIALS

- A. General: Provide products of material, size, and shape complying with referenced glazing standard, requirements of manufacturers of glass and other glazing materials for application indicated, and with a proven record of compatibility with surfaces contacted in installation.
- B. Cleaners, Primers, and Sealers: Types recommended by sealant or gasket manufacturer.
- C. Setting Blocks: Elastomeric material with a Shore, Type A durometer hardness of 85, plus or minus 5.
- D. Spacers: Elastomeric blocks or continuous extrusions with a Shore, Type A durometer hardness required by glass manufacturer to maintain glass lites in place for installation indicated.

- E. Edge Blocks: Elastomeric material of hardness needed to limit glass lateral movement (side walking).
- F. Cylindrical Glazing Sealant Backing: ASTM C 1330, Type O (open-cell material), of size and density to control glazing sealant depth and otherwise produce optimum glazing sealant performance.
- G. Perimeter Insulation for Fire-Resistive Glazing: Identical to product used in test assembly to obtain fire-resistance rating.

2.6 FABRICATION OF GLAZING UNITS

- A. Fabricate glazing units in sizes required to glaze openings indicated for Project, with edge and face clearances, edge and surface conditions, and bite complying with written instructions of product manufacturer and referenced glazing publications, to comply with system performance requirements.
- B. Clean-cut or flat-grind vertical edges of butt-glazed monolithic lites in a manner that produces square edges with slight kerfs at junctions with outdoor and indoor faces.
- C. Grind smooth and polish exposed glass edges and corners.

2.7 INSULATING-GLASS UNITS

- A. Reflective and Low-E Insulating-Glass Units:
 - 1. Overall Unit Thickness and Thickness of Each Lite: 25 and 6.0 mm.
 - 2. Interspace Content: Argon.
 - 3. Outdoor Lite: Class 2 (tinted) float glass.
 - a. Tint Color: "Grey" by Pilkington.
 - 4. Low-E Coating: Sputtered on second.
 - 5. Reflective Coating: Sputtered.
 - a. Color: Grey
 - b. Location: First surface.
 - 6. Self-Cleaning, Low-Maintenance Coating: Pyrolytic coating on first surface.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine framing glazing, with Installer present, for compliance with the following:

1. Manufacturing and installation tolerances, including those for size, squareness, and offsets at corners.
2. Presence and functioning of weep system.
3. Minimum required face or edge clearances.
4. Effective sealing between joints of glass-framing members.

B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

A. Clean glazing channels and other framing members receiving glass immediately before glazing. Remove coatings not firmly bonded to substrates.

3.3 GLAZING, GENERAL

A. Comply with combined written instructions of manufacturers of glass, sealants, gaskets, and other glazing materials, unless more stringent requirements are indicated, including those in referenced glazing publications.

B. Glazing channel dimensions, as indicated on Drawings, provide necessary bite on glass, minimum edge and face clearances, and adequate sealant thicknesses, with reasonable tolerances. Adjust as required by Project conditions during installation.

C. Protect glass edges from damage during handling and installation. Remove damaged glass from Project site and legally dispose of off Project site. Damaged glass is glass with edge damage or other imperfections that, when installed, could weaken glass and impair performance and appearance.

D. Apply primers to joint surfaces where required for adhesion of sealants, as determined by preconstruction sealant-substrate testing.

E. Install setting blocks in sill rabbets, sized and located to comply with referenced glazing publications, unless otherwise required by glass manufacturer. Set blocks in thin course of compatible sealant suitable for heel bead.

F. Do not exceed edge pressures stipulated by glass manufacturers for installing glass lites.

G. Provide spacers for glass lites where length plus width is larger than 50 inches as follows:

1. Locate spacers directly opposite each other on both inside and outside faces of glass. Install correct size and spacing to preserve required face clearances, unless gaskets and glazing tapes are used that have demonstrated ability to maintain required face clearances and to comply with system performance requirements.

2. Provide 1/8-inch minimum bite of spacers on glass and use thickness equal to sealant width. With glazing tape, use thickness slightly less than final compressed thickness of tape.
- H. Provide edge blocking where indicated or needed to prevent glass lites from moving sideways in glazing channel, as recommended in writing by glass manufacturer and according to requirements in referenced glazing publications.
- I. Set glass lites in each series with uniform pattern, draw, bow, and similar characteristics.
- J. Where wedge-shaped gaskets are driven into one side of channel to pressurize sealant or gasket on opposite side, provide adequate anchorage so gasket cannot walk out when installation is subjected to movement.
- K. Square cut wedge-shaped gaskets at corners and install gaskets in a manner recommended by gasket manufacturer to prevent corners from pulling away; seal corner joints and butt joints with sealant recommended by gasket manufacturer.

3.4 TAPE GLAZING

- A. Position tapes on fixed stops so that, when compressed by glass, their exposed edges are flush with or protrude slightly above sightline of stops.
- B. Install tapes continuously, but not necessarily in one continuous length. Do not stretch tapes to make them fit opening.
- C. Cover vertical framing joints by applying tapes to heads and sills first and then to jambs. Cover horizontal framing joints by applying tapes to jambs and then to heads and sills.
- D. Place joints in tapes at corners of opening with adjoining lengths butted together, not lapped. Seal joints in tapes with compatible sealant approved by tape manufacturer.
- E. Do not remove release paper from tape until just before each glazing unit is installed.
- F. Apply heel bead of elastomeric sealant.
- G. Center glass lites in openings on setting blocks and press firmly against tape by inserting dense compression gaskets formed and installed to lock in place against faces of removable stops. Start gasket applications at corners and work toward centers of openings.
- H. Apply cap bead of elastomeric sealant over exposed edge of tape.

3.5 GASKET GLAZING (DRY)

- A. Fabricate compression gaskets in lengths recommended by gasket manufacturer to fit openings exactly, with allowance for stretch during installation.
- B. Insert soft compression gasket between glass and frame or fixed stop so it is securely in place with joints miter cut and bonded together at corners.
- C. Center glass lites in openings on setting blocks and press firmly against soft compression gasket by inserting dense compression gaskets formed and installed to lock in place against faces of removable stops. Start gasket applications at corners and work toward centers of openings. Compress gaskets to produce a weathertight seal without developing bending stresses in glass. Seal gasket joints with sealant recommended by gasket manufacturer.
- D. Install gaskets so they protrude past face of glazing stops.

3.6 SEALANT GLAZING (WET)

- A. Install continuous spacers, or spacers combined with cylindrical sealant backing, between glass lites and glazing stops to maintain glass face clearances and to prevent sealant from extruding into glass channel and blocking weep systems until sealants cure. Secure spacers or spacers and backings in place and in position to control depth of installed sealant relative to edge clearance for optimum sealant performance.
- B. Force sealants into glazing channels to eliminate voids and to ensure complete wetting or bond of sealant to glass and channel surfaces.
- C. Tool exposed surfaces of sealants to provide a substantial wash away from glass.

3.7 LOCK-STRIP GASKET GLAZING

- A. Comply with ASTM C 716 and gasket manufacturer's written instructions. Provide supplementary wet seal and weep system, unless otherwise indicated.

3.8 CLEANING AND PROTECTION

- A. Protect exterior glass from damage immediately after installation by attaching crossed streamers to framing held away from glass. Do not apply markers to glass surface. Remove nonpermanent labels, and clean surfaces.
- B. Protect glass from contact with contaminating substances resulting from construction operations, including weld splatter. If, despite such protection, contaminating substances do come into contact with glass, remove substances immediately as recommended by glass manufacturer.

- C. Examine glass surfaces adjacent to or below exterior concrete and other masonry surfaces at frequent intervals during construction, but not less than once a month, for buildup of dirt, scum, alkaline deposits, or stains; remove as recommended in writing by glass manufacturer.
- D. Remove and replace glass that is broken, chipped, cracked, or abraded or that is damaged from natural causes, accidents, and vandalism, during construction period.
- E. Wash glass on both exposed surfaces in each area of Project not more than four days before date scheduled for inspections that establish date of Substantial Completion. Wash glass as recommended in writing by glass manufacturer.

END OF SECTION 088000

DIVISION 9

FINISHES

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: www.dammonengineering.com



SECTION 092900

GYPSUM BOARD

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Interior gypsum board.
 - 2. Tile backing panels.

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples: For the following products:
 - 1. Trim Accessories: Full-size Sample in 12-inch long length for each trim accessory indicated.
 - 2. Textured Finishes: Manufacturer's standard size for each textured finish indicated and on same backing indicated for Work.

1.4 QUALITY ASSURANCE

- A. Fire-Resistance-Rated Assemblies: For fire-resistance-rated assemblies, provide materials and construction identical to those tested in assembly indicated according to ASTM E 119 by an independent testing agency.
- B. STC-Rated Assemblies: For STC-rated assemblies, provide materials and construction identical to those tested in assembly indicated according to ASTM E 90 and classified according to ASTM E 413 by an independent testing agency.

1.5 STORAGE AND HANDLING

- A. Store materials inside under cover and keep them dry and protected against damage from weather, condensation, direct sunlight, construction traffic, and other causes. Stack panels flat to prevent sagging.

1.6 PROJECT CONDITIONS

- A. Environmental Limitations: Comply with ASTM C 840 requirements or gypsum board manufacturer's written recommendations, whichever are more stringent.
- B. Do not install interior products until installation areas are enclosed and conditioned.
- C. Do not install panels that are wet, those that are moisture damaged, and those that are mold damaged.
 - 1. Indications that panels are wet or moisture damaged include, but are not limited to, discoloration, sagging, or irregular shape.
 - 2. Indications that panels are mold damaged include, but are not limited to, fuzzy or splotchy surface contamination and discoloration.

PART 2 - PRODUCTS

2.1 PANELS, GENERAL

- A. Size: Provide in maximum lengths and widths available that will minimize joints in each area and that correspond with support system indicated.

2.2 INTERIOR GYPSUM BOARD

- A. General: Complying with ASTM C 36/C 36M or ASTM C 1396/C 1396M, as applicable to type of gypsum board indicated and whichever is more stringent.
 - 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. American Gypsum Co.
 - b. BPB America Inc.
 - c. G-P Gypsum.
 - d. Lafarge North America Inc.
 - e. National Gypsum Company.
 - f. PABCO Gypsum.
 - g. Temple.

h. USG Corporation.

B. Type X:

1. Thickness: 5/8 inch.
2. Long Edges: Tapered.

C. Flexible Type: Manufactured to bend to fit radii and to be more flexible than standard regular-type gypsum board of same thickness.

1. Thickness: 1/4 inch .
2. Long Edges: Tapered.

D. Moisture- and Mold-Resistant Type: With moisture- and mold-resistant core and surfaces.

1. Core: 5/8 inch, Type X.
2. Long Edges: Tapered.

E. Moisture/Abuse Resistant

1. Thickness: 5/8"
2. Long Edges: Tapered
3. Manufacturer: National Gypsum; American-Gypsum

2.3 EXTERIOR GYPSUM BOARD FOR WALLS

A. Glass-Mat Gypsum Sheathing Board: ASTM C 1177/C 1177M.

1. Product: Subject to compliance with requirements, provide "Dens-Glass Gold" by G-P Gypsum.
2. Core: 5/8 inch , Type X

2.4 TILE BACKING PANELS

A. Water-Resistant Gypsum Backing Board: ASTM C 630/C 630M or ASTM C 1396/C 1396M.

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. American Gypsum Co.
 - b. BPB America Inc.
 - c. G-P Gypsum.
 - d. Lafarge North America Inc.

- e. National Gypsum Company.
 - f. PABCO Gypsum.
 - g. Temple.
 - h. USG Corporation.
 3. Core: 5/8 inch, Type X.
 - B. Glass-Mat, Water-Resistant Backing Board:
 1. Complying with ASTM C 1178/C 1178M.
 - a. Product: Subject to compliance with requirements, provide "DensShield Tile Guard" by G-P Gypsum.
 2. Complying with ASTM C1177/C 1177M.
 - a. Product: Subject to compliance with requirements, provide "DensArmor Plus Interior Guard" by G-P Gypsum.
 3. Core: 5/8 inch, regular type or 5/8 inch, Type X.
 - C. Cementitious Backer Units: ANSI A118.9.
 1. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
 2. Products: Subject to compliance with requirements, provide one of the following:
 - a. Custom Building Products; Wonderboard.
 - b. FinPan, Inc.; Util-A-Crete Concrete Backer Board.
 - c. USG Corporation; DUROCK Cement Board.
 3. Thickness: 5/8 inch.
- 2.5 TRIM ACCESSORIES
- A. Interior Trim: ASTM C 1047.
 1. Material: Galvanized or aluminum-coated steel sheet, rolled zinc, plastic, or paper-faced galvanized steel sheet.
 2. Shapes:
 - a. Cornerbead.
 - b. Bullnose bead.
 - c. LC-Bead: J-shaped; exposed long flange receives joint compound.
 - d. L-Bead: L-shaped; exposed long flange receives joint compound.

- e. U-Bead: J-shaped; exposed short flange does not receive joint compound.
- f. Expansion (control) joint.
- g. Curved-Edge Cornerbead: With notched or flexible flanges.

B. Exterior Trim: ASTM C 1047.

- 1. Material: Hot-dip galvanized steel sheet, plastic, or rolled zinc.
- 2. Shapes:
 - a. Cornerbead.
 - b. LC-Bead: J-shaped; exposed long flange receives joint compound.
 - c. Expansion (Control) Joint: One-piece, rolled zinc with V-shaped slot and removable strip covering slot opening.

C. Aluminum Trim: Extruded accessories of profiles and dimensions indicated.

- 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- 2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Fry Reglet Corp.
 - b. Gordon, Inc.
 - c. Pittcon Industries.
- 3. Aluminum: Alloy and temper with not less than the strength and durability properties of ASTM B 221, Alloy 6063-T5.
- 4. Finish: Corrosion-resistant primer compatible with joint compound and finish materials specified.

2.6 JOINT TREATMENT MATERIALS

A. General: Comply with ASTM C 475/C 475M.

B. Joint Tape:

- 1. Interior Gypsum Wallboard: Paper.
- 2. Glass-Mat Gypsum Sheathing Board: 10-by-10 glass mesh.
- 3. Tile Backing Panels: As recommended by panel manufacturer.

C. Joint Compound for Interior Gypsum Wallboard: For each coat use formulation that is compatible with other compounds applied on previous or for successive coats.

- 1. Prefilling: At open joints, rounded or beveled panel edges, and damaged surface areas, use setting-type taping compound.

2. Embedding and First Coat: For embedding tape and first coat on joints, fasteners, and trim flanges, use setting-type taping or drying-type, all-purpose compound.
 - a. Use setting-type compound for installing paper-faced metal trim accessories.
3. Fill Coat: For second coat, use setting-type, sandable topping or drying-type, all-purpose compound.
4. Finish Coat: For third coat, use setting-type, sandable topping or drying-type, all-purpose compound.
5. Skim Coat: For final coat of Level 5 finish, use setting-type, sandable topping compound or drying-type, all-purpose compound.

D. Joint Compound for Exterior Applications:

1. Glass-Mat Gypsum Sheathing Board: As recommended by sheathing board manufacturer.

E. Joint Compound for Tile Backing Panels:

1. Water-Resistant Gypsum Backing Board: Use setting-type taping compound and setting-type, sandable topping compound.
2. Glass-Mat, Water-Resistant Backing Panel: As recommended by backing panel manufacturer.
3. Cementitious Backer Units: As recommended by backer unit manufacturer.

2.7 AUXILIARY MATERIALS

- A. General: Provide auxiliary materials that comply with referenced installation standards and manufacturer's written recommendations.
- B. Laminating Adhesive: Adhesive or joint compound recommended for directly adhering gypsum panels to continuous substrate.
 1. Use adhesives that have a VOC content of 50 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- C. Steel Drill Screws: ASTM C 1002, unless otherwise indicated.
 1. Use screws complying with ASTM C 954 for fastening panels to steel members from 0.033 to 0.112 inch thick.
 2. For fastening cementitious backer units, use screws of type and size recommended by panel manufacturer.

- D. Sound Attenuation Blankets: ASTM C 665, Type I (blankets without membrane facing) produced by combining thermosetting resins with mineral fibers manufactured from glass, slag wool, or rock wool.
 - 1. Fire-Resistance-Rated Assemblies: Comply with mineral-fiber requirements of assembly.
- E. Acoustical Sealant: As specified in Division 7 Section "Joint Sealants."
 - 1. Provide sealants that have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
- F. Thermal Insulation: As specified in Division 7 Section "Building Insulation."
- G. Vapor Retarder: As specified in Division 7 Section "Building Insulation."

2.8 TEXTURE FINISHES

- A. Primer: As recommended by textured finish manufacturer.
- B. Aggregate or Unaggregated Finish: Water-based, job-mixed, drying-type texture finish for spray application.
 - 1. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
 - 2. Products: Subject to compliance with requirements, provide one of the following:
 - a. G-P Gypsum; Georgia-Pacific Ceiling Textures/Vermiculite.
 - b. USG Corporation; SHEETROCK Wall and Ceiling Spray Texture.
 - 3. Texture: Light orange peel.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine areas and substrates, with Installer present, and including welded hollow-metal frames and framing, for compliance with requirements and other conditions affecting performance.
- B. Examine panels before installation. Reject panels that are wet, moisture damaged, and mold damaged.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 APPLYING AND FINISHING PANELS, GENERAL

- A. Comply with ASTM C 840.
- B. Install ceiling panels across framing to minimize the number of abutting end joints and to avoid abutting end joints in central area of each ceiling. Stagger abutting end joints of adjacent panels not less than one framing member.
- C. Install panels with face side out. Butt panels together for a light contact at edges and ends with not more than 1/16 inch of open space between panels. Do not force into place.
- D. Locate edge and end joints over supports, except in ceiling applications where intermediate supports or gypsum board back-blocking is provided behind end joints. Do not place tapered edges against cut edges or ends. Stagger vertical joints on opposite sides of partitions. Do not make joints other than control joints at corners of framed openings.
- E. Form control and expansion joints with space between edges of adjoining gypsum panels.
- F. Cover both faces of support framing with gypsum panels in concealed spaces (above ceilings, etc.), except in chases braced internally.
 - 1. Unless concealed application is indicated or required for sound, fire, air, or smoke ratings, coverage may be accomplished with scraps of not less than 8 sq. ft. in area.
 - 2. Fit gypsum panels around ducts, pipes, and conduits.
 - 3. Where partitions intersect structural members projecting below underside of floor/roof slabs and decks, cut gypsum panels to fit profile formed by structural members; allow 1/4- to 3/8-inch wide joints to install sealant.
- G. Isolate perimeter of gypsum board applied to non-load-bearing partitions at structural abutments, except floors. Provide 1/4- to 1/2-inch wide spaces at these locations, and trim edges with edge trim where edges of panels are exposed. Seal joints between edges and abutting structural surfaces with acoustical sealant.
- H. Attachment to Steel Framing: Attach panels so leading edge or end of each panel is attached to open (unsupported) edges of stud flanges first.
- I. Wood Framing: Install gypsum panels over wood framing, with floating internal corner construction. Do not attach gypsum panels across the flat grain of wide-dimension lumber, including floor joists and headers. Float gypsum panels over these members, or provide control joints to counteract wood shrinkage.
- J. STC-Rated Assemblies: Seal construction at perimeters, behind control joints, and at openings and penetrations with a continuous bead of acoustical sealant. Install acoustical sealant at both faces of partitions at perimeters and through penetrations. Comply with ASTM C 919 and with manufacturer's written recommendations for

locating edge trim and closing off sound-flanking paths around or through assemblies, including sealing partitions above acoustical ceilings.

3.3 APPLYING INTERIOR GYPSUM BOARD

A. Single-Layer Application:

1. On ceilings, apply gypsum panels before wall/partition board application to greatest extent possible and at right angles to framing, unless otherwise indicated.
2. On partitions/walls, apply gypsum panels vertically (parallel to framing) or horizontally (perpendicular to framing), unless otherwise indicated or required by fire-resistance-rated assembly, and minimize end joints.
 - a. Stagger abutting end joints not less than one framing member in alternate courses of panels.
 - b. At stairwells and other high walls, install panels horizontally, unless otherwise indicated or required by fire-resistance-rated assembly.
3. On Z-furring members, apply gypsum panels vertically (parallel to framing) with no end joints. Locate edge joints over furring members.
4. Fastening Methods: Apply gypsum panels to supports with steel drill screws.

B. Multilayer Application:

1. On ceilings, apply gypsum board indicated for base layers before applying base layers on walls/partitions; apply face layers in same sequence. Apply base layers at right angles to framing members and offset face-layer joints 1 framing member, 16 inches minimum, from parallel base-layer joints, unless otherwise indicated or required by fire-resistance-rated assembly.
2. On partitions/walls, apply gypsum board indicated for base layers and face layers vertically (parallel to framing) with joints of base layers located over stud or furring member and face-layer joints offset at least one stud or furring member with base-layer joints, unless otherwise indicated or required by fire-resistance-rated assembly. Stagger joints on opposite sides of partitions.
3. On Z-furring members, apply base layer vertically (parallel to framing) and face layer either vertically (parallel to framing) or horizontally (perpendicular to framing) with vertical joints offset at least one furring member. Locate edge joints of base layer over furring members.
4. Fastening Methods: Fasten base layers and face layers separately to supports with screws.

C. Laminating to Substrate: Where gypsum panels are indicated as directly adhered to a substrate (other than studs, joists, furring members, or base layer of gypsum board), comply with gypsum board manufacturer's written recommendations and temporarily brace or fasten gypsum panels until fastening adhesive has set.

D. Curved Surfaces:

1. Install panels horizontally (perpendicular to supports) and unbroken, to extent possible, across curved surface plus 12-inch long straight sections at ends of curves and tangent to them.
2. For double-layer construction, fasten base layer to studs with screws 16 inches o.c. Center gypsum board face layer over joints in base layer, and fasten to studs with screws spaced 12 inches o.c.

3.4 APPLYING TILE BACKING PANELS

- A. Water-Resistant Gypsum Backing Board: Install at showers, tubs, and where indicated. Install with 1/4-inch gap where panels abut other construction or penetrations.
- B. Glass-Mat, Water-Resistant Backing Panel: Comply with manufacturer's written installation instructions and install at locations indicated to receive tile. Install with 1/4-inch gap where panels abut other construction or penetrations.
- C. Cementitious Backer Units: ANSI A108.11, at where indicated or locations indicated to receive tile.
- D. Areas Not Subject to Wetting: Install regular-type gypsum wallboard panels to produce a flat surface except at showers, tubs, and other locations indicated to receive water-resistant panels.
- E. Where tile backing panels abut other types of panels in same plane, shim surfaces to produce a uniform plane across panel surfaces.

3.5 INSTALLING TRIM ACCESSORIES

- A. General: For trim with back flanges intended for fasteners, attach to framing with same fasteners used for panels. Otherwise, attach trim according to manufacturer's written instructions.
- B. Control Joints: Install control joints according to ASTM C 840 and in specific locations approved by Architect for visual effect.
- C. Interior Trim: Install in the following locations:
 1. Cornerbead: Use at outside corners.
 2. LC-Bead: Use at exposed panel edges.
 3. L-Bead: Use where indicated.
 4. J-Bead: Use at exposed panel edges.
 5. Curved-Edge Cornerbead: Use at curved openings.
- D. Exterior Trim: Install in the following locations:
 1. Cornerbead: Use at outside corners.

2. LC-Bead: Use at exposed panel edges.

3.6 FINISHING GYPSUM BOARD

- A. General: Treat gypsum board joints, interior angles, edge trim, control joints, penetrations, fastener heads, surface defects, and elsewhere as required to prepare gypsum board surfaces for decoration. Promptly remove residual joint compound from adjacent surfaces.
- B. Prefill open joints, rounded or beveled edges, and damaged surface areas.
- C. Apply joint tape over gypsum board joints, except those with trim having flanges not intended for tape.
- D. Gypsum Board Finish Levels: Finish panels to levels indicated below and according to ASTM C 840:
 1. Level 1: Ceiling plenum areas, concealed areas, and where indicated.
 2. Level 2: Panels that are substrate for tile.
 3. Level 3: Not Used.
 4. Level 4: At panel surfaces that will be exposed to view, unless otherwise indicated.
 - a. Primer and its application to surfaces are specified in other Division 9 Sections.
 5. Level 5: Not Used.
 - a. Primer and its application to surfaces are specified in other Division 9 Sections.
- E. Glass-Mat Gypsum Sheathing Board: Finish according to manufacturer's written instructions for use as exposed soffit board.
- F. Glass-Mat, Water-Resistant Backing Panels: Finish according to manufacturer's written instructions.
- G. Cementitious Backer Units: Finish according to manufacturer's written instructions.

3.7 APPLYING TEXTURE FINISHES

- A. Surface Preparation and Primer: Prepare and apply primer to gypsum panels and other surfaces receiving texture finishes. Apply primer to surfaces that are clean, dry, and smooth.
- B. Texture Finish Application: Mix and apply finish using powered spray equipment, to produce a uniform texture matching approved mockup and free of starved spots or other evidence of thin application or of application patterns.

- C. Prevent texture finishes from coming into contact with surfaces not indicated to receive texture finish by covering them with masking agents, polyethylene film, or other means. If, despite these precautions, texture finishes contact these surfaces, immediately remove droppings and overspray to prevent damage according to texture-finish manufacturer's written recommendations.

3.8 PROTECTION

- A. Protect installed products from damage from weather, condensation, direct sunlight, construction, and other causes during remainder of the construction period.
- B. Remove and replace panels that are wet, moisture damaged, and mold damaged.
 - 1. Indications that panels are wet or moisture damaged include, but are not limited to, discoloration, sagging, or irregular shape.
 - 2. Indications that panels are mold damaged include, but are not limited to, fuzzy or splotchy surface contamination and discoloration.

END OF SECTION 092900

SECTION 093000

TILE SETTING MATERIALS AND ACCESSORIES

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Tile Setting Mortar and Adhesive.
- B. Grout.
- C. Electric Radiant Floor Warming.
- D. Flooring Underlayment.
- E. Waterproofing.
- F. Thresholds, Trim and Accessories.

1.2 REFERENCES

- A. ANSI A108 Series/A118 Series - American National Standards for Installation of Ceramic Tile; 1999.
- B. ANSI A136.1 - American National Standard for Organic Adhesives for Installation of Ceramic Tile; 1999.
- C. ASTM C 109/C 109M - Standard Test Method for Compressive Strength of Hydraulic Cement Mortars (Using 2-in. or (50-mm) Cube Specimens); 1999.
- D. ASTM C 241 - Standard Test Method for Abrasion Resistance of Stone Subjected to Foot Traffic; 1990 (Reapproved 1997).
- E. ASTM C 503 - Standard Specification for Marble Dimension Stone (Exterior); 1999.
- F. ASTM C 627 - Standard Test Method for Evaluating Ceramic Floor Tile Installation Systems Using the Robinson-Type Floor Tester; 1993.
- G. ASTM C 905 - Standard Test Methods for Apparent Density of Chemical-Resistant Mortars, Grouts and Monolithic Surfacing; 1996.
- H. ASTM C 1353 - Standard Test Method Using the Taber Abrader for Abrasion Resistance of Dimension Stone Subjected to Foot Traffic; 1998.
- I. ASTM D 226 - Standard Specification for Asphalt-Saturated Organic Felt Used in Roofing and Waterproofing; 1997.
- J. ASTM D 751 - Standard Test Methods for Coated Fabrics; 1998.

- K. ASTM D 2240 - Standard Test Method for Rubber Property--Durometer Hardness; 1997.
- L. ASTM D 4397 - Standard Specification for Polyethylene Sheeting for Construction, Industrial, and Agricultural Applications; 2000.
- M. ASTM E 90 - Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions and Elements; 1999.
- N. ASTM E 96 - Standard Test Methods for Water Vapor Transmission of Materials; 1995.
- O. ASTM E 413 - Classification for Rating Sound Insulation; 1987 (Reapproved 1999).
- P. ASTM E 492 - Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine; 1990 (Reapproved 1996).
- Q. FS TT-C-555 - Coating, Textured (For Interior and Exterior Masonry Surfaces); cancelled 2001.
- R. TCA (HB) - Handbook for Ceramic Tile Installation; Tile Council of America; 2001.

1.3 SUBMITTALS

- A. Submit under provisions of Section 01300.
- B. Product Data: Manufacturer's technical information for each product specified.
- C. Sound Control Underlayment Test Reports: Demonstrate compliance with specified acoustical performance criteria; furnish reports of tests conducted by independent testing agency.
- D. Selection Samples: Color charts for selection of grout.
- E. Verification Samples: Actual samples of mortars, grouts and adhesives, tested for compatibility in relationships to be found in project installation.
- F. Installation Instructions: Manufacturer's printed instructions for each product.
- G. Maintenance Instructions: Include cleaning and stain removal methods and cleaning solutions recommended.

1.4 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Firm specializing in manufacture of tile installation materials, including mortars, grouts, and adhesives, with minimum 10 years experience and ISO 9001 certification.

- B. Laboratory Testing: For each mortar, grout, and adhesive specified, submit laboratory confirmation using positive analytical methods of:
 - 1. Compatibility of materials to be used together.
 - 2. Proper usage of specified materials.
 - 3. Color matching.
- C. Installer Qualifications: Firm specializing in installation of ceramic and/or stone tile, with minimum 5 years documented experience with projects of similar scope, design, and materials.
- D. Pre-Installation Meeting: At least three weeks prior to commencing tile work conduct a meeting at the project site to discuss contract requirements and job conditions; require the attendance of tile installers, representative of installation materials manufacturer, and installers of related materials; notify Architect in advance of meeting.

1.5 DELIVERY, STORAGE, AND HANDLING

- A. Deliver and store packaged materials in original containers with seals unbroken and labels intact until time of use. Prevent damage or contamination to materials by water, freezing, foreign matter or other causes.
- B. Store materials subject to damage by freezing or overheating, including latex, organic, and epoxy materials, at room temperature if possible.
- C. Deliver and store materials on site at least 24 hours before work begins.

1.6 PROJECT CONDITIONS

- A. Maintain environmental conditions and protect work during and after installation to comply with referenced standards and manufacturer's printed recommendations.
- B. Vent temporary heaters to exterior to prevent damage to tile work from carbon dioxide build-up.
- C. Maintain temperatures at not less than 50 degrees F (10 degrees C) and not more than 100 degrees F (38 degrees C) in tiled areas during installation and for 7 days after completion, unless other temperatures are required by referenced installation standards or manufacturer's written instructions.
- D. Protect Portland cement based materials from direct sunlight, radiant heat, forced hot and cold ventilation and drafts until cured, to prevent premature evaporation of moisture. When installed at low temperatures allow for longer curing time and protect from damage until cured.
- E. Do not install epoxy based materials when surface temperature is less than 60 degrees F (16 degrees C) or over 90 degrees F (32 degrees C).

1.7 WARRANTY

- A. Provide manufacturer's standard written 10-year warranty, covering materials and labor for replacement of defective materials.
- B. Provide Contractor's warranty that work will be free of defects in materials and workmanship for 10 years.

1.8 MAINTENANCE MATERIALS

- A. Deliver to Owner minimum of 1 gallon (4 L) of each type of mortar, grout, and adhesive, for use in repair and maintenance; provide color matched materials from same production run or batch as installed materials.

PART 2 PRODUCTS

2.1 MANUFACTURERS

- A. Acceptable Manufacturer: LATICRETE International, Inc.,
- B. Requests for substitutions will be considered in accordance with provisions of Section 012500.
- C. Obtain products from a single manufacturer.

2.2 UNDERLAYMENT

- A. Laticrete 816 LatiPatch: Rapid Cementitious patching compound for application over concrete or exterior grade plywood, cutback adhesive, vinyl tile, dry concrete or unglazed tile.
 - 1. Curing Time: Tile - Approximately 1 1/2 to 2 hours.
 - 2. Compressive Strength - 28 day cure, ANSI A118.4 F.6: 5000 psi (34.5 MPa).

2.3 LATEX MORTAR BED

- A. Slurry Bond Coat:
 - 1. Laticrete 254 Platinum: High strength slurry bond coat that is frost, weather and shock resistant.
 - a. Compressive Strength: 5,000 psi (34.5 MPa), min., in accordance with ANSI A118.4.
 - b. Hardness: 50 to 60, min., in accordance with ASTM D 2240, D-scale for 72 hours.
 - c. Bond Strength: 500 psi (3.5 MPa), min., in accordance with ANSI A118.4.
 - d. Wet Density: 102 pcf (1637 kg/cu m) nominal, in accordance with ASTM C 905.
 - e. Water Absorption: 4 percent, max., in accordance with ANSI A118.6.
 - f. Surface Burning Characteristics: Flame spread and smoke developed indices of 0, in accordance with ASTM E 84, modified.
 - g. Service Rating: Passing ASTM C 627 cycles 1-14 (TCA "Extra

Heavy").

B. Mortar Bed:

1. Laticrete 226 Thick-Bed Mortar with Laticrete 3701 Mortar Admix: Latex portland cement mortar made of factory-blended cement and aggregates requiring only the addition of latex mortar additive; weather, frost, and shock resistant.
 - a. Compressive Strength: 5,000 psi (34.5 MPa) min., in accordance with ANSI A118.4.
 - b. Hardness: 70 to 80, in accordance with ASTM D 2240 D-scale for 72 hours.
 - c. Wet Density: 135 pcf (2166 kg/cu m), nominal, in accordance with ASTM C 905.
 - d. Water Absorption: 5 percent, maximum, in accordance with ANSI A118.6.
 - e. Surface Burning Characteristics: Flame spread and smoke developed indices of 0 in accordance with ASTM E 84, modified.
2. Laticrete 209 Floor Mud: Pre-mixed, alternative to 226 Thick Bed Mortar. Mixes with 3701 Mortar Admix to provide a conventional floor mortar bed. For interior applications such as small shower pan fills in bathrooms. Covers 6 square feet (0.56 sm) at 1 inch (25mm) thickness per 60 lb (27.3kg) bag.

2.4 MULTIPURPOSE THIN-SET MORTAR

- A. LATICRETE 254 R Platinum Rapid: One-step, polymer fortified, thin-set mortar for interior and exterior installation of ceramic tile, stone, quarry tile, pavers and brick.
1. Shear Bond, Porcelain Tile, 28 day cure - ANSI A118.4-1999; F-5.2.4: 450-500 psi (3.1 - 3.8 MPa).
 2. Water Immersion, 7 Day Cure - ANSI A118.4-1999; F-5.2.3 225 - 275 psi (1.6 - 1.9 MPa).
 3. Color: Gray.
 4. Color: White.

2.5 EPOXY GROUT

- A. Laticrete SpectraLOCK PRO Grout: High performance grout for use with ceramic, glass and stone tile for residential or commercial applications.
1. Water cleanability: Up to 80 minutes.
 2. Initial set: 2 hours.
 3. Service strength: 24 hours.
 4. Shrinkage: 0.25 percent.
 5. Quarry/quarry bond strength: 1,000 psi (6.9 MPa) - Failure at tile.
 6. Compressive strength 3,500 psi (24 MPa) - 7 days.
 7. Tensile strength 1,100 psi (7.6 MPa) - 7 days.
 8. Thermal shock 510 psi (3.5 MPa).
 9. Water absorption: Less than 0.50 percent.

2.6 EDGE PROTECTION AND TRANSITION PROFILES FOR FLOORS

- A. Description: L-shaped extruded aluminum profile
 - 1. Manufacturer: Schluter Systems or approved equal.
 - 2. Profile and color to be selected by Architect from manufacturer's standard collection.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Examine surfaces to receive tile work and conditions under which tile will be installed.
- B. Do not proceed with tile work until surfaces and conditions comply with requirements indicated in reference tile installation standard and manufacturer's printed instructions.

3.2 PREPARATION OF EXISTING FLOOR SURFACES

- A. Remove existing floor coverings that are not sound, solid, well bonded, clean and free of dust, wax, grease, sealers, and other contaminants that may reduce or prevent adhesion.
- B. Do not install tile over cushioned vinyl flooring.

3.3 GROUTING

- A. Grout joints in accordance with manufacturer's instructions and ANSI A108.10.
- B. Clean sanding water, dust, and foreign substances from joints to be grouted.
- C. Clean and dry tile surfaces.
- D. After grouting, remove all grout residue promptly.

3.4 CLEANING

- A. Clean excess mortar from surfaces with water as work progresses while mortar is fresh and before it hardens.
- B. Remove grout haze promptly; do not use acids.

3.5 PROTECTION

- A. Floors: Protect from all traffic for at least 72 hours after installation.
 - 1. Do not step on floor for at least 24 hours; if traffic is unavoidable after that, use plywood stepping boards.
 - 2. Protect from heavy traffic for at least 7 days after installation.

3. When fast-setting materials are used to allow faster occupancy, comply with the manufacturer's recommendations.
- B. Walls: Protect from impact, vibration and heavy hammering on adjacent and opposite walls for at least 14 days after installation, unless manufacturer's instructions allow a shorter period.
- C. Protect from food products and chemicals which can cause staining for at least 14 days.
- D. Protect from freezing and total water immersion for at least 21 days after installation.

END OF SECTION 093000

SECTION 093013 - CERAMIC TILING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Ceramic mosaic tile.
 - 2. Quarry tile.
 - 3. Pressed floor tile.
 - 4. Porcelain tile.
 - 5. Glazed wall tile.
 - 6. Glass Tile.
 - 7. Stone thresholds.
 - 8. Tile backing panels.
 - 9. Waterproof membrane for thinset applications.

1.3 DEFINITIONS

- A. General: Definitions in the ANSI A108 series of tile installation standards and in ANSI A137.1 apply to Work of this Section unless otherwise specified.
- B. ANSI A108 Series: ANSI A108.01, ANSI A108.02, ANSI A108.1A, ANSI A108.1B, ANSI A108.1C, ANSI A108.4, ANSI A108.5, ANSI A108.6, ANSI A108.8, ANSI A108.9, ANSI A108.10, ANSI A108.11, ANSI A108.12, ANSI A108.13, ANSI A108.14, ANSI A108.15, ANSI A108.16, and ANSI A108.17, which are contained in its "Specifications for Installation of Ceramic Tile."
- C. Module Size: Actual tile size plus joint width indicated.
- D. Face Size: Actual tile size, excluding spacer lugs.

1.4 SUBMITTALS

- A. Product Data: For each type of product indicated.

- B. Shop Drawings: Show locations of each type of tile and tile pattern. Show widths, details, and locations of expansion, contraction, control, and isolation joints in substrates and finished ceramic tile surfaces.
- C. Samples for Initial Selection: For each type of grout indicated and accessories involving color selection.
- D. Samples for Verification:
 - 1. Full-size units of each type and composition of tile and for each color and finish required. For ceramic mosaic tile in color blend patterns, provide full sheets of each color blend.
 - 2. Full-size units of each type of trim and accessory for each color and finish required.
 - 3. Ceramic thresholds in 6-inch lengths.

1.5 QUALITY ASSURANCE

- A. Supplier Qualifications: A firm experienced in supplying products similar to those indicated for the Project and with a record of successful in-service performance.
- B. Source Limitations for Ceramic Tile. Obtain each type of ceramic product through one source from a single producer.
 - 1. Obtain each variety of ceramic, regardless of product, size, and finish, from same location in a single quarry with resources to provide materials of consistent quality in appearance and physical properties.
- C. Source Limitations for Setting and Grouting Materials: Obtain each type of manufactured product through one source from a single manufacturer.
 - 1. For aggregates added at Project site, obtain from one source or producer.
- D. Source Limitations for Other Products: Obtain each of the following products specified in this Section through one source from a single manufacturer:
 - 1. Joint sealants.
 - 2. Cementitious backer units.
 - 3. Metal edge strips.
- E. Mockups: Build mockups to verify selections made under sample submittals and to demonstrate aesthetic effects.
 - 1. Build mockup of[each type of floor tile installation.
 - 2. Build mockup of[each type of wall tile installation.
 - 3. Approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver materials to Project site in factory wrappings, clearly labeled with identification of manufacturer and lot number.
- B. Store tile and cementitious materials on elevated platforms, under cover, and in a dry location.
- C. Store aggregates where grading and other required characteristics can be maintained and contamination avoided.
- D. Store liquid latexes and emulsion adhesives in unopened containers and protected from freezing.

1.7 PROJECT CONDITIONS

- A. Environmental Limitations: Do not install ceramic tile until construction in spaces is complete and ambient temperature and humidity conditions are maintained at the levels indicated in referenced standards and manufacturer's written instructions.

1.8 SEQUENCING AND SCHEDULING

- A. Sequence ceramic tile installation with other work to minimize possibility of damage and soiling during remainder of construction period.
- B. Install ceramic tile and accessories only after other finishing operations, including painting, have been completed.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Source Limitations for Tile: Obtain tile of each type from single source or producer.
 - 1. Obtain tile of each type and color or finish from same production run and of consistent quality in appearance and physical properties for each contiguous area.
- B. Source Limitations for Setting and Grouting Materials: Obtain ingredients of a uniform quality for each mortar, adhesive, and grout component from single manufacturer and each aggregate from single source or producer.
 - 1. Obtain setting and grouting materials, except for unmodified Portland cement and aggregate, from single manufacturer.
 - 2. Obtain waterproof membrane and crack isolation membrane, except for sheet products, from manufacturer of setting and grouting materials.

- C. Source Limitations for Other Products: Obtain each of the following products specified in this Section from a single manufacturer:
 - 1. Stone thresholds.
 - 2. Waterproof membrane.
 - 3. Crack isolation membrane.
 - 4. Cementitious backer units. Copy and re-edit paragraph and subparagraphs below for each stone tile type required. Delete inapplicable subparagraphs. Insert number to complete designation for each stone tile type retained below. Use this designation on Drawings to show where each stone tile type is required.

- D. Ceramic Threshold Installation[**STHI-<#>**]: Interior installation on cementitious backer units over wood; thin-set mortar; TCA F144 and ANSI A108.5.
 - 1. Ceramic Threshold Type: **<Insert ceramic threshold type designation.>**
 - 2. Thin-Set Mortar: **[Dry-set]** **[Latex-]** portland cement mortar.

2.2 PRODUCTS, GENERAL

- A. ANSI Ceramic Tile Standard: Provide tile that complies with ANSI A137.1 for types, compositions, and other characteristics indicated.
- B. ANSI Standards for Tile Installation Materials: Provide materials complying with ANSI A108.02, ANSI standards referenced in other Part 2 articles, ANSI standards referenced by TCNA installation methods specified in tile installation schedules, and other requirements specified.
- C. Factory Blending: For tile exhibiting color variations within ranges, blend tile in factory and package so tile units taken from one package show same range in colors as those taken from other packages and match approved Samples.
- D. Mounting: For factory-mounted tile, provide back- or edge-mounted tile assemblies as standard with manufacturer unless otherwise indicated.
 - 1. Where tile is indicated for installation on exteriors or in wet areas, do not use back- or edge-mounted tile assemblies unless tile manufacturer specifies in writing that this type of mounting is suitable for installation indicated and has a record of successful in-service performance.

2.3 TILE PRODUCTS

- A. Ceramic Tile Type: Factory-mounted glazed ceramic mosaic tile.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. American Olean; a division of Dal-Tile Corporation.
 - b. Crossville, Inc.
 - c. Daltile.
 - 2. Composition: **[Porcelain]** **[Impervious natural clay or porcelain]** **[Vitreous or impervious natural clay or porcelain]**.
 - 3. Certification: Porcelain tile certified by the Porcelain Tile Certification Agency.

4. Module Size: <Insert dimensions>.
5. Thickness: 1/4 inch (6.4 mm).
6. Face: [Plain] [Pattern of design indicated,] with cushion edges.
7. Surface: [Smooth, without] [Slip resistant, with] abrasive admixture.
8. Dynamic Coefficient of Friction: Not less than 0.42.
9. Finish: <Insert description> glaze.
10. Tile Color and Pattern: <Insert color and pattern>.
11. Grout Color: <Insert color>.
12. Trim Units: Coordinated with sizes and coursing of adjoining flat tile where applicable and matching characteristics of adjoining flat tile. Provide shapes as follows, selected from manufacturer's standard shapes:
 - a. Base Cove: Cove, module size <Insert dimensions>.
 - b. Base Cap for Portland Cement Mortar Installations: Bead (bullnose), module size <Insert dimensions>.
 - c. Base Cap for Thinset Mortar Installations: Surface bullnose, module size Insert dimensions.
 - d. Wainscot Cap for Portland Cement Mortar Installations: Bead (bullnose), module size <Insert dimensions>.
 - e. Wainscot Cap for Thinset Mortar Installations: Surface bullnose, module size <Insert dimensions>.
 - f. Wainscot Cap for Flush Conditions: Regular flat tile for conditions where tile wainscot is shown flush with wall surface above it, same size as adjoining flat tile.
 - g. External Corners for Portland Cement Mortar Installations: Bead (bullnose), module size <Insert dimensions>.
 - h. External Corners for Thinset Mortar Installations: Surface bullnose, module size <Insert dimensions>.
 - i. Internal Corners: Cove, module size <Insert dimensions>.
 - j. Internal Corners: Field-buttet square corners. For coved base and cap, use angle pieces designed to fit with stretcher shapes.

B. Ceramic Tile Type: Glazed square-edged quarry tile.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. American Olean; a division of Dal-Tile Corporation.
 - b. Daltile.
 - c. Florida Brick & Clay Company Inc.
 - d. Quarry Tile Co.
 - e. Summitville Tiles, Inc.
2. Face Size: <Insert dimensions>.
3. Thickness: [3/8 inch (9.5 mm)] [1/2 inch (12.7 mm)] [3/4 inch (19 mm)].
4. Wearing Surface: [Nonabrasive, smooth] [Abrasive aggregate embedded in surface].
5. Dynamic Coefficient of Friction: Not less than 0.42.
6. Finish: <Insert description> glaze.
7. Tile Color and Pattern: <Insert color and pattern>.
8. Grout Color: <Insert color>.

9. Trim Units: Coordinated with sizes and coursing of adjoining flat tile where applicable and matching characteristics of adjoining flat tile. Provide shapes as follows, selected from manufacturer's standard shapes:

- a. Base: Coved with surface bullnose top edge, face size <Insert dimensions>.
- b. Wainscot Cap: Surface bullnose, face size <Insert dimensions>.
- c. Wainscot Cap for Flush Conditions: Regular flat tile for conditions where tile wainscot is shown flush with wall surface above it, same size as adjoining flat tile.

C. Ceramic Tile Type: Glazed matte porcelain tile.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Florim USA
- b. American Olean; a division of Dal-Tile Corporation.
- c. Crossville, Inc.
- d. Daltile.

2. Certification: Tile certified by the Porcelain Tile Certification Agency.

3. Face Size: 6" (152 mm) x 36" (914 mm).

4. Face Size Variation: Rectified.

5. Thickness: 5/16" (8 mm).

6. Dynamic Coefficient of Friction: Not less than 0.42.

8. Tile Color, Glaze, and Pattern: Cocoa/Monica, matte glaze.

9. Grout Color: Selected by owner, see submittals.

D. Ceramic Tile Type: Glazed wall tile.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. American Marazzi Tile, Inc.
- b. American Olean; a division of Dal-Tile Corporation.
- c. Daltile.
- d. Florim USA

2. Module Size: <Insert dimensions>.

3. Face Size Variation: Rectified.

4. Thickness: 5/16 inch (8 mm).

5. Finish: [Bright, opaque] [Bright, clear] [Mat, opaque] [Mat, clear] [Semimat, opaque] [Semimat, clear] [Vellum, opaque] [Vellum, clear] [Crystalline] <Insert description> glaze.

7. Tile Color and Pattern: <Insert color and pattern>.

8. Grout Color: Selected by owner, see submittals.

9. Mounting: Factory, back mounted.

10. Trim Units: Coordinated with sizes and coursing of adjoining flat tile where applicable and matching characteristics of adjoining flat tile. Provide shapes as follows, selected from manufacturer's standard shapes:

- a. Base for Portland Cement Mortar Installations: Coved, module size <Insert dimensions>.
- b. Base for Thinset Mortar Installations: Straight, module size <Insert dimensions>.
- c. Wainscot Cap for Portland Cement Mortar Installations: Bullnose cap, module size <Insert dimensions>.

- d. Wainscot Cap for Thinset Mortar Installations: Surface bullnose, module size <Insert dimensions>.
- e. Wainscot Cap for Flush Conditions: Regular flat tile for conditions where tile wainscot is shown flush with wall surface above it, same size as adjoining flat tile.
- f. External Corners for Portland Cement Mortar Installations: Bullnose shape with radius of at least 3/4 inch (19 mm) unless otherwise indicated.
- g. External Corners for Thinset Mortar Installations: Surface bullnose, same size as adjoining flat tile.
- h. Internal Corners: Field-buttet square corners. For coved base and cap use angle pieces designed to fit with stretcher shapes.

2.4 THRESHOLDS

A. General: Fabricate to sizes and profiles indicated or required to provide transition between adjacent floor finishes.

- 1. Bevel edges at 1:2 slope, with lower edge of bevel aligned with or up to 1/16 inch (1.5 mm) above adjacent floor surface. Finish bevel to match top surface of threshold. Limit height of threshold to 1/2 inch (12.7 mm) or less above adjacent floor surface.

B. Granite Thresholds: ASTM C 615/C 615M, with [polished] [honed] finish.

- 1. Description: Uniform, [fine] [medium]-grained, <Insert color> stone without veining.
- 2. Description: Match Architect's sample.

C. Marble Thresholds: ASTM C 503/C 503M, with a minimum abrasion resistance of [10] [12] according to ASTM C 1353 or ASTM C 241/C 241M and with honed finish.

- 1. Description: Uniform, fine- to medium-grained white stone with gray veining.
- 2. Description: Match Architect's sample.

2.6 TILE BACKING PANELS

A. Cementitious Backer Units: ANSI A118.9 or ASTM C 1325, Type A, in maximum lengths available to minimize end-to-end butt joints.

- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. C-Cure.
 - b. Custom Building Products.
 - c. Georgia-Pacific Building Products.
- 2. Thickness: 5/8 inch (15.9 mm).

2.7 WATERPROOF MEMBRANE

A. General: Manufacturer's standard product that complies with ANSI A118.10 and is recommended by the manufacturer for the application indicated. Include reinforcement and accessories recommended by manufacturer.

B. Fabric-Reinforced, Modified-Bituminous Sheet: Self-adhering, SBS-modified-bituminous sheet with fabric reinforcement facing; 0.040-inch (1 -mm) nominal thickness.

- 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Boiard Products Corporation; a QEP company.

2.8 CRACK ISOLATION MEMBRANE

- A. General: Manufacturer's standard product that complies with ANSI A118.12 for high performance and is recommended by the manufacturer for the application indicated. Include reinforcement and accessories recommended by manufacturer.
- B. Latex-Portland Cement Crack-Resistant Mortar: Flexible mortar consisting of cement-based mix and latex additive.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. ARDEX Americas.
 - b. Boiardi Products Corporation; a QEP company.
 - c. C-Cure.
 - d. MAPEI Corporation.

2.9 SETTING MATERIALS

- A. Portland Cement Mortar (Thickset) Installation Materials: ANSI A108.02.
1. Cleavage Membrane: Asphalt felt, ASTM D 226/D 226M, Type I (No. 15); or polyethylene sheeting, ASTM D 4397, 4.0 mils (0.1 mm) thick.
 2. Reinforcing Wire Fabric: Galvanized, welded-wire fabric, 2 by 2 inches (50.8 by 50.8 mm) by 0.062-inch (1.57-mm) diameter; comply with ASTM A 185/A 185M and ASTM A 82/A 82M, except for minimum wire size.
 3. Expanded Metal Lath: Diamond-mesh lath complying with ASTM C 847.
 - a. Base Metal and Finish for Interior Applications: Uncoated or zinc-coated (galvanized) steel sheet, with uncoated steel sheet painted after fabrication into lath.
 - b. Base Metal and Finish for Exterior Applications: Zinc-coated (galvanized) steel sheet.
 - c. Configuration over Studs and Furring: Flat.
 - d. Configuration over Solid Surfaces: Self-furring.
 - e. Weight: 2.5 lb/sq. yd. (1.4 kg/sq. m).
- B. Dry-Set Portland Cement Mortar (Thinset): ANSI A118.1.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Boiardi Products Corporation; a QEP company.
 - b. Bonsal American, an Oldcastle company.
 - c. Bostik, Inc.
 - d. Laticrete International, Inc.
 - e. MAPEI Corporation.
 2. For wall applications, provide mortar that complies with requirements for nonsagging mortar in addition to the other requirements in ANSI A118.1.
- C. Latex-Portland Cement Mortar (Thinset): ANSI A118.4.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Bostik, Inc.
 - b. Custom Building Products.

- c. Laticrete International, Inc.
- d. MAPEI Corporation.

- 2. Provide prepackaged, dry-mortar mix containing dry, redispersible, vinyl acetate or acrylic additive to which only water must be added at Project site.
- 3. For wall applications, provide mortar that complies with requirements for nonsagging mortar in addition to the other requirements in ANSI A118.4.

2.10 GROUT MATERIALS

A. Sand-Portland Cement Grout: ANSI A108.10, consisting of white or gray cement and white or colored aggregate as required to produce color indicated.

B. Standard Cement Grout: ANSI A118.6.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Bostik, Inc.
- b. Laticrete International, Inc.
- c. MAPEI Corporation.

C. High-Performance Tile Grout: ANSI A118.7.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Bostik, Inc.
- b. Laticrete International, Inc.
- c. MAPEI Corporation.

2. Polymer Type: Ethylene vinyl acetate or acrylic additive, in dry, redispersible form, prepackaged with other dry ingredients.

D. Water-Cleanable Epoxy Grout: ANSI A118.3, with a VOC content of 65 g/L or less.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Boiardi Products Corporation; a QEP company.
- b. Bostik, Inc.
- c. Laticrete International, Inc.
- d. MAPEI Corporation.

2.11 MISCELLANEOUS MATERIALS

A. Trowelable Underlayments and Patching Compounds: Latex-modified, portland cement-based formulation provided or approved by manufacturer of tile-setting materials for installations indicated.

B. Vapor-Retarder Membrane: Polyethylene sheeting, ASTM D 4397, 4.0 mils (0.1 mm) thick.

C. Tile Cleaner: A neutral cleaner capable of removing soil and residue without harming tile and grout surfaces, specifically approved for materials and installations indicated by tile and grout manufacturers.

D. Grout Sealer: Manufacturer's standard product for sealing grout joints and that does not change color or appearance of grout.

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- a. Bonsal American, an Oldcastle company.
- b. Custom Building Products.
- c. Southern Grouts & Mortars, Inc.

2. Grout sealers shall comply with requirements of FloorScore certification.

2.12 MIXING MORTARS AND GROUT

A. Mix mortars and grouts to comply with referenced standards and mortar and grout manufacturers' written instructions.

B. Add materials, water, and additives in accurate proportions.

C. Obtain and use type of mixing equipment, mixer speeds, mixing containers, mixing time, and other procedures to produce mortars and grouts of uniform quality with optimum performance characteristics for installations indicated.

PART 3 - EXECUTION

3.1 EXAMINATION

A. Examine substrates, areas, and conditions where tile will be installed, with Installer present, for compliance with requirements for installation tolerances and other conditions affecting performance of the Work.

1. Verify that substrates for setting tile are firm; dry; clean; free of coatings that are incompatible with tile-setting materials, including curing compounds and other substances that contain soap, wax, oil, or silicone; and comply with flatness tolerances required by ANSI A108.01 for installations indicated.

2. Verify that concrete substrates for tile floors installed with bonded mortar bed or thin set mortar comply with surface finish requirements in ANSI A108.01 for installations indicated.

a. Verify that surfaces that received a steel trowel finish have been mechanically scarified.

b. Verify that protrusions, bumps, and ridges have been removed by sanding or grinding.

3. Verify that installation of grounds, anchors, recessed frames, electrical and mechanical units of work, and similar items located in or behind tile has been completed.

4. Verify that joints and cracks in tile substrates are coordinated with tile joint locations; if not coordinated, adjust joint locations in consultation with Architect.

B. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

A. Fill cracks, holes, and depressions in concrete substrates for tile floors installed with thin set mortar with trowelable leveling and patching compound specifically recommended by tile-setting material manufacturer.

B. Where indicated, prepare substrates to receive waterproofing by applying a reinforced mortar bed that complies with ANSI A108.1A and is sloped 1/4 inch per foot (1:50) toward drains.

C. Blending: For tile exhibiting color variations, verify that tile has been factory blended and packaged so tile units taken from one package show same range of colors as those taken from other packages and match approved Samples. If not factory blended, either return to manufacturer or blend tiles at Project site before installing.

3.3 CERAMIC TILE INSTALLATION

A. Comply with TCNA's "Handbook for Ceramic, Glass, and Stone Tile Installation" for TCNA installation methods specified in tile installation schedules. Comply with parts of the ANSI A108 series "Specifications for Installation of Ceramic Tile" that are referenced in TCNA installation methods, specified in tile installation schedules, and apply to types of setting and grouting materials used.

1. For the following installations, follow procedures in the ANSI A108 series of tile installation standards for providing 95 percent mortar coverage:

- a. Exterior tile floors.
- b. Tile floors in wet areas.
- c. Tile swimming pool decks.
- d. Tile floors in laundries.
- e. Tile floors consisting of tiles 8 by 8 inches (200 by 200 mm) or larger.
- f. Tile floors consisting of rib-backed tiles.

B. Extend tile work into recesses and under or behind equipment and fixtures to form complete covering without interruptions unless otherwise indicated. Terminate work neatly at obstructions, edges, and corners without disrupting pattern or joint alignments.

C. Accurately form intersections and returns. Perform cutting and drilling of tile without marring visible surfaces. Carefully grind cut edges of tile abutting trim, finish, or built-in items for straight aligned joints. Fit tile closely to electrical outlets, piping, fixtures, and other penetrations so plates, collars, or covers overlap tile.

D. Provide manufacturer's standard trim shapes where necessary to eliminate exposed tile edges.

E. Where accent tile differs in thickness from field tile, vary setting-bed thickness so that tiles are flush.

F. Jointing Pattern: Lay tile in grid pattern unless otherwise indicated. Lay out tile work and center tile fields in both directions in each space or on each wall area. Lay out tile work to minimize the use of pieces that are less than half of a tile. Provide uniform joint widths unless otherwise indicated.

1. For tile mounted in sheets, make joints between tile sheets same width as joints within tile sheets so joints between sheets are not apparent in finished work.

2. Where adjoining tiles on floor, base, walls, or trim are specified or indicated to be same size, align joints.

3. Where tiles are specified or indicated to be whole integer multiples of adjoining tiles on floor, base, walls, or trim, align joints unless otherwise indicated.

G. Joint Widths: Unless otherwise indicated, install tile with the following joint widths:

1. Ceramic Mosaic Tile: [1/16 inch (1.6 mm)] [1/8 inch (3.2 mm)].
2. Quarry Tile: [1/4 inch (6.4 mm)] [3/8 inch (9.5 mm)].
3. Pressed Floor Tile: [1/4 inch (6.4 mm)] [3/8 inch (9.5 mm)].
4. Glazed Wall Tile: [1/16 inch (1.6 mm)] [1/8 inch (3.2 mm)].
5. Porcelain Tile: [1/4 inch (6.4 mm)] [3/8 inch (9.5 mm)].

H. Lay out tile wainscots to dimensions indicated or to next full tile beyond dimensions indicated.

I. Expansion Joints: Provide expansion joints and other sealant-filled joints, including control, contraction, and isolation joints, where indicated. Form joints during installation of setting materials, mortar beds, and tile. Do not saw-cut joints after installing tiles.

1. Where joints occur in concrete substrates, locate joints in tile surfaces directly above them.

J. Stone Thresholds: Install stone thresholds in same type of setting bed as adjacent floor unless otherwise indicated.

1. At locations where mortar bed (thickset) would otherwise be exposed above adjacent floor finishes, set thresholds in latex-Portland cement mortar (thin set).
2. Do not extend cleavage membrane waterproofing or crack isolation membrane under thresholds set in dry-set Portland cement or latex-Portland cement mortar. Fill joints between such thresholds and adjoining tile set on cleavage membrane waterproofing or crack isolation membrane with elastomeric sealant.

K. Grout Sealer: Apply grout sealer to cementitious grout joints in tile floors according to grout-sealer manufacturer's written instructions. As soon as grout sealer has penetrated grout joints, remove excess sealer and sealer from tile faces by wiping with soft cloth.

3.4 GLASS TILE INSTALLATION

A. Comply with TCNA's "Handbook for Ceramic, Glass, and Stone Tile Installation" for TCNA installation methods specified in tile installation schedules. Comply with parts of the ANSI A108 series "Specifications for Installation of Ceramic Tile" that are referenced in TCNA installation methods, specified in tile installation schedules, and apply to types of setting and grouting materials used.

B. Extend tile work into recesses and under or behind equipment and fixtures to form complete covering without interruptions unless otherwise indicated. Terminate work neatly at obstructions, edges, and corners without disrupting pattern or joint alignments.

C. Accurately form intersections and returns. Perform cutting and drilling of tile without marring visible surfaces. Carefully grind cut edges of tile abutting trim, finish, or built-in items for straight aligned joints. Fit tile closely to electrical outlets, piping, fixtures, and other penetrations so plates, collars, or covers overlap tile.

D. Where accent tile differs in thickness from field tile, vary setting-bed thickness so that tiles are flush.

E. Jointing Pattern: Lay tile in grid pattern unless otherwise indicated. Lay out tile work and center tile fields in both directions in each space or on each wall area. Lay out tile work to minimize the use of pieces that are less than half of a tile. Provide uniform joint widths unless otherwise indicated.

1. For tile mounted in sheets, make joints between tile sheets same width as joints within tile sheets so joints between sheets are not apparent in finished work.
- F. Joint Widths: Unless otherwise indicated, install tile with the following joint widths:
 1. Large Format Glass Tile: [1/16 inch (1.6 mm)] [1/8 inch (3.2 mm)].
 2. Mosaic Glass Tile: [1/16 inch (1.6 mm)] [1/8 inch (3.2 mm)].
 3. Miniature Mosaic Glass Tile: [1/16 inch (1.6 mm)] [1/8 inch (3.2 mm)].
- G. Lay out tile wainscots to dimensions indicated or to next full tile beyond dimensions indicated.
- H. Expansion Joints: Provide expansion joints and other sealant-filled joints, including control, contraction, and isolation joints, where indicated. Form joints during installation of setting materials, mortar beds, and tile. Do not saw-cut joints after installing tiles.
 1. Where joints occur in concrete substrates, locate joints in tile surfaces directly above them.
- I. Metal Edge Strips: Install at locations indicated.
- J. Grout Sealer: Apply grout sealer to grout joints according to grout-sealer manufacturer's written instructions. As soon as grout sealer has penetrated grout joints, remove excess sealer and sealer from tile faces by wiping with soft cloth.

3.5 TILE BACKING PANEL INSTALLATION

- A. Install panels and treat joints according to ANSI A108.11 and manufacturer's written instructions for type of application indicated.

3.6 WATERPROOFING INSTALLATION

- A. Install waterproofing to comply with ANSI A108.13 and manufacturer's written instructions to produce waterproof membrane of uniform thickness that is bonded securely to substrate.
- B. Allow waterproofing to cure and verify by testing that it is watertight before installing tile or setting materials over it.
 1. Testing Agency: Engage a qualified testing agency to inspect substrate conditions, surface preparation, and membrane application, and furnish reports to Architect.
 2. Flood Testing: Flood test each waterproofed area for leaks, according to recommendations in ASTM D 5957, after completing waterproofing installation but before overlying construction is placed. Install temporary containment assemblies, plug or dam drains, and flood with potable water.

- a. Flood to an average depth of 2-1/2 inches (65 mm) with a minimum depth of 1 inch (25 mm) and not exceeding a depth of 4 inches (100 mm).
- b. Flood each area for 48 hours.
- c. After flood testing, repair leaks, repeat flood tests, and make further repairs until installations are watertight.

3.7 CRACK ISOLATION MEMBRANE INSTALLATION

- A. Install crack isolation membrane to comply with ANSI A108.17 and manufacturer's written instructions to produce membrane of uniform thickness that is bonded securely to substrate.
- B. Allow crack isolation membrane to cure before installing tile or setting materials over it.

3.8 ADJUSTING AND CLEANING

A. Remove and replace tile that is damaged or that does not match adjoining tile. Provide new matching units, installed as specified and in a manner to eliminate evidence of replacement.

B. Cleaning: On completion of placement and grouting, clean all ceramic tile surfaces so they are free of foreign matter.

1. Remove grout residue from tile as soon as possible.

2. Clean grout smears and haze from tile according to tile and grout manufacturer's written instructions but no sooner than 10 days after installation. Use only cleaners recommended by tile and grout manufacturers and only after determining that cleaners are safe to use by testing on samples of tile and other surfaces to be cleaned. Protect metal surfaces and plumbing fixtures from effects of cleaning. Flush surfaces with clean water before and after cleaning.

3.9 PROTECTION

A. Protect installed tile work with kraft paper or other heavy covering during construction period to prevent staining, damage, and wear. If recommended by tile manufacturer, apply coat of neutral protective cleaner to completed tile walls and floors.

B. Prohibit foot and wheel traffic from tiled floors for at least seven days after grouting is completed.

C. Before final inspection, remove protective coverings and rinse neutral protective cleaner from tile surfaces.

END OF SECTION 093013

SECTION 096513

RESILIENT BASE AND ACCESSORIES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Resilient base.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product.

- B. Samples: For each exposed product and for each color and texture specified, not less than 12 inches (300 mm) long.

PART 2 - PRODUCTS

2.1 THERMOPLASTIC-RUBBER BASE

A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

1. AB; American Biltrite.
2. Allstate Rubber Corp.
3. Armstrong World Industries, Inc.
4. Burke Mercer Flooring Products, Division of Burke Industries Inc.
5. Flexco.
6. Johnsonite; A Tarkett Company.
7. Mondo Rubber International, Inc.
8. Nora Systems, Inc.
9. Roppe Corporation, USA.
10. VPI, LLC, Floor Products Division.

B. Product Standard: ASTM F 1861, Type TP (rubber).

1. Group: I (solid, homogeneous).
2. Style and Location:
 - a. Style B, Cove: Provide in areas with resilient flooring.

C. Thickness: 0.125 inch (3.2 mm).

- D. Height: 4 inches (102 mm).
- E. Lengths: Cut lengths 48 inches (1219 mm) long or coils in manufacturer's standard length.
- F. Outside Corners: Preformed.
- G. Inside Corners: Preformed.
- H. Colors: As selected by Architect from full range of industry colors.

2.2 INSTALLATION MATERIALS

- A. Trowelable Leveling and Patching Compounds: Latex-modified, portland cement based or blended hydraulic-cement-based formulation provided or approved by resilient-product manufacturer for applications indicated.
- B. Adhesives: Water-resistant type recommended by resilient-product manufacturer for resilient products and substrate conditions indicated.
 - 1. Adhesives shall have a VOC content of 50 g/L or less.
 - 2. Adhesives shall comply with the testing and product requirements of the California Department of Public Health's "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers."

PART 3 - EXECUTION

3.1 PREPARATION

- A. Prepare substrates according to manufacturer's written instructions to ensure adhesion of resilient products.
- B. Concrete Substrates for Resilient Stair Accessories: Prepare horizontal surfaces according to ASTM F 710.
 - 1. Verify that substrates are dry and free of curing compounds, sealers, and hardeners.
 - 2. Remove substrate coatings and other substances that are incompatible with adhesives and that contain soap, wax, oil, or silicone, using mechanical methods recommended by manufacturer. Do not use solvents.
 - 3. Alkalinity and Adhesion Testing: Perform tests recommended by manufacturer. Proceed with installation only after substrate alkalinity falls within range on pH scale recommended by manufacturer in writing, but not less than 5 or more than 10 pH.

4. Moisture Testing: Proceed with installation only after substrates pass testing according to manufacturer's written recommendations, but not less stringent than the following:
 - a. Perform anhydrous calcium chloride test according to ASTM F 1869. Proceed with installation only after substrates have maximum moisture-vapor-emission rate of 3 lb of water/1000 sq. ft. (1.36 kg of water/92.9 sq. m) in 24 hours.
 - b. Perform relative humidity test using in situ probes according to ASTM F 2170. Proceed with installation only after substrates have maximum 75 percent relative humidity level.
- C. Fill cracks, holes, and depressions in substrates with trowelable leveling and patching compound; remove bumps and ridges to produce a uniform and smooth substrate.
- D. Do not install resilient products until they are the same temperature as the space where they are to be installed.
- E. Immediately before installation, sweep and vacuum clean substrates to be covered by resilient products.

3.2 RESILIENT BASE INSTALLATION

- A. Comply with manufacturer's written instructions for installing resilient base.
- B. Apply resilient base to walls, columns, pilasters, casework and cabinets in toe spaces, and other permanent fixtures in rooms and areas where base is required.
- C. Install resilient base in lengths as long as practical without gaps at seams and with tops of adjacent pieces aligned.
- D. Tightly adhere resilient base to substrate throughout length of each piece, with base in continuous contact with horizontal and vertical substrates.
- E. Do not stretch resilient base during installation.
- F. On masonry surfaces or other similar irregular substrates, fill voids along top edge of resilient base with manufacturer's recommended adhesive filler material.
- G. Preformed Corners: Install preformed corners before installing straight pieces.

3.3 RESILIENT ACCESSORY INSTALLATION

- A. Comply with manufacturer's written instructions for installing resilient accessories.
- B. Resilient Stair Accessories:

1. Use stair-tread-nose filler to fill nosing substrates that do not conform to tread contours.
 2. Tightly adhere to substrates throughout length of each piece.
 3. For treads installed as separate, equal-length units, install to produce a flush joint between units.
- C. Resilient Molding Accessories: Butt to adjacent materials and tightly adhere to substrates throughout length of each piece. Install reducer strips at edges of floor covering that would otherwise be exposed.

3.4 CLEANING AND PROTECTION

- A. Comply with manufacturer's written instructions for cleaning and protecting resilient products.

END OF SECTION 096513

SECTION 099113

EXTERIOR COMMERCIAL PAINTS AND COATINGS

Part 1 GENERAL

1.1 SECTION INCLUDES

- A Exterior paint and coating systems.

1.2 SUBMITTALS

- A Submit under provisions of Section 01 33 00, Submittal Procedures.
- B Product Data: Manufacturer's data sheets on each paint and coating product should include:
 - 1 Product characteristics
 - 2 Surface preparation instructions and recommendations
 - 3 Primer requirements and finish specification
 - 4 Storage and handling requirements and recommendations
 - 5 Application methods
 - 6 Clean-up Information
- C Selection Samples: Submit a complete set of color chips that represent the full range of manufacturer's color samples available.
- D Coating Maintenance Manual: upon conclusion of the project, the Contractor or paint manufacture/supplier shall furnish a coating maintenance manual, such as Sherwin-Williams "Custodian Project Color and Product Information" report or equal. Manual shall include an Area Summary with finish schedule, Area Detail designating where each product/color/finish was used, product data pages, Material Safety Data Sheets, care and cleaning instructions, touch-up procedures, and color samples of each color and finish used.

1.3 DELIVERY, STORAGE, AND HANDLING

- A Delivery: Deliver manufacturer's unopened containers to the work site. Packaging shall bear the manufacturers name, label, and the following list of information:
 - 1 Product name, and type (description)
 - 2 Application & use instructions
 - 3 Surface preparation
 - 4 VOC content
 - 5 Environmental handling

- 6 Batch date
- 7 Color number

- B Storage: Store and dispose of solvent-based materials, and materials used with solvent-based materials, in accordance with requirements of local authorities having jurisdiction.
Store materials in an area that is within the acceptable temperature range, per manufacturer's instructions. Protect from freezing.
- C Handling: Maintain a clean, dry storage area, to prevent contamination or damage to the coatings.

1.4 PROJECT CONDITIONS

Maintain environmental conditions (temperature, humidity, and ventilation) within limits recommended by manufacturer for optimum results. Do not apply coatings under environmental conditions outside manufacturer's absolute limits.

Part 2 PRODUCTS

2.1 MANUFACTURERS

A Basis of Design:

- 1. Benjamin Moore & Co.
- 2. Bennette Paint Mfg. Co., Inc.
- 3. BLP Mobile Paint Manufacturing.
- 4. California Paints.
- 5. ChemRex.
- 6. Cloverdale Paint.
- 7. Color Wheel Paints & Coatings.
- 8. Columbia Paint & Coatings.
- 9. Coronado Paint.
- 10. Davis Paint Company.
- 11. Diamond Vogel Paints.
- 12. Dunn-Edwards Corporation.
- 13. Durant Paints Inc.
- 14. Duron, Inc.
- 15. Envirocoat Technologies Inc.
- 16. Farrell-Calhoun.
- 17. Flex Bon Paints.
- 18. Frazee Paint.
- 19. General Paint.
- 20. Griggs Paint.
- 21. Hallman Lindsay Quality Paints.
- 22. Hirshfield's, Inc.
- 23. ICI Devoe (Canada).
- 24. ICI Paints.
- 25. Insl-x.

26. Iowa Paint Manufacturing Company, Inc.
27. Kelly-Moore Paints.
28. Kryton Canada Corporation.
29. Kwal-Howells Paint.
30. M.A.B. Paints.
31. McCormick Paints.
32. Miller Paint.
33. Mills Paint.
34. Northern Paint.
35. PARA Paints.
36. Parker Paint Mfg. Co. Inc.
37. Porter Paints.
38. PPG Architectural Finishes, Inc.
39. Rodda Paint Co.
40. Sherwin-Williams Company (The).
41. Sico, Inc.
42. Sigma Coatings.
43. Smiland Paint Company.
44. Spectra-Tone.
45. Sterling Paint.
46. Tnemic
47. Tower Paint.
48. Vista Paint.

- B Substitutions: Requests for substitutions will be considered in accordance with provisions of Section 01 60 00 Product Requirements. When submitting request for substitution, provide complete product data specified above under Submittals, for each substitute product.

2.2 APPLICATIONS/SCOPE

- A Use this article to define the scope of painting if not fully defined in a Finish Schedule or on the drawings. This article must be carefully edited to reflect the surfaces actually found on the project. In some cases, it may be enough to use the first paragraph that says, in effect, "paint everything" along with a list of items not to paint, without exhaustively defining all the different surfaces and items that must be painted.
- B If the project involves repainting some but not all existing painted surfaces, be sure to indicate the extent of the repainting.
- C The descriptions of each system can also be used to further refine the definition of what is to be painted, stained, or clear finished.
- D Surfaces to Be Coated:

Concrete: Cementitious Siding, Flexboard, Transite, and Shingles (Non-Roof)
Masonry: Concrete Masonry Units, Cinder or Concrete Block
Concrete: Concrete Floors, Patios, Porches, Steps & Platforms.
Metal: Aluminum/ Galvanized

Metal Ferrous: Misc. Iron, Ornamental Iron,
Wood: Floors, and Platforms
Wood: Siding, Trim, Shutters, Sash, and Misc. Hardboard
Architectural PVC, Plastic, Fiberglass
Drywall: Gypsum Board, and Exterior Drywall
Vinyl: Siding, EIFS, Synthetic Stucco

2.3 SCHEDULE INDEX - EXTERIOR SURFACES (NORMAL EXPOSURE)

- A. CONCRETE - (Cementitious Siding, Flexboard, Transite, Shingles (Non-Roof))
 - 1. Latex Systems
 - 2. Elastomeric System
 - 3. Textured Elastomeric System
 - 4. Textured & Smooth Systems
 - 5. Stain System
 - 6. Clear Water Repellant
- B. MASONRY - (Concrete Masonry Units Cinder or Concrete Block)
 - 1. Latex Systems
 - 2. Elastomeric System
 - 3. Textured Elastomeric System
 - 4. Textured & Smooth Systems
 - 5. Stain System
 - 6. Clear Water Repellant
- C. CONCRETE - (Concrete Floors, Patios, Porches, Steps & Platforms)
 - 1. Acrylic Water-Based System
- D. METAL - Aluminum, Galvanized
 - 1. Latex Systems
- E. METAL - Ferrous (Misc. Iron, Ornamental Iron, Structural Iron & Steel)
 - 1. Latex Systems
- F. WOOD - Decks, Floors, Platforms, non-vehicular
 - 1. Acrylic System
 - 2. Stain
- G. WOOD - (Siding, Trim, Shutters, Sashes, Misc., Hardboard)
 - 1. Latex Systems
 - 2. Stain - Water Reducible Systems
- H. ARCHITECTURAL PVC, PLASTIC, FIBERGLASS
 - 1. Latex Systems
- I. DRYWALL - (Gypsum Board, Exterior Drywall)
 - 1. Latex Systems
- J. VINYL SIDING, EIFS, Synthetic Stucco
 - 1. Latex Systems

2.3 SCHEDULE

- A. CONCRETE - (Cementitious Siding, Flexboard, Transite Board, Shingles (Non-Roof), Common Brick, Stucco, Tilt-up, Precast, and Poured-in-place Cement)
 - 1. Latex Systems
 - a. Gloss Finish
 - 1st Coat: S-W Loxon® Concrete & Masonry Primer Sealer, A24W8300
(8.0 mils wet, 3.2 dry)
 - 2nd Coat: S-W A-100® Exterior Latex Gloss, A8 Series
 - 3rd Coat: S-W A-100 Exterior Latex Gloss, A8 Series

(4.0 mils wet, 1.3 mils dry per coat)

Early Moisture Resistant Finish

1st Coat: S-W Loxon Concrete & Masonry Primer Sealer, A24W8300
(8.0 mils wet, 3.2 dry)

2nd Coat: S-W Resilience® Latex Gloss, K44 Series

3rd Coat: S-W Resilience Latex Gloss, K44 Series
(4.0 mils wet, 1.6 mils dry per coat)

b. Semi-Gloss Finish

1st Coat: S-W Loxon Concrete & Masonry Primer Sealer, A24W8300
(8.0 mils wet, 3.2 mils dry)

2nd Coat: S-W Solo® Acrylic Semi-Gloss, A76 Series

3rd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
(4.0 mils wet, 1.5 mils dry per coat)

c. Satin Finish

1st Coat: S-W Loxon Concrete & Masonry Primer Sealer, A24W8300
(8.0 mils wet, 3.2 dry)

2nd Coat: S-W A-100 Exterior Latex Satin, A82 Series

3rd Coat: S-W A-100 Exterior Latex Satin, A82 Series
(4.0 mils wet, 1.5 mils dry per coat)

Early Moisture Resistant Finish

1st Coat: S-W Loxon Concrete & Masonry Primer Sealer, A24W8300
(8.0 mils wet, 3.2 mils dry)

2nd Coat: S-W Resilience Latex Satin, K43 Series

3rd Coat: S-W Resilience Latex Satin, K43 Series
(4.0 mils wet, 1.52 mils dry per coat)

d. Low Sheen Finish

1st Coat: S-W Loxon Concrete & Masonry Primer Sealer, A24W8300
(8.0 mils wet, 3.2 dry)

2nd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series

3rd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
(4.0 mils wet, 1.5 mils dry per coat)

e. Flat Finish

1st Coat: S-W Loxon Concrete & Masonry Primer Sealer, A24W8300
(8.0 mils wet, 3.2 mils dry)

2nd Coat: S-W A-100 Exterior Latex Flat, A6 Series

3rd Coat: S-W A-100 Exterior Latex Flat, A6 Series
(4.0 mils wet, 1.2 mils dry per coat)

A. CONCRETE - (Cementitious Siding, Flexboard, Transite Board, Shingles (Non-Roof),
Common Brick, Stucco, Tilt-up, Precast, and Poured-in-place Cement) (Cont.)

1. Latex Systems

e. Flat Finish

Early Moisture Resistant Finish

1st Coat: S-W Loxon Concrete & Masonry Primer Sealer, A24W8300

- (8.0 mils wet, 3.2 mils dry)
 - 2nd Coat: S-W Resilience Latex Flat, K42 Series
 - 3rd Coat: S-W Resilience Latex Flat, K42 Series
(4.0 mils wet, 1.56 mils dry per coat)
 - High Build Coating
 - 1st Coat: S-W Loxon XP, A24-1400 Series
(14.0 mils wet; 6.4 mils dry per coat)
- 2. Elastomeric System (not including; cementitious siding, Flexboard, Transite board, shingles (Non-Roof))
 - a. Flat Finish
 - 1st Coat: S-W Loxon Concrete & Masonry Primer Sealer, A24W8300
(8.0 mils wet, 3.2 mils dry)
 - 2nd Coat: S-W ConFlex XL Elastomeric High Build Coating, A5-400 Series
 - 3rd Coat: S-W ConFlex XL Elastomeric High Build Coating, A5-400 Series
(16.0 mils wet, 7.5 mils dry per coat)
 - Alternate:
 - 1st Coat: S-W Loxon Block Surfacer, A24W200
(50-100 sq ft/gal)
 - 2nd Coat: S-W SherLastic® Elastomeric Coating, A5 Series
 - 3rd Coat: S-W SherLastic Elastomeric Coating, A5 Series
(14.0 mils wet, 6.0 mils dry per coat)
- 3. Textured Elastomeric System
 - a. Textured Finish
 - 1st Coat: S-W Loxon Concrete & Masonry Primer Sealer, A24W8300
(8.0 mils wet, 3.2 mils dry)
 - 2nd Coat: S-W ConFlex XL Elastomeric High Build Coating, A5-400 Series
(16.0 mils wet, 7.5 mils dry per coat)
 - 3rd Coat: S-W ConFlex XL Textured Elastomeric High Build Coating, A5-800
(Fine, Medium, Extra Coarse) (20.0 mils wet, 9.4 mils dry per coat)
- 4. Textured & Smooth Systems
 - a. Textured (Waterbased Finish)
 - 1st Coat: S-W Loxon Block Surfacer, A24W200
(50-100 sq ft/gal)
 - 2nd Coat: S-W UltraCrete Textured Masonry Topcoat, A44-800 Series
(Fine, Medium, Extra Coarse) (50-80 sq ft/gal)
 - b. Textured Finish (Solvent Based)
 - 1st Coat: S-W UltraCrete Smooth Masonry Water Proof Topcoat, B46 Series
(100-160 sq ft/gal)
 - 2nd Coat: S-W UltraCrete Textured Masonry Water Proof Topcoat, B46 Series
(Fine, Medium, Extra Coarse) (50-80 sq ft/gal)
 - c. Smooth (Waterbased Finish)
 - 1st Coat: S-W Loxon XP, A24-1400 Series
 - 2nd Coat: S-W Loxon XP, A24-1400 Series

(14.0 mils wet, 6.4mils dry per coat) optional

- A. CONCRETE (Cont.)
- 5. Stain System
 - a. Solid Color Waterborne Finish
 - 1st Coat: S-W Loxon Vertical Concrete Stain, A31 Series
 - 2nd Coat: S-W Loxon Vertical Concrete Stain, A31 Series (50-250 sq/ft gal)
- 6. Clear Water Repellant
 - a. Clear
 - 1st Coat: S-W Loxon 7% Siloxane Water Repellant, A10T7
 - 2nd Coat: S-W Loxon 7% Siloxane Water Repellant, A10T7 (50-200 sq ft/ gal)
- B. MASONRY (Concrete Masonry Units [CMU]- Cinder or Concrete Block)
- 1. Latex Systems
 - a. Gloss Finish
 - 1st Coat: S-W PrepRite® Block Filler, B25W25 (75-125 sq ft/gal)
 - 2nd Coat: S-W A-100 Exterior Latex Gloss, A8
 - 3rd Coat: S-W A-100 Exterior Latex Gloss, A8 (4.0 mils wet, 1.3 mils dry per coat)

Early Moisture Resistant Finish

 - 1st Coat: S-W PrepRite Block Filler, B25W25 (75-125 sq ft/gal)
 - 2nd Coat: S-W Resilience Latex Gloss, K44 Series
 - 3rd Coat: S-W Resilience Latex Gloss, K44 Series (4.0 mils wet, 1.6 mils dry per coat)
 - b. Semi-Gloss Finish
 - 1st Coat: S-W PrepRite Block Filler, B25W25 (75-125 sq ft/gal)
 - 2nd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
 - 3rd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series (4.0 mils wet, 1.5 mils dry per coat)
 - c. Satin Finish
 - 1st Coat: S-W PrepRite Block Filler, B25W25 (75-125 sq ft/gal)
 - 2nd Coat: S-W A-100 Exterior Latex Satin, A82 Series
 - 3rd Coat: S-W A-100 Exterior Latex Satin, A82 Series (4.0 mils wet, 1.5 mils dry per coat)

Early Moisture Resistant Finish

 - 1st Coat: S-W Loxon Block Surfacer, A24W200 (50-100 sq ft/gal)
 - 2nd Coat: S-W Resilience Latex Satin, K43 Series
 - 3rd Coat: S-W Resilience Latex Satin, K43 Series

(4.0 mils wet, 1.52 mils dry per coat)

- d. Low Sheen Finish
 - 1st Coat: S-W PrepRite Block Filler, B25W25
(75-125 sq ft/gal)
 - 2nd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
 - 3rd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
(4.0 mils wet, 1.5 mils dry per coat)

B. MASONRY (Concrete Masonry Units [CMU]- Cinder or Concrete Block) (Cont.)

1. Latex Systems

- e. Flat Finish
 - 1st Coat: S-W PrepRite Block Filler, B25W25
(75-125 sq ft/gal)
 - 2nd Coat: S-W A-100 Exterior Latex Flat, A6 Series
 - 3rd Coat: S-W A-100 Exterior Latex Flat, A6 Series
(4.0 mils wet, 1.2 mils dry per coat)

Early Moisture Resistant Finish

- 1st Coat: S-W Loxon Block Surfacer, A24W200
(50-100 sq ft/gal)
- 2nd Coat: S-W Resilience Latex Flat, K42 Series
- 3rd Coat: S-W Resilience Latex Flat, K42 Series
(4.0 mils wet, 1.56 mils dry per coat)

High Build Coating

- 1st Coat: S-W Loxon XP, A24-1400 Series
(14.0 mils wet, 6.4 mils dry per coat)

2. Elastomeric System

- a. Flat Finish
 - 1st Coat: S-W Loxon Block Surfacer, A24W200
(50-100 sq ft/gal)
 - 2nd Coat: S-W ConFlex XL Elastomeric High Build Coating, A5-400 Series
 - 3rd Coat: S-W ConFlex XL Elastomeric High Build Coating, A5-400 Series
(16.0 mils wet, 7.5 mils dry per coat)
 - Alternate:
 - 1st Coat: S-W Loxon Block Surfacer, A24W200
(50-100 sq ft/gal)
 - 2nd Coat: S-W Sherlastic Elastomeric Coating, A5 Series
 - 3rd Coat: S-W Sherlastic Elastomeric Coating, A5 Series
(14.0 mils wet, 6.0 mils dry per coat)

3. Textured Elastomeric System

- a. Textured Finish
 - 1st Coat: S-W Loxon Block Surfacer, A24W200
(50-100 sq ft/gal)
 - 2nd Coat: S-W ConFlex XL Elastomeric High Build Coating, A5-400 Series

- (16.0 mils wet, 7.5 mils dry per coat)
3rd Coat: S-W ConFlex XL Textured Elastomeric High Build Coating, A5-800
(Fine, Medium, Extra Coarse) (20.0 mils wet, 9.4 mils dry per coat)
4. Textured & Smooth Masonry System
- a. Textured (Water Based Finish)
1st Coat: S-W Loxon Block Surfacer, A24W200
(50-100 sq ft/gal)
2nd Coat: S-W UltraCrete Textured Masonry Topcoat, A44-800 Series
(Fine, Medium, Extra Coarse) (50-80 sq ft/ gal)
- b. Textured Finish (Solvent Based)
1st Coat: S-W UltraCrete Smooth Masonry Water Proof Topcoat, B46 Series
(100-160 sq ft/gal)
2nd Coat: S-W UltraCrete Textured Masonry Water Proof Topcoat, B46 Series
(Fine, Medium, Extra Coarse) (50-80 sq ft/gal)
- B. MASONRY (Concrete Masonry Units [CMU]- Cinder or Concrete Block)(Cont.)
4. Textured & Smooth Masonry System
- c. Smooth (Water Based Finish)
1st Coat: S-W Loxon XP, A24-1400 Series
2nd Coat: S-W Loxon XP, A24-1400 Series
(14.0 mils wet 6.4 mils dry per coat) optional
5. Stain System
- a. Solid Color Waterborne Finish
1st Coat: S-W Loxon Vertical Concrete Stain, A31 Series
2nd Coat: S-W Loxon Vertical Concrete Stain, A31 Series
(50-250 sq/ft gal)
6. Clear Water Repellant
- a. Clear
1st Coat: S-W Loxon 7% Siloxane Water Repellant, A10T7
2nd Coat: S-W Loxon 7% Siloxane Water Repellant, A10T7
(50-200 sq ft/ gal)
- C. CONCRETE- (Concrete Floors, Patios, Porches, Steps & Platforms, non-vehicular)
1. Acrylic System Water-Based
- a. Floor Finish
1st Coat: S-W Porch & Floor Enamel, A32-Series
2nd Coat: S-W Porch & Floor Enamel, A32-Series
(4.0 mils wet; 1.5 mils dry per coat)
Alternate:
1st Coat: S-W Sher-Crete Flexible Concrete Waterproof, A5 Series
2nd Coat: S-W Sher-Crete Flexible Concrete Waterproof, A5 Series
(10.0-12.0 mils wet per coat)

2. Solid Stain Finish

- a. Low Luster Finish
 - 1st Coat: S-W H&C Concrete Stain Solid Color Water Based
 - 2nd Coat: S-W H&C Concrete Stain Solid Color Water Based
(50-250 sq ft/ gal)

- D. METAL - Aluminum/ Galvanized
 - 1. Latex Systems
 - a. Gloss Finish
 - 1st Coat: S-W A-100 Exterior Latex Gloss, A8
 - 2nd Coat: S-W A-100 Exterior Latex Gloss, A8
(4.0 mils wet, 1.3 mils dry per coat)

 - Early Moisture Resistant Finish
 - 1st Coat: S-W Resilience Latex Gloss, K44 Series
 - 2nd Coat: S-W Resilience Latex Gloss, K44 Series
(4.0 mils wet, 1.6 mils dry per coat)

 - b. Semi-Gloss Finish
 - 1st Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
 - 2nd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
(4.0 mils wet, 1.5 mils dry per coat)

 - c. Satin Finish
 - 1st Coat: S-W A-100 Exterior Latex Satin, A82 Series
 - 2nd Coat: S-W A-100 Exterior Latex Satin, A82 Series
(4.0 mils wet, 1.5 mils dry per coat)

- D. METAL - Aluminum/ Galvanized (Cont.)
 - 1. Latex Systems
 - c. Early Moisture Resistant Finish
 - 1st Coat: S-W Resilience Latex Satin, K43 Series
 - 2nd Coat: S-W Resilience Latex Satin, K43 Series
(4.0 mils wet, 1.52 mils dry per coat)

 - d. Low Sheen Finish
 - 1st Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
 - 2nd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
(4.0 mils wet, 1.5 mils dry per coat)

 - e. Flat Finish
 - 1st Coat: S-W A-100 Exterior Latex Flat, A6 Series
 - 2nd Coat: S-W A-100 Exterior Latex Flat, A6 Series
(4.0 mils wet, 1.4 mils dry per coat)

 - Early Moisture Resistant Finish
 - 1st Coat: S-W Resilience Latex Flat, K42 Series
 - 2nd Coat: S-W Resilience Latex Flat, K42 Series
(4.0 mils wet, 1.2 mils dry per coat)

- E. METAL Ferrous- (Misc. Iron, Ornamental Iron, Structural Iron & Steel,)

1. Latex Systems
 - a. Gloss Finish
 - 1st Coat: S-W Pro Industrial™ Pro-Cryl® Universal Primer, B66-310 Series
(5.0 mils wet, 2.0 mils dry)
 - 2nd Coat: S-W A-100 Exterior Latex Gloss, A8 Series
 - 3rd Coat: S-W A-100 Exterior Latex Gloss, A8 Series
(4.0 mils wet, 1.3 mils dry per coat)
 - b. Semi-Gloss Finish
 - 1st Coat: S-W Pro Industrial Pro-Cryl Universal Primer, B66-310 Series
(5.0 mils wet, 2.0 mils dry)
 - 2nd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
 - 3rd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
(4.0 mils wet, 1.5 mils dry per coat)

- F. WOOD- Decks, (including pressure treated lumber) (Floors, Platforms non-vehicular)
 1. Acrylic System
 - a. Satin Floor Finish
 - 1st Coat: S-W Porch & Floor Enamel, A32 Series
 - 2nd Coat: S-W Porch & Floor Enamel, A32 Series
(4.0 mils wet, 1.5 mils dry per coat)
 2. Stain Systems
 - a. Solid Color Acrylic Latex
 - 1st Coat: S-W DeckScapes Exterior Acrylic Solid Color Deck Stain, A15-150 Series
 - 2nd Coat: S-W DeckScapes Exterior Acrylic Solid Color Deck Stain, A15-150 Series
(200-400 s/f per gal.)

- F. WOOD- Decks, (including pressure treated lumber) (Floors, Platforms non-vehicular)
 2. Stain Systems (Cont.)
 - b. Semi-Transparent Stain
 - 1st Coat: S-W DeckScapes Exterior Waterborne Deck Stain, A15T215 Series
 - 2nd Coat: S-W DeckScapes Exterior Waterborne Deck Stain, A15T215 Series
(100-350 s/f per gal)
 - c. Clear Stain
 - 1st Coat: S-W DeckScapes Exterior Waterborne Clear, A15T260
 - 2nd Coat: S-W DeckScapes Exterior Waterborne Clear, A15T260
(150-300 sq/ft gal)

- G. WOOD (Siding, Trim, Shutters, Sashes, Hardboard-Bare/Primed)
 1. Latex Systems
 - a. Gloss Finish
 - 1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
 - 2nd Coat: S-W A-100 Exterior Latex Gloss, A8
 - 3rd Coat: S-W A-100 Exterior Latex Gloss, A8
(4.0 mils wet, 1.3 mils dry per coat)

Early Moisture Resistant Finish

- 1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
- 2nd Coat: S-W Resilience Latex Gloss, K44 Series
- 3rd Coat: S-W Resilience Latex Gloss, K44 Series
(4.0 mils wet, 1.6 mils dry per coat)

b. Semi-Gloss Finish

- 1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
- 2nd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
- 3rd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
(4.0 mils wet, 1.5 mils dry per coat)

c. Satin Finish

- 1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
- 2nd Coat: S-W A-100 Exterior Latex Satin, A82 Series
- 3rd Coat: S-W A-100 Exterior Latex Satin, A82 Series
(4.0 mils wet, 1.5 mils dry per coat)

Early Moisture Resistant Finish

- 1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
- 2nd Coat: S-W Resilience Latex Satin, K43 Series
- 3rd Coat: S-W Resilience Latex Satin, K43 Series
(4.0 mils wet, 1.52 mils dry per coat)

d. Low Sheen Finish

- 1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
- 2nd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
- 3rd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
(4.0 mils wet, 1.5 mils dry per coat)

G. WOOD (Siding, Trim, Shutters, Sashes, Hardboard-Bare/Primed) (Cont.)

1. Latex Systems

e. Flat Finish

- 1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
- 2nd Coat: S-W A-100 Exterior Latex Flat, A6 Series
- 3rd Coat: S-W A-100 Exterior Latex Flat, A6 Series
(4.0 mils wet, 1.2 mils dry per coat)

Early Moisture Resistant Finish

- 1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
- 2nd Coat: S-W Resilience Latex Flat, K42 Series
- 3rd Coat: S-W Resilience Latex Flat, K42 Series
(4.0 mils wet, 1.56 mils dry per coat)

2. Stain - Water Reducible Systems

a. Semi-Transparent

1st Coat: S-W WoodScapes® Semi-Transparent Stain, A15T5

2nd Coat: S-W WoodScapes Semi-Transparent Stain, A15T5
(100-350 sq ft/gal)

Satin Finish

1st Coat: S-W Log Home Semi-Transparent Stain Satin, A15T1000

2nd Coat: S-W Log Home Semi-Transparent Stain Satin, A15T1000
(100-350 sq ft/gal)

b. Solid Color

1st Coat: S-W WoodScapes Solid Color Stain, A15 Series

2nd Coat: S-W WoodScapes Solid Color Stain, A15 Series
(200-400 sq ft/gal)

Alternate:

1st Coat: S-W ProMar Solid Color Stain, A16 Series

2nd Coat: S-W ProMar Solid Color Stain, A16 Series
(200-400 sq ft/gal)

H. ARCHITECTURAL PVC, PLASTIC, FIBERGLASS

(due to the variety of substrate, check for compatibility)

1. Latex Systems

a. Gloss Finish

1st Coat: S-W PrepRite ProBlock Latex Primer/ Sealer, B51 Series
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W A-100 Exterior Latex Gloss, A8

3rd Coat: S-W A-100 Exterior Latex Gloss, A8
(4.0 mils wet, 1.3 mils dry per coat)

Early Moisture Resistant Finish

1st Coat: S-W PrepRite ProBlock Latex Primer/ Sealer, B51 Series
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W Resilience Latex Gloss, K44 Series

3rd Coat: S-W Resilience Latex Gloss, K44 Series
(4.0 mils wet, 1.6 mils dry per coat)

b. Semi-Gloss

1st Coat: S-W PrepRite ProBlock Latex Primer/ Sealer, B51 Series
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series

3rd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
(4.0 mils wet, 1.5 mils dry per coat)

c. Satin Finish

1st Coat: S-W PrepRite ProBlock Latex Primer/ Sealer, B51 Series
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W A-100 Exterior Latex Satin, A82 Series

3rd Coat: S-W A-100 Exterior Latex Satin, A82 Series
(4.0 mils wet, 1.5 mils dry per coat)

Early Moisture Resistant Finish

1st Coat: S-W PrepRite ProBlock Latex Primer/ Sealer, B51 Series
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W Resilience Latex Satin, K43 Series

3rd Coat: S-W Resilience Latex Satin, K43 Series
(4.0 mils wet, 1.52 mils dry per coat)

d. Low Sheen Finish

1st Coat: S-W PrepRite® ProBlock® Latex Primer/ Sealer, B51 Series
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series

3rd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
(4.0 mils wet, 1.5 mils dry per coat)

e. Flat Finish

1st Coat: S-W PrepRite ProBlock Latex Primer/ Sealer, B51 Series
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W A-100 Exterior Latex Flat, A6 Series

3rd Coat: S-W A-100 Exterior Latex Flat, A6 Series
(4.0 mils wet, 1.2 mils dry per coat)

Early Moisture Resistant Finish

1st Coat: S-W PrepRite ProBlock Latex Primer/ Sealer, B51 Series
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W Resilience Latex Flat, K42 Series

3rd Coat: S-W Resilience Latex Flat, K42 Series
(4.0 mils wet, 1.56 mils dry per coat)

I. DRYWALL (Gypsum Board, Exterior Drywall)

1. Latex Systems

a. Gloss Finish

1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W A-100 Exterior Latex Gloss, A8

3rd Coat: S-W A-100 Exterior Latex Gloss, A8
(4.0 mils wet, 1.3 mils dry per coat)

Early Moisture Resistant Finish

1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W Resilience Latex Gloss, K44 Series

3rd Coat: S-W Resilience Latex Gloss, K44 Series
(4.0 mils wet, 1.6 mils dry per coat)

b. Semi-Gloss Finish

1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)

2nd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
3rd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
(4.0 mils wet, 1.5 mils dry per coat)

c. Satin Finish

1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
2nd Coat: S-W A-100 Exterior Latex Satin, A82 Series
3rd Coat: S-W A-100 Exterior Latex Satin, A82 Series
(4.0 mils wet, 1.5 mils dry per coat)

Early Moisture Resistant Finish

1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
2nd Coat: S-W Resilience Latex Satin, K43 Series
3rd Coat: S-W Resilience Latex Satin, K43 Series
(4.0 mils wet, 1.52 mils dry per coat)

d. Low Sheen Finish

1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
2nd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
3rd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
(4.0 mils wet, 1.5 mils dry per coat)

e. Flat Finish

1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
2nd Coat: S-W A-100 Exterior Latex Flat, A6 Series
3rd Coat: S-W A-100 Exterior Latex Flat, A6 Series
(4.0 mils wet, 1.2 mils dry per coat)

Early Moisture Resistant Finish

1st Coat: S-W Exterior Latex Wood Primer, B42W8041
(4.0 mils wet, 1.4 mils dry)
2nd Coat: S-W Resilience Latex Flat, K42 Series
3rd Coat: S-W Resilience Latex Flat, K42 Series
(4.0 mils wet, 1.56 mils dry per coat)

J. VINYL SIDING EIFS, SYNTHETIC STUCCO

1. Latex Systems

a. Gloss Finish

1st Coat: S-W A-100 Exterior Latex Gloss, A8
2nd Coat: S-W A-100 Exterior Latex Gloss, A8
(4.0 mils wet, 1.3 mils dry per coat)

VinylSafe™ Early Moisture Resistant Finish

1st Coat: S-W Resilience Latex Gloss, K44 Series
2nd Coat: S-W Resilience Latex Gloss, K44 Series
(4.0 mils wet, 1.6 mils dry per coat)

- b. Semi-Gloss Finish
 - 1st Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
 - 2nd Coat: S-W Solo Acrylic Semi-Gloss, A76 Series
(4.0 mils wet, 1.5 mils dry per coat)

- c. Satin Finish
 - 1st Coat: S-W A-100 Exterior Latex Satin, A82 Series
 - 2nd Coat: S-W A-100 Exterior Latex Satin, A82 Series
(4.0 mils wet, 1.5 mils dry per coat)

VinylSafe™ Early Moisture Resistant Finish

 - 1st Coat: S-W Resilience Latex Satin, K43 Series
 - 2nd Coat: S-W Resilience Latex Satin, K43 Series
(4.0 mils wet, 1.52 mils dry per coat)

- d. Low Sheen Finish
 - 1st Coat: S-W A-100® Exterior Latex Low Sheen, A12 Series
 - 2nd Coat: S-W A-100 Exterior Latex Low Sheen, A12 Series
(4.0 mils wet, 1.5 mils dry per coat)

- e. Flat Finish
 - 1st Coat: S-W A-100 Exterior Latex Flat, A6 Series
 - 2nd Coat: S-W A-100 Exterior Latex Flat, A6 Series
(4.0 mils wet, 1.2 mils dry per coat)

VinylSafe™ Early Moisture Resistant Finish

 - 1st Coat: S-W Resilience Latex Flat, K42 Series
 - 2nd Coat: S-W Resilience Latex Flat, K42 Series
(4.0 mils wet, 1.56 mils dry per coat)

2.4 MATERIALS - GENERAL REQUIREMENTS

A Paints and Coatings - General:

- 1 Unless otherwise indicated, provide factory-mixed coatings. When required, mix coatings to correct consistency in accordance with manufacturer's instructions before application. Do not reduce, thin, or dilute coatings or add materials to coatings unless such a procedure is specifically described in manufacturer's product instructions. VOCs need to be confirmed by using the products MSDS sheets.

B Primers:

- 1 Where the manufacturer offers options on primers for a particular substrate, use primer categorized as "best" by the manufacturer.

2.5 ACCESSORIES:

A Coating Application Accessories:

- 1 Provide all primers, sealers, cleaning agents, cleaning cloths, sanding materials, and clean-up materials required per manufacturer's specifications.

Part 3 EXECUTION

3.1 EXAMINATION

- A Do not begin application of coatings until substrates have been properly examined and prepared. Notify Architect of unsatisfactory conditions before proceeding
- B If substrate preparation is the responsibility of another installer, notify Architect of unsatisfactory preparation before proceeding.
- C Proceed with work only after conditions have been corrected, and approved by all parties, otherwise application of coatings will be considered as an acceptance of surface conditions.
- D Previously Painted Surfaces: Verify that existing painted surfaces do not contain lead based paints, notify Architect immediately if lead based paints are encountered.

3.2 SURFACE PREPARATION:

- A. Proper product selection, surface preparation, and application affect coating performance. Coating integrity and service life will be reduced because of improperly prepared surfaces. Selection and implementation of proper surface preparation ensures coating adhesion to the substrate and prolongs the service life of the coating system.
- B. Selection of the proper method of surface preparation depends on the substrate, the environment, and the expected service life of the coating system. Economics, surface contamination, and the effect on the substrate will also influence the selection of surface preparation methods.
- C. The surface must be dry and in sound condition. Remove oil, dust, dirt, loose rust, peeling paint or other contamination to ensure good adhesion.
- D. Remove mildew before painting by washing with a solution of 1 part liquid household bleach and 3 parts of warm water. Apply the solution and scrub the mildewed area. Allow the solution to remain on the surface for 10 minutes. Rinse thoroughly with clean water and allow the surface to dry 48 hours before painting. Wear protective glasses or goggles, waterproof gloves, and protective clothing. Quickly wash off any of the mixture that comes in contact with your skin. Do not add detergents or ammonia to the bleach/water solution.
- E. No exterior painting should be done immediately after a rain, during foggy weather, when rain is predicted, or when the temperature is below 50° F, unless products are designed specifically for these conditions. On large expanses of metal siding, the air, surface and material temperatures must be 50° F or higher to use low temperature products.

F. Methods:

- 1 Aluminum

- Remove all oil, grease, dirt, oxide and other foreign material by cleaning per SSPC-SP1, Solvent Cleaning.
- 2 **Block (Cinder and Concrete)**
Remove all loose mortar and foreign material. Surface must be free of laitance, concrete dust, dirt, form release agents, moisture curing membranes, loose cement, and hardeners. Concrete and mortar must be cured at least 30 days at 75° F, unless the manufactures products are designed for application prior to the 30-day period. The pH of the surface should be between 6 and 9, unless the products are designed to be used in high pH environments. On tilt-up and poured-in-place concrete, commercial detergents and abrasive blasting may be necessary to prepare the surface. Fill bug holes, air pockets, and other voids with a cement patching compound.
 - 3 **Concrete, SSPC-SP13 or NACE 6**
This standard gives requirements for surface preparation of concrete by mechanical, chemical, or thermal methods prior to the application of bonded protective coating or lining systems. The requirements of this standard are applicable to all types of cementitious surfaces including cast-in-place concrete floors and walls, precast slabs, masonry walls, and shotcrete surfaces. An acceptable prepared concrete surface should be free of contaminants, laitance, loosely adhering concrete, and dust, and should provide a sound, uniform substrate suitable for the application of protective coating or lining systems.
 - 4 **Cement Composition Siding/Panels**
Remove all surface contamination by washing with an appropriate cleaner, rinse thoroughly and allow to dry. Existing peeled or checked paint should be scraped and sanded to a sound surface. Pressure clean, if needed, with a minimum of 2100 psi pressure to remove all dirt, dust, grease, oil, loose particles, laitance, foreign material, and peeling or defective coatings. Allow the surface to dry thoroughly. The pH of the surface should be between 6 and 9, unless the products are designed to be used in high pH environments.
 - 5 **Copper and Stainless Steel**
Remove all oil, grease, dirt, oxide and other foreign material by cleaning per SSPC-SP 2, Hand Tool Cleaning.
 - 6 **Drywall—Exterior**
Must be clean and dry. All nail heads must be set and spackled. Joints must be taped and covered with a joint compound. Spackled nail heads and tape joints must be sanded smooth and all dust removed prior to painting. Exterior surfaces must be spackled with exterior grade compounds.
 - 7 **Exterior Composition Board (Hardboard)**
Some composition boards may exude a waxy material that must be removed with a solvent prior to coating. Whether factory primed or unprimed, exterior composition board siding (hardboard) must be cleaned thoroughly and primed with an alkyd primer.
 - 8 **Galvanized Metal**

Clean per SSPC-SP1 using detergent and water or a degreasing cleaner to remove greases and oils. Apply a test area, priming as required. Allow the coating to dry at least one week before testing. If adhesion is poor, Brush Blast per SSPC-SP7 is necessary to remove these treatments.

- 9 Steel: Structural, Plate, etc.
Should be cleaned by one or more of the surface preparations described below. These methods are used throughout the world for describing methods for cleaning structural steel. Visual standards are available through the Society of Protective Coatings. A brief description of these standards together with numbers by which they can be specified follow.
- 10 Solvent Cleaning, SSPC-SP1
Solvent cleaning is a method for removing all visible oil, grease, soil, drawing and cutting compounds, and other soluble contaminants. Solvent cleaning does not remove rust or mill scale. Change rags and cleaning solution frequently so that deposits of oil and grease are not spread over additional areas in the cleaning process. Be sure to allow adequate ventilation.
- 11 Hand Tool Cleaning, SSPC-SP2
Hand Tool Cleaning removes all loose mill scale, loose rust, and other detrimental foreign matter. It is not intended that adherent mill scale, rust, and paint be removed by this process. Before hand tool cleaning, remove visible oil, grease, soluble welding residues, and salts by the methods outlined in SSPC-SP1.
- 12 Power Tool Cleaning, SSPC-SP3
Power Tool Cleaning removes all loose mill scale, loose rust, and other detrimental foreign matter. It is not intended that adherent mill scale, rust, and paint be removed by this process. Before power tool cleaning, remove visible oil, grease, soluble welding residues, and salts by the methods outlined in SSPC-SP1.
- 13 White Metal Blast Cleaning, SSPC-SP5 or NACE 1
A White Metal Blast Cleaned surface, when viewed without magnification, shall be free of all visible oil, grease, dirt, dust, mill scale, rust, paint, oxides, corrosion products, and other foreign matter. Before blast cleaning, visible deposits of oil or grease shall be removed by any of the methods specified in SSPC-SP1 or other agreed upon methods.
- 14 Commercial Blast Cleaning, SSPC-SP6 or NACE 3
A Commercial Blast Cleaned surface, when viewed without magnification, shall be free of all visible oil, grease, dirt, dust, mill scale, rust, paint, oxides, corrosion products, and other foreign matter, except for staining. Staining shall be limited to no more than 33 percent of each square inch of surface area and may consist of light shadows, slight streaks, or minor discoloration caused by stains of rust, stains of mill scale, or stains of previously applied paint. Before blast cleaning, visible deposits of oil or grease shall be removed by any of the methods specified in SSPC-SP1 or other agreed upon methods.
- 15 Brush-Off Blast Cleaning, SSPC-SP7 or NACE 4

- A Brush-Off Blast Cleaned surface, when viewed without magnification, shall be free of all visible oil, grease, dirt, dust, loose mill scale, loose rust, and loose paint. Tightly adherent mill scale, rust, and paint may remain on the surface. Before blast cleaning, visible deposits of oil or grease shall be removed by any of the methods specified in SSPC-SP 1 or other agreed upon methods.
- 16 Power Tool Cleaning to Bare Metal, SSPC-SP11
Metallic surfaces that are prepared according to this specification, when viewed without magnification, shall be free of all visible oil, grease, dirt, dust, mill scale, rust, paint, oxide corrosion products, and other foreign matter. Slight residues of rust and paint may be left in the lower portions of pits if the original surface is pitted. Prior to power tool surface preparation, remove visible deposits of oil or grease by any of the methods specified in SSPC-SP1, Solvent Cleaning, or other agreed upon methods.
- 17 Near-White Blast Cleaning, SSPC-SP10 or NACE 2
A Near White Blast Cleaned surface, when viewed without magnification, shall be free of all visible oil, grease, dirt, dust, mill scale, rust, paint, oxides, corrosion products, and other foreign matter, except for staining. Staining shall be limited to no more than 5 percent of each square inch of surface area and may consist of light shadows, slight streaks, or minor discoloration caused by stains of rust, stains of mill scale, or stains of previously applied paint. Before blast cleaning, visible deposits of oil or grease shall be removed by any of the methods specified in SSPC-SP1 or other agreed upon methods.
- 18 High- and Ultra-High Pressure Water Jetting for Steel and Other Hard Materials
SSPC-SP12 or NACE 5
This standard provides requirements for the use of high- and ultra-high pressure water jetting to achieve various degrees of surface cleanliness. This standard is limited in scope to the use of water only without the addition of solid particles in the stream.
- 19 Water Blasting, NACE Standard RP-01-72
Removal of oil grease dirt, loose rust, loose mill scale, and loose paint by water at pressures of 2,000 to 2,500 psi at a flow of 4 to 14 gallons per minute.
- 20 Stucco
Must be clean and free of any loose stucco. If recommended procedures for applying stucco are followed, and normal drying conditions prevail, the surface may be painted in 30 days. The pH of the surface should be between 6 and 9, unless the products are designed to be used in high pH environments such as Loxon®.
- 21 Wood—Exterior
Must be clean and dry. Knots and pitch streaks must be scraped, sanded, and spot primed before a full priming coat is applied. Patch all nail holes and imperfections with a wood filler or putty and sand smooth.
- 22 Vinyl Siding, Architectural Plastics, EIFS and Fiberglass

Clean vinyl siding thoroughly by scrubbing with a warm, soapy water solution. Rinse thoroughly. Do not paint with any color darker than the original siding, unless the paint system features Sherwin-Williams VinylSafe technology. Painting with darker colors that are not Sherwin-Williams VinylSafe may cause siding to warping.

3.3 INSTALLATION

- A Apply all coatings and materials with the manufacturer's specifications in mind. Mix and thin coatings according to manufacturer's recommendation.
- B Do not apply to wet or damp surfaces.
 - 1 Wait at least 30 days before applying to new concrete or masonry. Or follow manufacturer's procedures to apply appropriate coatings prior to 30 days.
 - 2 Test new concrete for moisture content.
 - 3 Wait until wood is fully dry after rain or morning fog or dew.
- C Apply coatings using methods recommended by manufacturer.
- D Uniformly apply coatings without runs, drips, or sags, without brush marks, and with consistent sheen.
- E Apply coatings at spreading rate required to achieve the manufacturer's recommended dry film thickness.
- F Regardless of number of coats specified, apply as many coats as necessary for complete hide.
- G Exterior Woodwork: If final painting must be delayed more than 2 weeks after installation of woodwork, apply primer within 2 weeks and final coating within 2 weeks.
- H Inspection: The coated surface must be inspected and approved by the Architect or Engineer just prior to the application of each coat.

3.4 PROTECTION

- A Protect finished coatings from damage until completion of project.
- B Touch-up damaged coatings after substantial completion, following manufacturer's recommendation for touch up or repair of damaged coatings. Repair any defects that will hinder the performance of the coatings.

3.5 SCHEDULES

END OF SECTION 099113

SECTION 099123
INTERIOR PAINTING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes surface preparation and the application of paint systems on the following interior substrates:
 - 1. Steel.
 - 2. Galvanized metal.
 - 3. Aluminum (not anodized or otherwise coated).
 - 4. Wood (not coated with clear finish).
 - 5. Gypsum board.
 - 6. Plaster.
 - 7. Spray-textured ceilings.
 - 8. Concrete.

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Samples for Initial Selection: For each type of topcoat product indicated.
- C. Samples for Verification: For each type of paint system and in each color and gloss of topcoat indicated.
 - 1. Submit Samples on rigid backing, 8 inches square.
 - 2. Step coats on Samples to show each coat required for system.
 - 3. Label each coat of each Sample.
 - 4. Label each Sample for location and application area.
- D. Product List: For each product indicated, include the following:
 - 1. Cross-reference to paint system and locations of application areas. Use same designations indicated on Drawings and in schedules.

2. Printout of current "MPI Approved Products List" for each product category specified in Part 2, with the proposed product highlighted.

1.4 QUALITY ASSURANCE

A. MPI Standards:

1. Products: Complying with MPI standards indicated and listed in "MPI Approved Products List."
2. Preparation and Workmanship: Comply with requirements in "MPI Architectural Painting Specification Manual" for products and paint systems indicated.

B. Mockups: Apply benchmark samples of each paint system indicated and each color and finish selected to verify preliminary selections made under sample submittals and to demonstrate aesthetic effects and set quality standards for materials and execution.

1. Architect will select one surface to represent surfaces and conditions for application of each paint system specified in Part 3.
 - a. Wall and Ceiling Surfaces: Provide samples of at least 100 sq. ft.
 - b. Other Items: Architect will designate items or areas required.
2. Apply benchmark samples after permanent lighting and other environmental services have been activated.
3. Final approval of color selections will be based on benchmark samples.
 - a. If preliminary color selections are not approved, apply additional benchmark samples of additional colors selected by Architect at no added cost to Owner.

1.5 DELIVERY, STORAGE, AND HANDLING

- ##### A. Store materials not in use in tightly covered containers in well-ventilated areas with ambient temperatures continuously maintained at not less than 45 deg F.
1. Maintain containers in clean condition, free of foreign materials and residue.
 2. Remove rags and waste from storage areas daily.

1.6 PROJECT CONDITIONS

- ##### A. Apply paints only when temperature of surfaces to be painted and ambient air temperatures are between 50 and 95 deg F.
- ##### B. Do not apply paints when relative humidity exceeds 85 percent; at temperatures less than 5 deg F above the dew point; or to damp or wet surfaces.

1.7 EXTRA MATERIALS

- A. Furnish extra materials described below that are from same production run (batch mix) as materials applied and that are packaged for storage and identified with labels describing contents.
 - 1. Quantity: Furnish an additional 5 percent, but not less than 1 gal. of each material and color applied.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1. Benjamin Moore & Co.
 - 2. Bennette Paint Mfg. Co., Inc.
 - 3. BLP Mobile Paint Manufacturing.
 - 4. California Paints.
 - 5. ChemRex.
 - 6. Cloverdale Paint.
 - 7. Color Wheel Paints & Coatings.
 - 8. Columbia Paint & Coatings.
 - 9. Coronado Paint.
 - 10. Davis Paint Company.
 - 11. Diamond Vogel Paints.
 - 12. Dunn-Edwards Corporation.
 - 13. Durant Paints Inc.
 - 14. Duron, Inc.
 - 15. Envirocoat Technologies Inc.
 - 16. Farrell-Calhoun.
 - 17. Flex Bon Paints.
 - 18. Frazee Paint.
 - 19. General Paint.
 - 20. Griggs Paint.
 - 21. Hallman Lindsay Quality Paints.
 - 22. Hirshfield's, Inc.
 - 23. ICI Devoe (Canada).
 - 24. ICI Paints.
 - 25. Insl-x.
 - 26. Iowa Paint Manufacturing Company, Inc.
 - 27. Kelly-Moore Paints.

28. Kryton Canada Corporation.
29. Kwal-Howells Paint.
30. M.A.B. Paints.
31. McCormick Paints.
32. Miller Paint.
33. Mills Paint.
34. Northern Paint.
35. PARA Paints.
36. Parker Paint Mfg. Co. Inc.
37. Porter Paints.
38. PPG Architectural Finishes, Inc.
39. Rodda Paint Co.
40. Sherwin-Williams Company (The).
41. Sico, Inc.
42. Sigma Coatings.
43. Smiland Paint Company.
44. Spectra-Tone.
45. Sterling Paint.
46. Tnemic
47. Tower Paint.
48. Vista Paint.

2.2 PAINT, GENERAL

A. Material Compatibility:

1. Provide materials for use within each paint system that are compatible with one another and substrates indicated, under conditions of service and application as demonstrated by manufacturer, based on testing and field experience.
2. For each coat in a paint system, provide products recommended in writing by manufacturers of topcoat for use in paint system and on substrate indicated.

B. VOC Content of Field-Applied Interior Paints and Coatings: Provide products that comply with the following limits for VOC content, exclusive of colorants added to a tint base, when calculated according to 40 CFR 59, Subpart D (EPA Method 24); these requirements do not apply to paints and coatings that are applied in a fabrication or finishing shop:

1. Flat Paints, Coatings, and Primers: VOC content of not more than 50 g/L.
2. Nonflat Paints, Coatings, and Primers: VOC content of not more than 150 g/L.
3. Anti-Corrosive and Anti-Rust Paints Applied to Ferrous Metals: VOC not more than 250 g/L.
4. Floor Coatings: VOC not more than 100 g/L.
5. Shellacs, Clear: VOC not more than 730 g/L.
6. Shellacs, Pigmented: VOC not more than 550 g/L.
7. Flat Topcoat Paints: VOC content of not more than 50 g/L.
8. Nonflat Topcoat Paints: VOC content of not more than 150 g/L.

9. Anti-Corrosive and Anti-Rust Paints Applied to Ferrous Metals: VOC not more than 250 g/L.
 10. Floor Coatings: VOC not more than 100 g/L.
 11. Shellacs, Clear: VOC not more than 730 g/L.
 12. Shellacs, Pigmented: VOC not more than 550 g/L.
 13. Primers, Sealers, and Undercoaters: VOC content of not more than 200 g/L.
 14. Dry-Fog Coatings: VOC content of not more than 400 g/L.
 15. Zinc-Rich Industrial Maintenance Primers: VOC content of not more than 340 g/L.
 16. Pre-Treatment Wash Primers: VOC content of not more than 420 g/L.
- C. Chemical Components of Field-Applied Interior Paints and Coatings: Provide topcoat paints and anti-corrosive and anti-rust paints applied to ferrous metals that comply with the following chemical restrictions; these requirements do not apply to paints and coatings that are applied in a fabrication or finishing shop:
1. Aromatic Compounds: Paints and coatings shall not contain more than 1.0 percent by weight of total aromatic compounds (hydrocarbon compounds containing one or more benzene rings).
 2. Restricted Components: Paints and coatings shall not contain any of the following:
 - a. Acrolein.
 - b. Acrylonitrile.
 - c. Antimony.
 - d. Benzene.
 - e. Butyl benzyl phthalate.
 - f. Cadmium.
 - g. Di (2-ethylhexyl) phthalate.
 - h. Di-n-butyl phthalate.
 - i. Di-n-octyl phthalate.
 - j. 1,2-dichlorobenzene.
 - k. Diethyl phthalate.
 - l. Dimethyl phthalate.
 - m. Ethylbenzene.
 - n. Formaldehyde.
 - o. Hexavalent chromium.
 - p. Isophorone.
 - q. Lead.
 - r. Mercury.
 - s. Methyl ethyl ketone.
 - t. Methyl isobutyl ketone.
 - u. Methylene chloride.
 - v. Naphthalene.
 - w. Toluene (methylbenzene).
 - x. 1,1,1-trichloroethane.
 - y. Vinyl chloride.
- D. Colors: As selected by Architect from manufacturer's full range.

2.3 PRIMERS/SEALERS

- A. Interior Latex Primer/Sealer: MPI #50.
- B. Interior Alkyd Primer/Sealer: MPI #45.
- C. Wood-Knot Sealer: Sealer recommended in writing by topcoat manufacturer for use in paint systems indicated.

2.4 METAL PRIMERS

- A. Alkyd Anticorrosive Metal Primer: MPI #79.
- B. Quick-Drying Alkyd Metal Primer: MPI #76.
- C. Rust-Inhibitive Primer (Water Based): MPI #107.
- D. Cementitious Galvanized-Metal Primer: MPI #26.
- E. Waterborne Galvanized-Metal Primer: MPI #134.
- F. Vinyl Wash Primer: MPI #80.
- G. Quick-Drying Primer for Aluminum: MPI #95.

2.5 WOOD PRIMERS

- A. Interior Latex-Based Wood Primer: MPI #39.

2.6 ALUMINUM PAINT

- A. Aluminum Paint: MPI #1.

2.7 FLOOR COATINGS

- A. Interior/Exterior Latex Floor and Porch Paint (Low Gloss): MPI #60 (maximum Gloss Level 3).

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates and conditions, with Applicator present, for compliance with requirements for maximum moisture content and other conditions affecting performance of work.
- B. Maximum Moisture Content of Substrates: When measured with an electronic moisture meter as follows:
 - 1. Concrete: 12 percent.
 - 2. Wood: 15 percent.
 - 3. Gypsum Board: 12 percent.
- C. Verify suitability of substrates, including surface conditions and compatibility with existing finishes and primers.
- D. Begin coating application only after unsatisfactory conditions have been corrected and surfaces are dry.
 - 1. Beginning coating application constitutes Contractor's acceptance of substrates and conditions.

3.2 PREPARATION

- A. Comply with manufacturer's written instructions and recommendations in "MPI Architectural Painting Specification Manual" applicable to substrates indicated.
- B. Remove plates, machined surfaces, and similar items already in place that are not to be painted. If removal is impractical or impossible because of size or weight of item, provide surface-applied protection before surface preparation and painting.
 - 1. After completing painting operations, use workers skilled in the trades involved to reinstall items that were removed. Remove surface-applied protection if any.
 - 2. Do not paint over labels of independent testing agencies or equipment name, identification, performance rating, or nomenclature plates.
- C. Clean substrates of substances that could impair bond of paints, including dirt, oil, grease, and incompatible paints and encapsulants.
 - 1. Remove incompatible primers and reprime substrate with compatible primers as required to produce paint systems indicated.

- D. Concrete Substrates: Remove release agents, curing compounds, efflorescence, and chalk. Do not paint surfaces if moisture content or alkalinity of surfaces to be painted exceeds that permitted in manufacturer's written instructions.
- E. Clay Masonry Substrates: Remove efflorescence and chalk. Do not paint surfaces if moisture content of surfaces or alkalinity of mortar joints to be painted exceed that permitted in manufacturer's written instructions.
- F. Concrete Masonry Substrates: Remove efflorescence and chalk. Do not paint surfaces if moisture content or alkalinity of surfaces to be painted exceeds that permitted in manufacturer's written instructions.
- G. Steel Substrates: Remove rust and loose mill scale. Clean using methods recommended in writing by paint manufacturer.
- H. Galvanized-Metal Substrates: Remove grease and oil residue from galvanized sheet metal fabricated from coil stock by mechanical methods to produce clean, lightly etched surfaces that promote adhesion of subsequently applied paints.
- I. Aluminum Substrates: Remove surface oxidation.
- J. Wood Substrates:
 - 1. Scrape and clean knots, and apply coat of knot sealer before applying primer.
 - 2. Sand surfaces that will be exposed to view, and dust off.
 - 3. Prime edges, ends, faces, undersides, and backsides of wood.
 - 4. After priming, fill holes and imperfections in the finish surfaces with putty or plastic wood filler. Sand smooth when dried.
- K. Gypsum Board Substrates: Do not begin paint application until finishing compound is dry and sanded smooth.
- L. Plaster Substrates: Do not begin paint application until plaster is fully cured and dry.
- M. Spray-Textured Ceiling Substrates: Do not begin paint application until surfaces are dry.

3.3 APPLICATION

- A. Apply paints according to manufacturer's written instructions.
 - 1. Use applicators and techniques suited for paint and substrate indicated.
 - 2. Paint surfaces behind movable equipment and furniture same as similar exposed surfaces. Before final installation, paint surfaces behind permanently fixed equipment or furniture with prime coat only.

3. Paint front and backsides of access panels, removable or hinged covers, and similar hinged items to match exposed surfaces.
 - B. Tint each undercoat a lighter shade to facilitate identification of each coat if multiple coats of same material are to be applied. Tint undercoats to match color of topcoat, but provide sufficient difference in shade of undercoats to distinguish each separate coat.
 - C. If undercoats or other conditions show through topcoat, apply additional coats until cured film has a uniform paint finish, color, and appearance.
 - D. Apply paints to produce surface films without cloudiness, spotting, holidays, laps, brush marks, roller tracking, runs, sags, ropiness, or other surface imperfections. Cut in sharp lines and color breaks.
 - E. Painting Mechanical and Electrical Work: Paint items exposed in equipment rooms and occupied spaces including, but not limited to, the following:
 1. Mechanical Work:
 - a. Uninsulated metal piping.
 - b. Uninsulated plastic piping.
 - c. Pipe hangers and supports.
 - d. Tanks that do not have factory-applied final finishes.
 - e. Visible portions of internal surfaces of metal ducts, without liner, behind air inlets and outlets.
 - f. Duct, equipment, and pipe insulation having cotton or canvas insulation covering or other paintable jacket material.
 - g. Mechanical equipment that is indicated to have a factory-primed finish for field painting.
 2. Electrical Work:
 - a. Switchgear.
 - b. Panelboards.
 - c. Electrical equipment that is indicated to have a factory-primed finish for field painting.
- 3.4 FIELD QUALITY CONTROL
- A. Testing of Paint Materials: Owner reserves the right to invoke the following procedure at any time and as often as Owner deems necessary during the period when paints are being applied:
 1. Owner will engage the services of a qualified testing agency to sample paint materials being used. Samples of material delivered to Project site will be taken, identified, sealed, and certified in presence of Contractor.
 2. Testing agency will perform tests for compliance with product requirements.

3. Owner may direct Contractor to stop applying paints if test results show materials being used do not comply with product requirements. Contractor shall remove noncomplying-paint materials from Project site, pay for testing, and repaint surfaces painted with rejected materials. Contractor will be required to remove rejected materials from previously painted surfaces if, on repainting with complying materials, the two paints are incompatible.

3.5 CLEANING AND PROTECTION

- A. At end of each workday, remove rubbish, empty cans, rags, and other discarded materials from Project site.
- B. After completing paint application, clean spattered surfaces. Remove spattered paints by washing, scraping, or other methods. Do not scratch or damage adjacent finished surfaces.
- C. Protect work of other trades against damage from paint application. Correct damage to work of other trades by cleaning, repairing, replacing, and refinishing, as approved by Architect, and leave in an undamaged condition.
- D. At completion of construction activities of other trades, touch up and restore damaged or defaced painted surfaces.

3.6 INTERIOR PAINTING SCHEDULE

- A. Steel Substrates:
 1. Quick-Drying Enamel System: MPI INT 5.1A.
 - a. Prime Coat: Quick-drying alkyd metal primer.
 - b. Intermediate Coat: Quick-drying enamel matching topcoat.
 - c. Topcoat: Quick-drying enamel.
 2. Water-Based Dry-Fall System: MPI INT 5.1C.
 - a. Prime Coat: Alkyd anticorrosive or Quick-drying alkyd metal primer.
 - b. Topcoat: Latex dry fog/fall or Waterborne dry fall.
 3. Alkyd Dry-Fall System: MPI INT 5.1D.
 - a. Prime Coat: Alkyd anticorrosive or Quick-drying alkyd metal primer.
 - b. Topcoat: Interior alkyd dry fog/fall.
 4. Latex Over Alkyd Primer System: MPI INT 5.1Q.
 - a. Prime Coat: Alkyd anticorrosive or Quick-drying alkyd metal primer.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.

5. Alkyd System: MPI INT 5.1E.
 - a. Prime Coat: Alkyd anticorrosive or Quick-drying alkyd metal primer.
 - b. Intermediate Coat: Interior alkyd matching topcoat.
 - c. Topcoat: Interior alkyd.
 6. Aluminum Paint System: MPI INT 5.1M.
 - a. Prime Coat: Alkyd anticorrosive or Quick-drying alkyd metal primer.
 - b. Intermediate Coat: Aluminum paint.
 - c. Topcoat: Aluminum paint.
 7. Institutional Low-Odor/VOC Latex System: MPI INT 5.1S.
 - a. Prime Coat: Rust-inhibitive primer (water based).
 - b. Intermediate Coat: Institutional low-odor/VOC interior latex matching topcoat.
 - c. Topcoat: Institutional low-odor/VOC interior latex.
 8. High-Performance Architectural Latex System: MPI INT 5.1R.
 - a. Prime Coat: Alkyd anticorrosive or Quick-drying alkyd metal primer.
 - b. Intermediate Coat: High-performance architectural latex matching topcoat.
 - c. Topcoat: High-performance architectural latex.
- B. Galvanized-Metal Substrates:
1. Water-Based Dry-Fall System: MPI INT 5.3H.
 - a. Prime Coat: Waterborne dry fall.
 - b. Topcoat: Waterborne dry fall.
 2. Alkyd Dry-Fall System: MPI INT 5.3F.
 - a. Prime Coat: Cementitious galvanized-metal primer.
 - b. Topcoat: Interior alkyd dry fog/fall.
 3. Latex System: MPI INT 5.3A.
 - a. Prime Coat: Cementitious galvanized-metal primer.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.
 4. Latex Over Waterborne Primer System: MPI INT 5.3J.
 - a. Prime Coat: Waterborne galvanized-metal primer.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.

5. Alkyd System: MPI INT 5.3C.
 - a. Prime Coat: Cementitious galvanized-metal primer.
 - b. Intermediate Coat: Interior alkyd matching topcoat.
 - c. Topcoat: Interior alkyd.
 6. Aluminum Paint System: MPI INT 5.3G.
 - a. Prime Coat: Cementitious galvanized-metal primer.
 - b. Intermediate Coat: Aluminum paint.
 - c. Topcoat: Aluminum paint.
 7. Institutional Low-Odor/VOC Latex System: MPI INT 5.3N.
 - a. Prime Coat: Waterborne galvanized-metal primer.
 - b. Intermediate Coat: Institutional low-odor/VOC interior latex matching topcoat.
 - c. Topcoat: Institutional low-odor/VOC interior latex.
 8. High-Performance Architectural Latex System: MPI INT 5.3M.
 - a. Prime Coat: Waterborne galvanized-metal primer.
 - b. Intermediate Coat: High-performance architectural latex matching topcoat.
 - c. Topcoat: High-performance architectural latex.
- C. Aluminum (Not Anodized or Otherwise Coated) Substrates:
1. Latex System: MPI INT 5.4H.
 - a. Prime Coat: Quick-drying primer for aluminum.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.
 2. Alkyd Over Vinyl Wash Primer System: MPI INT 5.4A.
 - a. Prime Coat: Vinyl wash primer.
 - b. Intermediate Coat: Interior alkyd matching topcoat.
 - c. Topcoat: Interior alkyd.
 3. Alkyd Over Quick-Drying Primer System: MPI INT 5.4J.
 - a. Prime Coat: Quick-drying primer for aluminum.
 - b. Intermediate Coat: Interior alkyd matching topcoat.
 - c. Topcoat: Interior alkyd.
 4. Aluminum Paint System: MPI INT 5.4D.
 - a. Prime Coat: Vinyl wash primer.

- b. Intermediate Coat: Aluminum paint.
 - c. Topcoat: Aluminum paint.
 - 5. Institutional Low-Odor/VOC Latex System: MPI INT 5.4G.
 - a. Prime Coat: Quick-drying primer for aluminum.
 - b. Intermediate Coat: Institutional low-odor/VOC interior latex matching topcoat.
 - c. Topcoat: Institutional low-odor/VOC interior latex.
 - 6. High-Performance Architectural Latex System: MPI INT 5.4F.
 - a. Prime Coat: Quick-drying primer for aluminum.
 - b. Intermediate Coat: High-performance architectural latex matching topcoat.
 - c. Topcoat: High-performance architectural latex.
- D. Dressed Lumber Substrates: Including architectural woodwork.
- 1. Latex System: MPI INT 6.3T.
 - a. Prime Coat: Interior latex-based wood primer.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.
 - 2. Latex Over Alkyd Primer System: MPI INT 6.3U.
 - a. Prime Coat: Interior alkyd primer/sealer.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.
 - 3. Alkyd System: MPI INT 6.3B.
 - a. Prime Coat: Interior alkyd primer/sealer.
 - b. Intermediate Coat: Interior alkyd matching topcoat.
 - c. Topcoat: Interior alkyd.
 - 4. Institutional Low-Odor/VOC Latex System: MPI INT 6.3V.
 - a. Prime Coat: Interior latex-based wood primer.
 - b. Intermediate Coat: Institutional low-odor/VOC interior latex matching topcoat.
 - c. Topcoat: Institutional low-odor/VOC interior latex.
 - 5. High-Performance Architectural Latex System: MPI INT 6.3A.
 - a. Prime Coat: Interior latex-based wood primer.
 - b. Intermediate Coat: High-performance architectural latex matching topcoat.

- c. Topcoat: High-performance architectural latex.
- E. Dimension Lumber Substrates, Nontraffic Surfaces.
- 1. Latex System: MPI INT 6.2D.
 - a. Prime Coat: Interior latex-based wood primer.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.
 - 2. Latex Over Alkyd Primer System: MPI INT 6.2A.
 - a. Prime Coat: Interior alkyd primer/sealer.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.
 - 3. Alkyd System: MPI INT 6.2C.
 - a. Prime Coat: Interior alkyd primer/sealer.
 - b. Intermediate Coat: Interior alkyd matching topcoat.
 - c. Topcoat: Interior alkyd.
 - 4. Institutional Low-Odor/VOC Latex System: MPI INT 6.2L.
 - a. Prime Coat: Interior latex-based wood primer.
 - b. Intermediate Coat: Institutional low-odor/VOC interior latex matching topcoat.
 - c. Topcoat: Institutional low-odor/VOC interior latex.
 - 5. High-Performance Architectural Latex System: MPI INT 6.2B.
 - a. Prime Coat: Interior alkyd primer/sealer.
 - b. Intermediate Coat: High-performance architectural latex matching topcoat.
 - c. Topcoat: High-performance architectural latex.
- F. Gypsum Board Substrates:
- 1. Latex System: MPI INT 9.2A.
 - a. Prime Coat: Interior latex primer/sealer or matching topcoat.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.
 - 2. Alkyd Over Latex Primer System: MPI INT 9.2C.
 - a. Prime Coat: Interior latex primer/sealer.
 - b. Intermediate Coat: Interior alkyd matching topcoat.
 - c. Topcoat: Interior alkyd.

3. Institutional Low-Odor/VOC Latex System: MPI INT 9.2M.
 - a. Prime Coat: Interior latex primer/sealer.
 - b. Intermediate Coat: Institutional low-odor/VOC interior latex matching topcoat.
 - c. Topcoat: Institutional low-odor/VOC interior latex.
 4. High-Performance Architectural Latex System: MPI INT 9.2B.
 - a. Prime Coat: Interior latex primer/sealer.
 - b. Intermediate Coat: High-performance architectural latex matching topcoat.
 - c. Topcoat: High-performance architectural latex.
- G. Spray-Textured Ceiling Substrates:
1. Latex (Flat) System: MPI INT 9.1A, spray applied.
 - a. Prime Coat: Interior latex.
 - b. Topcoat: Interior latex (flat).
 2. Latex System: MPI INT 9.1E, spray applied.
 - a. Prime Coat: Interior latex matching topcoat.
 - b. Intermediate Coat: Interior latex matching topcoat.
 - c. Topcoat: Interior latex.
 3. Latex Over Alkyd Primer System: MPI INT 9.1B.
 - a. Prime Coat: Interior alkyd primer/sealer.
 - b. Topcoat: Interior latex.
 4. Alkyd (Flat) System: MPI INT 9.1C.
 - a. Prime Coat: Interior alkyd (flat).
 - b. Topcoat: Interior alkyd (flat).
 5. Alkyd System: MPI INT 9.1D.
 - a. Prime Coat: Interior alkyd primer/sealer.
 - b. Intermediate Coat: Interior alkyd matching topcoat.
 - c. Topcoat: Interior alkyd

END OF SECTION 099123

SECTION 099600

HIGH PERFORMANCE COATINGS

Part 1 - GENERAL

1.01 WORK INCLUDED

- A. This specification covers preparation of surfaces, material performance standards and completion of painting of all surfaces, as required by the drawings and as specified herein.

1.02 QUALITY ASSURANCE

- A. Job Mock-Up:
 - 1. Minimum 10 sq. ft. application of each specified coating system on each type of substrate.
 - 2. Mock-ups will serve as standard for acceptance of work.
 - 3. Leave approved mock-ups in place as part of completed project.
 - 4. Manufacturer's representative shall be available to advise applicator on proper application techniques and procedures.
 - 5. Mock-up shall be tested to verify compatibility and adhesion to the substrate.
- B. Regulatory Requirements: Comply with applicable codes, regulations, ordinances, and laws regarding use and application of coating systems that contain volatile organic compounds (VOC).
- C. Field Quality Control:
 - 1. Installer shall request acceptance by Owner's Representative of each coat before applying succeeding coats.
 - 2. Furnish and maintain at Project site following fully calibrated testing and inspection devices:
 - a. Wet Mil Gauge
 - b. Micro Test Magnetic Dry Film Gauge with Calibration Shims
 - c. Sling Psychrometer

- 1.03 Initiate and maintain for duration of Project field quality control program using certified calibration and testing devices to ensure conformance with application requirements.

1.04 REFERENCE STANDARDS

- A. American Society for Testing and Materials (ASTM)
 - 1. ASTM D 4585 Condensing Humidity
 - 2. ASTM B 117 Salt Spray
 - 3. ASTM D 3359B Adhesion
 - 4. ASTM D 3273 Fungal Resistance
 - 5. ASTM D 1653 Moisture Vapor Transmission
 - 6. ASTM G 53 QUV Exposure
 - 7. ASTM D 4213 Scrubbability
 - 8. ASTM D 1308 Stain Resistance

9. ASTM D 4060 Abrasion Resistance
10. ASTM D 2246 Freeze Thaw
11. ASTM D 3363 Hardness
12. ASTM D 2794 Impact Resistance

B. Federal Test Methods:

1. Standard #TT-C-555B, Paragraph 4.4.7.3, Wind Driven Rain

C. Exterior Exposure - Exterior Exposure at 45 degrees facing south

1.05 SUBMITTALS

A. Product Data:

1. Submit manufacturer's descriptive literature fully describing each product and solids by volume contents.
2. Include manufacturer's recommendations for mixing, thinning, application and curing.
3. Submit manufacturer's product data sheets.
4. Submit special coating schedule indicating locations and applications by manufacturer's name and product number.

B. Samples:

1. Submit manufacturer's standard colors for selection by Architect.
2. Submit two (2) 12" x 12" samples of each coating system in selected colors on substrate sample to be finished.
3. Indicate finish texture and color.

C. Test Samples:

1. When requested by Architect, obtain test samples from material stored at project site or source of supply.
2. Retain all paint cans and lids on site until authorized to discard by Architect.

D. Certificates: Manufacturer's certified test report from acceptable independent testing laboratory indicating coatings comply with performance requirements.

1.06 PRODUCT DELIVERY, STORAGE, HANDLING:

- A. Deliver materials in factory-sealed containers with manufacturer's labels intact and legible.
- B. Store materials in accordance with manufacturer's written instructions.

1.07 JOB CONDITIONS:

A. Apply coating materials only under following prevailing conditions, unless otherwise noted on manufacturer's product data:

1. Air and surface temperatures are in accordance with the manufacturer's product literature.
2. Do not apply coatings to damp or wet surfaces.
3. Relative humidity is below 85% and surface temperature is at least 5 degrees F above dewpoint.

4. Wind velocity must be under 20 mph.

B. Protect all surface not to be coated.

1.08 SAFETY:

- A. Submit to the client, current manufacturer's product data sheets as well as Material Safety Data Sheets.
- B. Ensure that waste material is disposed of in accordance with applicable government regulations.
- C. Report to a responsible person, any condition that may pose a threat to the health and welfare of your employees.
- D. Keep working area clean and safe.
- E. Obey all jobsite rules and regulations.

Part 2 - PRODUCTS

1.01 ACCEPTABLE MANUFACTURERS:

- A. Products specified are manufactured by Tnemec Company, Inc. Dupont or prior approved equal.
- B. Bidders desiring to use coatings other than those specified shall submit their proposal in writing to the Architect at least ten (10) days prior to the bid opening. Requests for substitution shall include manufacturer's literature for each product giving the name, generic type, descriptive information, solids by volume, recommended dry film thickness and a list of five projects where each product has been used and rendered satisfactory service. No request for substitution shall be considered that would decrease film thickness, the number of coats applied, offer a change in the generic type of coating specified or fail to meet the performance requirements of the specified materials. The coating contractor shall submit manufacturer's certified test reports showing that the substitute product(s) equal or exceed the performance of the specified products outlined in section 3.6 painting schedule.
- C. Bidders desiring to use coatings, other than those specified, shall submit those with their proposal based on the specified materials, together with the information required in Paragraph 2.1B above, and indicate the sum which will be added to or deducted from the base bid should alternate materials be accepted.
- D. Products for each specified function and system shall be of a single manufacturer.
- E. Requests for substitution will be considered in accordance with provisions of Section 01251.

1.02 MATERIALS

- A. See Finish schedule Section 3.6

1.03 MATERIAL PREPARATION:

- A. Mix and thin materials according to manufacturer's latest printed instructions.
- B. Do not use materials beyond manufacturer's recommended shelf life.
- C. Do not use mixed materials beyond manufacturer's recommended pot life.

Part 3 - EXECUTION

3.1 PRE - WORK INSPECTION:

- A. Examine surfaces to be coated and report conditions that would adversely affect appearance or performance of coating systems and which cannot be put into an acceptable condition by preparatory work specified in Paragraph 3.2.
- B. Do not proceed with surface preparation and application until surface is acceptable or authorization to proceed is given by architect.

3.2 SURFACE PREPARATION

- A. General:
 - 1. Dislodge dirt, rust, plaster nibs, mortar spatter and other dry material by scraping or brushing. Remove dust and loose material by brushing, sweeping, vacuuming or blowing with high-pressure air.
 - 2. Remove oil, wax and grease by scraping off heavy deposits and cleaning with industrial grade cleaner followed by a water rinse.
 - 3. Verify that surfaces to be coated are dry, clean and free of dust, dirt, oil, wax, grease or other contaminants.
- B. Gypboard
 - 1. Clean dry and free of contaminants.
 - 2. Sand joint compound smooth and feather.

3.3 APPLICATION

- A. Apply materials at specified film thickness by method recommended by manufacturer.
- B. Make finish coats smooth, uniform in color, and free of brush marks, laps, runs, dry spray, overspray and skipped or missed areas.
- C. Do not apply initial coating until moisture content of surface is within limitations recommended by paint manufacturer. Test with moisture meter.
- D. Apply all coatings in strict accordance with manufacturer's latest printed and published instructions.
- E. Provide "Wet Paint" signs as required to protect newly coated finishes. Remove temporary protective wrappings provided by other for protection of their work, after completion for painting operations.
- F. Protect all surfaces not to be painted.
- G. Good painting practices shall be employed at all times.

3.4 INSPECTION

- A. Request acceptance of each coat before applying succeeding coats.
- B. Repair and touch-up all work that is not acceptable to the architect and request final acceptance.

3.5 CLEANING

- A. Remove paint spatters from glass, plumbing fixtures and adjoining surfaces.
- B. Repair damage to coating or surfaces caused by cleaning operations.
- C. Remove debris from jobsite and leave storage areas clean.

3.6 PAINTING SCHEDULE

- A. Gypboard
 - 1st Coat Tnemec Series 51-792 PVA Sealer 1.0 dry mils
 - 2nd Coat Tnemec Series 1029 Enduratone 2.0-3.0 dry mils
 - 3rd Coat Tnemec Series 1029 Enduratone 2.0-3.0 dry mils

3.7 ACCEPTANCE

- A. Final acceptance of coatings shall be based upon inspection by the Owner's Representative. Coatings falling below specified and/or scheduled finish and shade shall be redone as required without expense to the Owner.

END OF SECTION 099600

DIVISION 10

SPECIALTIES

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: www.dammonengineering.com



SECTION 102113
TOILET COMPARTMENTS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Steel toilet compartments configured as toilet enclosures, entrance screens, and urinal screens.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: For toilet compartments. Include plans, elevations, sections, details, and attachments to other work.
- C. Samples for each exposed product and for each color and texture specified.

1.3 INFORMATIONAL SUBMITTALS

- A. Product certificates.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Steel Sheet: Commercial steel sheet for exposed applications; mill phosphatized and selected for smoothness.
 1. Hot-Dip Galvanized: ASTM A 653/A 653M, either hot-dip galvanized or galvanized.
- B. Zamac: ASTM B 86, commercial zinc-alloy die castings.

2.2 STEEL UNITS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following:

- B. Basis-of-Design Product: Subject to compliance with requirements, Bradley Series 400, or comparable product by one of the following:
1. Accurate Partitions Corporation.
 2. All American Metal Corp.
 3. American Sanitary Partition Corporation.
 4. Ampco, Inc.
 5. Bradley Corporation; Mills Partitions.
 6. Flush Metal Partition Corp.
 7. General Partitions Mfg. Corp.
 8. Global Steel Products Corp.
 9. Hadrian Manufacturing Inc.
 10. Knickerbocker Partition Corporation.
 11. Metpar Corp.
 12. Rockville Partitions Incorporated.
 13. Sanymetal; a Crane Plumbing company.
 14. Shanahan's Limited.
- C. Toilet-Enclosure Style: Overhead braced.
- D. Entrance-Screen Style: Overhead braced.
- E. Urinal-Screen Style: Wall hung, flat panel.
- F. Door, Panel, and Pilaster Construction: Seamless, metal facing sheets pressure laminated to core material; with continuous, interlocking molding strip or lapped-and-formed edge closures; corners secured by welding or clips and exposed welds ground smooth.[Provide with no-sightline system.] Exposed surfaces shall be free of pitting, seam marks, roller marks, stains, discolorations, telegraphing of core material, or other imperfections.
1. Core Material: Manufacturer's standard sound-deadening honeycomb of resin-impregnated kraft paper in thickness required to provide finished thickness of 1 inch (25 mm) for doors and panels and 1-1/4 inches (32 mm) for pilasters.
 2. Grab-Bar Reinforcement: Provide concealed internal reinforcement for grab bars mounted on units.
 3. Tapping Reinforcement: Provide concealed reinforcement for tapping (threading) at locations where machine screws are used for attaching items to units.
- G. Urinal-Screen Construction:
1. Flat-Panel Urinal Screen: Matching panel construction.
 2. Integral-Flange, Wall-Hung Urinal Screen: Similar to panel construction, with integral full-height flanges for wall attachment, and maximum 1-1/4 inches (32 mm) thick.
 3. Wedge-Shaped, Wall-Hung Urinal Screen: Similar to panels, V-shaped, fabricated for concealed wall attachment, and maximum 6 inches (152 mm) wide at wall and minimum 1 inch (25 mm) wide at protruding end.

- H. Facing Sheets and Closures: Hot-dip galvanized-steel sheet with nominal base-metal (uncoated) thicknesses standard with manufacturer.
- I. Pilaster Sleeves (Caps): Stainless-steel sheet, not less than 3 inches (76 mm) high, finished to match hardware.
- J. Brackets (Fittings):
 - 1. Stirrup Type: Ear or U-brackets; stainless steel.
 - 2. Full-Height (Continuous) Type: Manufacturer's standard design; stainless steel.
- K. Steel-Sheet Finish: Manufacturer's standard baked-on finish, with one color in each room.
 - 1. Color: As selected by Architect from manufacturer's full range.

2.3 ACCESSORIES

- A. Hardware and Accessories: Manufacturer's standard design, heavy-duty operating hardware and accessories.
 - 1. Material: Stainless steel.
 - 2. Hinges: Manufacturer's standard continuous, cam type that swings to a closed or partially open position.
 - 3. Latch and Keeper: Manufacturer's standard surface-mounted latch unit designed for emergency access and with combination rubber-faced door strike and keeper. Provide units that comply with regulatory requirements for accessibility at compartments designated as accessible.
 - 4. Coat Hook: Manufacturer's standard combination hook and rubber-tipped bumper, sized to prevent in-swinging door from hitting compartment-mounted accessories.
 - 5. Door Bumper: Manufacturer's standard rubber-tipped bumper at out-swinging doors and entrance-screen doors.
 - 6. Door Pull: Manufacturer's standard unit at out-swinging doors that complies with regulatory requirements for accessibility. Provide units on both sides of doors at compartments designated as accessible.
- B. Anchorages and Fasteners: Manufacturer's standard exposed fasteners of stainless steel or chrome-plated steel or brass, finished to match the items they are securing, with theft-resistant-type heads. Provide sex-type bolts for through-bolt applications. For concealed anchors, use stainless steel, hot-dip galvanized steel, or other rust-resistant, protective-coated steel.

2.4 FABRICATION

- A. Ceiling-Hung Units: Provide manufacturer's standard corrosion-resistant anchoring assemblies with leveling adjustment nuts at pilasters for connection to structural

support above finished ceiling. Provide assemblies that support pilasters from structure without transmitting load to finished ceiling. Provide sleeves (caps) at tops of pilasters to conceal anchorage.

- B. Door Size and Swings: Unless otherwise indicated, provide 24-inch- (610-mm-) wide, in-swinging doors for standard toilet compartments and 36-inch- (914-mm-) wide, out-swinging doors with a minimum 32-inch- (813-mm-) wide, clear opening for compartments designated as accessible.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. General: Comply with manufacturer's written installation instructions. Install units rigid, straight, level, and plumb. Secure units in position with manufacturer's recommended anchoring devices.
- B. Clearances: Maximum 1/2 inch (13 mm) between pilasters and panels; 1 inch (25 mm) between panels and walls.
- C. Stirrup Brackets: Secure panels to walls and to pilasters with no fewer than three brackets attached at midpoint and near top and bottom of panel. Locate wall brackets so holes for wall anchors occur in masonry or tile joints. Align brackets at pilasters with brackets at walls.

3.2 ADJUSTING

- A. Hardware Adjustment: Adjust and lubricate hardware according to hardware manufacturer's written instructions for proper operation. Set hinges on in-swinging doors to hold doors open approximately 30 degrees from closed position when unlatched. Set hinges on out-swinging doors and doors in entrance screens to return doors to fully closed position.

END OF SECTION 102113

SECTION 102800

TOILET, BATH, AND LAUNDRY ACCESSORIES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Public-use washroom accessories.
2. Public-use shower room accessories.
3. Private-use bathroom accessories.
4. Healthcare accessories.
5. Warm-air dryers.
6. Childcare accessories.
7. Underlatory guards.
8. Custodial accessories.

1.2 ACTION SUBMITTALS

- ###### A. Product Data: For each type of product indicated.
- ###### B. Product Schedule: Indicating types, quantities, sizes, and installation locations by room of each accessory required.
1. Identify locations using room designations indicated.
 2. Identify products using designations indicated.

1.3 INFORMATIONAL SUBMITTALS

- ###### A. Warranty: Sample of special warranty.

1.4 CLOSEOUT SUBMITTALS

- ###### A. Maintenance data.

1.5 QUALITY ASSURANCE

- ###### A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

1.6 WARRANTY

- A. Special Mirror Warranty: Manufacturer's standard form in which manufacturer agrees to replace mirrors that develop visible silver spoilage defects and that fail in materials or workmanship within specified warranty period.
1. Warranty Period: 5 years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 PUBLIC-USE WASHROOM ACCESSORIES

- A. Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
1. Bradley Corporation.
 2. Bobrick Washroom Equipment, Inc.
- C. Toilet Tissue (Roll) Dispenser TP1:
1. Basis-of-Design Product: Bradley 5084.
 2. Description: Single roll dispenser.
 3. Mounting: Surface mounted.
 4. Material and Finish: Stainless steel, No. 4 finish (satin).
- D. Paper Towel (Folded) Dispenser PT 1:
1. Basis-of-Design Product: Bradley 2441-11
 2. Mounting: Surface Mounted
 3. Material and Finish: Stainless steel, No. 4 finish (satin)
 4. Lockset: Tumbler type.
- E. Grab Bar GB1 & GB3i:
1. Basis-of-Design Product: Bradley 812.
 2. Mounting: Flanges with concealed fasteners.
 3. Material: Stainless steel, 0.05 inch (1.3 mm) thick.
 - a. Finish: Smooth, No. 4 finish (satin).
 4. Outside Diameter: 1-1/2 inches (38 mm).
 5. Configuration and Length: As indicated on Drawings.
- F. Mirror Unit M1:
1. Basis-of-Design Product: Bradley 781-2436.

2. Frame: Stainless-steel channel.
 - a. Corners: Manufacturer's standard.
3. Hangers: Produce rigid, tamper- and theft-resistant installation, using method indicated below.
 - a. One-piece, galvanized-steel, wall-hanger device with spring-action locking mechanism to hold mirror unit in position with no exposed screws or bolts.
 - b. Wall bracket of galvanized steel, equipped with concealed locking devices requiring a special tool to remove.
4. Size: 24" x 36".

G. Shower Curtain Rod R1 & R2:

1. Basis-of-Design Product: Bradley 9539.
2. Description: 1-1/4-inch (32-mm) OD; fabricated from nominal 0.05-inch- (1.3-mm-) thick stainless steel.
3. Mounting Flanges: Stainless-steel flanges designed for concealed fasteners.
4. Finish: No. 4 (satin).

H. Robe Hook H1:

1. Basis-of-Design Product: Bradley 932.
2. Description: Double-prong unit.
3. Material and Finish: Stainless steel, No. 4 finish (satin).

2.2 FABRICATION

- A. Keys: Provide universal keys for internal access to accessories for servicing and resupplying. Provide minimum of six keys to Owner's representative.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install accessories according to manufacturers' written instructions, using fasteners appropriate to substrate indicated and recommended by unit manufacturer. Install units level, plumb, and firmly anchored in locations and at heights indicated.
- B. Grab Bars: Install to withstand a downward load of at least 250 lbf (1112 N), when tested according to ASTM F 446.

END OF SECTION 102800

DIVISION 103000

Engineered Composites Fabrications

PART 1 GENERAL

1.1 SECTION INCLUDES

A. Mastercast™ Engineered Composites:

1. Tub & Shower Wall Panels

1.2 RELATED SECTIONS

- A. Section 102800 - Toilet, Bath & Laundry Accessories
- B. Section 224000 - Plumbing fixtures

1.3 REFERENCES

- A. ASTM E 84 - Standard Test Method for Surface Burning Characteristics of Building Materials.

1.4 SUBMITTALS

- A. Comply with Section 01330 - Submittal Procedures.
- B. Product Data: Submit manufacturer's product data including installation instructions.
- C. Shop Drawings: Submit manufacturer's shop drawings, including plans, elevations, sections, and details indicating dimensions, sizes, installation details, attachment provisions, and coordination requirements with adjacent work.
- D. Samples: Submit 3 manufacturer's 4-inch by 4-inch samples of engineered marble for each color specified, showing material thickness and finish. Indicate full range of colors and patterns.
- E. Manufacturer's Certification: Submit manufacturer's certification that materials comply with specified requirements and are suitable for intended application.
- F. Maintenance Data: Submit manufacturer's care and maintenance recommendations, including recommended repair and cleaning instructions.

G. Warranty: Submit manufacturer's standard commercial warranty.

1.5 QUALITY ASSURANCE

A. Manufacturer Qualifications:

1. Sufficient plant facilities to provide quality, quantities, shapes, and sizes of engineered marble units required without delaying progress of the Work.
2. Minimum of 20 years experience in producing engineered composite products.

B. Installer Qualifications: Experienced installer who has demonstrated successful installation of engineered marble or cast polymer products similar to that specified.

1.6 DELIVERY, STORAGE, AND HANDLING

A. Delivery: Deliver materials to site in manufacturer's original, unopened containers and packaging, with labels clearly identifying product name, manufacturer, and individual unit number.

B. Storage: Store materials flat in clean, dry area indoors in accordance with manufacturer's instructions.

C. Handling: Protect materials and finish from damage during handling and installation in accordance with manufacturer's instructions.

1.7 SCHEDULING

A. Schedule and deliver engineered composite units when ready for installation.

PART 2 PRODUCTS

2.1 ENGINEERED COMPOSITE

A. Material: Engineered marble

B. Compliance:

1. ASTM E 84.

C. Fabrication:

1. Mix clean aggregate filler with polyester resin to create a matrix.
2. Add colorants to matrix in a manner to provide veining to mimic appearance of natural marble products.
3. Pour material into molds behind gel coat
4. Allow to fully cure to a solid material.
5. Coat finished engineered marble units with protective wax.
6. Provide consistent color throughout depth of material, not just the

surface.

2.2 TUB AND SHOWER WALL PANELS

- A. Size: As indicated on the drawings.
- B. Thickness: 3/8 inch.
- C. Color: To be selected by Architect from manufacturer's standard color selection.
- D. Accessories:
 - 1. Panel Adhesive: Clear or color-matched 100 percent silicone panel adhesive.
 - 2. Sealant: Clear or color-matched 100 percent silicone sealant.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Examine surfaces to receive engineered marble units. Notify Architect if surfaces are not acceptable. Do not begin installation until unacceptable conditions have been corrected.
- B. Examine engineered composite units before installation. Do not install unacceptable units.

3.2 INSTALLATION

- A. Install engineered composite units in accordance with manufacturer's instructions.
- B. Install engineered composite units level, plumb, square, and in proper alignment.
- C. Make field cuts as necessary from unfinished bottom side in accordance with manufacturer's instructions.
- D. Form field joints using manufacturer's recommended adhesive.
- E. Do not excessively tighten faucet fixtures or sink drains on bathroom vanities. Hand tighten sink drains in accordance with manufacturer's instructions.
- F. Do not allow hot water temperature over 140 degrees F to come into contact with engineered composite units.
- G. Repair nicks, scratches, and other minor damages to finish in accordance with manufacturer's instructions and as approved by Architect.
- H. Remove and replace damaged units that cannot be successfully repaired as

determined by Architect.

3.3 CLEANING

- A. Clean and polish engineered composite units promptly after installation in accordance with manufacturer's instructions.
- B. Do not use abrasive or harsh cleaning materials or methods that would damage finish.
- C. Protect Finish from damage until job completion using plastic wrap, cardboard or a soft cloth.

3.4 PROTECTION

- A. Protect installed engineered composite units from damage for duration of project.

END OF SECTION 103000

SECTION 104413
FIRE PROTECTION CABINETS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes fire-protection cabinets for portable fire extinguishers.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.
- B. Shop Drawings: For fire-protection cabinets.

1.3 COORDINATION

- A. Coordinate size of fire-protection cabinets to ensure that type and capacity of fire extinguishers indicated are accommodated.
- B. Coordinate sizes and locations of fire-protection cabinets with wall depths.

1.4 SEQUENCING

- A. Apply vinyl lettering on field-painted fire-protection cabinets after painting is complete.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. Fire-Rated Fire-Protection Cabinets: Listed and labeled to comply with requirements in ASTM E 814 for fire-resistance rating of walls where they are installed.

2.2 FIRE-PROTECTION CABINET

- A. Cabinet Type: Suitable for fire extinguisher.
 - 1. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings Larsens Manufacturing Company, Occult Series or comparable product by one of the following:

- a. Fire-End & Croker Corporation.
 - b. GMR International Equipment Corporation.
 - c. Guardian Fire Equipment, Inc.
 - d. JL Industries, Inc.; a division of the Activar Construction Products Group.
 - e. Larsens Manufacturing Company.
 - f. Modern Metal Products, Division of Technico Inc.
 - g. Nystrom, Inc.
 - h. Potter Roemer LLC.
 - i. Strike First Corporation of America.
- B. Cabinet Construction: Nonrated.
- C. Cabinet Material: Cold-rolled steel sheet.
- D. Recessed Cabinet:
1. Trimless with Concealed Flange: Surface of surrounding wall finishes flush with exterior finished surface of cabinet frame and door, without overlapping trim attached to cabinet. Provide recessed flange, of same material as box, attached to box to act as drywall bead.
 2. Trimless with Hidden Flange: Flange of same metal and finish as box overlaps surrounding wall finish and is concealed from view by an overlapping door.
 3. Exposed Flat Trim: One-piece combination trim and perimeter door frame overlapping surrounding wall surface with exposed trim face and wall return at outer edge (backbend).
- E. Door Material: Stainless-steel sheet.
- F. Door Hardware: Manufacturer's standard door-operating hardware of proper type for cabinet type, trim style, and door material and style indicated.
- G. Accessories:
1. Identification: Lettering complying with authorities having jurisdiction for letter style, size, spacing, and location. Locate as directed by Architect.
 - a. Identify fire extinguisher in fire-protection cabinet with the words "FIRE EXTINGUISHER."
 - 1) Location: Applied to cabinet door.
 - 2) Application Process: Pressure-sensitive vinyl letters.
 - 3) Lettering Color: Black.
 - 4) Orientation: Vertical.
- H. Materials:
1. Cold-Rolled Steel: ASTM A 1008/A 1008M, Commercial Steel (CS), Type B.
 - a. Finish: Baked enamel or powder coat.

- b. Color: As selected by Architect from full range of industry colors and color densities.
- 2. Stainless Steel: ASTM A 666, Type 304.
 - a. Finish: No. 4 directional satin finish.

2.3 FABRICATION

- A. Fire-Protection Cabinets: Provide manufacturer's standard box (tub) with trim, frame, door, and hardware to suit cabinet type, trim style, and door style indicated.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Prepare recesses for recessed fire-protection cabinets as required by type and size of cabinet and trim style.
- B. Install fire-protection cabinets in locations and at mounting heights indicated or, if not indicated, at heights acceptable to authorities having jurisdiction.
- C. Fire-Protection Cabinets: Fasten cabinets to structure, square and plumb.
- D. Adjust fire-protection cabinet doors to operate easily without binding. Verify that integral locking devices operate properly.

END OF SECTION 104413

SECTION 104416
FIRE EXTINGUISHERS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes portable, hand-carried fire extinguishers and mounting brackets for fire extinguishers.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product.

1.3 INFORMATIONAL SUBMITTALS

- A. Warranty: Sample of special warranty.

1.4 COORDINATION

- A. Coordinate type and capacity of fire extinguishers with fire-protection cabinets to ensure fit and function.

1.5 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace fire extinguishers that fail in materials or workmanship within specified warranty period.

- 1. Warranty Period: Six years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 PERFORMANCE REQUIREMENTS

- A. NFPA Compliance: Fabricate and label fire extinguishers to comply with NFPA 10, "Portable Fire Extinguishers."
- B. Fire Extinguishers: Listed and labeled for type, rating, and classification by an independent testing agency acceptable to authorities having jurisdiction.

2.2 PORTABLE, HAND-CARRIED FIRE EXTINGUISHERS

- A. Fire Extinguishers: Type, size, and capacity for each fire-protection cabinet and mounting bracket indicated.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Amerex Corporation.
 - b. Ansul Incorporated.
 - c. Badger Fire Protection.
 - d. Buckeye Fire Equipment Company.
 - e. Fire End & Croker Corporation.
 - f. Guardian Fire Equipment, Inc.
 - g. JL Industries, Inc.; a division of the Activar Construction Products Group.
 - h. Kidde Residential and Commercial Division; Subsidiary of Kidde plc.
 - i. Larsens Manufacturing Company.
 - j. Moon American.
 - k. Nystrom Building Products.
 - l. Pem All Fire Extinguisher Corp.
 - m. Potter Roemer LLC.
 - n. Pyro-Chem; Tyco Safety Products.
 - o. Strike First Corporation of America.
 2. Instruction Labels: Include pictorial marking system complying with NFPA 10, Appendix B, and bar coding for documenting fire-extinguisher location, inspections, maintenance, and recharging.
- B. Multipurpose Dry-Chemical Type: UL-rated 5 lb. nominal capacity, with monoammonium phosphate-based dry chemical in manufacturer's standard enameled container.

2.3 MOUNTING BRACKETS

- A. Mounting Brackets: Manufacturer's standard galvanized steel, designed to secure fire extinguisher to wall or structure, of sizes required for types and capacities of fire extinguishers indicated, with plated or black baked-enamel finish.
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Amerex Corporation.
 - b. Ansul Incorporated.
 - c. Badger Fire Protection.
 - d. Buckeye Fire Equipment Company.
 - e. Fire End & Croker Corporation.
 - f. Guardian Fire Equipment, Inc.
 - g. JL Industries, Inc.; a division of the Activar Construction Products Group.

- h. Larsens Manufacturing Company.
 - i. Nystrom Building Products.
 - j. Potter Roemer LLC.
 - k. Strike First Corporation of America.
- B. Identification: Lettering complying with authorities having jurisdiction for letter style, size, spacing, and location. Locate as indicated by Architect.
- 1. Identify bracket-mounted fire extinguishers with the words "FIRE EXTINGUISHER" in red letter decals applied to mounting surface.
 - a. Orientation: Horizontal.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Examine fire extinguishers for proper charging and tagging.
 - 1. Remove and replace damaged, defective, or undercharged fire extinguishers.
- B. Install fire extinguishers and mounting brackets in locations indicated and in compliance with requirements of authorities having jurisdiction.
 - 1. Mounting Brackets: 48 inches above finished floor to top of fire extinguisher.
- C. Mounting Brackets: Fasten mounting brackets to surfaces, square and plumb, at locations indicated.

END OF SECTION 104416

DIVISION 12

FURNISHINGS

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: www.dammonengineering.com



SECTION 123000

CASEWORK

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes kitchen cabinets.

1.2 DEFINITIONS

- A. MDF: Medium-density fiberboard.

1.3 ACTION SUBMITTALS

- A. Product Data: For the following:
1. Cabinets.
 2. Cabinet hardware.

1.4 INFORMATIONAL SUBMITTALS

- A. Product Certificates: For casework.

PART 2 - PRODUCTS

2.1 CABINETS

- A. Basis of Design: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
- Cabinetry by Diamond
 - Aristokraft Cabinetry
 - Singer Kitchens
- B. Product Line: Prelude
Door Style: Wallace

2.2 CABINET MATERIALS

A. General:

1. Adhesives and Composite Wood and Agrifiber Products: Do not use products that contain urea formaldehyde.
2. Hardwood Lumber: Kiln dried to 7 percent moisture content.
3. Softwood Lumber: Kiln dried to 10 percent moisture content.
4. Hardwood Plywood: HPVA HP-1; made with adhesive containing no urea formaldehyde.
5. Particleboard: ANSI A208.1, Grade M-2; made with binder containing no urea formaldehyde.
6. MDF: ANSI A208.2, Grade MD; made with binder containing no urea formaldehyde.

B. Exposed Materials:

1. Exposed Wood Species: Maple
 - a. Select materials for compatible color and grain. Do not use two adjacent exposed surfaces that are noticeably dissimilar in color, grain, figure, or natural character markings.
 - b. Staining and Finish: As selected by Architect from manufacturer's full range.
2. Solid Wood: Clear hardwood lumber of species indicated, free of defects.
3. Plywood: Hardwood plywood with face veneer of species indicated, with Grade A faces and Grade C backs of same species as faces.
4. Plastic Laminate: Particleboard faced with high-pressure decorative laminate complying with NEMA LD 3.
 - a. Colors, Textures, and Patterns: As selected by Architect from cabinet manufacturer's full range.

C. Concealed Materials: Solid wood or plywood, of any hardwood or softwood species, with no defects affecting strength or utility; particleboard; MDF; or hardboard.

2.3 CABINET HARDWARE

- A. General: Manufacturer's standard units complying with BHMA A156.9, of type, size, style, material, and finish as indicated by manufacturer's designations.
- B. Pulls: Back-mounted decorative pulls. Basis of design: Diamond Pull H63.
- C. Hinges: Concealed European-style, self-closing hinges.

- D. Drawer Guides: Epoxy-coated-metal, self-closing drawer guides; designed to prevent rebound when drawers are closed; with nylon-tired, ball-bearing rollers; and complying with BHMA A156.9, Type B05011 or Type B05091.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install cabinets with no variations in flushness of adjoining surfaces; use concealed shims. Where cabinets abut other finished work, scribe and cut for accurate fit. Provide filler strips, scribe strips, and moldings in finish to match cabinet face.
- B. Install cabinets without distortion so doors and drawers fit the openings, are aligned, and are uniformly spaced. Complete installation of hardware and accessories as indicated.
- C. Install cabinets level and plumb to a tolerance of 1/8 inch in 8 feet.
- D. Fasten cabinets to adjacent units and to backing.
 - 1. Fasten wall cabinets through back, near top and bottom, and at ends not more than 16 inches o.c. with No. 10 wafer-head screws sized for not less than 1-1/2-inch penetration into wood framing, blocking, or hanging strips.

3.2 ADJUSTING AND CLEANING

- A. Adjust cabinets and hardware so doors and drawers are centered in openings and operate smoothly without warp or bind. Lubricate operating hardware as recommended by manufacturer.

END OF SECTION 123000

SECTION 123640

STONE COUNTERTOP

PART 1 GENERAL

1.1 SUMMARY

- A. Section Includes:
 - 1. Granite Countertops
 - 2. Granite Splashes

1.2 REFERENCES

- A. ASTM: American Society for Testing and Materials International
- B. AWI: Architectural Woodwork Institute
- C. AWMAC: Architectural Woodwork Manufacturers' Association of Canada.
- D. MIA: Marble Institute of America
- E. NBGQA: National Building Granite Quarries Association, Inc.
- F. WI: Woodwork Institute (Formerly: WIC - Woodwork Institute of California)

1.3 SUBMITTALS

- A. Product Data: Provide data on stone units.
- B. Shop Drawings
 - 1. Indicate facing layout and sizes.
 - 2. Indicate countertop dimensions and installation methods.
- C. Samples for Initial Selection:
 - 1. Stone Samples: Submit three stone samples 6 by 6 inch (15.0 by 15.0 cm) in size, illustrating color range and texture, markings, and surface finish for each stone product and color required.
 - 2. Sealant Samples: Manufacturer's color chart indicating full range of standard sealant colors.
- D. Qualification Statements:
 - 1. Fabricator's qualification statement.
 - 2. Installer's qualification statement.

- E. Operation and Maintenance Data: Indicate list of approved cleaning materials and procedures required; list of substances that are harmful to the component materials.

1.4 QUALITY ASSURANCE

- A. Fabricator/Installer: Listed as an Approved Fabricators in Part 2 Products below.
- B. Fabricator: Company with experience in the fabrication and installation] of work similar to that required for this project for a period of 3 years or more and meets the following requirements:
 - 1. Member of Marble Institute of America.
 - 2. Experience with wet fabrication techniques and has a shop capable of cutting and polishing granite in compliance with MIA Standards.

PART 2 PRODUCTS

2.1 STONE MATERIALS

- A. Granite: ASTM C615; type, color, and surface texture as specified by Architect.
 - 1. Species: Uba Tuba
 - 2. Grade: Architectural

2.2 COMPONENTS

- A. Granite Countertops:
 - 1. Dimensions: As indicated on drawings.
 - a. Thickness: As required by base cabinet depth indicated on drawings.
 - b. Width: As required by base cabinet depth indicated on drawings.
 - 2. Standard Edge Detail:
 - a. Straight with eased edge: 1/8 inch (0.30 cm), top and bottom
- B. Granite Backsplashes and End Splashes:
 - 1. Dimensions: As indicated on drawings.
 - a. Thickness: 3/4 inch (2.0 cm).
 - b. Height: As indicated on drawings.

2.3 PERFORMANCE CRITERIA

- A. Sustainability Characteristics: Maximum VOC content for field applied materials calculated according to 40 CFR 59, Subpart D (EPA Method 24):
1. Adhesives: 65 g/L.
 2. Sealants: 250 g/L.
 3. Sealers: 250 g/L.

2.4 FABRICATION

- A. General:
1. Comply with the requirements of the following reference standards:
 - a. NBGQA's "Standard Specifications for Architectural Granite."
 - b. Marble Institute of America's "Dimension Stone Design Manual."
 2. Cut edges, corners, intersections, openings square, true, and straight unless otherwise indicated.
 3. Seam Width: 1/8 inch (0.30 cm) maximum.
 4. Lippage Mismatch: 1/16 inch (0.15 cm) maximum.
 5. Cut openings in shop and grind edges to remove cut marks.
 - a. Finish exposed edges of cut outs to match exposed finish of granite piece.
- B. Layout:
1. Field verify dimension before fabricating components.
 2. Layout work to minimize the number of seams.
 3. Align seams with joints in cabinets and casework.
 4. Do not locate seams at large openings, such as sinks.
- C. Counter:
1. Sink Mount: Under-mount.
 2. Cutouts: Coordinate size and location with other trades and comply with sink manufacturer's product specifications.
 - a. Accurately locate and size cutouts.
 - b. Polish edges of cutouts.
 3. Corners Condition: Common seam with bullnose return corner.
- D. Splashes:
1. Provide separate from countertops for field installation.
 2. Corners Condition: Butt.
- E. Seams:
1. Bonded Seams: Polyester resin or Epoxy Resin.
 2. Sealant Filled Seams: As specified in Division 07 Section titled, "Joint Sealants."

- F. Edge Condition: Cutout Edges:
 - 1. Hand grind to create a sharp line of reprise.

- G. Finish:
 - 1. Polished finish.

2.5 MISCELLANEOUS MATERIALS

- A. Adhesive: DuPont™ Silicone Adhesive.

- B. Sealant: Manufacturer's recommended sealant.
 - 1. Color: As specified by Architect.

2.6 ACCESSORIES

- A. Attachments: Stainless steel.

- B. Fixture Mountings: Stainless steel, suitable for top and under counter mounting and countertop construction.

PART 3 EXECUTION

3.1 INSTALLATION

- A. General:
 - 1. Install items specified in this section according to countertop manufacturer's instructions and in compliance with the installation requirements of the following referenced standards:
 - a. MIA's "Dimension Stone Design Manual" Chapters 13 & 17.
 - b. NBGQA's "Standard Specifications for Architectural Granite"
 - c. Architectural Woodwork Standards, Section 11, Subparagraph 6.2.5 for installation of epoxy resin, natural/manufactured stone as published by AWI, WI, and AWMAC.
 - 2. Do not field cut stone unless otherwise indicated.
 - 3. "Dry assemble" pieces to verify fit before applying adhesives.
 - 4. Shim pieces as required to produce surfaces that are plumb, level, flush, aligned, and true.
 - 5. Apply adhesives only after final adjustments and corrections to fit have been made.
 - 6. Fill seams with sealants before final positioning.

- B. Countertop:
 - 1. Install countertop to plywood substrate with adhesive.
 - 2. Apply adhesive to seams and draw panels tight.

- C. Sealant: Apply sealant around fixtures and appliances set into panels and seams between granite units.

3.2 CLEANING

- A. Clean according to manufacturer's instructions, but not less than the following:
 - 1. Wash with clean, water suitable for drinking and neutral (pH 7), soapless cleaner approved by countertop manufacturer.
 - 2. Leave no streaks, smears, or stains.

3.3 PROTECTION

- A. Repair scratches and scars according to manufacturer's instructions.
- B. Provide protection according to countertop manufacturer's instructions, but not less than the following:
 - 1. Sealer: Apply according to sealer manufacturers instructions.
 - 2. Protective Covering: Cover granite surfaces with nonstaining kraft paper, clean fabric tarp, or 6 mil plastic film.
 - a. Remove protective covering at Substantial Completion.

END OF SECTION 123640

DIVISION 13

SPECIAL CONSTRUCTION

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832

Email: info@dammonengineering.com
Website: www.dammonengineering.com



SECTION 133419
METAL BUILDING SYSTEMS

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes metal building systems that consist of integrated sets of mutually dependent components including structural framing and accessories.

1.3 DEFINITIONS

- A. Bay: Dimension between main frames measured normal to frame (at centerline of frame) for interior bays, and dimension from centerline of first interior main frame measured normal to end wall (outside face of end-wall girt) for end bays.
- B. Building Length: Dimension of the building measured perpendicular to main framing from end wall to end wall (outside face of girt to outside face of girt).
- C. Building Width: Dimension of the building measured parallel to main framing from sidewall to sidewall (outside face of girt to outside face of girt).
- D. Clear Span: Distance between supports of beams, girders, or trusses (measured from lowest level of connecting area of a column and a rafter frame or knee).
- E. Eave Height: Vertical dimension from finished floor to eave (the line along the sidewall formed by intersection of the planes of the roof and wall).
- F. Clear Height under Structure: Vertical dimension from finished floor to lowest point of any part of primary or secondary structure, not including crane supports, located within clear span.
- G. Terminology Standard: Refer to MBMA's "Metal Building Systems Manual" for definitions of terms for metal building system construction not otherwise defined in this Section or in referenced standards.

1.4 SYSTEM DESCRIPTION

- A. General: Provide a complete, integrated set of metal building system manufacturer's standard mutually dependent components and assemblies that form a metal building system capable of withstanding structural and other loads, thermally induced movement, and exposure to weather without failure or infiltration of water into building interior. Include primary and secondary framing and accessories complying with requirements indicated.
 - 1. Provide metal building system of size and with spacings, slopes, and spans indicated.
- B. Primary Frame Type:
 - 1. Rigid Clear Span: Solid-member, structural-framing system without interior columns.
- C. End-Wall Framing: Manufacturer's standard, for buildings not required to be expandable, consisting of primary frame, capable of supporting one-half of a bay design load, and end-wall columns.
- D. Secondary Frame Type: Manufacturer's standard purlins and joists.
- E. Eave Height: As indicated by nominal height on Drawings.

1.5 SYSTEM PERFORMANCE REQUIREMENTS

- A. Structural Performance: Provide metal building systems capable of withstanding the effects of gravity loads and the following loads and stresses within limits and under conditions indicated:
 - 1. Engineer metal building systems according to procedures in MBMA's "Metal Building Systems Manual."
 - 2. Design Loads: As indicated on Drawings.
 - 3. Design Loads: As required by MBMA's "Metal Building Systems Manual." and ASCE 7-10, "Minimum Design Loads for Buildings and Other Structures."
 - 4. Live Loads: Include vertical loads induced by the building occupancy indicated on Drawings. Include loads induced by maintenance workers, materials, and equipment for roof live loads.
 - 5. Wind Loads: Include horizontal loads induced by a basic wind speed corresponding to a 50-year, mean-recurrence interval at Project site of 155 mph.
 - 6. Collateral Loads: Include additional dead loads other than the weight of metal building system for permanent items such as sprinklers, mechanical systems, electrical systems, and ceilings.
 - 7. Auxiliary Loads: Include dynamic live loads, such as those generated by cranes and materials-handling equipment indicated on Drawings.

8. Load Combinations: Design metal building systems to withstand the most critical effects of load factors and load combinations as required by MBMA's "Metal Building Systems Manual." and ASCE 7-10, "Minimum Design Loads for Buildings and Other Structures."
 9. Deflection Limits: Engineer assemblies shall be designed to accommodate long-term irreversible deflections under sustained loads:
 - a. Purlins and Rafters: Vertical deflection of 1/240 of the span.
 10. Design secondary framing system to accommodate deflection of primary building structure and construction tolerances, and to maintain clearances at openings.
 11. Provide metal panel assemblies capable of withstanding the effects of loads and stresses indicated, based on testing according to ASTM E 1592.
- B. Seismic Performance: Design and engineer metal building systems capable of withstanding the effects of earthquake motions determined according to ASCE 7-10, "Minimum Design Loads for Buildings and Other Structures": Sections 11-23.
- C. Thermal Movements: Provide metal panel systems that allow for thermal movements resulting from the following maximum change (range) in ambient and surface temperatures by preventing buckling, opening of joints, overstressing of components, failure of joint sealants, failure of connections, and other detrimental effects. Base engineering calculation on surface temperatures of materials due to both solar heat gain and nighttime-sky heat loss.
1. Temperature Change (Range): 120 deg F, ambient; 180 deg F, material surfaces.
- D. Wind-Uplift Resistance: Provide metal roof panel assemblies that comply with UL 580 for Class 90.
- 1.6 SUBMITTALS
- A. Product Data: Include construction details, material descriptions, dimensions of individual components and profiles, and finishes for each type of the following metal building system components:
 1. Structural-framing system.
 2. Accessories.
 - B. Shop Drawings: For the following metal building system components. Include plans, elevations, sections, details, and attachments to other work.
 1. For installed products indicated to comply with design loads, include structural analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

2. Anchor-Bolt Plans: Submit anchor-bolt plans before foundation work begins. Include location, diameter, and projection of anchor bolts required to attach metal building to foundation. Indicate column reactions at each location.
 3. Structural-Framing Drawings: Show complete fabrication of primary and secondary framing; include provisions for openings. Indicate welds and bolted connections, distinguishing between shop and field applications. Include transverse cross-sections.
- C. Product Certificates: For each type of metal building system, signed by product manufacturer.
1. Letter of Design Certification: Signed and sealed by a qualified professional engineer. Include the following:
 - a. Name and location of Project.
 - b. Order number.
 - c. Name of manufacturer.
 - d. Name of Contractor.
 - e. Building dimensions including width, length, height, and roof slope.
 - f. Indicate compliance with AISC standards for hot-rolled steel and AISI standards for cold-rolled steel, including edition dates of each standard.
 - g. Governing building code and year of edition.
 - h. Design Loads: Include dead load, roof live load, collateral loads, roof snow load, deflection, wind loads/speeds and exposure, seismic design category or effective peak velocity-related acceleration/peak acceleration, and auxiliary loads (cranes).
 - i. Load Combinations: Indicate that loads were applied acting simultaneously with concentrated loads, according to governing building code.
 - j. Building-Use Category: Indicate category of building use and its effect on load importance factors.
 - k. AISC Certification for Category MB: Include statement that metal building system and components were designed and produced in an AISC-Certified Facility by an AISC-Certified Manufacturer.
- D. Welding certificates.
- E. Erector Certificate: Signed by manufacturer certifying that erector complies with requirements.
- F. Manufacturer Certificate: Signed by manufacturer certifying that products comply with requirements.
- G. Qualification Data: For Erector, manufacturer, professional engineer.
- H. Material Test Reports: Signed by manufacturers certifying that the following products comply with requirements:

1. Structural steel including chemical and physical properties.
 2. Bolts, nuts, and washers including mechanical properties and chemical analysis.
 3. Tension-control, high-strength, bolt-nut-washer assemblies.
 4. Shop primers.
 5. Nonshrink grout.
- I. Source quality-control test reports.
 - J. Field quality-control test reports.
 - K. Product Test Reports: Based on evaluation of comprehensive tests performed by manufacturer and witnessed by a qualified testing agency, for insulation and vapor retarders. Include reports for thermal resistance, fire-test-response characteristics, water-vapor transmission, and water absorption.
 - L. Surveys: Show final elevations and locations of major members. Indicate discrepancies between actual installation and the Contract Documents. Have surveyor who performed surveys certify their accuracy.
 - M. Warranties: Special warranties specified in this Section.

1.7 QUALITY ASSURANCE

- A. Erector Qualifications: An experienced erector who has specialized in erecting and installing work similar in material, design, and extent to that indicated for this Project and who is acceptable to manufacturer.
- B. Manufacturer Qualifications: A qualified manufacturer and member of MBMA.
 1. Certification for Metal Building: An AISC-Certified or IAS-Certified Manufacturer that designs and produces metal building systems and components in a Certified Facility.”.
 2. Engineering Responsibility: Preparation of Shop Drawings and comprehensive engineering analysis by a qualified professional engineer.
- C. Land Surveyor Qualifications: A professional land surveyor who is legally qualified to practice in jurisdiction where Project is located and who is experienced in providing surveying services of the kind indicated.
- D. Testing Agency Qualifications: An independent agency qualified according to ASTM E 329 for testing indicated, as documented according to ASTM E 548.
- E. Source Limitations: Obtain primary metal building system components, including structural framing and metal panel assemblies, through one source from a single manufacturer.

- F. Product Options: Drawings indicate size, profiles, and dimensional requirements of metal building system and are based on the specific system indicated. Refer to Division 1 Section "Product Requirements."
 - 1. Do not modify intended aesthetic effects, as judged solely by Architect, except with Architect's approval. If modifications are proposed, submit comprehensive explanatory data to Architect for review.
- G. Welding: Qualify procedures and personnel according to AWS D1.1, "Structural Welding Code--Steel," and AWS D1.3, "Structural Welding Code--Sheet Steel."
- H. Structural Steel: Comply with AISC's "Specification for Structural Steel Buildings--Allowable Stress Design, Plastic Design," or AISC's "Load and Resistance Factor Design Specification for Structural Steel Buildings," for design requirements and allowable stresses.
- I. Pre-Erection Conference: Conduct conference at Project site to comply with requirements in Division 1 Section "Project Management and Coordination." Review methods and procedures related to metal building systems including, but not limited to, the following:
 - 1. Inspect and discuss condition of foundations and other preparatory work performed by other trades.
 - 2. Review structural load limitations.
 - 3. Review and finalize construction schedule and verify availability of materials, Erector's personnel, equipment, and facilities needed to make progress and avoid delays.
 - 4. Review required testing, inspecting, and certifying procedures.
 - 5. Review weather and forecasted weather conditions and procedures for unfavorable conditions.

1.8 DELIVERY, STORAGE, AND HANDLING

- A. Deliver components, sheets, panels, and other manufactured items so as not to be damaged or deformed. Package metal panels for protection during transportation and handling.
- B. Unload, store, and erect metal panels in a manner to prevent bending, warping, twisting, and surface damage.

1.9 PROJECT CONDITIONS

- A. Weather Limitations: Proceed with installation only when weather conditions permit metal panels to be installed according to manufacturers' written instructions and warranty requirements.

B. Field Measurements:

1. Established Dimensions for Foundations: Comply with established dimensions on approved anchor-bolt plans, establishing foundation dimensions and proceeding with fabricating structural framing without field measurements. Coordinate anchor-bolt installation to ensure that actual anchorage dimensions correspond to established dimensions.

1.10 COORDINATION

- A. Coordinate size and location of concrete foundations and casting of anchor-bolt inserts into foundation walls and footings. Concrete, reinforcement, and formwork requirements are specified in Division 3 Section "Cast-in-Place Concrete."

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
- C. Basis-of-Design Product: The design for metal building systems is based on Ruffin Building Systems. Subject to compliance with requirements, provide the named product or a comparable product by one of the following:
 1. Alliance Steel, Inc.
 2. American Buildings Company.
 3. American Steel Building Company, Inc.; Division of NCI Building Systems, LLP.
 4. Behlen Mfg. Co.
 5. Butler Manufacturing Company.
 6. Ceco Building Systems; Division of Robertson-Ceco Corporation.
 7. Crown Metal Buildings, Inc.
 8. Garco Building Systems.
 9. Gulf States Manufacturers, Inc.
 10. Mesco Metal Buildings; Division of NCI Building Systems, LLP.
 11. Metallic Metal Building Company; Division of NCI Building Systems, LLP.
 12. Package Industries, Inc.
 13. Southern Structures, Inc.
 14. Spirco Manufacturing; Division of Metal Building Products, Inc.
 15. Star Building Systems; Division of Robertson-Ceco Corporation.
 16. Steelox Systems Inc.

17. United Structures of America, Inc.
18. VP Buildings, Inc.; a United Dominion Company.
19. Ascent Buildings

2.2 STRUCTURAL-FRAMING MATERIALS

- A. W-Shapes: ASTM A 992/A 992M; ASTM A 572/A 572M, Grade 50 or 55; or ASTM A 529/A 529M, Grade 50 or 55.
- B. Channels, Angles, M-Shapes, and S-Shapes: ASTM A 36/A 36M; ASTM A 572/A 572M, Grade 50 or 55; or ASTM A 529/A 529M, Grade 50 or 55.
- C. Plate and Bar: ASTM A 36/A 36M; ASTM A 572/A 572M, Grade 50 or 55; or ASTM A 529/A 529M, Grade 50 or 55.
- D. Steel Pipe: ASTM A 53/A 53M, Type E or S, Grade B.
- E. Cold-Formed Hollow Structural Sections: ASTM A 500, Grade B or C, structural tubing.
- F. Structural-Steel Sheet: Hot-rolled, ASTM A 1011/A 1011M, Structural Steel (SS), Grades 30 through 55, or High-Strength Low Alloy Steel (HSLAS), Grades 45 through 70; or cold-rolled, ASTM A 1008/A 1008M, Structural Steel (SS), Grades 25 through 80, or High-Strength Low Alloy Steel (HSLAS), Grades 45 through 70.
- G. Joist Girders: Manufactured according to "Standard Specifications for Joist Girders," in SJI's "Standard Specifications, Load Tables, and Weight Tables for Steel Joists and Joist Girders," with steel-angle, top- and bottom-chord members; with end- and top-chord arrangements as indicated and required for primary framing.
- H. Steel Joists: Manufactured according to "Standard Specifications for Open Web Steel Joists, K-Series," in SJI's "Standard Specifications, Load Tables, and Weight Tables for Steel Joists and Joist Girders," with steel-angle, top- and bottom-chord members; with end- and top-chord arrangements as indicated and required for secondary framing.
- I. Non-High-Strength Bolts, Nuts, and Washers: ASTM A 307, Grade A, carbon-steel, hex-head bolts; ASTM A 563 carbon-steel hex nuts; and ASTM F 844 plain (flat) steel washers.
 1. Finish: Mechanically deposited zinc coating, ASTM B 695, Class 50.
- J. High-Strength Bolts, Nuts, and Washers: ASTM A 325, Type 1, heavy hex steel structural bolts; ASTM A 563 heavy hex carbon-steel nuts; and ASTM F 436 hardened carbon-steel washers.
 1. Finish: Mechanically deposited zinc coating, ASTM B 695, Class 50.

2. Tension-Control, High-Strength Bolt-Nut-Washer Assemblies: ASTM F 1852, Type 1, heavy-hex-head steel structural bolts with splined ends.
 - a. Finish: Mechanically deposited zinc coating, ASTM B 695, Class 50.
- K. High-Strength Bolts, Nuts, and Washers: ASTM A 490, Type 1, heavy hex steel structural bolts; ASTM A 563 heavy hex carbon-steel nuts; and ASTM F 436 hardened carbon-steel washers, plain.
- L. Unheaded Anchor Rods: ASTM F 1554, Grade 36.
 1. Configuration: Straight.
 2. Nuts: ASTM A 563 heavy hex carbon steel.
 3. Plate Washers: ASTM A 36/A 36M carbon steel.
 4. Washers: ASTM F 436 hardened carbon steel.
 5. Finish: Hot-dip zinc coating, ASTM A 153, Class C.
- M. Headed Anchor Rods: ASTM F 1554, Grade 36, straight.
 1. Nuts: ASTM A 563 heavy hex carbon steel.
 2. Plate Washers: ASTM A 36/A 36M carbon steel.
 3. Washers: ASTM F 436 hardened carbon steel.
 4. Finish: Hot-dip zinc coating, ASTM A 153, Class C.
- N. Threaded Rods: ASTM A 36.
 1. Nuts: ASTM A 563 heavy hex carbon steel.
 2. Washers: ASTM A 36 carbon steel.
 3. Finish: Hot-dip zinc coating, ASTM A 153.
- O. Primer: SSPC-Paint 15, Type I, red oxide.

2.3 MISCELLANEOUS MATERIALS

- A. Fasteners: Self-tapping screws, bolts, nuts, self-locking rivets and bolts, end-welded studs, and other suitable fasteners designed to withstand design loads. Provide fasteners with heads matching color of materials being fastened by means of plastic caps or factory-applied coating.
 1. Fasteners for Metal Roof Panels: Self-drilling or self-tapping, zinc-plated, hex-head carbon-steel screws, with a stainless-steel cap or zinc-aluminum-alloy head and EPDM or neoprene sealing washer.
 2. Fasteners for Metal Wall Panels: Self-drilling or self-tapping, zinc-plated, hex-head carbon-steel screws, with nylon or polypropylene washer.
 3. Fasteners for Metal Roof and Wall Panels: Self-drilling Type 410 stainless-steel or self-tapping Type 304 stainless-steel or zinc-alloy-steel hex washer head,

with EPDM or PVC washer under heads of fasteners bearing on weather side of metal panels.

4. Fasteners for Flashing and Trim: Blind fasteners or self-drilling screws with hex washer head.
5. Blind Fasteners: High-strength aluminum or stainless-steel rivets.

2.4 FABRICATION, GENERAL

- A. General: Design components and field connections required for erection to permit easy assembly.
 1. Mark each piece and part of the assembly to correspond with previously prepared erection drawings, diagrams, and instruction manuals.
 2. Fabricate structural framing to produce clean, smooth cuts and bends. Punch holes of proper size, shape, and location. Members shall be free of cracks, tears, and ruptures.
- B. Tolerances: Comply with MBMA's "Metal Building Systems Manual": Chapter IV, Section 9, "Fabrication and Erection Tolerances."

2.5 STRUCTURAL FRAMING

- A. General:
 1. Primary Framing: Shop fabricate framing components to indicated size and section with baseplates, bearing plates, stiffeners, and other items required for erection welded into place. Cut, form, punch, drill, and weld framing for bolted field assembly.
 - a. Make shop connections by welding or by using high-strength bolts.
 - b. Join flanges to webs of built-up members by a continuous submerged arc-welding process.
 - c. Brace compression flange of primary framing with steel angles or cold-formed structural tubing between frame web and purlin or girt web, so flange compressive strength is within allowable limits for any combination of loadings.
 - d. Weld clips to frames for attaching secondary framing members.
 - e. Shop Priming: Prepare surfaces for shop priming according to SSPC-SP 2. Shop prime primary structural members with specified primer after fabrication.
 2. Secondary Framing: Shop fabricate framing components to indicated size and section by roll-forming or break-forming, with baseplates, bearing plates, stiffeners, and other plates required for erection welded into place. Cut, form, punch, drill, and weld secondary framing for bolted field connections to primary framing.

- a. Make shop connections by welding or by using non-high-strength bolts.
 - b. Shop Priming: Prepare uncoated surfaces for shop priming according to SSPC-SP 2. Shop prime uncoated secondary structural members with specified primer after fabrication.
- B. Primary Framing: Manufacturer's standard structural primary framing system, designed to withstand required loads and specified requirements. Primary framing includes transverse and lean-to frames; rafter, rake, and canopy beams; sidewall, intermediate, end-wall, and corner columns; and wind bracing.
 1. General: Provide frames with attachment plates, bearing plates, and splice members. Factory drill for field-bolted assembly. Provide frame span and spacing indicated.
 - a. Slight variations in span and spacing may be acceptable if necessary to meet manufacturer's standard, as approved by Architect.
 2. Rigid Clear-Span Frames: I-shaped frame sections fabricated from shop-welded, built-up steel plates or structural-steel shapes. Interior columns are not permitted.
 3. Frame Configuration: Two-directional sloped.
 4. Exterior Column Type: Tapered.
 5. Rafter Type: Tapered.
- C. End-Wall Framing: Manufacturer's standard primary end-wall framing fabricated for field-bolted assembly to comply with the following:
 1. End-Wall and Corner Columns: I-shaped sections fabricated from structural-steel shapes; shop-welded, built-up steel plates; or C-shaped, cold-formed, structural-steel sheet; with minimum thickness of 0.0598 inch.
 2. End-Wall Rafters: C-shaped, cold-formed, structural-steel sheet; with minimum thickness of 0.0598 inch; or I-shaped sections fabricated from shop-welded, built-up steel plates or structural-steel shapes.
- D. Secondary Framing: Manufacturer's standard secondary framing members, including purlins, girts, eave struts, flange bracing, base members, gable angles, clips, headers, jambs, and other miscellaneous structural members. Fabricate framing from cold-formed, structural-steel sheet or roll-formed, metallic-coated steel sheet prepainted with coil coating, unless otherwise indicated, to comply with the following:
 1. Purlins: C- or Z-shaped sections; fabricated from minimum 0.0598-inch thick steel sheet, built-up steel plates, or structural-steel shapes; minimum 2-1/2-inch wide flanges.
 - a. Depth: As required to comply with system performance requirements.
 2. Purlins: Steel joists of depths indicated.

3. Girts: C- or Z-shaped sections; fabricated from minimum 0.0598-inch thick steel sheet, built-up steel plates, or structural-steel shapes. Form ends of Z-sections with stiffening lips angled 40 to 50 degrees to flange and with minimum 2-1/2-inch wide flanges.
 - a. Depth: As required to comply with system performance requirements] <Insert dimension.
4. Eave Struts: Unequal-flange, C-shaped sections; fabricated from 0.0598-inch thick steel sheet, built-up steel plates, or structural-steel shapes; to provide adequate backup for metal panels.
5. Flange Bracing: Minimum 2-by-2-by-1/8-inch structural-steel angles or 1-inch diameter, cold-formed structural tubing to stiffen primary frame flanges.
6. Sag Bracing: Minimum 1-by-1-by-1/8-inch structural-steel angles.
7. Base or Sill Angles: Minimum 3-by-2-by-0.0598-inch zinc-coated (galvanized) steel sheet.
8. Purlin and Girt Clips: Minimum 0.0598-inch thick, steel sheet. Provide galvanized clips where clips are connected to galvanized framing members.
9. Secondary End-Wall Framing: Manufacturer's standard sections fabricated from minimum 0.0598-inch thick, structural-steel sheet.
10. Framing for Openings: Channel shapes; fabricated from minimum 0.0598-inch thick, cold-formed, structural-steel sheet or structural-steel shapes. Frame head and jamb of door openings, and head, jamb, and sill of other openings.
11. Miscellaneous Structural Members: Manufacturer's standard sections fabricated from cold-formed, structural-steel sheet; built-up steel plates; or zinc-coated (galvanized) steel sheet; designed to withstand required loads.

2.6 ACCESSORIES

- A. General: Provide accessories as standard with metal building system manufacturer and as specified. Fabricate and finish accessories at the factory to greatest extent possible, by manufacturer's standard procedures and processes. Comply with indicated profiles and with dimensional and structural requirements.

2.7 FINISHES, GENERAL

- A. Comply with NAAMM's "Metal Finishes Manual for Architectural and Metal Products" for recommendations for applying and designating finishes.

2.8 SOURCE QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing and inspecting agency to perform the following tests and inspections and to submit reports.

1. Special inspections will not be required if fabrication is performed by a manufacturer registered and approved by authorities having jurisdiction to perform such Work without special inspection.
 - a. After fabrication, submit certificate of compliance with copy to authorities having jurisdiction certifying that Work was performed according to Contract requirements.
- B. Tests and Inspections:
 1. Bolted Connections: Shop-bolted connections shall be tested and inspected according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."
 2. Welded Connections: In addition to visual inspection, shop-welded connections shall be tested and inspected according to AWS D1.1 and the following inspection procedures, at inspector's option:
 - a. Liquid Penetrant Inspection: ASTM E 165.
 - b. Magnetic Particle Inspection: ASTM E 709; performed on root pass and on finished weld. Cracks or zones of incomplete fusion or penetration will not be accepted.
 - c. Ultrasonic Inspection: ASTM E 164.
 - d. Radiographic Inspection: ASTM E 94.
- C. Correct deficiencies in Work that test reports and inspections indicate do not comply with the Contract Documents.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Erector present, for compliance with requirements for installation tolerances and other conditions affecting performance of work.
 1. For the record, prepare written report, endorsed by Erector, listing conditions detrimental to performance of work.
- B. Before erection proceeds, survey elevations and locations of concrete- and masonry-bearing surfaces and locations of anchor rods, bearing plates, and other embedments to receive structural framing, with Erector present, for compliance with requirements and metal building system manufacturer's tolerances.
 1. Engage land surveyor to perform surveying.
- C. Proceed with erection only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. Clean and prepare surfaces to be painted according to manufacturer's written instructions for each particular substrate condition.
- B. Provide temporary shores, guys, braces, and other supports during erection to keep structural framing secure, plumb, and in alignment against temporary construction loads and loads equal in intensity to design loads. Remove temporary supports when permanent structural framing, connections, and bracing are in place, unless otherwise indicated.

3.3 ERECTION OF STRUCTURAL FRAMING

- A. Erect metal building system according to manufacturer's written erection instructions and erection drawings.
- B. Do not field cut, drill, or alter structural members without written approval from metal building system manufacturer's professional engineer.
- C. Set structural framing accurately in locations and to elevations indicated and according to AISC specifications referenced in this Section. Maintain structural stability of frame during erection.
- D. Base and Bearing Plates: Clean concrete- and masonry-bearing surfaces of bond-reducing materials, and roughen surfaces prior to setting plates. Clean bottom surface of plates.
 - 1. Set plates for structural members on wedges, shims, or setting nuts as required.
 - 2. Tighten anchor rods after supported members have been positioned and plumbed. Do not remove wedges or shims but, if protruding, cut off flush with edge of plate before packing with grout.
 - 3. Promptly pack grout solidly between bearing surfaces and plates so no voids remain. Neatly finish exposed surfaces; protect grout and allow to cure. Comply with manufacturer's written installation instructions for shrinkage-resistant grouts.
- E. Align and adjust structural framing before permanently fastening. Before assembly, clean bearing surfaces and other surfaces that will be in permanent contact with framing. Perform necessary adjustments to compensate for discrepancies in elevations and alignment.
 - 1. Level and plumb individual members of structure.
 - 2. Make allowances for difference between temperature at time of erection and mean temperature when structure will be completed and in service.

- F. Primary Framing and End Walls: Erect framing true to line, level, plumb, rigid, and secure. Level baseplates to a true even plane with full bearing to supporting structures, set with double-nutted anchor bolts. Use grout to obtain uniform bearing and to maintain a level base-line elevation. Moist cure grout for not less than seven days after placement.
1. Make field connections using high-strength bolts installed according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for type of bolt and type of joint specified.
 - a. Joint Type: Snug tightened or pretensioned.
- G. Secondary Framing: Erect framing true to line, level, plumb, rigid, and secure. Fasten secondary framing to primary framing using clips with field connections using non-high-strength bolts.
1. Provide rake or gable purlins with tight-fitting closure channels and fasciae.
 2. Locate and space wall girts to suit openings such as doors and windows.
 3. Locate canopy framing as indicated.
 4. Provide supplemental framing at entire perimeter of openings, including doors, windows, louvers, ventilators, and other penetrations of roof and walls.
- H. Steel Joists and Joist Girders: Install joists, girders, and accessories plumb, square, and true to line; securely fasten to supporting construction according to SJI's "Standard Specifications, Load Tables, and Weight Tables for Steel Joists and Joist Girders," joist manufacturer's written recommendations, and requirements in this Section.
1. Before installation, splice joists delivered to Project site in more than one piece.
 2. Space, adjust, and align joists accurately in location before permanently fastening.
 3. Install temporary bracing and erection bridging, connections, and anchors to ensure that joists are stabilized during construction.
 4. Bolt joists to supporting steel framework using carbon-steel bolts, unless otherwise indicated.
 5. Bolt joists to supporting steel framework using high-strength structural bolts, unless otherwise indicated. Comply with RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts" for high-strength structural bolt installation and tightening requirements.
 6. Install and connect bridging concurrently with joist erection, before construction loads are applied. Anchor ends of bridging lines at top and bottom chords if terminating at walls or beams.
- I. Bracing: Install bracing in roof and sidewalls where indicated on erection drawings.
1. Tighten rod and cable bracing to avoid sag.
 2. Locate interior end-bay bracing only where indicated.

- J. Framing for Openings: Provide shapes of proper design and size to reinforce openings and to carry loads and vibrations imposed, including equipment furnished under mechanical and electrical work. Securely attach to structural framing.
- K. Erection Tolerances: Maintain erection tolerances of structural framing within AISC's "Code of Standard Practice for Steel Buildings and Bridges."

3.4 FIELD QUALITY CONTROL

- A. Testing Agency: Engage a qualified testing and inspecting agency to perform the following tests and inspections and to submit reports.
- B. Tests and Inspections:
 - 1. High-Strength, Field-Bolted Connections: Connections shall be tested and inspected during installation according to RCSC's "Specification for Structural Joints Using ASTM A 325 or A 490 Bolts."
 - 2. Welded Connections: In addition to visual inspection, field-welded connections shall be tested and inspected according to AWS D1.1 and the following inspection procedures, at inspector's option:
 - a. Inspection: ASTM E 165.
 - b. Magnetic Particle Inspection: ASTM E 709; performed on root pass and on finished weld. Cracks or zones of incomplete fusion or penetration will not be accepted.
 - c. Ultrasonic Inspection: ASTM E 164.
 - d. Radiographic Inspection: ASTM E 94.
- C. Correct deficiencies in Work that test reports and inspections indicate do not comply with the Contract Documents.

3.5 CLEANING AND PROTECTION

- A. Repair damaged galvanized coatings on galvanized items with galvanized repair paint according to ASTM A 780 and manufacturer's written instructions.
- B. Touchup Painting: After erection, promptly clean, prepare, and prime or reprime field connections, rust spots, and abraded surfaces of prime-painted structural framing, bearing plates, and accessories.
 - 1. Clean and prepare surfaces by SSPC-SP 2, "Hand Tool Cleaning," or SSPC-SP 3, "Power Tool Cleaning."
 - 2. Apply a compatible primer of same type as shop primer used on adjacent surfaces.
- C. Touchup Painting: Cleaning and touchup painting are specified in Division 9 painting Sections.

END OF SECTION 133419

- C. Touchup Painting: Cleaning and touchup painting are specified in Division 9 painting Sections.

END OF SECTION 133419

DIVISION 22

PLUMBING

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: www.dammonengineering.com



SECTION 220500

COMMON WORK RESULTS FOR PLUMBING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:

1. Piping materials and installation instructions common to most piping systems.
2. Transition fittings.
3. Dielectric fittings.
4. Mechanical sleeve seals.
5. Sleeves.
6. Escutcheons.
7. Grout.
8. Plumbing demolition.
9. Equipment installation requirements common to equipment sections.
10. Painting and finishing.
11. Concrete bases.
12. Supports and anchorages.

1.3 DEFINITIONS

- A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe chases, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.
- B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.
- D. Concealed, Interior Installations: Concealed from view and protected from physical contact by building occupants. Examples include above ceilings and in chases.

- E. Concealed, Exterior Installations: Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures. Examples include installations within unheated shelters.
- F. The following are industry abbreviations for plastic materials:
 - 1. ABS: Acrylonitrile-butadiene-styrene plastic.
 - 2. CPVC: Chlorinated polyvinyl chloride plastic.
 - 3. PE: Polyethylene plastic.
 - 4. PVC: Polyvinyl chloride plastic.
- G. The following are industry abbreviations for rubber materials:
 - 1. EPDM: Ethylene-propylene-diene terpolymer rubber.
 - 2. NBR: Acrylonitrile-butadiene rubber.

1.4 SUBMITTALS

- A. Product Data: For the following:
 - 1. Transition fittings.
 - 2. Dielectric fittings.
 - 3. Mechanical sleeve seals.
 - 4. Escutcheons.

- B. Welding certificates.

1.5 QUALITY ASSURANCE

- A. Steel Support Welding: Qualify processes and operators according to AWS D1.1, "Structural Welding Code--Steel."
- B. Steel Pipe Welding: Qualify processes and operators according to ASME Boiler and Pressure Vessel Code: Section IX, "Welding and Brazing Qualifications."
 - 1. Comply with provisions in ASME B31 Series, "Code for Pressure Piping."
 - 2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.
- C. Electrical Characteristics for Plumbing Equipment: Equipment of higher electrical characteristics may be furnished provided such proposed equipment is approved in writing and connecting electrical services, circuit breakers, and conduit sizes are appropriately modified. If minimum energy ratings or efficiencies are specified, equipment shall comply with requirements.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
- B. Store plastic pipes protected from direct sunlight. Support to prevent sagging and bending.

1.7 COORDINATION

- A. Arrange for pipe spaces, chases, slots, and openings in building structure during progress of construction, to allow for plumbing installations.
- B. Coordinate installation of required supporting devices and set sleeves in poured-in-place concrete and other structural components as they are constructed.
- C. Coordinate requirements for access panels and doors for plumbing items requiring access that are concealed behind finished surfaces.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. In other Part 2 articles where subparagraph titles below introduce lists, the following requirements apply for product selection:
 - 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the manufacturers specified.
 - 2. Manufacturers: Subject to compliance with requirements, provide products by the manufacturers specified.

2.2 PIPE, TUBE, AND FITTINGS

- A. Pipe Threads: ASME B1.20.1 for factory-threaded pipe and pipe fittings.

2.3 JOINING MATERIALS

- A. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
 - 1. ASME B16.21, nonmetallic, flat, asbestos-free, 1/8-inch maximum thickness unless thickness or specific material is indicated.

- a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
 - b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.
 2. AWWA C110, rubber, flat face, 1/8 inch thick, unless otherwise indicated; and full-face or ring type, unless otherwise indicated.
 - B. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.
 - C. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.
 - D. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.
 - E. Brazing Filler Metals: AWS A5.8, BCuP Series, copper-phosphorus alloys for general-duty brazing, unless otherwise indicated; and AWS A5.8, BAg1, silver alloy for refrigerant piping, unless otherwise indicated.
 - F. Welding Filler Metals: Comply with AWS D10.12 for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.
 - G. Solvent Cements for Joining Plastic Piping:
 1. ABS Piping: ASTM D 2235.
 2. CPVC Piping: ASTM F 493.
 3. PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.
 4. PVC to ABS Piping Transition: ASTM D 3138.
 - H. Fiberglass Pipe Adhesive: As furnished or recommended by pipe manufacturer.
- 2.4 TRANSITION FITTINGS
- A. AWWA Transition Couplings: Same size as, and with pressure rating at least equal to and with ends compatible with, piping to be joined.
 1. Available Manufacturers:
 - a. Cascade Waterworks Mfg. Co.
 - b. Dresser Industries, Inc.; DMD Div.
 - c. Ford Meter Box Company, Incorporated (The); Pipe Products Div.
 - d. JCM Industries.
 - e. Smith-Blair, Inc.
 - f. Viking Johnson.
 2. Underground Piping NPS 1-1/2 and Smaller: Manufactured fitting or coupling.

3. Underground Piping NPS 2 and Larger: AWWA C219, metal sleeve-type coupling.
 4. Aboveground Pressure Piping: Pipe fitting.
- B. Plastic-to-Metal Transition Fittings: CPVC and PVC one-piece fitting with manufacturer's Schedule 80 equivalent dimensions; one end with threaded brass insert, and one solvent-cement-joint end.
1. Available Manufacturers:
 - a. Eslon Thermoplastics.
- C. Plastic-to-Metal Transition Adaptors: One-piece fitting with manufacturer's SDR 11 equivalent dimensions; one end with threaded brass insert, and one solvent-cement-joint end.
1. Available Manufacturers:
 - a. Thompson Plastics, Inc.
- D. Plastic-to-Metal Transition Unions: MSS SP-107, CPVC and PVC four-part union. Include brass end, solvent-cement-joint end, rubber O-ring, and union nut.
1. Available Manufacturers:
 - a. NIBCO INC.
 - b. NIBCO, Inc.; Chemtrol Div.
- E. Flexible Transition Couplings for Underground Nonpressure Drainage Piping: ASTM C 1173 with elastomeric sleeve, ends same size as piping to be joined, and corrosion-resistant metal band on each end.
1. Available Manufacturers:
 - a. Cascade Waterworks Mfg. Co.
 - b. Fernco, Inc.
 - c. Mission Rubber Company.
 - d. Plastic Oddities, Inc.

2.5 DIELECTRIC FITTINGS

- A. Description: Combination fitting of copper alloy and ferrous materials with threaded, solder-joint, plain, or weld-neck end connections that match piping system materials.
- B. Insulating Material: Suitable for system fluid, pressure, and temperature.
- C. Dielectric Unions: Factory-fabricated, union assembly, for 250-psig minimum working pressure at 180 deg F.

1. Available Manufacturers:
 - a. Capitol Manufacturing Co.
 - b. Central Plastics Company.
 - c. Eclipse, Inc.
 - d. Epco Sales, Inc.
 - e. Hart Industries, International, Inc.
 - f. Watts Industries, Inc.; Water Products Div.
 - g. Zurn Industries, Inc.; Wilkins Div.

- D. Dielectric Flanges: Factory-fabricated, companion-flange assembly, for 150- or 300-psig minimum working pressure as required to suit system pressures.
 1. Available Manufacturers:
 - a. Capitol Manufacturing Co.
 - b. Central Plastics Company.
 - c. Epco Sales, Inc.
 - d. Watts Industries, Inc.; Water Products Div.

- E. Dielectric-Flange Kits: Companion-flange assembly for field assembly. Include flanges, full-face- or ring-type neoprene or phenolic gasket, phenolic or polyethylene bolt sleeves, phenolic washers, and steel backing washers.
 1. AvailableManufacturers:
 - a. Advance Products & Systems, Inc.
 - b. Calpico, Inc.
 - c. Central Plastics Company.
 - d. Pipeline Seal and Insulator, Inc.
 2. Separate companion flanges and steel bolts and nuts shall have 150- or 300-psig minimum working pressure where required to suit system pressures.

- F. Dielectric Couplings: Galvanized-steel coupling with inert and noncorrosive, thermoplastic lining; threaded ends; and 300-psig minimum working pressure at 225 deg F.
 1. Available Manufacturers:
 - a. Calpico, Inc.
 - b. Lochinvar Corp.

- G. Dielectric Nipples: Electroplated steel nipple with inert and noncorrosive, thermoplastic lining; plain, threaded, or grooved ends; and 300-psig minimum working pressure at 225 deg F .
 1. Available Manufacturers:

- a. Perfection Corp.
- b. Precision Plumbing Products, Inc.
- c. Sioux Chief Manufacturing Co., Inc.
- d. Victaulic Co. of America.

2.6 MECHANICAL SLEEVE SEALS

- A. Description: Modular sealing element unit, designed for field assembly, to fill annular space between pipe and sleeve.
 1. Available Manufacturers:
 - a. Advance Products & Systems, Inc.
 - b. Calpico, Inc.
 - c. Metraflex Co.
 - d. Pipeline Seal and Insulator, Inc.
 2. Sealing Elements: EPDM or NBR interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe.
 3. Pressure Plates: Plastic, Carbon steel or Stainless steel. Include two for each sealing element.
 4. Connecting Bolts and Nuts: Carbon steel with corrosion-resistant coating or Stainless steel of length required to secure pressure plates to sealing elements. Include one for each sealing element.

2.7 SLEEVES

- A. Galvanized-Steel Sheet: 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint.
- B. Steel Pipe: ASTM A 53, Type E, Grade B, Schedule 40, galvanized, plain ends.
- C. Cast Iron: Cast or fabricated "wall pipe" equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- D. Stack Sleeve Fittings: Manufactured, cast-iron sleeve with integral clamping flange. Include clamping ring and bolts and nuts for membrane flashing.
 1. Underdeck Clamp: Clamping ring with set screws.
- E. Molded PVC: Permanent, with nailing flange for attaching to wooden forms.
- F. PVC Pipe: ASTM D 1785, Schedule 40.
- G. Molded PE: Reusable, PE, tapered-cup shaped, and smooth-outer surface with nailing flange for attaching to wooden forms.

2.8 ESCUTCHEONS

- A. Description: Manufactured wall and ceiling escutcheons and floor plates, with an ID to closely fit around pipe, tube, and insulation of insulated piping and an OD that completely covers opening.
- B. One-Piece, Deep-Pattern Type: Deep-drawn, box-shaped brass with polished chrome-plated finish.
- C. One-Piece, Cast-Brass Type: With set screw.
 - 1. Finish: Polished chrome-plated.
- D. Split-Casting, Cast-Brass Type: With concealed hinge and set screw.
 - 1. Finish: Polished chrome-plated.
- E. One-Piece, Stamped-Steel Type: With set screw or spring clips and chrome-plated finish.
- F. Split-Plate, Stamped-Steel Type: With concealed hinge, set screw or spring clips, and chrome-plated finish.
- G. One-Piece, Floor-Plate Type: Cast-iron floor plate.
- H. Split-Casting, Floor-Plate Type: Cast brass with concealed hinge and set screw.

2.9 GROUT

- A. Description: ASTM C 1107, Grade B, nonshrink and nonmetallic, dry hydraulic-cement grout.
 - 1. Characteristics: Post-hardening, volume-adjusting, nonstaining, noncorrosive, nongaseous, and recommended for interior and exterior applications.
 - 2. Design Mix: 5000-psi, 28-day compressive strength.
 - 3. Packaging: Premixed and factory packaged.

PART 3 - EXECUTION

3.1 PLUMBING DEMOLITION

- A. Refer to Division 01 Section "Cutting and Patching" and Division 02 Section "Selective Demolition" for general demolition requirements and procedures.
- B. Disconnect, demolish, and remove plumbing systems, equipment, and components indicated to be removed.

1. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.
 2. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material.
 3. Equipment to Be Removed: Disconnect and cap services and remove equipment.
 4. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.
 5. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.
- C. If pipe, insulation, or equipment to remain is damaged in appearance or is unserviceable, remove damaged or unserviceable portions and replace with new products of equal capacity and quality.

3.2 PIPING SYSTEMS - COMMON REQUIREMENTS

- A. Install piping according to the following requirements and Division 22 Sections specifying piping systems.
- B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- C. Install piping in concealed locations, unless otherwise indicated and except in equipment rooms and service areas.
- D. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- E. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- F. Install piping to permit valve servicing.
- G. Install piping at indicated slopes.
- H. Install piping free of sags and bends.
- I. Install fittings for changes in direction and branch connections.
- J. Install piping to allow application of insulation.

- K. Select system components with pressure rating equal to or greater than system operating pressure.
- L. Install escutcheons for penetrations of walls, ceilings, and floors according to the following:
 - 1. New Piping:
 - a. Piping with Fitting or Sleeve Protruding from Wall: One-piece, deep-pattern type.
 - b. Chrome-Plated Piping: One-piece, cast-brass type with polished chrome-plated finish.
 - c. Insulated Piping: One-piece, stamped-steel type with spring clips.
 - d. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, cast-brass type with polished chrome-plated finish.
 - e. Bare Piping at Ceiling Penetrations in Finished Spaces: One-piece or split-casting, cast-brass type with polished chrome-plated finish.
 - f. Bare Piping in Unfinished Service Spaces: One-piece, cast-brass type with rough-brass finish.
 - g. Bare Piping in Equipment Rooms: One-piece, cast-brass type.
 - h. Bare Piping at Floor Penetrations in Equipment Rooms: One-piece, floor-plate type.
 - 2. Existing Piping: Use the following:
 - a. Chrome-Plated Piping: Split-casting, cast-brass type with chrome-plated finish.
 - b. Insulated Piping: Split-plate, stamped-steel type with concealed or exposed-rivet hinge and spring clips.
 - c. Bare Piping at Wall and Floor Penetrations in Finished Spaces: Split-casting, cast-brass type with chrome-plated finish.
 - d. Bare Piping at Ceiling Penetrations in Finished Spaces: Split-casting, cast-brass type with chrome-plated finish.
 - e. Bare Piping in Unfinished Service Spaces: Split-casting, cast-brass type with polished chrome-plated or rough-brass finish.
 - f. Bare Piping in Equipment Rooms: Split-casting, cast-brass type.
 - g. Bare Piping at Floor Penetrations in Equipment Rooms: Split-casting, floor-plate type.
- M. Sleeves are not required for core-drilled holes.
- N. Permanent sleeves are not required for holes formed by removable PE sleeves.
- O. Install sleeves for pipes passing through concrete and masonry walls and concrete floor and roof slabs.
- P. Install sleeves for pipes passing through concrete and masonry walls, gypsum-board partitions, and concrete floor and roof slabs.

1. Cut sleeves to length for mounting flush with both surfaces.
 - a. Exception: Extend sleeves installed in floors of mechanical equipment areas or other wet areas 2 inches above finished floor level. Extend cast-iron sleeve fittings below floor slab as required to secure clamping ring if ring is specified.
 2. Install sleeves in new walls and slabs as new walls and slabs are constructed.
 3. Install sleeves that are large enough to provide 1/4-inch annular clear space between sleeve and pipe or pipe insulation. Use the following sleeve materials:
 - a. PVC or Steel Pipe Sleeves: For pipes smaller than NPS 6.
 - b. Steel Sheet Sleeves: For pipes NPS 6 and larger, penetrating gypsum-board partitions.
 - c. Stack Sleeve Fittings: For pipes penetrating floors with membrane waterproofing. Secure flashing between clamping flanges. Install section of cast-iron soil pipe to extend sleeve to 2 inches above finished floor level.
 - 1) Seal space outside of sleeve fittings with grout.
 4. Except for underground wall penetrations, seal annular space between sleeve and pipe or pipe insulation, using joint sealants appropriate for size, depth, and location of joint. Refer to Division 07 Section "Joint Sealants" for materials and installation.
- Q. Aboveground, Exterior-Wall Pipe Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
1. Install steel pipe for sleeves smaller than 6 inches in diameter.
 2. Install cast-iron "wall pipes" for sleeves 6 inches and larger in diameter.
 3. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.
- R. Underground, Exterior-Wall Pipe Penetrations: Install cast-iron "wall pipes" for sleeves. Seal pipe penetrations using mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
1. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

- S. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Refer to Division 07 Section "Penetration Firestopping" for materials.
- T. Verify final equipment locations for roughing-in.
- U. Refer to equipment specifications in other Sections of these Specifications for roughing-in requirements.

3.3 PIPING JOINT CONSTRUCTION

- A. Join pipe and fittings according to the following requirements and Division 22 Sections specifying piping systems.
- B. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- D. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.
- E. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8.
- F. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
 - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- G. Welded Joints: Construct joints according to AWS D10.12, using qualified processes and welding operators according to Part 1 "Quality Assurance" Article.
- H. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.
- I. Plastic Piping Solvent-Cement Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:

1. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements.
2. ABS Piping: Join according to ASTM D 2235 and ASTM D 2661 Appendixes.
3. CPVC Piping: Join according to ASTM D 2846/D 2846M Appendix.
4. PVC Pressure Piping: Join schedule number ASTM D 1785, PVC pipe and PVC socket fittings according to ASTM D 2672. Join other-than-schedule-number PVC pipe and socket fittings according to ASTM D 2855.
5. PVC Nonpressure Piping: Join according to ASTM D 2855.
6. PVC to ABS Nonpressure Transition Fittings: Join according to ASTM D 3138 Appendix.

J. Plastic Pressure Piping Gasketed Joints: Join according to ASTM D 3139.

K. Plastic Nonpressure Piping Gasketed Joints: Join according to ASTM D 3212.

L. PE Piping Heat-Fusion Joints: Clean and dry joining surfaces by wiping with clean cloth or paper towels. Join according to ASTM D 2657.

1. Plain-End Pipe and Fittings: Use butt fusion.
2. Plain-End Pipe and Socket Fittings: Use socket fusion.

M. Fiberglass Bonded Joints: Prepare pipe ends and fittings, apply adhesive, and join according to pipe manufacturer's written instructions.

3.4 PIPING CONNECTIONS

A. Make connections according to the following, unless otherwise indicated:

1. Install unions, in piping NPS 2 and smaller, adjacent to each valve and at final connection to each piece of equipment.
2. Install flanges, in piping NPS 2-1/2 and larger, adjacent to flanged valves and at final connection to each piece of equipment.
3. Dry Piping Systems: Install dielectric unions and flanges to connect piping materials of dissimilar metals.
4. Wet Piping Systems: Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals.

3.5 EQUIPMENT INSTALLATION - COMMON REQUIREMENTS

- A. Install equipment to allow maximum possible headroom unless specific mounting heights are not indicated.
- B. Install equipment level and plumb, parallel and perpendicular to other building systems and components in exposed interior spaces, unless otherwise indicated.
- C. Install plumbing equipment to facilitate service, maintenance, and repair or replacement of components. Connect equipment for ease of disconnecting, with

minimum interference to other installations. Extend grease fittings to accessible locations.

- D. Install equipment to allow right of way for piping installed at required slope.

3.6 PAINTING

- A. Painting of plumbing systems, equipment, and components is specified in Division 09 Sections "Interior Painting".
- B. Damage and Touchup: Repair marred and damaged factory-painted finishes with materials and procedures to match original factory finish.

3.7 CONCRETE BASES

- A. Concrete Bases: Anchor equipment to concrete base according to equipment manufacturer's written instructions and according to seismic codes at Project.
 - 1. Construct concrete bases of dimensions indicated, but not less than 4 inches larger in both directions than supported unit.
 - 2. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around the full perimeter of the base.
 - 3. Install epoxy-coated anchor bolts for supported equipment that extend through concrete base, and anchor into structural concrete floor.
 - 4. Place and secure anchorage devices. Use supported equipment manufacturer's setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
 - 5. Install anchor bolts to elevations required for proper attachment to supported equipment.
 - 6. Install anchor bolts according to anchor-bolt manufacturer's written instructions.
 - 7. Use 3000-psi 28-day compressive-strength concrete and reinforcement as specified in Division 03 Section "Cast-in-Place Concrete".

3.8 ERECTION OF METAL SUPPORTS AND ANCHORAGES

- A. Refer to Division 05 Section "Metal Fabrications" for structural steel.
- B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor plumbing materials and equipment.
- C. Field Welding: Comply with AWS D1.1.

3.9 ERECTION OF WOOD SUPPORTS AND ANCHORAGES

- A. Cut, fit, and place wood grounds, nailers, blocking, and anchorages to support, and anchor plumbing materials and equipment.
- B. Select fastener sizes that will not penetrate members if opposite side will be exposed to view or will receive finish materials. Tighten connections between members. Install fasteners without splitting wood members.
- C. Attach to substrates as required to support applied loads.

3.10 GROUTING

- A. Mix and install grout for plumbing equipment base bearing surfaces, pump and other equipment base plates, and anchors.
- B. Clean surfaces that will come into contact with grout.
- C. Provide forms as required for placement of grout.
- D. Avoid air entrapment during placement of grout.
- E. Place grout, completely filling equipment bases.
- F. Place grout on concrete bases and provide smooth bearing surface for equipment.
- G. Place grout around anchors.
- H. Cure placed grout.

END OF SECTION 220500

SECTION 220523

GENERAL-DUTY VALVES FOR PLUMBING PIPING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Brass ball valves.
2. Bronze ball valves.
3. Iron, single-flange butterfly valves.
4. Bronze swing check valves.
5. Iron swing check valves.
6. Iron swing check valves with closure control.
7. Bronze gate valves.
8. Iron gate valves.
9. Bronze globe valves.
10. Iron globe valves.
11. Chainwheels.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of valve indicated.

1.3 QUALITY ASSURANCE

- A. ASME Compliance: ASME B16.10 and ASME B16.34 for ferrous valve dimensions and design criteria.
- B. NSF Compliance: NSF 61 for valve materials for potable-water service.

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS FOR VALVES

- A. Refer to valve schedule articles for applications of valves.
- B. Valve Pressure and Temperature Ratings: Not less than indicated and as required for system pressures and temperatures.
- C. Valve Sizes: Same as upstream piping unless otherwise indicated.

D. Valve Actuator Types:

1. Gear Actuator: For quarter-turn valves NPS 8 and larger.
2. Handwheel: For valves other than quarter-turn types.
3. Handlever: For quarter-turn valves NPS 6 and smaller except plug valves.
4. Chainwheel: Device for attachment to valve handwheel, stem, or other actuator; of size and with chain for mounting height, as indicated in the "Valve Installation" Article.

E. Valves in Insulated Piping: With 2-inch stem extensions and the following features:

1. Gate Valves: With rising stem.
2. Ball Valves: With extended operating handle of non-thermal-conductive material, and protective sleeve that allows operation of valve without breaking the vapor seal or disturbing insulation.
3. Butterfly Valves: With extended neck.

F. Valve-End Connections:

1. Flanged: With flanges according to ASME B16.1 for iron valves.
2. Solder Joint: With sockets according to ASME B16.18.
3. Threaded: With threads according to ASME B1.20.1.

2.2 BRASS BALL VALVES

A. One-Piece, Reduced-Port, Brass Ball Valves with Brass Trim:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Kitz Corporation.
2. Description:
 - a. Standard: MSS SP-110.
 - b. CWP Rating: 400 psig.
 - c. Body Design: One piece.
 - d. Body Material: Forged brass.
 - e. Ends: Threaded.
 - f. Seats: PTFE or TFE.
 - g. Stem: Brass.
 - h. Ball: Chrome-plated brass.
 - i. Port: Reduced.

B. Two-Piece, Full-Port, Brass Ball Valves with Brass Trim:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Crane Co.; Crane Valve Group; Crane Valves.
 - b. Crane Co.; Crane Valve Group; Jenkins Valves.
 - c. DynaQuip Controls.
 - d. Flow-Tek, Inc.; a subsidiary of Bray International, Inc.
 - e. Hammond Valve.
 - f. Jamesbury; a subsidiary of Metso Automation.
 - g. Jomar International, LTD.
 - h. Kitz Corporation.
 - i. Legend Valve.
 - j. Marwin Valve; a division of Richards Industries.
 - k. Milwaukee Valve Company.
 - l. NIBCO INC.
 - m. Red-White Valve Corporation.
 - n. RuB Inc.

2. Description:
 - a. Standard: MSS SP-110.
 - b. SWP Rating: 150 psig.
 - c. CWP Rating: 600 psig.
 - d. Body Design: Two piece.
 - e. Body Material: Forged brass.
 - f. Ends: Threaded.
 - g. Seats: PTFE or TFE.
 - h. Stem: Brass.
 - i. Ball: Chrome-plated brass.
 - j. Port: Full.

C. Two-Piece, Regular-Port, Brass Ball Valves with Brass Trim:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Hammond Valve.
 - b. Jamesbury; a subsidiary of Metso Automation.
 - c. Legend Valve.
 - d. Marwin Valve; a division of Richards Industries.
 - e. Milwaukee Valve Company.

2. Description:
 - a. Standard: MSS SP-110.
 - b. SWP Rating: 150 psig.
 - c. CWP Rating: 600 psig.

- d. Body Design: Two piece.
- e. Body Material: Forged brass.
- f. Ends: Threaded.
- g. Seats: PTFE or TFE.
- h. Stem: Brass.
- i. Ball: Chrome-plated brass.
- j. Port: Regular.

2.3 BRONZE BALL VALVES

A. One-Piece, Reduced-Port, Bronze Ball Valves with Bronze Trim:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. American Valve, Inc.
 - b. Conbraco Industries, Inc.; Apollo Valves.
 - c. NIBCO INC.
2. Description:
 - a. Standard: MSS SP-110.
 - b. CWP Rating: 400 psig.
 - c. Body Design: One piece.
 - d. Body Material: Bronze.
 - e. Ends: Threaded.
 - f. Seats: PTFE or TFE.
 - g. Stem: Bronze.
 - h. Ball: Chrome-plated brass.
 - i. Port: Reduced.

B. Two-Piece, Full-Port, Bronze Ball Valves with Bronze Trim:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. American Valve, Inc.
 - b. Conbraco Industries, Inc.; Apollo Valves.
 - c. Crane Co.; Crane Valve Group; Crane Valves.
 - d. Hammond Valve.
 - e. Lance Valves; a division of Advanced Thermal Systems, Inc.
 - f. Legend Valve.
 - g. Milwaukee Valve Company.
 - h. NIBCO INC.
 - i. Red-White Valve Corporation.
 - j. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:

- a. Standard: MSS SP-110.
- b. SWP Rating: 150 psig.
- c. CWP Rating: 600 psig.
- d. Body Design: Two piece.
- e. Body Material: Bronze.
- f. Ends: Threaded.
- g. Seats: PTFE or TFE.
- h. Stem: Bronze.
- i. Ball: Chrome-plated brass.
- j. Port: Full.

C. Two-Piece, Regular-Port, Bronze Ball Valves with Bronze Trim:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. American Valve, Inc.
- b. Conbraco Industries, Inc.; Apollo Valves.
- c. Crane Co.; Crane Valve Group; Jenkins Valves.
- d. Crane Co.; Crane Valve Group; Stockham Division.
- e. DynaQuip Controls.
- f. Hammond Valve.
- g. Lance Valves; a division of Advanced Thermal Systems, Inc.
- h. Milwaukee Valve Company.
- i. NIBCO INC.

2. Description:

- a. Standard: MSS SP-110.
- b. SWP Rating: 150 psig.
- c. CWP Rating: 600 psig.
- d. Body Design: Two piece.
- e. Body Material: Bronze.
- f. Ends: Threaded.
- g. Seats: PTFE or TFE.
- h. Stem: Bronze.
- i. Ball: Chrome-plated brass.
- j. Port: Regular.

2.4 IRON, SINGLE-FLANGE BUTTERFLY VALVES

A. 200 CWP, Iron, Single-Flange Butterfly Valves with EPDM Seat and Aluminum-Bronze Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. ABZ Valve and Controls; a division of ABZ Manufacturing, Inc.
 - b. Conbraco Industries, Inc.; Apollo Valves.
 - c. Cooper Cameron Valves; a division of Cooper Cameron Corporation.
 - d. Crane Co.; Crane Valve Group; Jenkins Valves.
 - e. Crane Co.; Crane Valve Group; Stockham Division.
 - f. DeZurik Water Controls.
 - g. Flo Fab Inc.
 - h. Hammond Valve.
 - i. Kitz Corporation.
 - j. Legend Valve.
 - k. Milwaukee Valve Company.
 - l. NIBCO INC.
 - m. Norriseal; a Dover Corporation company.
 - n. Red-White Valve Corporation.
 - o. Spence Strainers International; a division of CIRCOR International, Inc.
 - p. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:
 - a. Standard: MSS SP-67, Type I.
 - b. CWP Rating: 200 psig.
 - c. Body Design: Lug type; suitable for bidirectional dead-end service at rated pressure without use of downstream flange.
 - d. Body Material: ASTM A 126, cast iron or ASTM A 536, ductile iron.
 - e. Seat: EPDM.
 - f. Stem: One- or two-piece stainless steel.
 - g. Disc: Aluminum bronze.

- B. 200 CWP, Iron, Single-Flange Butterfly Valves with NBR Seat and Aluminum-Bronze Disc:
 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. ABZ Valve and Controls; a division of ABZ Manufacturing, Inc.
 - b. Conbraco Industries, Inc.; Apollo Valves.
 - c. Cooper Cameron Valves; a division of Cooper Cameron Corporation.
 - d. Crane Co.; Crane Valve Group; Jenkins Valves.
 - e. Crane Co.; Crane Valve Group; Stockham Division.
 - f. DeZurik Water Controls.
 - g. Flo Fab Inc.
 - h. Hammond Valve.
 - i. Kitz Corporation.
 - j. Legend Valve.

- k. Milwaukee Valve Company.
- l. NIBCO INC.
- m. Norriseal; a Dover Corporation company.
- n. Red-White Valve Corporation.
- o. Spence Strainers International; a division of CIRCOR International, Inc.
- p. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:

- a. Standard: MSS SP-67, Type I.
- b. CWP Rating: 200 psig.
- c. Body Design: Lug type; suitable for bidirectional dead-end service at rated pressure without use of downstream flange.
- d. Body Material: ASTM A 126, cast iron or ASTM A 536, ductile iron.
- e. Seat: NBR.
- f. Stem: One- or two-piece stainless steel.
- g. Disc: Aluminum bronze.

C. 200 CWP, Iron, Single-Flange Butterfly Valves with EPDM Seat and Ductile-Iron Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. ABZ Valve and Controls; a division of ABZ Manufacturing, Inc.
- b. American Valve, Inc.
- c. Conbraco Industries, Inc.; Apollo Valves.
- d. Cooper Cameron Valves; a division of Cooper Cameron Corporation.
- e. Crane Co.; Crane Valve Group; Center Line.
- f. Crane Co.; Crane Valve Group; Stockham Division.
- g. DeZurik Water Controls.
- h. Flo Fab Inc.
- i. Hammond Valve.
- j. Kitz Corporation.
- k. Legend Valve.
- l. Milwaukee Valve Company.
- m. Mueller Steam Specialty; a division of SPX Corporation.
- n. NIBCO INC.
- o. Norriseal; a Dover Corporation company.
- p. Spence Strainers International; a division of CIRCOR International, Inc.
- q. Sure Flow Equipment Inc.
- r. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:

- a. Standard: MSS SP-67, Type I.
- b. CWP Rating: 200 psig.
- c. Body Design: Lug type; suitable for bidirectional dead-end service at rated pressure without use of downstream flange.

- d. Body Material: ASTM A 126, cast iron or ASTM A 536, ductile iron.
- e. Seat: EPDM.
- f. Stem: One- or two-piece stainless steel.
- g. Disc: Nickel-plated ductile iron.

D. 200 CWP, Iron, Single-Flange Butterfly Valves with NBR Seat and Ductile-Iron Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. ABZ Valve and Controls; a division of ABZ Manufacturing, Inc.
- b. American Valve, Inc.
- c. Conbraco Industries, Inc.; Apollo Valves.
- d. Cooper Cameron Valves; a division of Cooper Cameron Corporation.
- e. Crane Co.; Crane Valve Group; Center Line.
- f. Crane Co.; Crane Valve Group; Stockham Division.
- g. DeZurik Water Controls.
- h. Flo Fab Inc.
- i. Hammond Valve.
- j. Kitz Corporation.
- k. Legend Valve.
- l. Milwaukee Valve Company.
- m. Mueller Steam Specialty; a division of SPX Corporation.
- n. NIBCO INC.
- o. Norriseal; a Dover Corporation company.
- p. Spence Strainers International; a division of CIRCOR International, Inc.
- q. Sure Flow Equipment Inc.
- r. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:

- a. Standard: MSS SP-67, Type I.
- b. CWP Rating: 200 psig.
- c. Body Design: Lug type; suitable for bidirectional dead-end service at rated pressure without use of downstream flange.
- d. Body Material: ASTM A 126, cast iron or ASTM A 536, ductile iron.
- e. Seat: NBR.
- f. Stem: One- or two-piece stainless steel.
- g. Disc: Nickel-plated ductile iron.

2.5 BRONZE SWING CHECK VALVES

A. Class 125, Bronze Swing Check Valves with Bronze Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. American Valve, Inc.
- b. Crane Co.; Crane Valve Group; Crane Valves.
- c. Crane Co.; Crane Valve Group; Jenkins Valves.
- d. Crane Co.; Crane Valve Group; Stockham Division.
- e. Hammond Valve.
- f. Kitz Corporation.
- g. Milwaukee Valve Company.
- h. NIBCO INC.
- i. Powell Valves.
- j. Red-White Valve Corporation.
- k. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
- l. Zy-Tech Global Industries, Inc.

2. Description:

- a. Standard: MSS SP-80, Type 3.
- b. CWP Rating: 200 psig.
- c. Body Design: Horizontal flow.
- d. Body Material: ASTM B 62, bronze.
- e. Ends: Threaded.
- f. Disc: Bronze.

B. Class 125, Bronze Swing Check Valves with Nonmetallic Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. Crane Co.; Crane Valve Group; Crane Valves.
- b. Crane Co.; Crane Valve Group; Jenkins Valves.
- c. Crane Co.; Crane Valve Group; Stockham Division.
- d. Hammond Valve.
- e. Kitz Corporation.
- f. Milwaukee Valve Company.
- g. NIBCO INC.
- h. Red-White Valve Corporation.
- i. Watts Regulator Co.; a division of Watts Water Technologies, Inc.

2. Description:

- a. Standard: MSS SP-80, Type 4.
- b. CWP Rating: 200 psig.
- c. Body Design: Horizontal flow.
- d. Body Material: ASTM B 62, bronze.
- e. Ends: Threaded.
- f. Disc: PTFE or TFE.

2.6 IRON SWING CHECK VALVES

A. Class 125, Iron Swing Check Valves with Metal Seats:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Crane Co.; Crane Valve Group; Crane Valves.
 - b. Crane Co.; Crane Valve Group; Jenkins Valves.
 - c. Crane Co.; Crane Valve Group; Stockham Division.
 - d. Hammond Valve.
 - e. Kitz Corporation.
 - f. Legend Valve.
 - g. Milwaukee Valve Company.
 - h. NIBCO INC.
 - i. Powell Valves.
 - j. Red-White Valve Corporation.
 - k. Sure Flow Equipment Inc.
 - l. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
 - m. Zy-Tech Global Industries, Inc.
2. Description:
 - a. Standard: MSS SP-71, Type I.
 - b. CWP Rating: 200 psig.
 - c. Body Design: Clear or full waterway.
 - d. Body Material: ASTM A 126, gray iron with bolted bonnet.
 - e. Ends: Flanged.
 - f. Trim: Bronze.
 - g. Gasket: Asbestos free.

B. Class 125, Iron Swing Check Valves with Nonmetallic-to-Metal Seats:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Crane Co.; Crane Valve Group; Crane Valves.
 - b. Crane Co.; Crane Valve Group; Stockham Division.
2. Description:
 - a. Standard: MSS SP-71, Type I.
 - b. CWP Rating: 200 psig.
 - c. Body Design: Clear or full waterway.
 - d. Body Material: ASTM A 126, gray iron with bolted bonnet.
 - e. Ends: Flanged.
 - f. Trim: Composition.

- g. Seat Ring: Bronze.
- h. Disc Holder: Bronze.
- i. Disc: PTFE or TFE.
- j. Gasket: Asbestos free.

2.7 IRON SWING CHECK VALVES WITH CLOSURE CONTROL

A. Class 125, Iron Swing Check Valves with Lever- and Spring-Closure Control:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. NIBCO INC.
2. Description:
 - a. Standard: MSS SP-71, Type I.
 - b. CWP Rating: 200 psig.
 - c. Body Design: Clear or full waterway.
 - d. Body Material: ASTM A 126, gray iron with bolted bonnet.
 - e. Ends: Flanged.
 - f. Trim: Bronze.
 - g. Gasket: Asbestos free.
 - h. Closure Control: Factory-installed, exterior lever and spring.

B. Class 125, Iron Swing Check Valves with Lever- and Weight-Closure Control:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Crane Co.; Crane Valve Group; Crane Valves.
 - b. Crane Co.; Crane Valve Group; Jenkins Valves.
 - c. Crane Co.; Crane Valve Group; Stockham Division.
 - d. Hammond Valve.
 - e. Milwaukee Valve Company.
 - f. NIBCO INC.
 - g. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
2. Description:
 - a. Standard: MSS SP-71, Type I.
 - b. CWP Rating: 200 psig.
 - c. Body Design: Clear or full waterway.
 - d. Body Material: ASTM A 126, gray iron with bolted bonnet.
 - e. Ends: Flanged.
 - f. Trim: Bronze.

- g. Gasket: Asbestos free.
- h. Closure Control: Factory-installed, exterior lever and weight.

2.8 BRONZE GATE VALVES

A. Class 125, NRS Bronze Gate Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. American Valve, Inc.
 - b. Crane Co.; Crane Valve Group; Crane Valves.
 - c. Crane Co.; Crane Valve Group; Jenkins Valves.
 - d. Crane Co.; Crane Valve Group; Stockham Division.
 - e. Hammond Valve.
 - f. Kitz Corporation.
 - g. Milwaukee Valve Company.
 - h. NIBCO INC.
 - i. Powell Valves.
 - j. Red-White Valve Corporation.
 - k. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
 - l. Zy-Tech Global Industries, Inc.
2. Description:
 - a. Standard: MSS SP-80, Type 1.
 - b. CWP Rating: 200 psig.
 - c. Body Material: ASTM B 62, bronze with integral seat and screw-in bonnet.
 - d. Ends: Threaded or solder joint.
 - e. Stem: Bronze.
 - f. Disc: Solid wedge; bronze.
 - g. Packing: Asbestos free.
 - h. Handwheel: Malleable iron, bronze, or aluminum.

B. Class 125, RS Bronze Gate Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. American Valve, Inc.
 - b. Crane Co.; Crane Valve Group; Crane Valves.
 - c. Crane Co.; Crane Valve Group; Jenkins Valves.
 - d. Crane Co.; Crane Valve Group; Stockham Division.
 - e. Hammond Valve.
 - f. Kitz Corporation.
 - g. Milwaukee Valve Company.

- h. NIBCO INC.
- i. Powell Valves.
- j. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
- k. Zy-Tech Global Industries, Inc.

2. Description:

- a. Standard: MSS SP-80, Type 2.
- b. CWP Rating: 200 psig.
- c. Body Material: ASTM B 62, bronze with integral seat and screw-in bonnet.
- d. Ends: Threaded or solder joint.
- e. Stem: Bronze.
- f. Disc: Solid wedge; bronze.
- g. Packing: Asbestos free.
- h. Handwheel: Malleable iron, bronze, or aluminum.

2.9 IRON GATE VALVES

A. Class 125, NRS, Iron Gate Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. Crane Co.; Crane Valve Group; Crane Valves.
- b. Crane Co.; Crane Valve Group; Jenkins Valves.
- c. Crane Co.; Crane Valve Group; Stockham Division.
- d. Flo Fab Inc.
- e. Hammond Valve.
- f. Kitz Corporation.
- g. Legend Valve.
- h. Milwaukee Valve Company.
- i. NIBCO INC.
- j. Powell Valves.
- k. Red-White Valve Corporation.
- l. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
- m. Zy-Tech Global Industries, Inc.

2. Description:

- a. Standard: MSS SP-70, Type I.
- b. CWP Rating: 200 psig.
- c. Body Material: ASTM A 126, gray iron with bolted bonnet.
- d. Ends: Flanged.
- e. Trim: Bronze.
- f. Disc: Solid wedge.
- g. Packing and Gasket: Asbestos free.

B. Class 125, OS&Y, Iron Gate Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Crane Co.; Crane Valve Group; Crane Valves.
 - b. Crane Co.; Crane Valve Group; Jenkins Valves.
 - c. Crane Co.; Crane Valve Group; Stockham Division.
 - d. Flo Fab Inc.
 - e. Hammond Valve.
 - f. Kitz Corporation.
 - g. Legend Valve.
 - h. Milwaukee Valve Company.
 - i. NIBCO INC.
 - j. Powell Valves.
 - k. Red-White Valve Corporation.
 - l. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
 - m. Zy-Tech Global Industries, Inc.

2. Description:
 - a. Standard: MSS SP-70, Type I.
 - b. CWP Rating: 200 psig.
 - c. Body Material: ASTM A 126, gray iron with bolted bonnet.
 - d. Ends: Flanged.
 - e. Trim: Bronze.
 - f. Disc: Solid wedge.
 - g. Packing and Gasket: Asbestos free.

2.10 BRONZE GLOBE VALVES

A. Class 125, Bronze Globe Valves with Bronze Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Crane Co.; Crane Valve Group; Crane Valves.
 - b. Crane Co.; Crane Valve Group; Stockham Division.
 - c. Hammond Valve.
 - d. Kitz Corporation.
 - e. Milwaukee Valve Company.
 - f. NIBCO INC.
 - g. Powell Valves.
 - h. Red-White Valve Corporation.
 - i. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
 - j. Zy-Tech Global Industries, Inc.

2. Description:

- a. Standard: MSS SP-80, Type 1.
- b. CWP Rating: 200 psig.
- c. Body Material: ASTM B 62, bronze with integral seat and screw-in bonnet.
- d. Ends: Threaded or solder joint.
- e. Stem and Disc: Bronze.
- f. Packing: Asbestos free.
- g. Handwheel: Malleable iron, bronze, or aluminum.

B. Class 125, Bronze Globe Valves with Nonmetallic Disc:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. Crane Co.; Crane Valve Group; Crane Valves.
- b. Crane Co.; Crane Valve Group; Stockham Division.
- c. NIBCO INC.
- d. Red-White Valve Corporation.

2. Description:

- a. Standard: MSS SP-80, Type 2.
- b. CWP Rating: 200 psig.
- c. Body Material: ASTM B 62, bronze with integral seat and screw-in bonnet.
- d. Ends: Threaded or solder joint.
- e. Stem: Bronze.
- f. Disc: PTFE or TFE.
- g. Packing: Asbestos free.
- h. Handwheel: Malleable iron, bronze, or aluminum.

2.11 IRON GLOBE VALVES

A. Class 125, Iron Globe Valves:

1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. Crane Co.; Crane Valve Group; Crane Valves.
- b. Crane Co.; Crane Valve Group; Jenkins Valves.
- c. Crane Co.; Crane Valve Group; Stockham Division.
- d. Hammond Valve.
- e. Kitz Corporation.
- f. Milwaukee Valve Company.
- g. NIBCO INC.
- h. Powell Valves.

- i. Red-White Valve Corporation.
- j. Watts Regulator Co.; a division of Watts Water Technologies, Inc.
- k. Zy-Tech Global Industries, Inc.

2. Description:

- a. Standard: MSS SP-85, Type I.
- b. CWP Rating: 200 psig.
- c. Body Material: ASTM A 126, gray iron with bolted bonnet.
- d. Ends: Flanged.
- e. Trim: Bronze.
- f. Packing and Gasket: Asbestos free.

2.12 CHAINWHEELS

A. Description: Valve actuation assembly with sprocket rim, brackets, and chain.

1. Brackets: Type, number, size, and fasteners required to mount actuator on valve.
2. Attachment: For connection to butterfly valve stems.
3. Sprocket Rim with Chain Guides: Ductile iron, of type and size required for valve. Include zinc coating.
4. Chain: Hot-dip, galvanized steel, of size required to fit sprocket rim.

PART 3 - EXECUTION

3.1 VALVE INSTALLATION

- A. Install valves with unions or flanges at each piece of equipment arranged to allow service, maintenance, and equipment removal without system shutdown.
- B. Locate valves for easy access and provide separate support where necessary.
- C. Install valves in horizontal piping with stem at or above center of pipe.
- D. Install valves in position to allow full stem movement.
- E. Install chainwheels on operators for butterfly, gate, and globe valves NPS 4 and larger and more than 96 inches above floor. Extend chains to 60 inches above finished floor.
 1. Install swing check valves for proper direction of flow and in horizontal position with hinge pin level.

3.2 ADJUSTING

- A. Adjust or replace valve packing after piping systems have been tested and put into service but before final adjusting and balancing. Replace valves if persistent leaking occurs.

3.3 GENERAL REQUIREMENTS FOR VALVE APPLICATIONS

- A. If valve applications are not indicated, use the following:
 - 1. Shutoff Service: Ball, butterfly, or gate valves.
 - 2. Throttling Service: Globe, ball, or butterfly valves.
 - 3. Pump-Discharge Check Valves:
 - a. NPS 2 and Smaller: Bronze swing check valves with bronze or nonmetallic disc.
 - b. NPS 2-1/2 and Larger for Domestic Water: Iron swing check valves with lever and weight or with spring.
 - c. NPS 2-1/2 and Larger for Sanitary Waste and Storm Drainage: Iron swing check valves with lever and weight or spring.
- B. If valves with specified SWP classes or CWP ratings are not available, the same types of valves with higher SWP class or CWP ratings may be substituted.
- C. Select valves, except wafer types, with the following end connections:
 - 1. For Copper Tubing, NPS 2 and Smaller: Threaded ends except where solder-joint valve-end option is indicated in valve schedules below.
 - 2. For Copper Tubing, NPS 2-1/2 to NPS 4: Flanged ends except where threaded valve-end option is indicated in valve schedules below.
 - 3. For Copper Tubing, NPS 5 and Larger: Flanged ends.
 - 4. For Steel Piping, NPS 2 and Smaller: Threaded ends.
 - 5. For Steel Piping, NPS 2-1/2 to NPS 4: Flanged ends except where threaded valve-end option is indicated in valve schedules below.
 - 6. For Steel Piping, NPS 5 and Larger: Flanged ends.

3.4 LOW-PRESSURE, COMPRESSED-AIR VALVE SCHEDULE (150 PSIG OR LESS)

- A. Pipe NPS 2 and Smaller:
 - 1. Bronze and Brass Valves: May be provided with solder-joint ends instead of threaded ends.
 - 2. Ball Valves: One or Two piece, full port, brass or bronze with brass trim.
 - 3. Bronze Swing Check Valves: Class 125, bronze disc.
 - 4. Bronze Gate Valves: Class 125, NRS.
- B. Pipe NPS 2-1/2 and Larger:

1. Iron Valves, NPS 2-1/2 to NPS : May be provided with threaded ends instead of flanged ends.
2. Iron, Single-Flange Butterfly Valves: 200 CWP, NBR seat, aluminum-bronze disc.
3. Iron Swing Check Valves: Class 125, nonmetallic-to-metal seats.
4. Iron Gate Valves: Class 125, NRS.

3.5 HIGH-PRESSURE, COMPRESSED-AIR VALVE SCHEDULE (150 TO 200 PSIG)

A. Pipe NPS 2 and Smaller:

1. Bronze and Brass Valves: May be provided with solder-joint ends instead of threaded ends.
2. Ball Valves: One or Two piece, full port, brass or bronze with brass or bronze trim.
3. Bronze Swing Check Valves: Class 125, bronze disc.
4. Bronze Gate Valves: Class 125, NRS.

B. Pipe NPS 2-1/2 and Larger:

1. Iron Valves, NPS 2-1/2 to NPS 4: May be provided with threaded ends instead of flanged ends.
2. Iron, Single-Flange Butterfly Valves: 200 CWP, NBR seat, aluminum-bronze disc.
3. Iron Swing Check Valves: Class 125, nonmetallic-to-metal seats.
4. Iron Gate Valves: Class 125, NRS.

3.6 DOMESTIC, HOT- AND COLD-WATER VALVE SCHEDULE

A. Pipe NPS 2 and Smaller:

1. Bronze and Brass Valves: May be provided with solder-joint ends instead of threaded ends.
2. Bronze Angle Valves: Class 125, bronze disc.
3. Ball Valves: One or Two piece, full port, brass or bronze with brass or bronze trim.
4. Bronze Swing Check Valves: Class 125, bronze disc.
5. Bronze Gate Valves: Class 125, NRS.
6. Bronze Globe Valves: Class 125, bronze disc.

B. Pipe NPS 2-1/2 and Larger:

1. Iron Valves, NPS 2-1/2 to NPS 4: May be provided with threaded ends instead of flanged ends.
2. Iron, Single-Flange Butterfly Valves: 200 CWP, EPDM seat, aluminum-bronze disc.
3. Iron Swing Check Valves: Class 125, nonmetallic-to-metal seats.
4. Iron Swing Check Valves with Closure Control: Class 125, lever and spring.
5. Iron Gate Valves: Class 125, NRS.

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1
NEW TRAINING FACILITY
34780 S. RANGE ROAD
SLIDELL LA 70460

6. Iron Globe Valves: Class 125.

END OF SECTION 220523

SECTION 221113

FACILITY WATER DISTRIBUTION PIPING

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes water-distribution piping and related components outside the building for water service and fire-service.
- B. Utility-furnished products include water meters that will be furnished to the site, ready for installation.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Detail precast concrete vault assemblies and indicate dimensions, method of field assembly, and components.

1.3 INFORMATIONAL SUBMITTALS

- A. Field quality-control test reports.

1.4 CLOSEOUT SUBMITTALS

- A. Operation and maintenance data.

1.5 QUALITY ASSURANCE

- A. Regulatory Requirements:
 - 1. Comply with requirements of utility company supplying water. Include tapping of water mains and backflow prevention.
 - 2. Comply with standards of authorities having jurisdiction for potable-water-service piping, including materials, installation, testing, and disinfection.
 - 3. Comply with standards of authorities having jurisdiction for fire-suppression water-service piping, including materials, hose threads, installation, and testing.
- B. Piping materials shall bear label, stamp, or other markings of specified testing agency.

- C. Comply with ASTM F 645 for selection, design, and installation of thermoplastic water piping.
- D. Comply with FMG's "Approval Guide" or UL's "Fire Protection Equipment Directory" for fire-service-main products.
- E. NFPA Compliance: Comply with NFPA 24 for materials, installations, tests, flushing, and valve and hydrant supervision for fire-service-main piping for fire suppression.
- F. NSF Compliance:
 - 1. Comply with NSF 14 for plastic potable-water-service piping. Include marking "NSF-pw" on piping.
 - 2. Comply with NSF 61 for materials for water-service piping and specialties for domestic water.

1.6 PROJECT CONDITIONS

- A. Interruption of Existing Water-Distribution Service: Do not interrupt service to facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary water-distribution service according to requirements indicated:
 - 1. Notify Engineer no fewer than two days in advance of proposed interruption of service.
 - 2. Do not proceed with interruption of water-distribution service without Engineer's written permission.

1.7 COORDINATION

- A. Coordinate connection to water main with utility company.

PART 2 - PRODUCTS

2.1 PIPE AND FITTINGS

- A. Soft Copper Tube: ASTM B 88, Type K, water tube, annealed temper.
 - 1. Copper, Solder-Joint Fittings: ASME B16.18, cast-copper-alloy or ASME B16.22, wrought-copper, solder-joint pressure type. Furnish only wrought-copper fittings if indicated.
- B. Hard Copper Tube: ASTM B 88, Type L, water tube, drawn temper.

1. Copper, Solder-Joint Fittings: ASME B16.18, cast-copper-alloy or ASME B16.22, wrought-copper, solder-joint pressure type. Furnish only wrought-copper fittings if indicated.
- C. Mechanical-Joint, Ductile-Iron Pipe: AWWA C151, with mechanical-joint bell and plain spigot end unless grooved or flanged ends are indicated.
1. Mechanical-Joint, Ductile-Iron Fittings: AWWA C110, ductile- or gray-iron standard pattern or AWWA C153, ductile-iron compact pattern.
 2. Glands, Gaskets, and Bolts: AWWA C111, ductile- or gray-iron glands, rubber gaskets, and steel bolts.
- D. Push-on-Joint, Ductile-Iron Pipe: AWWA C151, with push-on-joint bell and plain spigot end unless grooved or flanged ends are indicated.
1. Push-on-Joint, Ductile-Iron Fittings: AWWA C110, ductile- or gray-iron standard pattern or AWWA C153, ductile-iron compact pattern.
 2. Gaskets: AWWA C111, rubber.
- E. Grooved-Joint, Ductile-Iron Pipe: AWWA C151, with cut, rounded-grooved ends.
1. Grooved-End, Ductile-Iron Pipe Appurtenances:
 - a. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1) Anvil International, Inc.
 - 2) Victaulic Company of America.
- F. PE, Fire-Service Pipe: ASTM F 714, AWWA C906, or equivalent for PE water pipe; FMG approved, with minimum thickness equivalent to FMG Class 200.
1. Molded PE Fittings: ASTM D 3350, PE resin, socket- or butt-fusion type, made to match PE pipe dimensions and class.
- G. PVC, AWWA Pipe: AWWA C900, Class 200, with bell end with gasket, and with spigot end.
1. Comply with UL 1285 for fire-service mains if indicated.
 2. PVC Fabricated Fittings: AWWA C900, Class 200, with bell-and-spigot or double-bell ends. Include elastomeric gasket in each bell.
 3. PVC Molded Fittings: AWWA C907, Class 150, with bell-and-spigot or double-bell ends. Include elastomeric gasket in each bell.
 4. Push-on-Joint, Ductile-Iron Fittings: AWWA C110, ductile- or gray-iron standard pattern or AWWA C153, ductile-iron compact pattern.
 - a. Gaskets: AWWA C111, rubber.

5. Mechanical-Joint, Ductile-Iron Fittings: AWWA C110, ductile- or gray-iron standard pattern or AWWA C153, ductile-iron compact pattern.
 - a. Glands, Gaskets, and Bolts: AWWA C111, ductile- or gray-iron glands, rubber gaskets, and steel bolts.

2.2 JOINING MATERIALS

- A. Refer to Section 330500 "Common Work Results for Utilities" for commonly used joining materials.
- B. Brazing Filler Metals: AWS A5.8, BCuP Series.
- C. Bonding Adhesive for Fiberglass Piping: As recommended by fiberglass piping manufacturer.
- D. Plastic Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.

2.3 PIPING SPECIALTIES

- A. Transition Fittings: Manufactured fitting or coupling same size as, with pressure rating at least equal to and ends compatible with, piping to be joined.
- B. Tubular-Sleeve Pipe Couplings:
 1. Description: Metal, bolted, sleeve-type, reducing or transition coupling, with center sleeve, gaskets, end rings, and bolt fasteners and with ends of same sizes as piping to be joined.
 - a. Standard: AWWA C219.

2.4 GATE VALVES

- A. AWWA, Cast-Iron Gate Valves:
 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. American AVK Co.; Valves & Fittings Div.
 - b. American Cast Iron Pipe Co.; American Flow Control Div.
 - c. American Cast Iron Pipe Co.; Waterous Co. Subsidiary.
 - d. Crane Co.; Crane Valve Group; Stockham Div.
 - e. East Jordan Iron Works, Inc.
 - f. McWane, Inc.; Clow Valve Co. Div. (Oskaloosa).
 - g. McWane, Inc.; Kennedy Valve Div.

- h. McWane, Inc.; M & H Valve Company Div.
 - i. McWane, Inc.; Tyler Pipe Div.; Utilities Div.
 - j. Mueller Co.; Water Products Div.
 - k. NIBCO INC.
 - l. U.S. Pipe and Foundry Company.
2. Nonrising-Stem, Metal-Seated Gate Valves:
- a. Description: Gray- or ductile-iron body and bonnet; with cast-iron or bronze double-disc gate, bronze gate rings, bronze stem, and stem nut.
 - 1) Standard: AWWA C500.
 - 2) Minimum Pressure Rating: 200 psig
 - 3) End Connections: Mechanical joint.
 - 4) Interior Coating: Complying with AWWA C550.
3. Nonrising-Stem, Resilient-Seated Gate Valves:
- a. Description: Gray- or ductile-iron body and bonnet; with bronze or gray- or ductile-iron gate, resilient seats, bronze stem, and stem nut.
 - 1) Standard: AWWA C509.
 - 2) Minimum Pressure Rating: 200 psig.
 - 3) End Connections: Mechanical joint.
 - 4) Interior Coating: Complying with AWWA C550.
4. Nonrising-Stem, High-Pressure, Resilient-Seated Gate Valves:
- a. Description: Ductile-iron body and bonnet; with bronze or ductile-iron gate, resilient seats, bronze stem, and stem nut.
 - 1) Standard: AWWA C509.
 - 2) Minimum Pressure Rating: 250 psig.
 - 3) End Connections: Push on or mechanical joint.
 - 4) Interior Coating: Complying with AWWA C550.
5. OS&Y, Rising-Stem, Metal-Seated Gate Valves:
- a. Description: Cast- or ductile-iron body and bonnet, with cast-iron double disc, bronze disc and seat rings, and bronze stem.
 - 1) Standard: AWWA C500.
 - 2) Minimum Pressure Rating: 200 psig.
 - 3) End Connections: Flanged.
6. OS&Y, Rising-Stem, Resilient-Seated Gate Valves:
- a. Description: Cast- or ductile-iron body and bonnet, with bronze or gray- or ductile-iron gate, resilient seats, and bronze stem.

- 1) Standard: AWWA C509.
- 2) Minimum Pressure Rating: 200 psig.
- 3) End Connections: Flanged.

B. UL/FMG, Cast-Iron Gate Valves:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. American Cast Iron Pipe Co.; American Flow Control Div.
 - b. American Cast Iron Pipe Co.; Waterous Co. Subsidiary.
 - c. Crane Co.; Crane Valve Group; Stockham Div.
 - d. McWane, Inc.; Clow Valve Co. Div. (Oskaloosa).McWane, Inc.; Kennedy Valve Div.
 - e. McWane, Inc.; M & H Valve Company Div.
 - f. Mueller Co.; Water Products Div.
 - g. NIBCO INC.
 - h. U.S. Pipe and Foundry Company.
2. UL/FMG, Nonrising-Stem Gate Valves:
 - a. Description: Iron body and bonnet with flange for indicator post, bronze seating material, and inside screw.
 - 1) Standards: UL 262 and FMG approved.
 - 2) Minimum Pressure Rating: 175 psig.
 - 3) End Connections: Flanged.
3. OS&Y, Rising-Stem Gate Valves:
 - a. Description: Iron body and bonnet and bronze seating material.
 - 1) Standards: UL 262 and FMG approved.
 - 2) Minimum Pressure Rating: 175 psig.
 - 3) End Connections: Flanged.

C. Bronze Gate Valves:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Crane Co.; Crane Valve Group; Crane Valves.
 - b. Crane Co.; Crane Valve Group; Jenkins Valves.
 - c. Crane Co.; Crane Valve Group; Stockham Div.
 - d. Hammond Valve.
 - e. Milwaukee Valve Company.
 - f. NIBCO INC.

- g. Red-White Valve Corporation.
- 2. OS&Y, Rising-Stem Gate Valves:
 - a. Description: Bronze body and bonnet and bronze stem.
 - 1) Standards: UL 262 and FMG approved.
 - 2) Minimum Pressure Rating: 175 psig.
 - 3) End Connections: Threaded.
- 3. Nonrising-Stem Gate Valves:
 - a. Description: Class 125, Type 1, bronze with solid wedge, threaded ends, and malleable-iron handwheel.
 - 1) Standard: MSS SP-80.

2.5 GATE VALVE ACCESSORIES AND SPECIALTIES

A. Tapping-Sleeve Assemblies:

- 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. American Cast Iron Pipe Co.; Waterous Co. Subsidiary.
 - b. East Jordan Iron Works, Inc.
 - c. Flowserve.
 - d. McWane, Inc.; Clow Valve Co. Div. (Oskaloosa).
 - e. McWane, Inc.; Kennedy Valve Div.
 - f. McWane, Inc.; M & H Valve Company Div.
 - g. Mueller Co.; Water Products Div.
 - h. U.S. Pipe and Foundry Company.
- 2. Description: Sleeve and valve compatible with drilling machine.
 - a. Standard: MSS SP-60.
 - b. Tapping Sleeve: Cast- or ductile-iron or stainless-steel, two-piece bolted sleeve with flanged outlet for new branch connection. Include sleeve matching size and type of pipe material being tapped and with recessed flange for branch valve.
 - c. Valve: AWWA, cast-iron, nonrising-stem, resilient-seated gate valve with one raised face flange mating tapping-sleeve flange.

- B. Valve Boxes: Comply with AWWA M44 for cast-iron valve boxes. Include top section, adjustable extension of length required for depth of burial of valve, plug with lettering "WATER," and bottom section with base that fits over valve and with a barrel approximately 5 inches in diameter.

1. Operating Wrenches: Steel, tee-handle with one pointed end, stem of length to operate deepest buried valve, and socket matching valve operating nut.
- C. Indicator Posts: UL 789, FMG-approved, vertical-type, cast-iron body with operating wrench, extension rod, and adjustable cast-iron barrel of length required for depth of burial of valve.

2.6 CORPORATION VALVES AND CURB VALVES

A. Manufacturers:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Amcast Industrial Corporation; Lee Brass Co.
 - b. Ford Meter Box Company, Inc. (The); Pipe Products Div.
 - c. Jones, James Company.
 - d. Master Meter, Inc.
 - e. McDonald, A. Y. Mfg. Co.
 - f. Mueller Co.; Water Products Div.
 - g. Red Hed Manufacturing & Supply.

B. Service-Saddle Assemblies: Comply with AWWA C800. Include saddle and valve compatible with tapping machine.

1. Service Saddle: Copper alloy with seal and AWWA C800, threaded outlet for corporation valve.
2. Corporation Valve: Bronze body and ground-key plug, with AWWA C800, threaded inlet and outlet matching service piping material.
3. Manifold: Copper fitting with two to four inlets as required, with ends matching corporation valves and outlet matching service piping material.

C. Curb Valves: Comply with AWWA C800. Include bronze body, ground-key plug or ball, and wide tee head, with inlet and outlet matching service piping material.

D. Service Boxes for Curb Valves: Similar to AWWA M44 requirements for cast-iron valve boxes. Include cast-iron telescoping top section of length required for depth of burial of valve, plug with lettering "WATER," and bottom section with base that fits over curb valve and with a barrel approximately 3 inches in diameter.

1. Shutoff Rods: Steel, tee-handle with one pointed end, stem of length to operate deepest buried valve, and slotted end matching curb valve.

2.7 WATER METERS

- A. Water meters will be furnished by utility company.

B. Manufacturers:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. AMCO Water Metering Systems.
 - b. Badger Meter, Inc.
 - c. Carlon Meter.
 - d. Hays Fluid Controls; a division of ROMAC Industries Inc.
 - e. McCrometer.
 - f. Mueller Co.; Hersey Meters.
 - g. Neptune Technology Group Inc.
 - h. Sensus Metering Systems.

C. Displacement-Type Water Meters:

1. Description: With bronze main case.
 - a. Standard: AWWA C700.
 - b. Registration: Flow in gallons.

D. Compound-Type Water Meters:

1. Description:
 - a. Standard: AWWA C702.
 - b. Registration: Flow in gallons.

2.8 BACKFLOW PREVENTERS

A. Double-Check, Backflow-Prevention Assemblies:

1. Basis-of-Design Product: Subject to compliance with requirements, provide the product indicated on Drawings or a comparable product by one of the following, but not limited to:
 - a. Ames Fire & Waterworks; a division of Watts Regulator Co.
 - b. Conbraco Industries, Inc.
 - c. FEBCO; SPX Valves & Controls.
 - d. Flomatic Corporation.
 - e. Watts Water Technologies, Inc.
 - f. Wilkins; a Zurn company.
2. Standard: ASSE 1015 or AWWA C510.
3. Operation: Continuous-pressure applications, unless otherwise indicated.
4. Pressure Loss: 5 psig maximum, through middle 1/3 of flow range.
5. Size: See Drawing.

6. Body: Bronze for NPS 2 and smaller; cast iron with interior lining complying with AWWA C550 or that is FDA approved for NPS 2-1/2 and larger.
7. End Connections: Threaded for NPS 2 and smaller; flanged for NPS 2-1/2 and larger.
8. Configuration: Designed for horizontal, straight through flow.
9. Accessories: Ball valves with threaded ends on inlet and outlet of NPS 2 and smaller; OS&Y gate valves with flanged ends on inlet and outlet of NPS 2-1/2 and larger.

2.9 WATER METER BOXES

- A. Description: Cast-iron body and cover for disc-type water meter, with lettering "WATER METER" in cover; and with slotted, open-bottom base section of length to fit over service piping.
 1. Option: Base section may be cast-iron, PVC, clay, or other pipe.
- B. Description: Cast-iron body and double cover for disc-type water meter, with lettering "WATER METER" in top cover; and with separate inner cover; air space between covers; and slotted, open-bottom base section of length to fit over service piping.
- C. Description: Polymer-concrete body and cover for disc-type water meter, with lettering "WATER" in cover; and with slotted, open-bottom base section of length to fit over service piping. Include vertical and lateral design loadings of 15,000 lb minimum over 10 by 10 inches square.

2.10 CONCRETE VAULTS

- A. Description: Precast, reinforced-concrete vault, designed for A-16 load designation according to ASTM C 857 and made according to ASTM C 858.
 1. Ladder: ASTM A 36/A 36M, steel or polyethylene-encased steel steps.
 2. Manhole: ASTM A 48/A 48M Class No. 35A minimum tensile strength, gray-iron traffic frame and cover.
 - a. Dimension: 24-inch-minimum diameter, unless otherwise indicated.
 3. Manhole: ASTM A 536, Grade 60-40-18, ductile-iron traffic frame and cover.
 - a. Dimension: 24-inch-minimum diameter, unless otherwise indicated.
 4. Drain: ASME A112.6.3, cast-iron floor drain with outlet of size indicated. Include body anchor flange, light-duty cast-iron grate, bottom outlet, and integral or field-installed bronze ball or clapper-type backwater valve.

2.11 FIRE HYDRANTS

A. Dry-Barrel Fire Hydrants:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. American AVK Co.; Valves & Fittings Div.
 - b. American Cast Iron Pipe Co.; American Flow Control Div.
 - c. American Cast Iron Pipe Co.; Waterous Co. Subsidiary.
 - d. American Foundry Group, Inc.
 - e. East Jordan Iron Works, Inc.
 - f. McWane, Inc.; Clow Valve Co. Div. (Oskaloosa).
 - g. McWane, Inc.; Kennedy Valve Div.
 - h. McWane, Inc.; M & H Valve Company Div.
 - i. Mueller Co.; Water Products Div.
 - j. Troy Valve; a division of Penn-Troy Manufacturing, Inc.
 - k. U.S. Pipe and Foundry Company.
2. Description: Freestanding, with one NPS 4-1/2 and two NPS 2-1/2 outlets, 5-1/4-inch main valve, drain valve, and NPS 6 mechanical-joint inlet. Include interior coating according to AWWA C550. Hydrant shall have cast-iron body, compression-type valve opening against pressure and closing with pressure.
 - a. Standard: AWWA C502.
 - b. Pressure Rating: 250 psig.
3. Description: Freestanding, with one NPS 4-1/2 and two NPS 2-1/2 outlets, 5-1/4-inch main valve, drain valve, and NPS 6 mechanical-joint inlet. Hydrant shall have cast-iron body, compression-type valve opening against pressure and closing with pressure.
 - a. Standards: UL 246, FMG approved.
 - b. Pressure Rating: 250 psig.
 - c. Outlet Threads: NFPA 1963, with external hose thread used by local fire department. Include cast-iron caps with steel chains.
 - d. Operating and Cap Nuts: Pentagon, 1-1/2 inches point to flat.
 - e. Direction of Opening: Open hydrant valve by turning operating nut to left or counterclockwise.
 - f. Exterior Finish: Red alkyd-gloss enamel paint, unless otherwise indicated.

B. Wet-Barrel Fire Hydrants:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. American AVK Co.; Valves & Fittings Div.

- b. Jones, James Company.
 - c. McWane, Inc.; Clow Valve Co. Div. (Corona).
 - d. McWane, Inc.; Clow Valve Co. Div. (Oskaloosa).
 - e. Mueller Co.; Water Products Div.
2. Description: Freestanding, with one NPS 4-1/2 and two NPS 2-1/2 outlets, NPS 6 threaded or flanged inlet, and base section with NPS 6 mechanical-joint inlet. Include interior coating according to AWWA C550.
 - a. Standard: AWWA C503.
 - b. Pressure Rating: 150 psig minimum.
3. Description: Freestanding, with one NPS 4-1/2 and two NPS 2-1/2 outlets, NPS 6 threaded or flanged inlet, and base section with NPS 6 mechanical-joint inlet.
 - a. Standards: UL 246 and FMG approved.
 - b. Pressure Rating: 150 psig minimum.
 - c. Outlet Threads: NFPA 1963, with external hose thread used by local fire department. Include cast-iron caps with steel chains.
 - d. Operating and Cap Nuts: Pentagon, 1-1/2 inches point to flat.
 - e. Direction of Opening: Open hydrant valves by turning operating nut to left or counterclockwise.
 - f. Exterior Finish: Red alkyd-gloss enamel paint, unless otherwise indicated.

2.12 FIRE DEPARTMENT CONNECTIONS

A. Fire Department Connections:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Elkhart Brass Mfg. Co., Inc.
 - b. Fire End & Croker Corporation.
 - c. Guardian Fire Equipment, Inc.
 - d. Kidde Fire Fighting.
 - e. Potter Roemer.
 - f. Reliable Automatic Sprinkler Co., Inc.
2. Description: Freestanding, with cast-bronze body, thread inlets according to NFPA 1963 and matching local fire department hose threads, and threaded bottom outlet. Include lugged caps, gaskets, and chains; lugged swivel connection and drop clapper for each hose-connection inlet; 18-inch-high brass sleeve; and round escutcheon plate.
 - a. Standard: UL 405.
 - b. Connections: Two NPS 2-1/2 inlets and one NPS 6 outlet.

- c. Inlet Alignment: horizontal.
- d. Finish Including Sleeve: Rough chrome-plated.
- e. Escutcheon Plate Marking: "STANDPIPE."

PART 3 - EXECUTION

3.1 EARTHWORK

- A. Refer to Section 312000 "Earth Moving" for excavating, trenching, and backfilling.

3.2 PIPING APPLICATIONS

- A. General: Use pipe, fittings, and joining methods for piping systems according to the following applications.
- B. Transition couplings and special fittings with pressure ratings at least equal to piping pressure rating may be used, unless otherwise indicated.
- C. Do not use flanges or unions for underground piping.
- D. Flanges, unions, and special fittings may be used, instead of joints indicated, on aboveground piping and piping in vaults.
- E. Underground water-service piping NPS 3/4 to NPS 3 shall be soft copper tube, ASTM B 88, Type K; wrought-copper, solder-joint fittings; and brazed joints.
- F. Underground water-service piping NPS 4 and NPS 6 shall be any of the following:
 - 1. Soft copper tube, ASTM B 88, Type K or ASTM B 88, Type L; wrought-copper, solder-joint fittings; and brazed joints.
 - 2. Ductile-iron, push-on-joint pipe; ductile-iron, push-on-joint fittings; and gasketed joints.
 - 3. NPS 4 and NPS 6 : NPS 6 PVC, AWWA Class 150 pipe; PVC, AWWA Class 150 molded fittings; and gasketed joints.
- G. Water Meter Box Water-Service Piping NPS 3/4 to NPS 2 shall be same as underground water-service piping.
- H. Aboveground Water-Service Piping NPS 3/4 to NPS 3 shall be hard copper tube, ASTM B 88, Type K; wrought-copper, solder-joint fittings; and brazed joints.
- I. Aboveground water-service piping NPS 4 and NPS 6 shall be any of the following:
 - 1. Hard copper tube, ASTM B 88, Type K; wrought-copper, solder-joint fittings; and brazed joints.
 - 2. Ductile-iron, grooved-end pipe; ductile-iron, grooved-end appurtenances; and grooved joints.

- J. Underground Fire-Service-Main Piping NPS 4 to NPS 8 shall be any of the following:
 - 1. Ductile-iron, push-on-joint pipe; ductile-iron, push-on-joint fittings; and gasketed or mechanical-joint pipe; ductile-iron, mechanical-joint fittings; and mechanical or grooved-end pipe; ductile-iron-pipe appurtenances; and grooved joints.
 - 2. PE, Class 200, fire-service pipe; molded PE fittings; and heat-fusion joints.
 - 3. PVC, AWWA Class 150 pipe listed for fire-protection service; PVC Class 150 fabricated or molded fittings; and gasketed joints.
 - 4. PVC, AWWA Class 200 pipe listed for fire-protection service; PVC Class 200 fabricated fittings; and gasketed joints.
- K. Aboveground Fire-Service-Main Piping NPS 4 to NPS 8 shall be ductile-iron, grooved-end pipe; ductile-iron-pipe appurtenances; and grooved joints.
- L. Underground Combined Water-Service and Fire-Service-Main Piping NPS 6 to NPS 10 shall be any of the following:
 - 1. Ductile-iron, push-on-joint pipe; ductile-iron, push-on-joint fittings; and gasketed or mechanical-joint pipe; ductile-iron, mechanical-joint fittings; and mechanical or grooved-end pipe; ductile-iron-pipe appurtenances; and grooved joints.
 - 2. PVC, AWWA Class 200 pipe listed for fire-protection service; PVC fabricated or molded fittings of same class as pipe; and gasketed joints.
- M. Aboveground Combined Water Service and Fire-Service-Main Piping NPS 6 to NPS 10 shall be ductile-iron, grooved-end pipe; ductile-iron-pipe appurtenances; and grooved joints.

3.3 VALVE APPLICATIONS

- A. General Application: Use mechanical-joint-end valves for NPS 3 and larger underground installation. Use threaded- or flanged-end valves for installation in vaults. Use UL/FMG, non-rising-stem gate valves for installation with indicator posts. Use corporation valves and curb valves with ends compatible with piping, for NPS 2 and smaller installation.
- B. Drawings indicate valve types to be used. Where specific valve types are not indicated, the following requirements apply:
 - 1. Underground Valves, NPS 3 and Larger: AWWA, cast-iron, non-rising-stem, high-pressure, resilient-seated gate valves with valve box.
 - 2. Underground Valves, NPS 4 and Larger, for Indicator Posts: UL/FMG, cast-iron, non-rising-stem gate valves with indicator post.
 - 3. Use the following for valves in vaults and aboveground:
 - a. Gate Valves, NPS 2 and Smaller: Bronze, nonrising or rising stem.

- b. Gate Valves, NPS 3 and Larger: AWWA, cast iron, OS&Y rising stem, resilient seated.

3.4 PIPING INSTALLATION

- A. Water-Main Connection: Arrange with utility company for tap of size and in location indicated in water main.
- B. Water-Main Connection: Tap water main according to requirements of water utility company and of size and in location indicated.
- C. Make connections larger than NPS 2 with tapping machine according to the following:
 - 1. Install tapping sleeve and tapping valve according to MSS SP-60.
 - 2. Install tapping sleeve on pipe to be tapped. Position flanged outlet for gate valve.
 - 3. Use tapping machine compatible with valve and tapping sleeve; cut hole in main. Remove tapping machine and connect water-service piping.
 - 4. Install gate valve onto tapping sleeve. Comply with MSS SP-60. Install valve with stem pointing up and with valve box.
- D. Make connections NPS 2 and smaller with drilling machine according to the following:
 - 1. Install service-saddle assemblies and corporation valves in size, quantity, and arrangement required by utility company standards.
 - 2. Install service-saddle assemblies on water-service pipe to be tapped. Position outlets for corporation valves.
 - 3. Use drilling machine compatible with service-saddle assemblies and corporation valves. Drill hole in main. Remove drilling machine and connect water-service piping.
 - 4. Install corporation valves into service-saddle assemblies.
 - 5. Install manifold for multiple taps in water main.
 - 6. Install curb valve in water-service piping with head pointing up and with service box.
- E. Comply with NFPA 24 for fire-service-main piping materials and installation.
 - 1. Install copper tube and fittings according to CDA's "Copper Tube Handbook."
- F. Install ductile-iron, water-service piping according to AWWA C600 and AWWA M41.
- G. Install PE pipe according to ASTM D 2774 and ASTM F 645.
- H. Install PVC, AWWA pipe according to ASTM F 645 and AWWA M23.
- I. Bury piping with depth of cover over top at least 30 inches, with top at least 12 inches below level of maximum frost penetration.

- J. Extend water-service piping and connect to water-supply source and building-water-piping systems at outside face of building wall in locations and pipe sizes indicated.
 - 1. Terminate water-service piping at building wall until building-water-piping systems are installed. Terminate piping with caps, plugs, or flanges as required for piping material. Make connections to building-water-piping systems when those systems are installed.
- K. Install underground piping with restrained joints at horizontal and vertical changes in direction. Use restrained-joint piping, thrust blocks, anchors, tie-rods and clamps, and other supports.

3.5 JOINT CONSTRUCTION

- A. Make pipe joints according to the following:
 - 1. Ductile-Iron Piping, Gasketed Joints for Water-Service Piping: AWWA C600 and AWWA M41.
 - 2. Ductile-Iron Piping, Gasketed Joints for Fire-Service-Main Piping: UL 194.
 - 3. Ductile-Iron Piping, Grooved Joints: Cut-groove pipe. Assemble joints with grooved-end, ductile-iron-piping couplings, gaskets, lubricant, and bolts according to coupling manufacturer's written instructions.
 - 4. PE Piping Insert-Fitting Joints: Use plastic insert fittings and fasteners according to fitting manufacturer's written instructions.
 - 5. PVC Piping Gasketed Joints: Use joining materials according to AWWA C900. Construct joints with elastomeric seals and lubricant according to ASTM D 2774 or ASTM D 3139 and pipe manufacturer's written instructions.
 - 6. Dissimilar Materials Piping Joints: Use adapters compatible with both piping materials, with OD, and with system working pressure.

3.6 ANCHORAGE INSTALLATION

- A. Anchorage, General: Install water-distribution piping with restrained joints. Anchorages and restrained-joint types that may be used include the following:
 - 1. Concrete thrust blocks.
 - 2. Locking mechanical joints.
 - 3. Set-screw mechanical retainer glands.
 - 4. Bolted flanged joints.
 - 5. Heat-fused joints.
 - 6. Pipe clamps and tie rods.
- B. Install anchorages for tees, plugs and caps, bends, crosses, valves, and hydrant branches. Include anchorages for the following piping systems:
 - 1. Gasketed-Joint, Ductile-Iron, Water-Service Piping: According to AWWA C600.
 - 2. Gasketed-Joint, PVC Water-Service Piping: According to AWWA M23.

3. Fire-Service-Main Piping: According to NFPA 24.

- C. Apply full coat of asphalt or other acceptable corrosion-resistant material to surfaces of installed ferrous anchorage devices.

3.7 VALVE INSTALLATION

- A. AWWA Gate Valves: Comply with AWWA C600 and AWWA M44. Install each underground valve with stem pointing up and with valve box.
- B. UL/FMG, Gate Valves: Comply with NFPA 24. Install each underground valve and valves in vaults with stem pointing up and with vertical cast-iron indicator post.
- C. MSS Valves: Install as component of connected piping system.
- D. Corporation Valves and Curb Valves: Install each underground curb valve with head pointed up and with service box.

3.8 WATER METER INSTALLATION

- A. Install water meters, piping, and specialties according to utility company's written instructions.
- B. Water Meters: Install displacement-type water meters, NPS 2 and smaller, in meter boxes with shutoff valves on water meter inlets. Include valves on water meter outlets and valved bypass around meters unless prohibited by authorities having jurisdiction.
- C. Water Meters: Install compound-type water meters, NPS 3 and larger, in meter vaults. Include shutoff valves on water meter inlets and outlets and valved bypass around meters. Support meters, valves, and piping on brick or concrete piers.

3.9 BACKFLOW PREVENTER INSTALLATION

- A. Install backflow preventers of type, size, and capacity indicated. Include valves and test cocks. Install according to requirements of plumbing and health department and authorities having jurisdiction.
- B. Do not install backflow preventers that have relief drain in vault or in other spaces subject to flooding.
- C. Do not install bypass piping around backflow preventers.
- D. Support NPS 2-1/2 and larger backflow preventers, valves, and piping near floor and on brick or concrete piers.

3.10 WATER METER BOX INSTALLATION

- A. Install water meter boxes in paved areas flush with surface.
- B. Install water meter boxes in grass or earth areas with top 2 inches above surface.

3.11 CONCRETE VAULT INSTALLATION

- A. Install precast concrete vaults according to ASTM C 891.

3.12 FIRE HYDRANT INSTALLATION

- A. General: Install each fire hydrant with separate gate valve in supply pipe, anchor with restrained joints or thrust blocks, and support in upright position.
- B. Wet-Barrel Fire Hydrants: Install with valve below frost line. Provide for drainage.
- C. AWWA Fire Hydrants: Comply with AWWA M17.
- D. UL/FMG Fire Hydrants: Comply with NFPA 24.

3.13 FIRE DEPARTMENT CONNECTION INSTALLATION

- A. Install protective pipe bollards on two sides of each fire department connection.

3.14 CONNECTIONS

- A. Connect water-distribution piping to utility water main. Use service clamp and corporation valve or as directed by utility company.
- B. Connect water-distribution piping to interior domestic water piping.
- C. Connect waste piping from concrete vault drains to storm-drainage system.

3.15 FIELD QUALITY CONTROL

- A. Piping Tests: Conduct piping tests before joints are covered and after concrete thrust blocks have hardened sufficiently. Fill pipeline 24 hours before testing and apply test pressure to stabilize system. Use only potable water.
- B. Hydrostatic Tests: Test at not less than one-and-one-half times working pressure for two hours.
 - 1. Increase pressure in 50-psig increments and inspect each joint between increments. Hold at test pressure for 1 hour; decrease to 0 psig . Slowly

increase again to test pressure and hold for 1 more hour. Maximum allowable leakage is 2 quarts per hour per 100 joints. Remake leaking joints with new materials and repeat test until leakage is within allowed limits.

- C. Prepare reports of testing activities.

3.16 IDENTIFICATION

- A. Install continuous underground detectable warning tape during backfilling of trench for underground water-distribution piping. Locate below finished grade, directly over piping. Underground warning tapes are specified in Section 02300 "Earthwork."
- B. Permanently attach equipment nameplate or marker indicating plastic water-service piping, on main electrical meter panel.

3.17 CLEANING

- A. Clean and disinfect water-distribution piping as follows:
 - 1. Purge new water-distribution piping systems and parts of existing systems that have been altered, extended, or repaired before use.
 - 2. Use purging and disinfecting procedure prescribed by authorities having jurisdiction or, if method is not prescribed by authorities having jurisdiction, use procedure described in NFPA 24 for flushing of piping. Flush piping system with clean, potable water until dirty water does not appear at points of outlet.
 - 3. Use purging and disinfecting procedure prescribed by authorities having jurisdiction or, if method is not prescribed by authorities having jurisdiction, use procedure described in AWWA C651 or do as follows:
 - a. Fill system or part of system with water/chlorine solution containing at least 50 ppm of chlorine; isolate and allow to stand for 24 hours.
 - b. Drain system or part of system of previous solution and refill with water/chlorine solution containing at least 200 ppm of chlorine; isolate and allow to stand for 3 hours.
 - c. After standing time, flush system with clean, potable water until no chlorine remains in water coming from system.
 - d. Submit water samples in sterile bottles to authorities having jurisdiction. Repeat procedure if biological examination shows evidence of contamination.
- B. Prepare reports of purging and disinfecting activities.

END OF SECTION 221113

SECTION 221116
DOMESTIC WATER PIPING

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes under-building-slab and aboveground domestic water pipes, tubes, and fittings inside buildings.

1.2 ACTION SUBMITTALS

- A. Product Data: For transition fittings and dielectric fittings.

1.3 INFORMATIONAL SUBMITTALS

- A. System purging and disinfecting activities report.
- B. Field quality-control reports.

PART 2 - PRODUCTS

2.1 PIPING MATERIALS

- A. Comply with requirements in "Piping Schedule" Article for applications of pipe, tube, fitting materials, and joining methods for specific services, service locations, and pipe sizes.
- B. Potable-water piping and components shall comply with NSF 14 and NSF 61. Plastic piping components shall be marked with "NSF-pw."

2.2 COPPER TUBE AND FITTINGS

- A. Hard Copper Tube: ASTM B 88, Type L water tube, drawn temper.
- B. Soft Copper Tube: ASTM B 88, Type K water tube, annealed temper.
- C. Cast-Copper, Solder-Joint Fittings: ASME B16.18, pressure fittings.
- D. Wrought-Copper, Solder-Joint Fittings: ASME B16.22, wrought-copper pressure fittings.

E. Bronze Flanges: ASME B16.24, Class 150, with solder-joint ends.

F. Copper Unions:

1. MSS SP-123.
2. Cast-copper-alloy, hexagonal-stock body.
3. Ball-and-socket, metal-to-metal seating surfaces.
4. Solder-joint or threaded ends.

G. Copper Pressure-Seal-Joint Fittings:

1. Fittings for NPS 2 and Smaller: Wrought-copper fitting with EPDM-rubber, O-ring seal in each end.
2. Fittings for NPS 2-1/2 to NPS 4: Cast-bronze or wrought-copper fitting with EPDM-rubber, O-ring seal in each end.

H. Copper Push-on-Joint Fittings:

1. Cast-copper fitting complying with ASME B16.18 or wrought-copper fitting complying with ASME B 16.22.
2. Stainless-steel teeth and EPDM-rubber, O-ring seal in each end instead of solder-joint ends.

2.3 DUCTILE-IRON PIPE AND FITTINGS

A. Mechanical-Joint, Ductile-Iron Pipe:

1. AWWA C151/A21.51, with mechanical-joint bell and plain spigot end unless grooved or flanged ends are indicated.
2. Glands, Gaskets, and Bolts: AWWA C111/A21.11, ductile- or gray-iron glands, rubber gaskets, and steel bolts.

B. Standard-Pattern, Mechanical-Joint Fittings:

1. AWWA C110/A21.10, ductile or gray iron.
2. Glands, Gaskets, and Bolts: AWWA C111/A21.11, ductile- or gray-iron glands, rubber gaskets, and steel bolts.

C. Compact-Pattern, Mechanical-Joint Fittings:

1. AWWA C153/A21.53, ductile iron.
2. Glands, Gaskets, and Bolts: AWWA C111/A21.11, ductile- or gray-iron glands, rubber gaskets, and steel bolts.

2.4 GALVANIZED-STEEL PIPE AND FITTINGS

A. Galvanized-Steel Pipe:

1. ASTM A 53/A 53M, Type E, Grade B, Standard Weight.
 2. Include ends matching joining method.
- B. Galvanized-Steel Pipe Nipples: ASTM A 733, made of ASTM A 53/A 53M or ASTM A 106/A 106M, Standard Weight, seamless steel pipe with threaded ends.
- C. Galvanized, Gray-Iron Threaded Fittings: ASME B16.4, Class 125, standard pattern.
- D. Malleable-Iron Unions:
1. ASME B16.39, Class 150.
 2. Hexagonal-stock body.
 3. Ball-and-socket, metal-to-metal, bronze seating surface.
 4. Threaded ends.
- E. Flanges: ASME B16.1, Class 125, cast iron.
- 2.5 CPVC PIPING
- A. CPVC Pipe: ASTM F 441/F 441M, Schedule 40 and Schedule 80.
1. CPVC Socket Fittings: ASTM F 438 for Schedule 40 and ASTM F 439 for Schedule 80.
 2. CPVC Threaded Fittings: ASTM F 437, Schedule 80.
- B. CPVC Piping System: ASTM D 2846/D 2846M, SDR 11, pipe and socket fittings.
- C. CPVC Tubing System: ASTM D 2846/D 2846M, SDR 11, tube and socket fittings.
- 2.6 PEX TUBE AND FITTINGS
- A. PEX Distribution System: ASTM F 877, SDR 9 tubing.
- B. Fittings for PEX Tube: ASTM F 1807, metal-insert type with copper or stainless-steel crimp rings and matching PEX tube dimensions.
- C. Manifold: Multiple-outlet, plastic or corrosion-resistant-metal assembly complying with ASTM F 877; with plastic or corrosion-resistant-metal valve for each outlet.
- 2.7 PVC PIPE AND FITTINGS
- A. PVC Pipe: ASTM D 1785, Schedule 40 and Schedule 80.
- B. PVC Socket Fittings: ASTM D 2466 for Schedule 40 and ASTM D 2467 for Schedule 80.
- C. PVC Schedule 80 Threaded Fittings: ASTM D 2464.

2.8 PIPING JOINING MATERIALS

A. Pipe-Flange Gasket Materials:

1. AWWA C110/A21.10, rubber, flat face, 1/8 inch thick or ASME B16.21, nonmetallic and asbestos free unless otherwise indicated.
2. Full-face or ring type unless otherwise indicated.

B. Metal, Pipe-Flange Bolts and Nuts: ASME B18.2.1, carbon steel unless otherwise indicated.

C. Solder Filler Metals: ASTM B 32, lead-free alloys.

D. Flux: ASTM B 813, water flushable.

E. Brazing Filler Metals: AWS A5.8/A5.8M, BCuP Series, copper-phosphorus alloys for general-duty brazing unless otherwise indicated.

F. Solvent Cements for Joining CPVC Piping and Tubing: ASTM F 493.

G. Solvent Cements for Joining PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.

H. Plastic, Pipe-Flange Gaskets, Bolts, and Nuts: Type and material recommended by piping system manufacturer unless otherwise indicated.

2.9 TRANSITION FITTINGS

A. General Requirements:

1. Same size as pipes to be joined.
2. Pressure rating at least equal to pipes to be joined.
3. End connections compatible with pipes to be joined.

B. Fitting-Type Transition Couplings: Manufactured piping coupling or specified piping system fitting.

C. Plastic-to-Metal Transition Fittings:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Charlotte Pipe and Foundry Company.
 - b. Harvel Plastics, Inc.
 - c. Spears Manufacturing Company.

3. Description:
 - a. CPVC or PVC one-piece fitting with manufacturer's Schedule 80 equivalent dimensions.
 - b. One end with threaded brass insert and one solvent-cement-socket or threaded end.

D. Plastic-to-Metal Transition Unions:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Colonial Engineering, Inc.
 - b. NIBCO Inc.
 - c. Spears Manufacturing Company.
3. Description:
 - a. CPVC or PVC four-part union.
 - b. Brass or stainless-steel threaded end.
 - c. Solvent-cement-joint or threaded plastic end.
 - d. Rubber O-ring.
 - e. Union nut.

2.10 DIELECTRIC FITTINGS

- A. General Requirements: Assembly of copper alloy and ferrous materials with separating nonconductive insulating material. Include end connections compatible with pipes to be joined.
- B. Dielectric Unions:
 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Capitol Manufacturing Company; member of the Phoenix Forge Group.
 - b. Central Plastics Company.
 - c. Hart Industries International, Inc.
 - d. Jomar International.
 - e. Matco-Norca.
 - f. McDonald, A. Y. Mfg. Co.
 - g. Watts; a division of Watts Water Technologies, Inc.

- h. Wilkins; a Zurn company.
 - 3. Standard: ASSE 1079.
 - 4. Pressure Rating: 125 psig minimum at 180 deg F.
 - 5. End Connections: Solder-joint copper alloy and threaded ferrous.
- C. Dielectric Flanges:
- 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Capitol Manufacturing Company; member of the Phoenix Forge Group.
 - b. Central Plastics Company.
 - c. Matco-Norca.
 - d. Watts; a division of Watts Water Technologies, Inc.
 - e. Wilkins; a Zurn company.
 - 3. Standard: ASSE 1079.
 - 4. Factory-fabricated, bolted, companion-flange assembly.
 - 5. Pressure Rating: 125 psig minimum at 180 deg F
 - 6. End Connections: Solder-joint copper alloy and threaded ferrous; threaded solder-joint copper alloy and threaded ferrous.
- D. Dielectric-Flange Insulating Kits:
- 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Advance Products & Systems, Inc.
 - b. Calpico, Inc.
 - c. Central Plastics Company.
 - d. Pipeline Seal and Insulator, Inc.
 - 3. Nonconducting materials for field assembly of companion flanges.
 - 4. Pressure Rating: 150.
 - 5. Gasket: Neoprene or phenolic.
 - 6. Bolt Sleeves: Phenolic or polyethylene.
 - 7. Washers: Phenolic with steel backing washers.
- E. Dielectric Nipples:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Elster Perfection Corporation.
 - b. Grinnell Mechanical Products; Tyco Fire Products LP.
 - c. Matco-Norca.
 - d. Precision Plumbing Products, Inc.
 - e. Victaulic Company.
3. Standard: IAPMO PS 66.
4. Electroplated steel nipple complying with ASTM F 1545.
5. Pressure Rating and Temperature: 300 psig at 225 deg F.
6. End Connections: Male threaded or grooved.
7. Lining: Inert and noncorrosive, propylene.

PART 3 - EXECUTION

3.1 EARTHWORK

- A. Comply with requirements in Section 02300 "Earth Work" for excavating, trenching, and backfilling.

3.2 PIPING INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of domestic water piping. Indicated locations and arrangements are used to size pipe and calculate friction loss, expansion, and other design considerations. Install piping as indicated unless deviations to layout are approved on coordination drawings.
- B. Install copper tubing under building slab according to CDA's "Copper Tube Handbook."
- C. Install ductile-iron piping under building slab with restrained joints according to AWWA C600 and AWWA M41.
- D. Install shutoff valve, hose-end drain valve, strainer, pressure gage, and test tee with valve inside the building at each domestic water-service entrance.
- E. Install shutoff valve immediately upstream of each dielectric fitting.
- F. Install water-pressure-reducing valves downstream from shutoff valves. Comply with requirements for pressure-reducing valves required by authorities having jurisdiction.

- G. Install domestic water piping level with 0.25 percent slope downward toward drain and plumb.
- H. Install piping concealed from view and protected from physical contact by building occupants unless otherwise indicated and except in equipment rooms and service areas.
- I. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- J. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal, and coordinate with other services occupying that space.
- K. Install piping to permit valve servicing.
- L. Install nipples, unions, special fittings, and valves with pressure ratings the same as or higher than the system pressure rating used in applications below unless otherwise indicated.
- M. Install piping free of sags and bends.
- N. Install fittings for changes in direction and branch connections.
- O. Install PEX piping with loop at each change of direction of more than 90 degrees.
- P. Install unions in copper tubing at final connection to each piece of equipment, machine, and specialty.
- Q. Install pressure gages on suction and discharge piping for each plumbing pump and packaged booster pump.
- R. Install thermometers on outlet piping from each water heater.
- S. Install sleeves for piping penetrations of walls, ceilings, and floors.
- T. Install sleeve seals for piping penetrations of concrete walls and slabs.
- U. Install escutcheons for piping penetrations of walls, ceilings, and floors.

3.3 JOINT CONSTRUCTION

- A. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- B. Remove scale, slag, dirt, and debris from inside and outside of pipes, tubes, and fittings before assembly.

- C. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads.
 - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged.
 - D. Brazed Joints for Copper Tubing: Comply with CDA's "Copper Tube Handbook," "Braze Joints" chapter.
 - E. Soldered Joints for Copper Tubing: Apply ASTM B 813, water-flushable flux to end of tube. Join copper tube and fittings according to ASTM B 828 or CDA's "Copper Tube Handbook."
 - F. Pressure-Sealed Joints for Copper Tubing: Join copper tube and pressure-seal fittings with tools recommended by fitting manufacturer.
 - G. Flanged Joints: Select appropriate asbestos-free, nonmetallic gasket material in size, type, and thickness suitable for domestic water service. Join flanges with gasket and bolts according to ASME B31.9.
 - H. Joint Construction for Solvent-Cemented Plastic Piping: Clean and dry joining surfaces. Join pipe and fittings according to the following:
 - 1. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements. Apply primer.
 - 2. CPVC Piping: Join according to ASTM D 2846/D 2846M Appendix.
 - 3. PVC Piping: Join according to ASTM D 2855.
 - I. Joints for PEX Piping: Join according to ASTM F 1807.
 - J. Joints for Dissimilar-Material Piping: Make joints using adapters compatible with materials of both piping systems.
- 3.4 TRANSITION FITTING INSTALLATION
- A. Install transition couplings at joints of dissimilar piping.
 - B. Transition Fittings in Underground Domestic Water Piping:
 - 1. Fittings for NPS 1-1/2 and Smaller: Fitting-type coupling.
 - 2. Fittings for NPS 2 and Larger: Sleeve-type coupling.
 - C. Transition Fittings in Aboveground Domestic Water Piping NPS 2 and Smaller: Plastic-to-metal transition fittings or unions.

3.5 DIELECTRIC FITTING INSTALLATION

- A. Install dielectric fittings in piping at connections of dissimilar metal piping and tubing.
- B. Dielectric Fittings for NPS 2 and Smaller: Use dielectric couplings or nipples.
- C. Dielectric Fittings for NPS 2-1/2 to NPS 4: Use dielectric flanges.
- D. Dielectric Fittings for NPS 5 and Larger: Use dielectric flange kits.

3.6 HANGER AND SUPPORT INSTALLATION

- A. Comply with requirements for pipe hanger, support products."
 - 1. Vertical Piping: MSS Type 8 or 42, clamps.
 - 2. Individual, Straight, Horizontal Piping Runs:
 - a. 100 Feet and Less: MSS Type 1, adjustable, steel clevis hangers.
 - b. Longer Than 100 Feet: MSS Type 43, adjustable roller hangers.
 - c. Longer Than 100 Feet if Indicated: MSS Type 49, spring cushion rolls.
 - 3. Multiple, Straight, Horizontal Piping Runs 100 Feet or Longer: MSS Type 44, pipe rolls. Support pipe rolls on trapeze.
 - 4. Base of Vertical Piping: MSS Type 52, spring hangers.
- B. Support vertical piping and tubing at base and at each floor.
- C. Rod diameter may be reduced one size for double-rod hangers, to a minimum of 3/8 inch.
- D. Install hangers for copper tubing with the following maximum horizontal spacing and minimum rod diameters:
 - 1. NPS 3/4 and Smaller: 60 inches with 3/8-inch rod.
 - 2. NPS 1 and NPS 1-1/4: 72 inches with 3/8-inch rod.
 - 3. NPS 1-1/2 and NPS 2: 96 inches with 3/8-inch rod.
 - 4. NPS 2-1/2: 108 inches with 1/2-inch rod.
 - 5. NPS 3 to NPS 5: 10 feet with 1/2-inch rod.
 - 6. NPS 6: 10 feet with 5/8-inch rod.
 - 7. NPS 8: 10 feet with 3/4-inch rod.
- E. Install supports for vertical copper tubing every 10 feet.
- F. Install hangers for steel piping with the following maximum horizontal spacing and minimum rod diameters:
 - 1. NPS 1-1/4 and Smaller: 84 inches with 3/8-inch rod.
 - 2. NPS 1-1/2: 108 inches with 3/8-inch rod.

3. NPS 2: 10 feet with 3/8-inch rod.
 4. NPS 2-1/2: 11 feet with 1/2-inch rod.
 5. NPS 3 and NPS 3-1/2: 12 feet with 1/2-inch rod.
 6. NPS 4 and NPS 5: 12 feet with 5/8-inch rod.
 7. NPS 6: 12 feet with 3/4-inch rod.
 8. NPS 8 to NPS 12: 12 feet with 7/8-inch rod.
- G. Install supports for vertical steel piping every 15 feet.
- H. Install vinyl-coated hangers for CPVC piping with the following maximum horizontal spacing and minimum rod diameters:
1. NPS 1 and Smaller: 36 inches with 3/8-inch rod.
 2. NPS 1-1/4 to NPS 2: 48 inches with 3/8-inch rod.
 3. NPS 2-1/2 to NPS 3-1/2: 48 inches with 1/2-inch rod.
 4. NPS 4 and NPS 5: 48 inches with 5/8-inch rod.
 5. NPS 6: 48 inches with 3/4-inch rod.
 6. NPS 8: 48 inches with 7/8-inch rod.
- I. Install supports for vertical CPVC piping every 60 inches for NPS 1 and smaller, and every 72 inches for NPS 1-1/4 and larger.
- J. Install vinyl-coated hangers for PEX piping with the following maximum horizontal spacing and minimum rod diameters:
1. NPS 1 and Smaller: 32 inches with 3/8-inch rod.
- K. Install hangers for vertical PEX piping every 48 inches.
- L. Install vinyl-coated hangers for PVC piping with the following maximum horizontal spacing and minimum rod diameters:
1. NPS 2 and Smaller: 48 inches with 3/8-inch rod.
 2. NPS 2-1/2 to NPS 3-1/2: 48 inches with 1/2-inch rod.
 3. NPS 4 and NPS 5: 48 inches with 5/8-inch rod.
 4. NPS 6: 48 inches with 3/4-inch rod.
 5. NPS 8: 48 inches with 7/8-inch rod.
- M. Install supports for vertical PVC piping every 48 inches.
- N. Support piping and tubing not listed in this article according to MSS SP-69 and manufacturer's written instructions.
- 3.7 CONNECTIONS
- A. Drawings indicate general arrangement of piping, fittings, and specialties.

- B. When installing piping adjacent to equipment and machines, allow space for service and maintenance.
- C. Connect domestic water piping to exterior water-service piping. Use transition fitting to join dissimilar piping materials.
- D. Connect domestic water piping to water-service piping with shutoff valve; extend and connect to the following:
 - 1. Domestic Water Booster Pumps: Cold-water suction and discharge piping.
 - 2. Water Heaters: Cold-water inlet and hot-water outlet piping in sizes indicated, but not smaller than sizes of water heater connections.
 - 3. Plumbing Fixtures: Cold- and hot-water-supply piping in sizes indicated, but not smaller than that required by plumbing code.
 - 4. Equipment: Cold- and hot-water-supply piping as indicated, but not smaller than equipment connections. Provide shutoff valve and union for each connection. Use flanges instead of unions for NPS 2-1/2 and larger.

3.8 IDENTIFICATION

- A. Identify system components.
- B. Label pressure piping with system operating pressure.

3.9 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
 - 1. Piping Inspections:
 - a. Do not enclose, cover, or put piping into operation until it has been inspected and approved by authorities having jurisdiction.
 - b. During installation, notify authorities having jurisdiction at least one day before inspection must be made. Perform tests specified below in presence of authorities having jurisdiction:
 - 1) Roughing-in Inspection: Arrange for inspection of piping before concealing or closing in after roughing in and before setting fixtures.
 - 2) Final Inspection: Arrange for authorities having jurisdiction to observe tests specified in "Piping Tests" Subparagraph below and to ensure compliance with requirements.
 - c. Reinspection: If authorities having jurisdiction find that piping will not pass tests or inspections, make required corrections and arrange for reinspection.

- d. Reports: Prepare inspection reports and have them signed by authorities having jurisdiction.
2. Piping Tests:
- a. Fill domestic water piping. Check components to determine that they are not air bound and that piping is full of water.
 - b. Test for leaks and defects in new piping and parts of existing piping that have been altered, extended, or repaired. If testing is performed in segments, submit a separate report for each test, complete with diagram of portion of piping tested.
 - c. Leave new, altered, extended, or replaced domestic water piping uncovered and unconcealed until it has been tested and approved. Expose work that was covered or concealed before it was tested.
 - d. Cap and subject piping to static water pressure of 50 psig above operating pressure, without exceeding pressure rating of piping system materials. Isolate test source and allow it to stand for four hours. Leaks and loss in test pressure constitute defects that must be repaired.
 - e. Repair leaks and defects with new materials, and retest piping or portion thereof until satisfactory results are obtained.
 - f. Prepare reports for tests and for corrective action required.
- B. Domestic water piping will be considered defective if it does not pass tests and inspections.
- C. Prepare test and inspection reports.
- 3.10 ADJUSTING
- A. Perform the following adjustments before operation:
- 1. Close drain valves, hydrants, and hose bibbs.
 - 2. Open shutoff valves to fully open position.
 - 3. Open throttling valves to proper setting.
 - 4. Adjust balancing valves in hot-water-circulation return piping to provide adequate flow.
 - a. Manually adjust ball-type balancing valves in hot-water-circulation return piping to provide hot-water flow in each branch.
 - b. Adjust calibrated balancing valves to flows indicated.
 - 5. Remove plugs used during testing of piping and for temporary sealing of piping during installation.
 - 6. Remove and clean strainer screens. Close drain valves and replace drain plugs.
 - 7. Remove filter cartridges from housings and verify that cartridges are as specified for application where used and are clean and ready for use.
 - 8. Check plumbing specialties and verify proper settings, adjustments, and operation.

3.11 CLEANING

- A. Clean and disinfect potable domestic water piping as follows:
 - 1. Purge new piping and parts of existing piping that have been altered, extended, or repaired before using.
 - 2. Use purging and disinfecting procedures prescribed by authorities having jurisdiction; if methods are not prescribed, use procedures described in either AWWA C651 or AWWA C652 or follow procedures described below:
 - a. Flush piping system with clean, potable water until dirty water does not appear at outlets.
 - b. Fill and isolate system according to either of the following:
 - 1) Fill system or part thereof with water/chlorine solution with at least 50 ppm of chlorine. Isolate with valves and allow to stand for 24 hours.
 - 2) Fill system or part thereof with water/chlorine solution with at least 200 ppm of chlorine. Isolate and allow to stand for three hours.
 - c. Flush system with clean, potable water until no chlorine is in water coming from system after the standing time.
 - d. Repeat procedures if biological examination shows contamination.
 - e. Submit water samples in sterile bottles to authorities having jurisdiction.
- B. Prepare and submit reports of purging and disinfecting activities. Include copies of water-sample approvals from authorities having jurisdiction.
- C. Clean interior of domestic water piping system. Remove dirt and debris as work progresses.

3.12 PIPING SCHEDULE

- A. Transition and special fittings with pressure ratings at least equal to piping rating may be used in applications below unless otherwise indicated.
- B. Flanges and unions may be used for aboveground piping joints unless otherwise indicated.
- C. Fitting Option: Extruded-tee connections and brazed joints may be used on aboveground copper tubing.
- D. Domestic water, building-service piping, shall be one of the following:
 - 1. Soft copper tube, ASTM B 88, Type K; solder-joint fittings and brazed joints.
 - 2. PVC, Schedule 40; socket fittings; and solvent-cemented joints.

- E. Under-building-slab, fire-service-main piping, shall be:
 - 1. Plain-end, ductile-iron pipe; grooved-joint, ductile-iron-pipe appurtenances; and grooved joints.
- F. Under-building-slab, domestic water piping, shall be:
 - 1. Soft copper tube, ASTM B 88, Type L.
- G. Aboveground domestic water piping, shall be:
 - 1. Hard copper tube, ASTM B 88, Type L, solder-joint fittings; and soldered joints.
- H. Aboveground, fire-service-main piping, shall be:
 - 1. Plain-end, ductile-iron pipe; grooved-joint, ductile-iron-pipe appurtenances; and grooved joints.
 - 2. Galvanized-steel pipe and nipples; galvanized, gray-iron threaded fittings; and threaded joints.

END OF SECTION 221116

SECTION 221313
FACILITY SANITARY SEWERS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section Includes gravity-flow, non-pressure and force-main, pressure sanitary sewerage:
 - 1. Pipe and fittings.
 - 2. Nonpressure and pressure couplings.
 - 3. Expansion joints.
 - 4. Cleanouts.
 - 5. Encasement for piping.

1.2 ACTION SUBMITTALS

- A. Product Data: For expansion joints.

1.3 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Show pipe sizes, locations, and elevations. Show other piping in same trench and clearances from sewer system piping. Indicate interface and spatial relationship between manholes, piping, and proximate structures.
- B. Product Certificates: For each type of cast-iron soil pipe and fitting, from manufacturer.
- C. Field quality-control reports.

PART 2 - PRODUCTS

2.1 HUB-AND-SPIGOT, CAST-IRON SOIL PIPE AND FITTINGS

- A. Pipe and Fittings: ASTM A 74, Service class.
- B. Gaskets: ASTM C 564, rubber.
- C. Calking Materials: ASTM B 29, pure lead and oakum or hemp fiber.

2.2 PVC PIPE AND FITTINGS

- A. PVC Pressure Pipe: AWWA C900, Class 150, for gasketed joints and using ASTM F 477, elastomeric seals.
 - 1. Fittings NPS 4 to NPS 8: PVC pressure fittings complying with AWWA C907, for gasketed joints and using ASTM F 477, elastomeric seals.
 - 2. Fittings NPS 10 and Larger: Ductile-iron, compact fittings complying with AWWA C153, for push-on joints and using AWWA C111, rubber gaskets.
- B. PVC Water-Service Pipe and Fittings: ASTM D 1785, Schedule 80 pipe, with plain ends for solvent-cemented joints with ASTM D 2466, Schedule 80, socket-type fittings.
- C. PVC Cellular-Core Pipe and Fittings: ASTM F 891, Sewer and Drain Series, PS 50 minimum stiffness pipe with ASTM D 3034, SDR 26, socket-type fittings for solvent-cemented joints.
- D. PVC Sewer Pipe and Fittings, NPS 15 and Smaller: ASTM D 3034, SDR 26, with bell-and-spigot ends for gasketed joints with ASTM F 477, elastomeric seals.
- E. PVC Sewer Pipe and Fittings, NPS 18 and Larger: ASTM F 679, T-2 wall thickness, with bell-and-spigot ends for gasketed joints with ASTM F 477, elastomeric seals.
- F. PVC Profile Gravity Sewer Pipe and Fittings: ASTM F 794 pipe, with bell-and-spigot ends; ASTM D 3034 fittings, with bell ends; and ASTM F 477, elastomeric seals.
- G. PVC Type PSM Sewer Piping:
 - 1. Pipe: ASTM D 3034, SDR 35, PVC Type PSM sewer pipe with bell-and-spigot ends for gasketed joints.
 - 2. Fittings: ASTM D 3034, PVC with bell ends.
 - 3. Gaskets: ASTM F 477, elastomeric seals.

2.3 NONPRESSURE-TYPE TRANSITION COUPLINGS

- A. Comply with ASTM C 1173, elastomeric, sleeve-type, reducing or transition coupling, for joining underground nonpressure piping. Include ends of same sizes as piping to be joined and corrosion-resistant-metal tension band and tightening mechanism on each end.
- B. Sleeve Materials:
 - 1. For Cast-Iron Soil Pipes: ASTM C 564, rubber.
 - 2. For Concrete Pipes: ASTM C 443, rubber.
 - 3. For Plastic Pipes: ASTM F 477, elastomeric seal or ASTM D 5926, PVC.
 - 4. For Dissimilar Pipes: ASTM D 5926, PVC or other material compatible with pipe materials being joined.

C. Unshielded, Flexible Couplings:

1. Description: Elastomeric sleeve with stainless-steel shear ring and corrosion-resistant-metal tension band and tightening mechanism on each end.

D. Ring-Type, Flexible Couplings: Elastomeric compression seal with dimensions to fit inside bell of larger pipe and for spigot of smaller pipe to fit inside ring.

2.4 PRESSURE-TYPE PIPE COUPLINGS

- A. Reducing or transition, metal, bolted, sleeve-type, reducing or transition coupling, for joining underground pressure piping. Include 150-psig minimum pressure rating and ends of same sizes as piping to be joined.

- B. Tubular-Sleeve Couplings: AWWA C219, with center sleeve, gaskets, end rings, and bolt fasteners.

1. Available Manufacturers:

- a. Cascade Waterworks Mfg.
- b. Dresser, Inc.; DMD Div.
- c. Ford Meter Box Company, Inc. (The); Pipe Products Div.
- d. JCM Industries.
- e. Romac Industries, Inc.
- f. Smith-Blair, Inc.
- g. Viking Johnson.

2. Center-Sleeve Material: Stainless steel.

3. Gasket Material: Natural or synthetic rubber.

4. Metal Component Finish: Corrosion-resistant coating or material.

- C. Split-Sleeve Couplings: With split sleeve with sealing pad and closure plates, O-ring gaskets, and bolt fasteners.

1. Sleeve Material: Stainless steel.

2. Sleeve Dimensions: Of thickness and width required to provide pressure rating.

3. Gasket Material: O-rings made of EPDM rubber, unless otherwise indicated.

4. Metal Component Finish: Corrosion-resistant coating or material.

2.5 SPECIAL PIPE FITTINGS

- A. Ductile-Iron, Flexible Expansion Joints: Compound fitting with combination of flanged and mechanical-joint ends complying with AWWA C110 or AWWA C153. Include 2 gasketed ball-joint sections and 1 or more gasketed sleeve sections, rated for 250-psig minimum working pressure and for offset and expansion indicated.

1. Available Manufacturers:

- a. EBAA Iron Sales, Inc.
 - b. Romac Industries, Inc.
 - c. Star Pipe Products.
- B. Ductile-Iron Deflection Fittings: Compound coupling fitting with ball joint, flexing section, gaskets, and restrained-joint ends complying with AWWA C110 or AWWA C153. Include rating for 250-psig minimum working pressure and for up to 15 degrees of deflection.
- C. Ductile-Iron Expansion Joints: Three-piece assembly of telescoping sleeve with gaskets and restrained-type, ductile-iron, bell-and-spigot end sections complying with AWWA C110 or AWWA C153. Include rating for 250-psig minimum working pressure and for expansion indicated.
- 1. Available Manufacturers:
 - a. Dresser, Inc.; DMD Div.
 - b. EBAA Iron Sales, Inc.
 - c. JCM Industries.
 - d. Smith-Blair, Inc.

2.6 BACKWATER VALVES

- A. Gray-Iron Backwater Valves: ASME A112.14.1, gray-iron body and bolted cover, with bronze seat.
- 1. Available Manufacturers:
 - a. Josam Company.
 - b. Smith, Jay R. Mfg. Co.
 - c. Wade Div.; Tyler Pipe.
 - d. Watts Industries, Inc.
 - e. Watts Industries, Inc.; Enpoco, Inc. Div.
 - f. Zurn Specification Drainage Operation; Zurn Plumbing Products Group.
 - 2. Horizontal Type: With swing check valve and hub-and-spigot ends.
 - 3. Combination Horizontal and Manual Gate-Valve Type: With swing check valve, integral gate valve, and hub-and-spigot ends.
 - 4. Terminal Type: With bronze seat, swing check valve, and hub inlet.
- B. PVC Backwater Valves: Horizontal type; with PVC body, PVC removable cover, and PVC swing check valve.
- 1. Available Manufacturers:
 - a. Canplas Inc.
 - b. IPS Corporation.
 - c. NDS Inc.

- d. Plastic Oddities, Inc.
- e. Sioux Chief Manufacturing Company, Inc.
- f. Zurn Light Commercial Specialty Plumbing Products; Zurn Plumbing Products Group.

2.7 EXPANSION JOINTS

A. Ductile-Iron, Flexible Expansion Joints:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. EBAA Iron, Inc.
 - b. Romac Industries, Inc.
 - c. Star Pipe Products.
3. Description: Compound fitting with combination of flanged and mechanical-joint ends complying with AWWA C110 or AWWA C153. Include two gasketed ball-joint sections and one or more gasketed sleeve sections, rated for 250-psig minimum working pressure and for offset and expansion indicated.

2.8 CLEANOUTS

A. Gray-Iron Cleanouts: ASME A112.36.2M, round, gray-iron housing with clamping device and round, secured, scoriated, gray-iron cover. Include gray-iron ferrule with inside calk or spigot connection and countersunk, tapered-thread, brass closure plug.

1. Available Manufacturers:
 - a. Josam Company.
 - b. MIFAB Manufacturing Inc.
 - c. Smith, Jay R. Mfg. Co.
 - d. Wade Div.; Tyler Pipe.
 - e. Watts Industries, Inc.
 - f. Watts Industries, Inc.; Enpoco, Inc. Div.
 - g. Zurn Specification Drainage Operation; Zurn Plumbing Products Group.
2. Top-Loading Classification: Heavy and Extra-heavy duty.
3. Sewer Pipe Fitting and Riser to Cleanout: ASTM A 74, Service class, cast-iron soil pipe and fittings.

B. PVC Cleanouts: PVC body with PVC threaded plug. Include PVC sewer pipe fitting and riser to clean-out of same material as sewer piping.

1. Available Manufacturers:

- a. Canplas Inc.
- b. IPS Corporation.
- c. NDS Inc.
- d. Plastic Oddities, Inc.
- e. Sioux Chief Manufacturing Company, Inc.
- f. Zurn Light Commercial Specialty Plumbing Products; Zurn Plumbing Products Group.

2.9 ENCASEMENT FOR PIPING

- A. Standard: ASTM A 674 or AWWA C105.
- B. Material: Linear low-density polyethylene film of 0.008-inch or high-density, cross-laminated polyethylene film of 0.004-inch minimum thickness.
- C. Form: Sheet or tube.
- D. Color: Black or natural.

PART 3 - EXECUTION

3.1 EARTHWORK

- A. Excavating, trenching, and backfilling are specified in Section 02300 "Earth Work."

3.2 PIPING APPLICATIONS

- A. Pipe couplings and special pipe fittings with pressure ratings at least equal to piping rating may be used in applications below, unless otherwise indicated.
 1. Use nonpressure-type flexible couplings where required to join gravity-flow, nonpressure sewer piping, unless otherwise indicated.
 - a. Unshielded flexible or rigid couplings for same or minor difference OD pipes.
 - b. Unshielded, increaser/reducer-pattern, flexible or rigid couplings for pipes with different OD.
 - c. Ring-type flexible couplings for piping of different sizes where annular space between smaller piping's OD and larger piping's ID permits installation.
 2. Use pressure-type pipe couplings for force-main joints.

- B. Special Pipe Fittings: Use for pipe expansion and deflection. Pipe couplings and special pipe fittings with pressure ratings at least equal to piping rating may be used in applications below, unless otherwise indicated.
- C. Gravity-Flow, Nonpressure Sewer Piping: Use any of the following pipe materials for each size range:
1. NPS 3: Hub-and-spigot, [Extra-Heavy] [Service] class, cast-iron soil pipe and fittings; [gaskets; and gasketed] [calking materials; and calked] joints.
 2. NPS 3: Hubless cast-iron soil pipe and fittings; [shielded, stainless-steel] [heavy-duty, shielded, stainless-steel] [heavy-duty, cast-iron] [unshielded] couplings; and coupled joints.
 3. NPS 3; NPS 6 ductile-iron, gravity sewer pipe or NPS 3 or NPS 4 ductile-iron pressure pipe; ductile-iron standard fittings; gaskets; and gasketed joints.
 4. NPS 3): Stainless-steel drainage pipe and fittings, gaskets, and gasketed joints. Use EPDM-compound gaskets, unless otherwise indicated. Use nitrile-rubber-compound gaskets for wastes containing gasoline or oil.
 5. NPS 3: ABS, SDR 35, sewer pipe and fittings; gaskets; and gasketed joints.
 6. NPS 3: PVC water-service pipe; PVC Schedule 80, water-service-pipe fittings; and solvent-cemented joints.
 7. NPS 3: NPS 4 PVC sewer pipe and fittings, gaskets, and gasketed joints.
 8. NPS 3 : NPS 4 Class 2, nonreinforced-concrete sewer pipe and fittings, gaskets, and gasketed joints.
 9. NPS 4: Hub-and-spigot, Extra-Heavy class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
 10. NPS 4: Hubless cast-iron soil pipe and fittings; stainless-steel or heavy-duty, shielded, stainless-steel couplings; and coupled joints.
 11. NPS 4 : NPS 6 ductile-iron, gravity sewer pipe or NPS 4 ductile-iron pressure pipe; ductile-iron standard fittings; gaskets; and gasketed joints.
 12. NPS 4 : Stainless-steel drainage pipe and fittings, gaskets, and gasketed joints. Use EPDM-compound gaskets, unless otherwise indicated. Use nitrile-rubber-compound gaskets for wastes containing gasoline or oil.
 13. NPS 4 : ABS, SDR 35, sewer pipe and fittings; gaskets; and gasketed joints.
 14. NPS 4 : PVC water-service pipe; PVC Schedule 80, water-service-pipe fittings; and solvent-cemented joints.
 15. NPS 4 : PVC sewer pipe and fittings, gaskets, and gasketed joints.
 16. NPS 4 : Class 2, nonreinforced-concrete sewer pipe and fittings, gaskets, and gasketed joints.
 17. NPS 5 and NPS 6 : Hub-and-spigot, Extra-Heavy class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
 18. NPS 5 and NPS 6 : Hubless cast-iron soil pipe and fittings; shielded, stainless-steel couplings; and coupled joints.
 19. NPS 5 and NPS 6 : NPS 6 ductile-iron, gravity sewer pipe; ductile-iron standard fittings; gaskets; and gasketed joints.
 20. NPS 5 and NPS 6 : NPS 6 stainless-steel drainage pipe and fittings, gaskets, and gasketed joints. Use EPDM-compound gaskets, unless otherwise indicated. Use nitrile-rubber-compound gaskets for wastes containing gasoline or oil.
 21. NPS 5 and NPS 6 : NPS 6 ABS, SDR 35, sewer pipe and fittings; gaskets; and gasketed joints.

22. NPS 5 and NPS 6 : NPS 6 cellular-core PVC pipe, PVC sewer pipe fittings, and solvent-cemented joints.
23. NPS 5 and NPS 6 : NPS 6 PVC sewer pipe and fittings, gaskets, and gasketed joints.
24. NPS 5 and NPS 6 : NPS 6 Class 2, nonreinforced-concrete sewer pipe and fittings, gaskets, and gasketed joints.
25. NPS 8 and NPS 10 : Hub-and-spigot, Extra-Heavy class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
26. NPS 8 and NPS 10 : Hubless cast-iron soil pipe and fittings; shielded, stainless-steel couplings; and coupled joints.
27. NPS 8 and NPS 10 : Ductile-iron, gravity sewer pipe; ductile-iron standard fittings; gaskets; and gasketed joints.
28. NPS 8 and NPS 10 : ABS, SDR 42, sewer pipe and fittings; gaskets; and gasketed joints.
29. NPS 8 and NPS 10 : Cellular-core PVC pipe, PVC sewer pipe fittings, and solvent-cemented joints.
30. NPS 8 and NPS 10 : PVC sewer pipe and fittings, gaskets, and gasketed joints.
31. NPS 8 and NPS 10 : PVC profile gravity sewer pipe and fittings, gaskets, and gasketed joints.
32. NPS 8 and NPS 10 : Fiberglass Type 2 or 4, Class III; sewer RTRP; Type 1 or 2 RTRF, gaskets, and gasketed joints.
33. NPS 8 and NPS 10 : Nonreinforced-concrete sewer pipe and fittings, gaskets, and gasketed joints.
34. NPS 12 and NPS 15 : Hub-and-spigot, Extra-Heavy class, cast-iron soil pipe and fittings; gaskets; and gasketed joints.
35. NPS 12 and NPS 15 : Hubless cast-iron soil pipe and fittings; heavy-duty, shielded, stainless-steel couplings; and coupled joints.
36. NPS 12 to NPS 16 : Ductile-iron, gravity sewer pipe; ductile-iron standard fittings; gaskets; and gasketed joints.
37. NPS 12: ABS, SDR 42, sewer pipe and fittings; gaskets; and gasketed joints.
38. NPS 12 and NPS 15: PVC sewer pipe and fittings, gaskets, and gasketed joints.
39. NPS 12 and NPS 15: PVC profile gravity sewer pipe and fittings, gaskets, and gasketed joints.
40. NPS 12 to NPS 16: Fiberglass Type 2 or 4, Class III; sewer RTRP; Type 1 or 2 RTRF, gaskets, and gasketed joints.
41. NPS 12 and NPS 15: Nonreinforced-concrete sewer pipe and fittings, gaskets, and gasketed joints.
42. NPS 12 and NPS 15: Reinforced-concrete sewer pipe and fittings, gaskets, and gasketed joints.
43. NPS 18 to NPS 24: Ductile-iron, gravity sewer pipe; ductile-iron standard fittings; gaskets; and gasketed joints.
44. NPS 18 to NPS 24: PVC sewer pipe and fittings, gaskets, and gasketed joints.
45. NPS 18 to NPS 24: PVC profile gravity sewer pipe and fittings, gaskets, and gasketed joints.
46. NPS 18 to NPS 24: Fiberglass Type 2 or 4, Class III; sewer RTRP; Type 1 or 2 RTRF, gaskets, and gasketed joints.
47. NPS 18 to NPS 24: Nonreinforced-concrete sewer pipe and fittings, gaskets, and gasketed joints.

48. NPS 18 to NPS 24: Reinforced-concrete sewer pipe and fittings, gaskets, and gasketed joints.

D. Force-Main, Pressure Piping: Use any of the following pipe materials for each size range:

1. NPS 2: PVC Schedule 80, water-service pipe; PVC Schedule 80, water-service-pipe fittings; and solvent-cemented joints.
2. NPS 3: Ductile-iron, gravity sewer pipe or ductile-iron pressure pipe; ductile-iron standard or compact fittings; gaskets; and gasketed joints.
3. NPS 3: PVC Schedule 80, water-service pipe; PVC Schedule 80, water-service-pipe fittings; and solvent-cemented joints.
4. NPS 4: Ductile-iron, gravity sewer pipe or ductile-iron pressure pipe; ductile-iron standard or compact fittings; gaskets; and gasketed joints.
5. NPS 4: PVC pressure pipe, PVC pressure fittings, gaskets, and gasketed joints.
6. NPS 6 to NPS 8: Ductile-iron sewer pipe; standard- or compact-pattern, ductile-iron fittings; gaskets; and gasketed joints.
7. NPS 6 to NPS 8: PVC pressure pipe, PVC pressure fittings, gaskets, and gasketed joints.
8. NPS 10 and NPS 12: Ductile-iron sewer pipe; standard- or compact-pattern, ductile-iron fittings; gaskets; and gasketed joints.
9. NPS 10 and NPS 12: PVC pressure pipe; compact-pattern, ductile-iron fittings; gaskets; and gasketed joints.

3.3 PIPING INSTALLATION

- A. General Locations and Arrangements: Drawing plans and details indicate general location and arrangement of underground sanitary sewer piping. Location and arrangement of piping layout take into account design considerations. Install piping as indicated, to extent practical. Where specific installation is not indicated, follow piping manufacturer's written instructions.
- B. Install piping beginning at low point, true to grades and alignment indicated with unbroken continuity of invert. Place bell ends of piping facing upstream. Install gaskets, seals, sleeves, and couplings according to manufacturer's written instructions for using lubricants, cements, and other installation requirements.
- C. Install proper size increasers, reducers, and couplings where different sizes or materials of pipes and fittings are connected. Reducing size of piping in direction of flow is prohibited.
- D. When installing pipe under streets or other obstructions that cannot be disturbed, use pipe-jacking process of microtunneling.
- E. Install gravity-flow, nonpressure, drainage piping according to the following:
 1. Install piping pitched down in direction of flow, at minimum slope of 2 percent, unless otherwise indicated.

2. Install piping NPS 6 and larger with restrained joints at tee fittings and at changes in direction. Use corrosion-resistant rods, pipe or fitting manufacturer's proprietary restraint system, or cast-in-place-concrete supports or anchors.
3. Install piping with 36-inch minimum cover.
4. Install piping below frost line.
5. Install hub-and-spigot, cast-iron soil piping according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook."
6. Install hubless cast-iron soil piping according to CISPI 310 and CISPI's "Cast Iron Soil Pipe and Fittings Handbook."
7. Install ductile-iron, gravity sewer piping according to ASTM A 746.
8. Install ductile-iron and special fittings according to AWWA C600 or AWWA M41.
9. Install stainless-steel drainage piping according to ASME A112.3.1.
10. Install ABS sewer piping according to ASTM D 2321 and ASTM F 1668.
11. Install PVC cellular-core piping according to ASTM D 2321 and ASTM F 1668.
12. Install PVC sewer piping according to ASTM D 2321 and ASTM F 1668.
13. Install PVC profile gravity sewer piping according to ASTM D 2321 and ASTM F 1668.
14. Install fiberglass sewer piping according to ASTM D 3839 and ASTM F 1668.
15. Install nonreinforced-concrete sewer piping according to ASTM C 1479 and ACPA's "Concrete Pipe Installation Manual."
16. Install reinforced-concrete sewer piping according to ASTM C 1479 and ACPA's "Concrete Pipe Installation Manual."

F. Install force-main, pressure piping according to the following:

1. Install piping with restrained joints at tee fittings and at horizontal and vertical changes in direction. Use corrosion-resistant rods, pipe or fitting manufacturer's proprietary restraint system, or cast-in-place-concrete supports or anchors.
2. Install piping with 36-inch minimum cover.
3. Install piping below frost line.
4. Install ductile-iron pressure piping according to AWWA C600 or AWWA M41.
5. Install ductile-iron special fittings according to AWWA C600.
6. Install PVC pressure piping according AWWA M23 or ASTM D 2774 and ASTM F 1668.
7. Install PVC water-service piping according ASTM D 2774 and ASTM F 1668.

G. Clear interior of piping of dirt and superfluous material as work progresses. Maintain swab or drag in piping, and pull past each joint as it is completed. Place plug in end of incomplete piping at end of day and when work stops.

3.4 PIPE JOINT CONSTRUCTION

A. Join gravity-flow, nonpressure, drainage piping according to the following:

1. Join hub-and-spigot, cast-iron soil piping with gasket joints according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for compression joints.

2. Join hub-and-spigot, cast-iron soil piping with calked joints according to CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for lead and oakum calked joints.
 3. Join hubless cast-iron soil piping according to CISPI 310 and CISPI's "Cast Iron Soil Pipe and Fittings Handbook" for hubless-coupling joints.
 4. Join ductile-iron, gravity sewer piping according to AWWA C600 for push-on joints.
 5. Join ductile-iron and special fittings according to AWWA C600 or AWWA M41.
 6. Join stainless-steel drainage piping according to ASME A112.3.1.
 7. Join ABS sewer piping according to ASTM D 2321 and ASTM D 2751 for elastomeric-seal joints.
 8. Join PVC cellular-core piping according to ASTM D 2321 and ASTM F 891 for solvent-cemented joints.
 9. Join PVC sewer piping according to ASTM D 2321 and ASTM D 3034 for elastomeric-seal joints or ASTM D 3034 for elastomeric-gasket joints.
 10. Join PVC profile gravity sewer piping according to ASTM D 2321 for elastomeric-seal joints or ASTM F 794 for gasketed joints.
 11. Join fiberglass sewer piping according to ASTM D 4161 for elastomeric-seal joints.
 12. Join nonreinforced-concrete sewer piping according to ASTM C 14 and ACPA's "Concrete Pipe Installation Manual" for rubber-gasket joints.
 13. Join reinforced-concrete sewer piping according to ACPA's "Concrete Pipe Installation Manual" for rubber-gasket joints.
 14. Join dissimilar pipe materials with nonpressure-type, flexible or rigid couplings.
- B. Join force-main, pressure piping according to the following:
1. Join ductile-iron pressure piping according to AWWA C600 or AWWA M41 for push-on joints.
 2. Join ductile-iron special fittings according to AWWA C600 or AWWA M41 for push-on joints.
 3. Join PVC pressure piping according AWWA M23 for gasketed joints.
 4. Join PVC water-service piping according ASTM D 2855.
 5. Join dissimilar pipe materials with pressure-type couplings.
- C. Pipe couplings with pressure ratings at least equal to piping rating may be used in applications below unless otherwise indicated.
1. Use nonpressure flexible couplings where required to join gravity-flow, nonpressure sewer piping unless otherwise indicated.
 - a. Unshielded flexible couplings for pipes of same or slightly different OD.
 - b. Unshielded, increaser/reducer-pattern, flexible couplings for pipes with different OD.
 - c. Ring-type flexible couplings for piping of different sizes where annular space between smaller piping's OD and larger piping's ID permits installation.

3.5 CONCRETE PLACEMENT

- A. Place cast-in-place concrete according to ACI 318.

3.6 BACKWATER VALVE INSTALLATION

- A. Install horizontal-type backwater valves in piping where indicated.
- B. Install combination horizontal and manual gate valve type in piping and in manholes where indicated.
- C. Install terminal-type backwater valves on end of piping and in manholes where indicated. Secure units to sidewalls.

3.7 CLEANOUT INSTALLATION

- A. Install cleanouts and riser extensions from sewer pipes to cleanouts at grade. Use cast-iron soil pipe fittings in sewer pipes at branches for cleanouts, and use cast-iron soil pipe for riser extensions to cleanouts. Install piping so cleanouts open in direction of flow in sewer pipe.
 - 1. Use Light-Duty, top-loading classification cleanouts in earth or unpaved foot-traffic areas.
 - 2. Use Medium-Duty, top-loading classification cleanouts in paved foot-traffic areas.
 - 3. Use Extra-Heavy-Duty, top-loading classification cleanouts in vehicle-traffic service areas.
- B. Set cleanout frames and covers in earth in cast-in-place-concrete block, 18 by 18 by 12 inches deep. Set with tops 1 inch above surrounding grade.
- C. Set cleanout frames and covers in concrete pavement and roads with tops flush with pavement surface.

3.8 CONNECTIONS

- A. Connect nonpressure, gravity-flow drainage piping to building's sanitary building drains.
- B. Make connections to existing piping and underground manholes.
 - 1. Use commercially manufactured wye fittings for piping branch connections. Remove section of existing pipe, install wye fitting into existing piping, and encase entire wye fitting plus 6-inch overlap with not less than 6 inches of concrete with 28-day compressive strength of 3000 psi.
 - 2. Make branch connections from side into existing piping, NPS 4 to NPS 20. Remove section of existing pipe, install wye fitting into existing piping, and

- encase entire wye with not less than 6 inches of concrete with 28-day compressive strength of 3000 psi.
3. Make branch connections from side into existing piping, NPS 21 or larger, or to underground manholes by cutting opening into existing unit large enough to allow 3 inches of concrete to be packed around entering connection. Cut end of connection pipe passing through pipe or structure wall to conform to shape of and be flush with inside wall unless otherwise indicated. On outside of pipe or manhole wall, encase entering connection in 6 inches of concrete for minimum length of 12 inches to provide additional support of collar from connection to undisturbed ground.
 - a. Use concrete that will attain a minimum 28-day compressive strength of 3000 psi unless otherwise indicated.
 - b. Use epoxy-bonding compound as interface between new and existing concrete and piping materials.
 4. Protect existing piping and manholes to prevent concrete or debris from entering while making tap connections. Remove debris or other extraneous material that may accumulate.
- C. Connect to oil and sand interceptors specified in Section 22132 "Sanitary Waste Interceptors."

3.9 IDENTIFICATION

- A. Materials and their installation are specified in Section 02300 "Earth Work." Arrange for installation of green warning tapes directly over piping and at outside edges of underground manholes.
1. Use detectable warning tape over ferrous piping.
 2. Use detectable warning tape over nonferrous piping and over edges of underground manholes.

3.10 FIELD QUALITY CONTROL

- A. Inspect interior of piping to determine whether line displacement or other damage has occurred. Inspect after approximately 24 inches of backfill is in place, and again at completion of Project.
1. Submit separate report for each system inspection.
 2. Defects requiring correction include the following:
 - a. Alignment: Less than full diameter of inside of pipe is visible between structures.
 - b. Deflection: Flexible piping with deflection that prevents passage of ball or cylinder of size not less than 92.5 percent of piping diameter.
 - c. Damage: Crushed, broken, cracked, or otherwise damaged piping.

- d. Infiltration: Water leakage into piping.
 - e. Exfiltration: Water leakage from or around piping.
 3. Replace defective piping using new materials, and repeat inspections until defects are within allowances specified.
 4. Reinspect and repeat procedure until results are satisfactory.
- B. Test new piping systems, and parts of existing systems that have been altered, extended, or repaired, for leaks and defects.
 1. Do not enclose, cover, or put into service before inspection and approval.
 2. Test completed piping systems according to requirements of authorities having jurisdiction.
 3. Schedule tests and inspections by authorities having jurisdiction with at least 24 hours' advance notice.
 4. Submit separate report for each test.
 5. Hydrostatic Tests: Test sanitary sewerage according to requirements of authorities having jurisdiction and the following:
 - a. Fill sewer piping with water. Test with pressure of at least 10-foot head of water, and maintain such pressure without leakage for at least 15 minutes.
 - b. Close openings in system and fill with water.
 - c. Purge air and refill with water.
 - d. Disconnect water supply.
 - e. Test and inspect joints for leaks.
 6. Air Tests: Test sanitary sewerage according to requirements of authorities having jurisdiction, UNI-B-6, and the following:
 - a. Option: Test plastic gravity sewer piping according to ASTM F 1417.
 - b. Option: Test concrete gravity sewer piping according to ASTM C 924.
 7. Force Main: Perform hydrostatic test after thrust blocks, supports, and anchors have hardened. Test at pressure not less than 1-1/2 times the maximum system operating pressure, but not less than 150 psig.
 - a. Ductile-Iron Piping: Test according to AWWA C600, "Hydraulic Testing" Section.
 - b. PVC Piping: Test according to AWWA M23, "Testing and Maintenance" Chapter.
- C. Leaks and loss in test pressure constitute defects that must be repaired.
- D. Replace leaking piping using new materials, and repeat testing until leakage is within allowances specified.

3.11 CLEANING

- A. Clean dirt and superfluous material from interior of piping. Flush with potable water.

END OF SECTION 221313

SECTION 224000
PLUMBING FIXTURES

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following conventional plumbing fixtures and related components:
 - 1. Showers.
 - 2. Faucets for showers.
 - 3. Dishwasher Air Gap.
 - 4. Faucets for lavatories.
 - 5. Faucets for sinks.
 - 6. Flushometers.
 - 7. Toilet seats.
 - 8. Protective shielding guards.
 - 9. Fixture supports.
 - 10. Interceptors.
 - 11. Water closets.
 - 12. Lavatories.
 - 13. Owner-furnished fixtures.

1.3 DEFINITIONS

- A. ABS: Acrylonitrile-butadiene-styrene plastic.
- B. Accessible Fixture: Plumbing fixture that can be approached, entered, and used by people with disabilities.
- C. Cast Polymer: Cast-filled-polymer-plastic material. This material includes cultured-marble and solid-surface materials.
- D. Cultured Marble: Cast-filled-polymer-plastic material with surface coating.
- E. Fitting: Device that controls the flow of water into or out of the plumbing fixture. Fittings specified in this Section include supplies and stops, faucets and spouts,

shower heads and tub spouts, drains and tailpieces, and traps and waste pipes. Piping and general-duty valves are included where indicated.

- F. FRP: Fiberglass-reinforced plastic.
- G. PMMA: Polymethyl methacrylate (acrylic) plastic.
- H. PVC: Polyvinyl chloride plastic.
- I. Solid Surface: Nonporous, homogeneous, cast-polymer-plastic material with heat-, impact-, scratch-, and stain-resistance qualities.

1.4 SUBMITTALS

- A. Product Data: For each type of plumbing fixture indicated. Include selected fixture and trim, fittings, accessories, appliances, appurtenances, equipment, and supports. Indicate materials and finishes, dimensions, construction details, and flow-control rates.
- B. Operation and Maintenance Data: For plumbing fixtures to include in emergency, operation, and maintenance manuals.
- C. Warranty: Special warranty specified in this Section.

1.5 QUALITY ASSURANCE

- A. Source Limitations: Obtain plumbing fixtures, faucets, and other components of each category through one source from a single manufacturer.
 - 1. Exception: If fixtures, faucets, or other components are not available from a single manufacturer, obtain similar products from other manufacturers specified for that category.
- B. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, Article 100, by a testing agency acceptable to authorities having jurisdiction, and marked for intended use.
- C. Regulatory Requirements: Comply with requirements in ICC A117.1, "Accessible and Usable Buildings and Facilities"; Public Law 90-480, "Architectural Barriers Act"; and Public Law 101-336, "Americans with Disabilities Act"; for plumbing fixtures for people with disabilities.
- D. Regulatory Requirements: Comply with requirements in Public Law 102-486, "Energy Policy Act," about water flow and consumption rates for plumbing fixtures.
- E. NSF Standard: Comply with NSF 61, "Drinking Water System Components--Health Effects," for fixture materials that will be in contact with potable water.

- F. Select combinations of fixtures and trim, faucets, fittings, and other components that are compatible.
- G. Comply with the following applicable standards and other requirements specified for plumbing fixtures:
 - 1. Enameled, Cast-Iron Fixtures: ASME A112.19.1M.
 - 2. Porcelain-Enameled, Formed-Steel Fixtures: ASME A112.19.4M.
 - 3. Slip-Resistant Bathing Surfaces: ASTM F 462.
 - 4. Solid-Surface-Material Lavatories and Sinks: ANSI/ICPA SS-1.
 - 5. Stainless-Steel Commercial, Handwash Sinks: NSF 2 construction.
 - 6. Vitreous-China Fixtures: ASME A112.19.2M.
 - 7. Water-Closet, Flush Valve, Tank Trim: ASME A112.19.5.
 - 8. Water-Closet, Flushometer Tank Trim: ASSE 1037.
- H. Comply with the following applicable standards and other requirements specified for lavatory sink faucets:
 - 1. Faucets: ASME A112.18.1.
 - 2. Hose-Connection Vacuum Breakers: ASSE 1011.
 - 3. Hose-Coupling Threads: ASME B1.20.7.
 - 4. Integral, Atmospheric Vacuum Breakers: ASSE 1001.
 - 5. NSF Potable-Water Materials: NSF 61.
 - 6. Pipe Threads: ASME B1.20.1.
 - 7. Sensor-Actuated Faucets and Electrical Devices: UL 1951.
 - 8. Supply Fittings: ASME A112.18.1.
 - 9. Brass Waste Fittings: ASME A112.18.2.
- I. Comply with the following applicable standards and other requirements specified for miscellaneous fittings:
 - 1. Atmospheric Vacuum Breakers: ASSE 1001.
 - 2. Brass and Copper Supplies: ASME A112.18.1.
 - 3. Dishwasher Air-Gap Fittings: ASSE 1021.
 - 4. Manual-Operation Flushometers: ASSE 1037.
 - 5. Plastic Tubular Fittings: ASTM F 409.
 - 6. Brass Waste Fittings: ASME A112.18.2.
 - 7. Sensor-Operation Flushometers: ASSE 1037 and UL 1951.
- J. Comply with the following applicable standards and other requirements specified for miscellaneous components:
 - 1. Flexible Water Connectors: ASME A112.18.6.
 - 2. Floor Drains: ASME A112.6.3.
 - 3. Grab Bars: ASTM F 446.
 - 4. Hose-Coupling Threads: ASME B1.20.7.
 - 5. Off-Floor Fixture Supports: ASME A112.6.1M.
 - 6. Pipe Threads: ASME B1.20.1.

7. Plastic Toilet Seats: ANSI Z124.5.
8. Supply and Drain Protective Shielding Guards: ICC A117.1.

1.6 WARRANTY

- A. Special Warranties: Manufacturer's standard form in which manufacturer agrees to repair or replace components of whirlpools that fail in materials or workmanship within specified warranty period.
 1. Failures include, but are not limited to, the following:
 - a. Structural failures of unit shell.
 - b. Faulty operation of controls, blowers, pumps, heaters, and timers.
 - c. Deterioration of metals, metal finishes, and other materials beyond normal use.
 2. Warranty Period for Commercial Applications: Three year(s) from date of Substantial Completion.

1.7 EXTRA MATERIALS

- A. Furnish extra materials described below that match products installed and that are packaged with protective covering for storage and identified with labels describing contents.
 1. Faucet Washers and O-Rings: Equal to 10 percent of amount of each type and size installed.
 2. Faucet Cartridges and O-Rings: Equal to 5 percent of amount of each type and size installed.
 3. Flushometer Valve, Repair Kits: Equal to 10 percent of amount of each type installed, but no fewer than 2 of each type.
 4. Toilet Seats: Equal to 5 percent of amount of each type installed, but no fewer than 2 of each type.

PART 2 - PRODUCTS

2.1 SHOWERS

- a. Showers Standard PMMA with base, and faucet.
 - 1) PMMA (Acrylic) Showers:
 - a) Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following but are not limited to:

- 1) Acryline USA, Inc.
- 2) Aqua Bath Company, Inc.
- 3) Aqua Glass Corporation.
- 4) Aquatic Industries, Inc.
- 5) Clarion Bathware.
- 6) Crane Plumbing, L.L.C.
- 7) Jacuzzi, Inc.
- 8) Kohler Co.
- 9) LASCO Bathware.
- 10) MAAX.
- 11) Praxis Industries, LLC.

- 2) Standard: ANSI Z124.1.2.
- 3) Nominal Size: 36 by 36 inches.
- 4) Surround: One piece.
- 5) Bathing Surface: Slip resistant according to ASTM F 462.
- 6) Color: White.
- 7) Drain Location: Center.

2.2 SHOWER FAUCETS

- a. NSF Standard: Comply with NSF/ANSI 61, "Drinking Water System Components - Health Effects," for faucet materials that will be in contact with potable water.
- b. Shower Faucets Single handle, thermostatic, mixing valve.
 - 1) Single-Handle, Thermostatic Faucets:
 - a) Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following but are not limited to:
 - 1) American Standard America.
 - 2) Lawler Manufacturing Co., Inc.
 - 3) Leonard Valve Company.
 - 4) Powers.
 - 2) Fixture:
 - a) Standard: ASME A112.18.1/CSA B125.1.
 - b) General: Include hot- and cold-water indicators; check stops; and fixed shower head, arm, and flange. Coordinate faucet inlets with supplies.
 - c) Body Material: Solid brass with nonmetallic trim.
 - d) Finish: Polished chrome plate.
 - e) Maximum Flow Rate: 2.5 gpm unless otherwise indicated.
 - f) Mounting: Exposed.
 - g) Operation: Compression, manual.
 - h) Antiscald Device: Integral with mixing valve.

- i) Check Stops: Check-valve type, integral with or attached to body; on hot- and cold-water supply connections.
- 3) Supply Connections: NPS 1/2.
- 4) Shower Head:
 - a) Type: Ball joint and head integral with mounting flange.
 - b) Shower Head Material: Combined, metallic and nonmetallic with chrome-plated finish.
 - c) Spray Pattern: Adjustable.
 - d) Integral Volume Control: Not required.
 - e) Shower-Arm, Flow-Control Fitting: 2.0 gpm.

2.3 DISHWASHER AIR-GAP FITTINGS

a. Dishwasher Air-Gap Fittings:

- 1) Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following but are not limited to:
 - a) B & K Industries, Inc.
 - b) Brass Craft Manufacturing; a subsidiary of Masco Corporation.
 - c) BrassTech Inc.
 - d) Dearborn Brass.
 - e) Geberit US.
 - f) Sioux Chief Manufacturing Company, Inc.
 - g) Watts Brass & Tubular; a division of Watts Water Technologies, Inc.
- 2) Standard: ASSE 1021.
- 3) Description: Device designed to prevent backflow of contaminated liquid into domestic dishwashers.
- 4) Material: Plastic body[with chrome-plated-brass cover].
- 5) Hose Connections: 5/8-inch- ID inlet and 7/8-inch- ID outlet.
- 6) Capacity: At least 5 gpm; at inlet pressure of at least 5 psig and at temperature of at least 140 deg F.
- 7) Mounting: Deck.
- 8) Hoses: Rubber and suitable for temperature of at least 140 deg F.
 - a) Inlet Hose: 5/8 inch ID and 48 inches long.
 - b) Outlet Hose: 7/8 inch ID and 48 inches long.

2.4 LAVATORY FAUCETS

A. Lavatory Faucets:

1. Basis-of-Design Product: Subject to compliance with requirements, provide the product indicated on Drawings or a comparable product by one of the following but are not limited to:
 - a. American Standard Companies, Inc.
 - b. Bradley Corporation.
 - c. Chicago Faucets.
 - d. Delta Faucet Company.
 - e. Eljer.
 - f. Elkay Manufacturing Co.
 - g. Fisher Manufacturing Co.
 - h. Grohe America, Inc.
 - i. Just Manufacturing Company.
 - j. Kohler Co.
 - k. Moen, Inc.
 - l. Royal Brass Mfg. Co.
 - m. Sayco; a Briggs Plumbing Products, Inc. Company.
 - n. Speakman Company.
 - o. T & S Brass and Bronze Works, Inc.
 - p. Zurn Plumbing Products Group; Commercial Brass Operation.

2. Description: Single-control mixing valve. Include hot- and cold-water indicators; coordinate faucet inlets with supplies and fixture holes; coordinate outlet with spout and fixture receptor.
 - a. Body Material: Commercial, solid brass
 - b. Finish: Polished chrome plate.
 - c. Maximum Flow Rate: 2.2 gpm.
 - d. Centers: 4 inches.
 - e. Mounting: Deck, exposed.
 - f. Valve Handle(s): Wrist blade, 4 inches.
 - g. Inlet(s): NPS 3/8 tubing, with NPS 1/2 male adaptor.
 - h. Spout: Rigid type.
 - i. Spout Outlet: Aerator.
 - j. Operation: Compression, manual.
 - k. Drain: Pop up.
 - l. Tempering Device: Mechanical.

2.5 SINK FAUCETS

A. Sink Faucets:

1. Basis-of-Design Product: Subject to compliance with requirements, provide the product indicated on Drawings or a comparable product by one of the following but are not limited to:
 - a. American Standard Companies, Inc.
 - b. Bradley Corporation.

- c. Broadway Collection.
 - d. Chicago Faucets.
 - e. Delta Faucet Company.
 - f. Dormont Manufacturing Company.
 - g. Eljer.
 - h. Elkay Manufacturing Co.
 - i. Fisher Manufacturing Co.
 - j. Grohe America, Inc.
 - k. Just Manufacturing Company.
 - l. Kohler Co.
 - m. Moen, Inc.
 - n. Royal Brass Mfg. Co.
 - o. Sayco; a Briggs Plumbing Products, Inc. Company.
 - p. Speakman Company.
 - q. T & S Brass and Bronze Works, Inc.
 - r. Zurn Plumbing Products Group; Commercial Brass Operation.
2. Description: Kitchen faucet with spray, three-hole fixture. Include hot- and cold-water indicators; coordinate faucet inlets with supplies and fixture holes; coordinate outlet with spout and fixture receptor.
- a. Body Material: Commercial, solid brass.
 - b. Finish: Satin Finish Nickel.
 - c. Maximum Flow Rate: 2.5 gpm, unless otherwise indicated.
 - d. Mixing Valve: Two-lever handle.
 - e. Centers: 6 inches.
 - f. Mounting: Deck.
 - g. Handle(s): Wrist blade, 4 inches.
 - h. Inlet(s): NPS 3/8 tubing with NPS 1/2 male adapter.
 - i. Spout Type: Swivel gooseneck].
 - j. Spout Outlet: Aerator.
 - k. Drain: Not required.

2.6 FLUSHOMETERS

A. Flushometers,:

- 1. Basis-of-Design Product: Subject to compliance with requirements, provide the product indicated on Drawings or a comparable product by one of the following but are not limited to:
 - a. Coyne & Delany Co.
 - b. Delta Faucet Company.
 - c. Hydrotek International, Inc.
 - d. Sloan Valve Company.
 - e. TOTO USA, Inc.
 - f. Zurn Plumbing Products Group; Commercial Brass Operation.

2. Description: Flushometer for water-closet-type fixture. Include brass body with corrosion-resistant internal components, control stop with check valve, vacuum breaker, copper or brass tubing, and polished chrome-plated finish on exposed parts.
 - a. Internal Design: Diaphragm or piston operation.
 - b. Style: Exposed.
 - c. Inlet Size: NPS 3/4.
 - d. Trip Mechanism: Mechanical, push-button actuator with stainless-steel access plate.
 - e. Consumption: 1.6 gal./flush.
 - f. Tailpiece Size: NPS 1-1/4 and standard length to top of bowl.

2.7 TOILET SEATS

A. Toilet Seats:

1. Basis-of-Design Product: Subject to compliance with requirements, provide the product indicated on Drawings or a comparable product by one of the following but are not limited to:
 - a. American Standard Companies, Inc.
 - b. Bemis Manufacturing Company.
 - c. Centoco Manufacturing Corp.
 - d. Church Seats.
 - e. Eljer.
 - f. Kohler Co.
 - g. Olsonite Corp.
 - h. Sanderson Plumbing Products, Inc.; Beneke Div.
 - i. Sperzel.
2. Description: Toilet seat for water-closet-type fixture.
 - a. Material: Molded, solid plastic with antimicrobial agent.
 - b. Configuration: Open front without cover.
 - c. Size: Elongated.
 - d. Hinge Type: SS, self-sustaining.
 - e. Class: Standard commercial.
 - f. Color: White.

2.8 PROTECTIVE SHIELDING GUARDS

A. Protective Shielding Pipe Covers:

1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. Engineered Brass Co.
 - b. Insul-Tect Products Co.; a Subsidiary of MVG Molded Products.
 - c. McGuire Manufacturing Co., Inc.
 - d. Plumberex Specialty Products Inc.
 - e. TCI Products.
 - f. TRUEBRO, Inc.
 - g. Zurn Plumbing Products Group; Tubular Brass Plumbing Products Operation.
2. Description: Manufactured plastic wraps for covering plumbing fixture hot- and cold-water supplies and trap and drain piping. Comply with Americans with Disabilities Act (ADA) requirements.
- B. Protective Shielding Piping Enclosures:
1. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. TRUEBRO, Inc.
 2. Description: Manufactured plastic enclosure for covering plumbing fixture hot- and cold-water supplies and trap and drain piping. Comply with ADA requirements.

2.9 FIXTURE SUPPORTS

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
1. Josam Company.
 2. MIFAB Manufacturing Inc.
 3. Smith, Jay R. Mfg. Co.
 4. Tyler Pipe; Wade Div.
 5. Watts Drainage Products Inc.; a div. of Watts Industries, Inc.
 6. Zurn Plumbing Products Group; Specification Drainage Operation.
- B. Water-Closet Supports:
1. Description: Combination carrier designed for accessible mounting height of wall-mounting, water-closet-type fixture. Include single or double, vertical or horizontal, hub-and-spigot or hubless waste fitting as required for piping arrangement; faceplates; couplings with gaskets; feet; and fixture bolts and hardware matching fixture. Include additional extension coupling, faceplate, and feet for installation in wide pipe space.
- C. Lavatory Supports,:

1. Description: Type III, lavatory carrier with hanger plate and tie rod for wall-mounting, lavatory-type fixture. Include steel uprights with feet.
2. Accessible-Fixture Support: Include rectangular steel uprights.

2.10 INTERCEPTORS

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

1. Josam Company.
2. MIFAB Manufacturing Inc.
3. Smith, Jay R. Mfg. Co.
4. Tyler Pipe; Wade Div.
5. Watts Drainage Products Inc.; a div. of Watts Industries, Inc.
6. Zurn Plumbing Products Group; Specification Drainage Operation.

2.11 WATER CLOSETS

- A. Water Closets:

1. Basis-of-Design Product: Subject to compliance with requirements, provide the product indicated on Drawings or a comparable product by one of the following, but are not limited to:
 - a. American Standard Companies, Inc.
 - b. Briggs Plumbing Products, Inc.
 - c. Capizzi.
 - d. Crane Plumbing, L.L.C./Fiat Products.
 - e. Eljer.
 - f. Kohler Co.
 - g. St. Thomas Creations.
 - h. TOTO USA, Inc.
2. Description Accessible, wall-mounting, back-outlet, vitreous-china fixture designed for flushometer valve operation.
 - a. Style: One piece.
 - 1) Bowl Type: Elongated with siphon-jet design.
 - 2) Design Consumption: 1.6 gal./flush.
 - 3) Trip Mechanism: Push-button actuator.
 - 4) Color: White.
 - b. Supply: NPS 1/2 chrome-plated brass or copper with wheel-handle stop.
 - c. Style: Flushometer valve.
 - 1) Bowl Type: Elongated with blowout design.

- 2) Design Consumption: 1.6 gal./flush.
- 3) Color: White..
- d. Fixture Support: Water-closet support combination carrier.

2.12 LAVATORIES

a. Lavatories solid surface round, PMMA.

- 1) Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following, but are not limited to:

- 1) American Standard America.
- 2) Bradley Corporation.
- 3) DuPont.
- 4) Formica Corporation.
- 5) Franke Consumer Products, Inc.
- 6) InPro Corporation (IPC).
- 7) Rynone Manufacturing Corp.
- 8) Swan Corporation (The).

- 2) Fixture:

- a) Standard: ASME A112.19.2/CSA B45.1 for vitreous-china lavatories.
- b) Type: Self-rimming.
- c) Round Nominal Size: 15 inches in diameter.
- d) Faucet-Hole Punching: Three holes, 2-inch centers mounted on vanity.
- e) Color: White.

B. Lavatories: wall hung

- 1. Basis-of-Design Product: Subject to compliance with requirements, provide the product indicated on Drawings or a comparable product by one of the following, but are not limited to:

- a. American Standard Companies, Inc.
- b. Barclay Products, Ltd.
- c. Briggs Plumbing Products, Inc.
- d. Crane Plumbing, L.L.C./Fiat Products.
- e. Eljer.
- f. Gerber Plumbing Fixtures LLC.
- g. Kohler Co.
- h. Mansfield Plumbing Products, Inc.
- i. Peerless Pottery, Inc.
- j. Sterling Plumbing Group, Inc.
- k. St. Thomas Creations.
- l. TOTO USA, Inc.

- 2. Description: Wall-mounting, vitreous-china fixture.

- a. Type: Slab.
- b. Size: 20x27 inches rectangular.
- c. Faucet Hole Punching: Three holes, 4-inch centers.
- d. Faucet Hole Location: Top.
- e. Pedestal: Not required.
- f. Color: White.
- g. Faucet: Lavatory with pop-up waste.
- h. Supplies: NPS 3/8 chrome-plated copper with stops.
- i. Drain: See faucet.
 - 1) Location: Near back of bowl.
- j. Drain Piping: Schedule 40 ABS or PVC, NPS 1-1/4 by NPS 1-1/2 P-trap; NPS 1-1/2, tubular waste to wall; and wall escutcheon.
- k. Hair Interceptor: Not required
- l. Protective Shielding Guard(s): ADA
- m. Fixture Support: Lavatory .

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine roughing-in of water supply and sanitary drainage and vent piping systems to verify actual locations of piping connections before plumbing fixture installation.
- B. Examine cabinets, counters, floors, and walls for suitable conditions where fixtures will be installed.
- C. Proceed with installation only after unsatisfactory conditions have been corrected.

3.2 INSTALLATION

- A. Assemble plumbing fixtures, trim, fittings, and other components according to manufacturers' written instructions.
- B. Install off-floor supports, affixed to building substrate, for wall-mounting fixtures.
 - 1. Use carrier supports with waste fitting and seal for back-outlet fixtures.
 - 2. Use carrier supports without waste fitting for fixtures with tubular waste piping.
 - 3. Use chair-type carrier supports with rectangular steel uprights for accessible fixtures.
- C. Install back-outlet, wall-mounting fixtures onto waste fitting seals and attach to supports.

- D. Install floor-mounting fixtures on closet flanges or other attachments to piping or building substrate.
- E. Install wall-mounting fixtures with tubular waste piping attached to supports.
- F. Install floor-mounting, back-outlet water closets attached to building floor substrate and wall bracket and onto waste fitting seals.
- G. Install counter-mounting fixtures in and attached to casework.
- H. Install fixtures level and plumb according to roughing-in drawings.
- I. Install water-supply piping with stop on each supply to each fixture to be connected to water distribution piping. Attach supplies to supports or substrate within pipe spaces behind fixtures. Install stops in locations where they can be easily reached for operation.
 - 1. Exception: Use ball, gate, or globe valves if supply stops are not specified with fixture. Valves are specified in Division 22 Section "General-Duty Valves for Plumbing Piping."
- J. Install trap and tubular waste piping on drain outlet of each fixture to be directly connected to sanitary drainage system.
- K. Install tubular waste piping on drain outlet of each fixture to be indirectly connected to drainage system.
- L. Install flushometer valves for accessible water closets and urinals with handle mounted on wide side of compartment. Install other actuators in locations that are easy for people with disabilities to reach.
- M. Install tanks for accessible, tank-type water closets with lever handle mounted on wide side of compartment.
- N. Install toilet seats on water closets.
- O. Install water-supply flow-control fittings with specified flow rates in fixture supplies at stop valves.
- P. Install faucet flow-control fittings with specified flow rates and patterns in faucet spouts if faucets are not available with required rates and patterns. Include adapters if required.
- Q. Install traps on fixture outlets.
 - 1. Exception: Omit trap on fixtures with integral traps.
 - 2. Exception: Omit trap on indirect wastes, unless otherwise indicated.

- R. Install escutcheons at piping wall ceiling penetrations in exposed, finished locations and within cabinets and millwork. Use deep-pattern escutcheons if required to conceal protruding fittings. Escutcheons are specified in Division 22 Section "Common Work Results for Plumbing."
- S. Seal joints between fixtures and walls, floors, and countertops using sanitary-type, one-part, mildew-resistant silicone sealant. Match sealant color to fixture color. Sealants are specified in Division 07 Section "Joint Sealants."

3.3 CONNECTIONS

- A. Piping installation requirements are specified in other Division 22 Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- B. Connect fixtures with water supplies, stops, and risers, and with traps, soil, waste, and vent piping. Use size fittings required to match fixtures.
- C. Ground equipment according to Division 26 Section "Grounding and Bonding for Electrical Systems."

3.4 FIELD QUALITY CONTROL

- A. Verify that installed plumbing fixtures are categories and types specified for locations where installed.
- B. Check that plumbing fixtures are complete with trim, faucets, fittings, and other specified components.
- C. Inspect installed plumbing fixtures for damage. Replace damaged fixtures and components.
- D. Test installed fixtures after water systems are pressurized for proper operation. Replace malfunctioning fixtures and components, then retest. Repeat procedure until units operate properly.
- E. Install fresh batteries in sensor-operated mechanisms.

3.5 ADJUSTING

- A. Operate and adjust faucets and controls. Replace damaged and malfunctioning fixtures, fittings, and controls.
- B. Adjust water pressure at faucets and flushometer valves to produce proper flow and stream.
- C. Replace washers and seals of leaking and dripping faucets and stops.

- D. Install fresh batteries in sensor-operated mechanisms.

3.6 CLEANING

- A. Clean fixtures, faucets, and other fittings with manufacturers' recommended cleaning methods and materials. Do the following:
 - 1. Remove faucet spouts and strainers, remove sediment and debris, and reinstall strainers and spouts.
 - 2. Remove sediment and debris from drains.
- B. After completing installation of exposed, factory-finished fixtures, faucets, and fittings, inspect exposed finishes and repair damaged finishes.

3.7 PROTECTION

- A. Provide protective covering for installed fixtures and fittings.
- B. Do not allow use of plumbing fixtures for temporary facilities unless approved in writing by Owner.

END OF SECTION 224000

***DIVISION* 23**

MECHANICAL

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: www.dammonengineering.com



SECTION 230500

COMMON WORK RESULTS FOR HVAC

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Piping materials and installation instructions common to most piping systems.
 - 2. Transition fittings.
 - 3. Dielectric fittings.
 - 4. Mechanical sleeve seals.
 - 5. Sleeves.
 - 6. Escutcheons.
 - 7. Grout.
 - 8. HVAC demolition.
 - 9. Equipment installation requirements common to equipment sections.
 - 10. Painting and finishing.
 - 11. Concrete bases.
 - 12. Supports and anchorages.

1.3 DEFINITIONS

- A. Finished Spaces: Spaces other than mechanical and electrical equipment rooms, furred spaces, pipe and duct chases, unheated spaces immediately below roof, spaces above ceilings, unexcavated spaces, crawlspaces, and tunnels.
- B. Exposed, Interior Installations: Exposed to view indoors. Examples include finished occupied spaces and mechanical equipment rooms.
- C. Exposed, Exterior Installations: Exposed to view outdoors or subject to outdoor ambient temperatures and weather conditions. Examples include rooftop locations.
- D. Concealed, Interior Installations: Concealed from view and protected from physical contact by building occupants. Examples include above ceilings and chases.

- E. Concealed, Exterior Installations: Concealed from view and protected from weather conditions and physical contact by building occupants but subject to outdoor ambient temperatures. Examples include installations within unheated shelters.
- F. The following are industry abbreviations for plastic materials:
 - 1. CPVC: Chlorinated polyvinyl chloride plastic.
 - 2. PE: Polyethylene plastic.
 - 3. PVC: Polyvinyl chloride plastic.
- G. The following are industry abbreviations for rubber materials:
 - 1. EPDM: Ethylene-propylene-diene terpolymer rubber.
 - 2. NBR: Acrylonitrile-butadiene rubber.

1.4 SUBMITTALS

- A. Product Data: For the following:
 - 1. Transition fittings.
 - 2. Dielectric fittings.
 - 3. Mechanical sleeve seals.
 - 4. Escutcheons.

- B. Welding certificates.

1.5 QUALITY ASSURANCE

- A. Steel Support Welding: Qualify processes and operators according to AWS D1.1, "Structural Welding Code--Steel."
- B. Steel Pipe Welding: Qualify processes and operators according to ASME Boiler and Pressure Vessel Code: Section IX, "Welding and Brazing Qualifications."
 - 1. Comply with provisions in ASME B31 Series, "Code for Pressure Piping."
 - 2. Certify that each welder has passed AWS qualification tests for welding processes involved and that certification is current.
- C. Electrical Characteristics for HVAC Equipment: Equipment of higher electrical characteristics may be furnished provided such proposed equipment is approved in writing and connecting electrical services, circuit breakers, and conduit sizes are appropriately modified. If minimum energy ratings or efficiencies are specified, equipment shall comply with requirements.

1.6 DELIVERY, STORAGE, AND HANDLING

- A. Deliver pipes and tubes with factory-applied end caps. Maintain end caps through shipping, storage, and handling to prevent pipe end damage and to prevent entrance of dirt, debris, and moisture.
- B. Store plastic pipes protected from direct sunlight. Support to prevent sagging and bending.

1.7 COORDINATION

- A. Arrange for pipe spaces, chases, slots, and openings in building structure during progress of construction, to allow for HVAC installations.
- B. Coordinate installation of required supporting devices and set sleeves in poured-in-place concrete and other structural components as they are constructed.
- C. Coordinate requirements for access panels and doors for HVAC items requiring access that are concealed behind finished surfaces

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. In other Part 2 articles where subparagraph titles below introduce lists, the following requirements apply for product selection:
 - 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the manufacturers specified.
 - 2. Manufacturers: Subject to compliance with requirements, provide products by the manufacturers specified.

2.2 PIPE, TUBE, AND FITTINGS

- A. Pipe Threads: ASME B1.20.1 for factory-threaded pipe and pipe fittings.

2.3 JOINING MATERIALS

- A. Pipe-Flange Gasket Materials: Suitable for chemical and thermal conditions of piping system contents.
 - 1. ASME B16.21, nonmetallic, flat, asbestos-free, 1/8-inch maximum thickness unless thickness or specific material is indicated.

- a. Full-Face Type: For flat-face, Class 125, cast-iron and cast-bronze flanges.
 - b. Narrow-Face Type: For raised-face, Class 250, cast-iron and steel flanges.
2. AWWA C110, rubber, flat face, 1/8 inch thick, unless otherwise indicated; and full-face or ring type, unless otherwise indicated.
- B. Flange Bolts and Nuts: ASME B18.2.1, carbon steel, unless otherwise indicated.
- C. Plastic, Pipe-Flange Gasket, Bolts, and Nuts: Type and material recommended by piping system manufacturer, unless otherwise indicated.
- D. Solder Filler Metals: ASTM B 32, lead-free alloys. Include water-flushable flux according to ASTM B 813.
- E. Brazing Filler Metals: AWS A5.8, BCuP Series, copper-phosphorus alloys for general-duty brazing, unless otherwise indicated; and AWS A5.8, BAg1, silver alloy for refrigerant piping, unless otherwise indicated.
- F. Welding Filler Metals: Comply with AWS D10.12 for welding materials appropriate for wall thickness and chemical analysis of steel pipe being welded.
- G. Solvent Cements for Joining Plastic Piping:
1. CPVC Piping: ASTM F 493.
 2. PVC Piping: ASTM D 2564. Include primer according to ASTM F 656.
- H. Fiberglass Pipe Adhesive: As furnished or recommended by pipe manufacturer.

2.4 TRANSITION FITTINGS

- A. Plastic-to-Metal Transition Fittings: CPVC and PVC one-piece fitting with manufacturer's Schedule 80 equivalent dimensions; one end with threaded brass insert, and one solvent-cement-joint end.
1. Available Manufacturers:
 - a. Eslon Thermoplastics.
- B. Plastic-to-Metal Transition Adaptors: One-piece fitting with manufacturer's SDR 11 equivalent dimensions; one end with threaded brass insert, and one solvent-cement-joint end.
1. Available Manufacturers:
 - a. Thompson Plastics, Inc.

- C. Plastic-to-Metal Transition Unions: MSS SP-107, CPVC and PVC four-part union. Include brass end, solvent-cement-joint end, rubber O-ring, and union nut.

- 1. Available Manufacturers:

- a. NIBCO INC.
- b. NIBCO, Inc.; Chemtrol Div.

2.5 DIELECTRIC FITTINGS

- A. Description: Combination fitting of copper alloy and ferrous materials with threaded, solder-joint, plain, or weld-neck end connections that match piping system materials.

- B. Insulating Material: Suitable for system fluid, pressure, and temperature.

- C. Dielectric Unions: Factory-fabricated, union assembly, for 250-psig minimum working pressure at 180 deg F.

- 1. Available Manufacturers:

- a. Capitol Manufacturing Co.
- b. Central Plastics Company.
- c. Eclipse, Inc.
- d. Epco Sales, Inc.
- e. Hart Industries, International, Inc.
- f. Watts Industries, Inc.; Water Products Div.
- g. Zurn Industries, Inc.; Wilkins Div.

- D. Dielectric Flanges: Factory-fabricated, companion-flange assembly, for 150- or 300-psig minimum working pressure as required to suit system pressures.

- 1. Available Manufacturers:

- a. Capitol Manufacturing Co.
- b. Central Plastics Company.
- c. Epco Sales, Inc.
- d. Watts Industries, Inc.; Water Products Div.

- E. Dielectric-Flange Kits: Companion-flange assembly for field assembly. Include flanges, full-face- or ring-type neoprene or phenolic gasket, phenolic or polyethylene bolt sleeves, phenolic washers, and steel backing washers.

- 1. Available Manufacturers:

- a. Advance Products & Systems, Inc.
- b. Calpico, Inc.
- c. Central Plastics Company.

- d. Pipeline Seal and Insulator, Inc.
- 2. Separate companion flanges and steel bolts and nuts shall have 150- or 300-psig minimum working pressure where required to suit system pressures.
- F. Dielectric Couplings: Galvanized-steel coupling with inert and noncorrosive, thermoplastic lining; threaded ends; and 300-psig minimum working pressure at 225 deg F.
 - 1. Available Manufacturers:
 - a. Calpico, Inc.
 - b. Lochinvar Corp.
- G. Dielectric Nipples: Electroplated steel nipple with inert and noncorrosive, thermoplastic lining; plain, threaded, or grooved ends; and 300-psig minimum working pressure at 225 deg F.
 - 1. Available Manufacturers:
 - a. Perfection Corp.
 - b. Precision Plumbing Products, Inc.
 - c. Sioux Chief Manufacturing Co., Inc.
 - d. Victaulic Co. of America.

2.6 MECHANICAL SLEEVE SEALS

- A. Description: Modular sealing element unit, designed for field assembly, to fill annular space between pipe and sleeve.
 - 1. Available Manufacturers:
 - a. Advance Products & Systems, Inc.
 - b. Calpico, Inc.
 - c. Metraflex Co.
 - d. Pipeline Seal and Insulator, Inc.
 - 2. Sealing Elements: EPDM interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe.
 - 3. Pressure Plates: Carbon steel or Stainless steel. Include two for each sealing element.
 - 4. Connecting Bolts and Nuts: Carbon steel with corrosion-resistant coating or Stainless steel of length required to secure pressure plates to sealing elements. Include one for each sealing element.

2.7 SLEEVES

- A. Galvanized-Steel Sheet: 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint.
- B. Steel Pipe: ASTM A 53, Type E, Grade B, Schedule 40, galvanized, plain ends.
- C. Cast Iron: Cast or fabricated "wall pipe" equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- D. Stack Sleeve Fittings: Manufactured, cast-iron sleeve with integral clamping flange. Include clamping ring and bolts and nuts for membrane flashing.
 - 1. Underdeck Clamp: Clamping ring with set screws.
- E. Molded PVC: Permanent, with nailing flange for attaching to wooden forms.
- F. PVC Pipe: ASTM D 1785, Schedule 40.
- G. Molded PE: Reusable, PE, tapered-cup shaped, and smooth-outer surface with nailing flange for attaching to wooden forms.

2.8 ESCUTCHEONS

- A. Description: Manufactured wall and ceiling escutcheons and floor plates, with an ID to closely fit around pipe, tube, and insulation of insulated piping and an OD that completely covers opening.
- B. One-Piece, Deep-Pattern Type: Deep-drawn, box-shaped brass with polished chrome-plated finish.
- C. One-Piece, Cast-Brass Type: With set screw.
 - 1. Finish: Polished chrome-plated and rough brass.
- D. Split-Casting, Cast-Brass Type: With concealed hinge and set screw.
 - 1. Finish: Polished chrome-plated and rough brass.
- E. One-Piece, Stamped-Steel Type: With set screw or spring clips and chrome-plated finish.
- F. Split-Plate, Stamped-Steel Type: With concealed hinge, set screw or spring clips, and chrome-plated finish.
- G. One-Piece, Floor-Plate Type: Cast-iron floor plate.
- H. Split-Casting, Floor-Plate Type: Cast brass with concealed hinge and set screw.

2.9 GROUT

- A. Description: ASTM C 1107, Grade B, nonshrink and nonmetallic, dry hydraulic-cement grout.
 - 1. Characteristics: Post-hardening, volume-adjusting, nonstaining, noncorrosive, nongaseous, and recommended for interior and exterior applications.
 - 2. Design Mix: 5000-psi, 28-day compressive strength.
 - 3. Packaging: Premixed and factory packaged.

PART 3 - EXECUTION

3.1 HVAC DEMOLITION

- A. Refer to Division 01 Section "Cutting and Patching" and Division 02 Section "Selective Demolition" for general demolition requirements and procedures.
- B. Disconnect, demolish, and remove HVAC systems, equipment, and components indicated to be removed.
 - 1. Piping to Be Removed: Remove portion of piping indicated to be removed and cap or plug remaining piping with same or compatible piping material.
 - 2. Piping to Be Abandoned in Place: Drain piping and cap or plug piping with same or compatible piping material.
 - 3. Ducts to Be Removed: Remove portion of ducts indicated to be removed and plug remaining ducts with same or compatible ductwork material.
 - 4. Ducts to Be Abandoned in Place: Cap or plug ducts with same or compatible ductwork material.
 - 5. Equipment to Be Removed: Disconnect and cap services and remove equipment.
 - 6. Equipment to Be Removed and Reinstalled: Disconnect and cap services and remove, clean, and store equipment; when appropriate, reinstall, reconnect, and make equipment operational.
 - 7. Equipment to Be Removed and Salvaged: Disconnect and cap services and remove equipment and deliver to Owner.
- C. If pipe, insulation, or equipment to remain is damaged in appearance or is unserviceable, remove damaged or unserviceable portions and replace with new products of equal capacity and quality.

3.2 PIPING SYSTEMS - COMMON REQUIREMENTS

- A. Install piping according to the following requirements and Division 23 Sections specifying piping systems.

- B. Drawing plans, schematics, and diagrams indicate general location and arrangement of piping systems. Indicated locations and arrangements were used to size pipe and calculate friction loss, expansion, pump sizing, and other design considerations. Install piping as indicated unless deviations to layout are approved on Coordination Drawings.
- C. Install piping in concealed locations, unless otherwise indicated and except in equipment rooms and service areas.
- D. Install piping indicated to be exposed and piping in equipment rooms and service areas at right angles or parallel to building walls. Diagonal runs are prohibited unless specifically indicated otherwise.
- E. Install piping above accessible ceilings to allow sufficient space for ceiling panel removal.
- F. Install piping to permit valve servicing.
- G. Install piping at indicated slopes.
- H. Install piping free of sags and bends.
- I. Install fittings for changes in direction and branch connections.
- J. Install piping to allow application of insulation.
- K. Select system components with pressure rating equal to or greater than system operating pressure.
- L. Install escutcheons for penetrations of walls, ceilings, and floors according to the following:
 - 1. New Piping:
 - a. Piping with Fitting or Sleeve Protruding from Wall: One-piece, deep-pattern type.
 - b. Chrome-Plated Piping: One-piece, cast-brass type with polished chrome-plated finish.
 - c. Insulated Piping: One-piece, stamped-steel type with spring clips.
 - d. Bare Piping at Wall and Floor Penetrations in Finished Spaces: One-piece, cast-brass type with polished chrome-plated finish.
 - e. Bare Piping at Ceiling Penetrations in Finished Spaces: One-piece or split-casting, cast-brass type with polished chrome-plated finish.
 - f. Bare Piping in Unfinished Service Spaces: One-piece, cast-brass type with polished chrome-plated or rough-brass finish.
 - g. Bare Piping in Equipment Rooms: One-piece, cast-brass type.
 - h. Bare Piping at Floor Penetrations in Equipment Rooms: One-piece, floor-plate type.

- M. Permanent sleeves are not required for holes formed by removable PE sleeves.
- N. Install sleeves for pipes passing through concrete and masonry walls, gypsum-board partitions, and concrete floor and roof slabs.
 - 1. Cut sleeves to length for mounting flush with both surfaces.
 - a. Exception: Extend sleeves installed in floors of mechanical equipment areas or other wet areas 2 inches above finished floor level. Extend cast-iron sleeve fittings below floor slab as required to secure clamping ring if ring is specified.
 - 2. Install sleeves in new walls and slabs as new walls and slabs are constructed.
 - a. Steel Pipe Sleeves: For pipes smaller than NPS 6.
 - b. Steel Sheet Sleeves: For pipes NPS 6 and larger, penetrating gypsum-board partitions.
 - c. Stack Sleeve Fittings: For pipes penetrating floors with membrane waterproofing. Secure flashing between clamping flanges. Install section of cast-iron soil pipe to extend sleeve to 2 inches above finished floor level.
 - 3. Except for underground wall penetrations, seal annular space between sleeve and pipe or pipe insulation, using joint sealants appropriate for size, depth, and location of joint. Refer to Division 07 Section "Joint Sealants" for materials and installation.
- O. Aboveground, Exterior-Wall Pipe Penetrations: Seal penetrations using sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
 - 1. Install steel pipe for sleeves smaller than 6 inches in diameter.
 - 2. Install cast-iron "wall pipes" for sleeves 6 inches and larger in diameter.
 - 3. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.
- P. Underground, Exterior-Wall Pipe Penetrations: Install cast-iron "wall pipes" for sleeves. Seal pipe penetrations using mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
 - 1. Mechanical Sleeve Seal Installation: Select type and number of sealing elements required for pipe material and size. Position pipe in center of sleeve. Assemble mechanical sleeve seals and install in annular space between pipe and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

- Q. Fire-Barrier Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at pipe penetrations. Seal pipe penetrations with firestop materials. Refer to Division 07 Section "Penetration Firestopping" for materials.
- R. Verify final equipment locations for roughing-in.
- S. Refer to equipment specifications in other Sections of these Specifications for roughing-in requirements.

3.3 PIPING JOINT CONSTRUCTION

- A. Join pipe and fittings according to the following requirements and Division 23 Sections specifying piping systems.
- B. Ream ends of pipes and tubes and remove burrs. Bevel plain ends of steel pipe.
- C. Remove scale, slag, dirt, and debris from inside and outside of pipe and fittings before assembly.
- D. Soldered Joints: Apply ASTM B 813, water-flushable flux, unless otherwise indicated, to tube end. Construct joints according to ASTM B 828 or CDA's "Copper Tube Handbook," using lead-free solder alloy complying with ASTM B 32.
- E. Brazed Joints: Construct joints according to AWS's "Brazing Handbook," "Pipe and Tube" Chapter, using copper-phosphorus brazing filler metal complying with AWS A5.8.
- F. Threaded Joints: Thread pipe with tapered pipe threads according to ASME B1.20.1. Cut threads full and clean using sharp dies. Ream threaded pipe ends to remove burrs and restore full ID. Join pipe fittings and valves as follows:
 - 1. Apply appropriate tape or thread compound to external pipe threads unless dry seal threading is specified.
 - 2. Damaged Threads: Do not use pipe or pipe fittings with threads that are corroded or damaged. Do not use pipe sections that have cracked or open welds.
- G. Welded Joints: Construct joints according to AWS D10.12, using qualified processes and welding operators according to Part 1 "Quality Assurance" Article.
- H. Flanged Joints: Select appropriate gasket material, size, type, and thickness for service application. Install gasket concentrically positioned. Use suitable lubricants on bolt threads.
- I. Plastic Piping Solvent-Cement Joints: Clean and dry joining surfaces. Join pipe and fittings according to the following:

1. Comply with ASTM F 402 for safe-handling practice of cleaners, primers, and solvent cements.
 2. CPVC Piping: Join according to ASTM D 2846/D 2846M Appendix.
 3. PVC Pressure Piping: Join schedule number ASTM D 1785, PVC pipe and PVC socket fittings according to ASTM D 2672. Join other-than-schedule-number PVC pipe and socket fittings according to ASTM D 2855.
 4. PVC Nonpressure Piping: Join according to ASTM D 2855.
- J. Plastic Pressure Piping Gasketed Joints: Join according to ASTM D 3139.
- K. Plastic Nonpressure Piping Gasketed Joints: Join according to ASTM D 3212.
- L. PE Piping Heat-Fusion Joints: Clean and dry joining surfaces by wiping with clean cloth or paper towels. Join according to ASTM D 2657.
1. Plain-End Pipe and Fittings: Use butt fusion.
 2. Plain-End Pipe and Socket Fittings: Use socket fusion.
- M. Fiberglass Bonded Joints: Prepare pipe ends and fittings, apply adhesive, and join according to pipe manufacturer's written instructions.

3.4 PIPING CONNECTIONS

- A. Make connections according to the following, unless otherwise indicated:
1. Install unions, in piping NPS 2 and smaller, adjacent to each valve and at final connection to each piece of equipment.
 2. Install flanges, in piping NPS 2-1/2 and larger, adjacent to flanged valves and at final connection to each piece of equipment.
 3. Dry Piping Systems: Install dielectric unions and flanges to connect piping materials of dissimilar metals.
 4. Wet Piping Systems: Install dielectric coupling and nipple fittings to connect piping materials of dissimilar metals.

3.5 EQUIPMENT INSTALLATION - COMMON REQUIREMENTS

- A. Install equipment to allow maximum possible headroom unless specific mounting heights are not indicated.
- B. Install equipment level and plumb, parallel and perpendicular to other building systems and components in exposed interior spaces, unless otherwise indicated.
- C. Install HVAC equipment to facilitate service, maintenance, and repair or replacement of components. Connect equipment for ease of disconnecting, with minimum interference to other installations. Extend grease fittings to accessible locations.

- D. Install equipment to allow right of way for piping installed at required slope.

3.6 PAINTING

- A. Painting of HVAC systems, equipment, and components is specified in Division 09 Sections "Interior Painting".
- B. Damage and Touchup: Repair marred and damaged factory-painted finishes with materials and procedures to match original factory finish.

3.7 CONCRETE BASES

- A. Concrete Bases: Anchor equipment to concrete base according to equipment manufacturer's written instructions and according to seismic codes at Project.
 - 1. Construct concrete bases of dimensions indicated, but not less than 4 inches larger in both directions than supported unit.
 - 2. Install dowel rods to connect concrete base to concrete floor. Unless otherwise indicated, install dowel rods on 18-inch centers around the full perimeter of the base.
 - 3. Install epoxy-coated anchor bolts for supported equipment that extend through concrete base, and anchor into structural concrete floor.
 - 4. Place and secure anchorage devices. Use supported equipment manufacturer's setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
 - 5. Install anchor bolts to elevations required for proper attachment to supported equipment.
 - 6. Install anchor bolts according to anchor-bolt manufacturer's written instructions.
 - 7. Use 3000-psi, 28-day compressive-strength concrete and reinforcement as specified in Division 03 Section "Cast-in-Place Concrete."

3.8 ERECTION OF METAL SUPPORTS AND ANCHORAGES

- A. Refer to Division 05 Section "Metal Fabrications" for structural steel.
- B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor HVAC materials and equipment.
- C. Field Welding: Comply with AWS D1.1.

3.9 ERECTION OF WOOD SUPPORTS AND ANCHORAGES

- A. Cut, fit, and place wood grounds, nailers, blocking, and anchorages to support, and anchor HVAC materials and equipment.

- B. Select fastener sizes that will not penetrate members if opposite side will be exposed to view or will receive finish materials. Tighten connections between members. Install fasteners without splitting wood members.
- C. Attach to substrates as required to support applied loads.

3.10 GROUTING

- A. Mix and install grout for HVAC equipment base bearing surfaces, pump and other equipment base plates, and anchors.
- B. Clean surfaces that will come into contact with grout.
- C. Provide forms as required for placement of grout.
- D. Avoid air entrapment during placement of grout.
- E. Place grout, completely filling equipment bases.
- F. Place grout on concrete bases and provide smooth bearing surface for equipment.
- G. Place grout around anchors.
- H. Cure placed grout.

END OF SECTION 230500

SECTION 230529

HANGERS AND SUPPORTS FOR HVAC PIPING AND EQUIPMENT

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Metal pipe hangers and supports.
2. Trapeze pipe hangers.
3. Thermal-hanger shield inserts.
4. Fastener systems.
5. Equipment supports.

1.2 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Design trapeze pipe hangers and equipment supports, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.
- B. Structural Performance: Hangers and supports for HVAC piping and equipment shall withstand the effects of gravity loads and stresses within limits and under conditions indicated according to ASCE/SEI 7.
 1. Design supports for multiple pipes capable of supporting combined weight of supported systems, system contents, and test water.
 2. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: Show fabrication and installation details and include calculations for the following; include Product Data for components:
 1. Trapeze pipe hangers.
 2. Equipment supports.
- C. Delegated-Design Submittal: For trapeze hangers indicated to comply with performance requirements and design criteria, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation.

1.4 INFORMATIONAL SUBMITTALS

- A. Welding certificates.

1.5 QUALITY ASSURANCE

- A. Structural Steel Welding Qualifications: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Pipe Welding Qualifications: Qualify procedures and operators according to ASME Boiler and Pressure Vessel Code.

PART 2 - PRODUCTS

2.1 METAL PIPE HANGERS AND SUPPORTS

- A. Carbon-Steel Pipe Hangers and Supports:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Galvanized Metallic Coatings: Pregalvanized or hot dipped.
3. Nonmetallic Coatings: Plastic coating, jacket, or liner.
4. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
5. Hanger Rods: Continuous-thread rod, nuts, and washer made of carbon steel.

- B. Stainless-Steel Pipe Hangers and Supports:

1. Description: MSS SP-58, Types 1 through 58, factory-fabricated components.
2. Padded Hangers: Hanger with fiberglass or other pipe insulation pad or cushion to support bearing surface of piping.
3. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.

- C. Copper Pipe Hangers:

1. Description: MSS SP-58, Types 1 through 58, copper-coated-steel, factory-fabricated components.
2. Hanger Rods: Continuous-thread rod, nuts, and washer made of stainless steel.

2.2 TRAPEZE PIPE HANGERS

- A. Description: MSS SP-69, Type 59, shop- or field-fabricated pipe-support assembly made from structural carbon-steel shapes with MSS SP-58 carbon-steel hanger rods, nuts, saddles, and U-bolts.

2.3 THERMAL-HANGER SHIELD INSERTS

- A. Insulation-Insert Material for Cold Piping: ASTM C 552, Type II cellular glass with 100-psig or ASTM C 591, Type VI, Grade 1 polyisocyanurate with 125-psig minimum compressive strength and vapor barrier.
- B. Insulation-Insert Material for Hot Piping: Water-repellent treated, ASTM C 533, Type I calcium silicate with 100-psig, ASTM C 552, Type II cellular glass with 100-psig or ASTM C 591, Type VI, Grade 1 polyisocyanurate with 125-psig minimum compressive strength.
- C. For Trapeze or Clamped Systems: Insert and shield shall cover entire circumference of pipe.
- D. For Clevis or Band Hangers: Insert and shield shall cover lower 180 degrees of pipe.
- E. Insert Length: Extend 2 inches beyond sheet metal shield for piping operating below ambient air temperature.

2.4 FASTENER SYSTEMS

- A. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.
- B. Mechanical-Expansion Anchors: Insert-wedge-type, stainless-steel anchors, for use in hardened portland cement concrete; with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

2.5 EQUIPMENT SUPPORTS

- A. Description: Welded, shop- or field-fabricated equipment support made from structural carbon-steel shapes.

2.6 MISCELLANEOUS MATERIALS

- A. Structural Steel: ASTM A 36/A 36M, carbon-steel plates, shapes, and bars; black and galvanized.
- B. Grout: ASTM C 1107, factory-mixed and -packaged, dry, hydraulic-cement, nonshrink and nonmetallic grout; suitable for interior and exterior applications.
 - 1. Properties: Nonstaining, noncorrosive, and nongaseous.
 - 2. Design Mix: 5000-psi, 28-day compressive strength.

PART 3 - EXECUTION

3.1 HANGER AND SUPPORT INSTALLATION

- A. Metal Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Install hangers, supports, clamps, and attachments as required to properly support piping from the building structure.
- B. Metal Trapeze Pipe-Hanger Installation: Comply with MSS SP-69 and MSS SP-89. Arrange for grouping of parallel runs of horizontal piping, and support together on field-fabricated trapeze pipe hangers.
 - 1. Pipes of Various Sizes: Support together and space trapezes for smallest pipe size or install intermediate supports for smaller diameter pipes as specified for individual pipe hangers.
 - 2. Field fabricate from ASTM A 36/A 36M, carbon-steel shapes selected for loads being supported. Weld steel according to AWS D1.1/D1.1M.
- C. Thermal-Hanger Shield Installation: Install in pipe hanger or shield for insulated piping.
- D. Fastener System Installation:
 - 1. Install powder-actuated fasteners for use in lightweight concrete or concrete slabs less than 4 inches thick in concrete after concrete is placed and completely cured. Use operators that are licensed by powder-actuated tool manufacturer. Install fasteners according to powder-actuated tool manufacturer's operating manual.
 - 2. Install mechanical-expansion anchors in concrete after concrete is placed and completely cured. Install fasteners according to manufacturer's written instructions.
- E. Install hangers and supports complete with necessary attachments, inserts, bolts, rods, nuts, washers, and other accessories.
- F. Equipment Support Installation: Fabricate from welded-structural-steel shapes.
- G. Install hangers and supports to allow controlled thermal and seismic movement of piping systems, to permit freedom of movement between pipe anchors, and to facilitate action of expansion joints, expansion loops, expansion bends, and similar units.
- H. Install lateral bracing with pipe hangers and supports to prevent swaying.
- I. Install building attachments within concrete slabs or attach to structural steel. Install additional attachments at concentrated loads, including valves, flanges, and strainers, NPS 2-1/2 and larger and at changes in direction of piping. Install concrete

inserts before concrete is placed; fasten inserts to forms and install reinforcing bars through openings at top of inserts.

- J. Load Distribution: Install hangers and supports so that piping live and dead loads and stresses from movement will not be transmitted to connected equipment.
- K. Pipe Slopes: Install hangers and supports to provide indicated pipe slopes and to not exceed maximum pipe deflections allowed by ASME B31.9 for building services piping.
- L. Insulated Piping:
 - 1. Attach clamps and spacers to piping.
 - a. Piping Operating above Ambient Air Temperature: Clamp may project through insulation.
 - b. Piping Operating below Ambient Air Temperature: Use thermal-hanger shield insert with clamp sized to match OD of insert.
 - c. Do not exceed pipe stress limits allowed by ASME B31.9 for building services piping.
 - 2. Install MSS SP-58, Type 39, protection saddles if insulation without vapor barrier is indicated. Fill interior voids with insulation that matches adjoining insulation.
 - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
 - 3. Install MSS SP-58, Type 40, protective shields on cold piping with vapor barrier. Shields shall span an arc of 180 degrees.
 - a. Option: Thermal-hanger shield inserts may be used. Include steel weight-distribution plate for pipe NPS 4 and larger if pipe is installed on rollers.
 - 4. Shield Dimensions for Pipe: Not less than the following:
 - a. NPS 1/4 to NPS 3-1/2: 12 inches long and 0.048 inch thick.
 - b. NPS 4: 12 inches long and 0.06 inch thick.
 - c. NPS 5 and NPS 6: 18 inches long and 0.06 inch thick.
 - d. NPS 8 to NPS 14: 24 inches long and 0.075 inch thick.
 - e. NPS 16 to NPS 24: 24 inches long and 0.105 inch thick.
 - 5. Pipes NPS 8 and Larger: Include wood or reinforced calcium-silicate-insulation inserts of length at least as long as protective shield.
 - 6. Thermal-Hanger Shields: Install with insulation same thickness as piping insulation.

3.2 EQUIPMENT SUPPORTS

- A. Fabricate structural-steel stands to suspend equipment from structure overhead or to support equipment above floor.
- B. Grouting: Place grout under supports for equipment and make bearing surface smooth.
- C. Provide lateral bracing, to prevent swaying, for equipment supports.

3.3 METAL FABRICATIONS

- A. Cut, drill, and fit miscellaneous metal fabrications for trapeze pipe hangers and equipment supports.
- B. Fit exposed connections together to form hairline joints. Field weld connections that cannot be shop welded because of shipping size limitations.
- C. Field Welding: Comply with AWS D1.1/D1.1M procedures for shielded, metal arc welding; appearance and quality of welds; and methods used in correcting welding work; and with the following:
 - 1. Use materials and methods that minimize distortion and develop strength and corrosion resistance of base metals.
 - 2. Obtain fusion without undercut or overlap.
 - 3. Remove welding flux immediately.
 - 4. Finish welds at exposed connections so no roughness shows after finishing and so contours of welded surfaces match adjacent contours.

3.4 ADJUSTING

- A. Hanger Adjustments: Adjust hangers to distribute loads equally on attachments and to achieve indicated slope of pipe.
- B. Trim excess length of continuous-thread hanger and support rods to 1-1/2 inches.

3.5 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
 - 1. Apply paint by brush or spray to provide a minimum dry film thickness of 2.0 mils.

- B. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

3.6 HANGER AND SUPPORT SCHEDULE

- A. Specific hanger and support requirements are in Sections specifying piping systems and equipment.
- B. Comply with MSS SP-69 for pipe-hanger selections and applications that are not specified in piping system Sections.
- C. Use hangers and supports with galvanized metallic coatings for piping and equipment that will not have field-applied finish.
- D. Use nonmetallic coatings on attachments for electrolytic protection where attachments are in direct contact with copper tubing.
- E. Use carbon-steel pipe hangers and supports metal trapeze pipe hangers and attachments for general service applications.
- F. Use stainless-steel pipe hangers and stainless-steel attachments for hostile environment applications.
- G. Use copper-plated pipe hangers and copper or stainless-steel attachments for copper piping and tubing.
- H. Use padded hangers for piping that is subject to scratching.
- I. Use thermal-hanger shield inserts for insulated piping and tubing.
- J. Horizontal-Piping Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
 - 1. Adjustable, Steel Clevis Hangers (MSS Type 1): For suspension of noninsulated or insulated, stationary pipes NPS 1/2 to NPS 30.
 - 2. Yoke-Type Pipe Clamps (MSS Type 2): For suspension of up to 1050 deg F, pipes NPS 4 to NPS 24, requiring up to 4 inches of insulation.
 - 3. Carbon- or Alloy-Steel, Double-Bolt Pipe Clamps (MSS Type 3): For suspension of pipes NPS 3/4 to NPS 36, requiring clamp flexibility and up to 4 inches of insulation.
 - 4. Adjustable, Steel Band Hangers (MSS Type 7): For suspension of noninsulated, stationary pipes NPS 1/2 to NPS 8.
 - 5. U-Bolts (MSS Type 24): For support of heavy pipes NPS 1/2 to NPS 30.
 - 6. Pipe Saddle Supports (MSS Type 36): For support of pipes NPS 4 to NPS 36, with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate.

7. Pipe Stanchion Saddles (MSS Type 37): For support of pipes NPS 4 to NPS 36, with steel-pipe base stanchion support and cast-iron floor flange or carbon-steel plate, and with U-bolt to retain pipe.
 8. Single-Pipe Rolls (MSS Type 41): For suspension of pipes NPS 1 to NPS 30, from two rods if longitudinal movement caused by expansion and contraction might occur.
 9. Complete Pipe Rolls (MSS Type 44): For support of pipes NPS 2 to NPS 42 if longitudinal movement caused by expansion and contraction might occur but vertical adjustment is not necessary.
- K. Vertical-Piping Clamps: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Extension Pipe or Riser Clamps (MSS Type 8): For support of pipe risers NPS 3/4 to NPS 24.
 2. Carbon- or Alloy-Steel Riser Clamps (MSS Type 42): For support of pipe risers NPS 3/4 to NPS 24 if longer ends are required for riser clamps.
- L. Hanger-Rod Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel Turnbuckles (MSS Type 13): For adjustment up to 6 inches for heavy loads.
 2. Steel Clevises (MSS Type 14): For 120 to 450 deg F piping installations.
- M. Building Attachments: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
1. Steel or Malleable Concrete Inserts (MSS Type 18): For upper attachment to suspend pipe hangers from concrete ceiling.
 2. Top-Beam C-Clamps (MSS Type 19): For use under roof installations with bar-joint construction, to attach to top flange of structural shape.
 3. Side-Beam or Channel Clamps (MSS Type 20): For attaching to bottom flange of beams, channels, or angles.
 4. Center-Beam Clamps (MSS Type 21): For attaching to center of bottom flange of beams.
 5. Welded Beam Attachments (MSS Type 22): For attaching to bottom of beams if loads are considerable and rod sizes are large.
 6. C-Clamps (MSS Type 23): For structural shapes.
 7. Welded-Steel Brackets: For support of pipes from below, or for suspending from above by using clip and rod. Use one of the following for indicated loads:
 - a. Light (MSS Type 31): 750 lb.
 - b. Medium (MSS Type 32): 1500 lb.
 - c. Heavy (MSS Type 33): 3000 lb.
 8. Side-Beam Brackets (MSS Type 34): For sides of steel or wooden beams.
 9. Plate Lugs (MSS Type 57): For attaching to steel beams if flexibility at beam is required.

- N. Saddles and Shields: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
 - 1. Steel-Pipe-Covering Protection Saddles (MSS Type 39): To fill interior voids with insulation that matches adjoining insulation.
 - 2. Protection Shields (MSS Type 40): Of length recommended in writing by manufacturer to prevent crushing insulation.
 - 3. Thermal-Hanger Shield Inserts: For supporting insulated pipe.

- O. Spring Hangers and Supports: Unless otherwise indicated and except as specified in piping system Sections, install the following types:
 - 1. Spring Cushions (MSS Type 48): For light loads if vertical movement does not exceed 1-1/4 inches.
 - 2. Spring-Cushion Roll Hangers (MSS Type 49): For equipping Type 41, roll hanger with springs.
 - 3. Variable-Spring Base Supports (MSS Type 52): Preset to indicated load and limit variability factor to 25 percent to allow expansion and contraction of piping system from base support.

- P. Comply with MSS SP-69 for trapeze pipe-hanger selections and applications that are not specified in piping system Sections.

- Q. Use powder-actuated fasteners or mechanical-expansion anchors instead of building attachments where required in concrete construction.

END OF SECTION 230529

SECTION 230593

TESTING, ADJUSTING, AND BALANCING FOR HVAC

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Blower Door Test
2. Balancing Air Systems:
 - a. Constant-volume air systems.
 - b. Variable-air-volume systems.
3. Balancing Hydronic Piping Systems:
 - a. Constant-flow hydronic systems.
 - b. Variable-flow hydronic systems.

1.2 DEFINITIONS

- A. AABC: Associated Air Balance Council.
- B. NEBB: National Environmental Balancing Bureau.
- C. TAB: Testing, adjusting, and balancing.
- D. TABB: Testing, Adjusting, and Balancing Bureau.
- E. TAB Specialist: An entity engaged to perform TAB Work.

1.3 ACTION SUBMITTALS

A. Submittals:

1. Air-Balance Report: Documentation of work performed for ASHRAE 62.1, Section 7.2.2 - "Air Balancing."
2. TAB: Documentation of work performed for ASHRAE/IESNA 90.1, Section 6.7.2.3 - "System Balancing."

1.4 INFORMATIONAL SUBMITTALS

- A. Strategies and Procedures Plan: Within 30 days of Contractor's Notice to Proceed, submit TAB strategies and step-by-step procedures as specified in "Preparation" Article.
- B. Certified TAB reports.

1.5 QUALITY ASSURANCE

- A. TAB Contractor Qualifications: Engage a TAB entity certified by AABC, NEBB or TABB.
 - 1. TAB Field Supervisor: Employee of the TAB contractor and certified by AABC, NEBB or TABB.
 - 2. TAB Technician: Employee of the TAB contractor and who is certified by AABC, NEBB or TABB as a TAB technician.
- B. Certify TAB field data reports and perform the following:
 - 1. Review field data reports to validate accuracy of data and to prepare certified TAB reports.
 - 2. Certify that the TAB team complied with the approved TAB plan and the procedures specified and referenced in this Specification.
- C. TAB Report Forms: Use standard TAB contractor's forms approved by Architect.
- D. Instrumentation Type, Quantity, Accuracy, and Calibration: As described in ASHRAE 11.

PART 2 - PRODUCTS (Not Applicable)

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine the Contract Documents to become familiar with Project requirements and to discover conditions in systems' designs that may preclude proper TAB of systems and equipment.
- B. Examine systems for installed balancing devices, such as test ports, gage cocks, thermometer wells, flow-control devices, balancing valves and fittings, and manual volume dampers. Verify that locations of these balancing devices are accessible.
- C. Examine the approved submittals for HVAC systems and equipment.

- D. Examine design data including HVAC system descriptions, statements of design assumptions for environmental conditions and systems' output, and statements of philosophies and assumptions about HVAC system and equipment controls.
- E. Examine ceiling plenums and underfloor air plenums used for supply, return, or relief air to verify that they meet the leakage class of connected ducts and are properly separated from adjacent areas. Verify that penetrations in plenum walls are sealed and fire-stopped if required.
- F. Examine equipment performance data including fan and pump curves.
 - 1. Relate performance data to Project conditions and requirements, including system effects that can create undesired or unpredicted conditions that cause reduced capacities in all or part of a system.
 - 2. Calculate system-effect factors to reduce performance ratings of HVAC equipment when installed under conditions different from the conditions used to rate equipment performance. To calculate system effects for air systems, use tables and charts found in AMCA 201, "Fans and Systems," or in SMACNA's "HVAC Systems - Duct Design." Compare results with the design data and installed conditions.
- G. Examine system and equipment installations and verify that field quality-control testing, cleaning, and adjusting specified in individual Sections have been performed.
- H. Examine test reports specified in individual system and equipment Sections.
- I. Examine HVAC equipment and filters and verify that bearings are greased, belts are aligned and tight, and equipment with functioning controls is ready for operation.
- J. Examine terminal units, such as variable-air-volume boxes, and verify that they are accessible and their controls are connected and functioning.
- K. Examine strainers. Verify that startup screens are replaced by permanent screens with indicated perforations.
- L. Examine three-way valves for proper installation for their intended function of diverting or mixing fluid flows.
- M. Examine heat-transfer coils for correct piping connections and for clean and straight fins.
- N. Examine system pumps to ensure absence of entrained air in the suction piping.
- O. Examine operating safety interlocks and controls on HVAC equipment.
- P. Report deficiencies discovered before and during performance of TAB procedures. Observe and record system reactions to changes in conditions. Record default set points if different from indicated values.

3.2 PREPARATION

- A. Prepare a TAB plan that includes strategies and step-by-step procedures.
- B. Complete system-readiness checks and prepare reports. Verify the following:
 - 1. Permanent electrical-power wiring is complete.
 - 2. Hydronic systems are filled, clean, and free of air.
 - 3. Automatic temperature-control systems are operational.
 - 4. Equipment and duct access doors are securely closed.
 - 5. Balance, smoke, and fire dampers are open.
 - 6. Isolating and balancing valves are open and control valves are operational.
 - 7. Ceilings are installed in critical areas where air-pattern adjustments are required and access to balancing devices is provided.
 - 8. Windows and doors can be closed so indicated conditions for system operations can be met.

3.3 GENERAL PROCEDURES FOR TESTING AND BALANCING

- A. Perform testing and balancing procedures on each system according to the procedures contained in SMACNA's "HVAC Systems - Testing, Adjusting, and Balancing" and in this Section.
 - 1. Comply with requirements in ASHRAE 62.1, Section 7.2.2 - "Air Balancing."
- B. Cut insulation, ducts, pipes, and equipment cabinets for installation of test probes to the minimum extent necessary for TAB procedures.
 - 1. After testing and balancing, patch probe holes in ducts with same material and thickness as used to construct ducts.
 - 2. Install and join new insulation that matches removed materials. Restore insulation, coverings, vapor barrier, and finish.
- C. Mark equipment and balancing devices, including damper-control positions, valve position indicators, fan-speed-control levers, and similar controls and devices, with paint or other suitable, permanent identification material to show final settings.
- D. Take and report testing and balancing measurements in inch-pound (IP) units.

3.4 GENERAL PROCEDURES FOR BALANCING AIR SYSTEMS

- A. Prepare test reports for both fans and outlets. Obtain manufacturer's outlet factors and recommended testing procedures. Crosscheck the summation of required outlet volumes with required fan volumes.
- B. Prepare schematic diagrams of systems' "as-built" duct layouts.

- C. For variable-air-volume systems, develop a plan to simulate diversity.
- D. Determine the best locations in main and branch ducts for accurate duct-airflow measurements.
- E. Check airflow patterns from the outdoor-air louvers and dampers and the return- and exhaust-air dampers through the supply-fan discharge and mixing dampers.
- F. Locate start-stop and disconnect switches, electrical interlocks, and motor starters.
- G. Verify that motor starters are equipped with properly sized thermal protection.
- H. Check dampers for proper position to achieve desired airflow path.
- I. Check for airflow blockages.
- J. Check condensate drains for proper connections and functioning.
- K. Check for proper sealing of air-handling-unit components.
- L. Verify that air duct system is sealed as specified in Section 23311 "Metal Ducts."

3.5 PROCEDURES FOR CONSTANT-VOLUME AIR SYSTEMS

- A. Adjust fans to deliver total indicated airflows within the maximum allowable fan speed listed by fan manufacturer.
 - 1. Measure total airflow.
 - a. Where sufficient space in ducts is unavailable for Pitot-tube traverse measurements, measure airflow at terminal outlets and inlets and calculate the total airflow.
 - 2. Measure fan static pressures as follows to determine actual static pressure:
 - a. Measure outlet static pressure as far downstream from the fan as practical and upstream from restrictions in ducts such as elbows and transitions.
 - b. Measure static pressure directly at the fan outlet or through the flexible connection.
 - c. Measure inlet static pressure of single-inlet fans in the inlet duct as near the fan as possible, upstream from the flexible connection, and downstream from duct restrictions.
 - d. Measure inlet static pressure of double-inlet fans through the wall of the plenum that houses the fan.
 - 3. Measure static pressure across each component that makes up an air-handling unit, rooftop unit, and other air-handling and -treating equipment.

- a. Report the cleanliness status of filters and the time static pressures are measured.
 4. Measure static pressures entering and leaving other devices, such as sound traps, heat-recovery equipment, and air washers, under final balanced conditions.
 5. Review Record Documents to determine variations in design static pressures versus actual static pressures. Calculate actual system-effect factors. Recommend adjustments to accommodate actual conditions.
 6. Obtain approval from Architect for adjustment of fan speed higher or lower than indicated speed. Comply with requirements in Sections for air-handling units for adjustment of fans, belts, and pulley sizes to achieve indicated air-handling-unit performance.
 7. Do not make fan-speed adjustments that result in motor overload. Consult equipment manufacturers about fan-speed safety factors. Modulate dampers and measure fan-motor amperage to ensure that no overload will occur. Measure amperage in full-cooling, full-heating, economizer, and any other operating mode to determine the maximum required brake horsepower.
- B. Adjust volume dampers for main duct, submain ducts, and major branch ducts to indicated airflows within specified tolerances.
1. Measure airflow of submain and branch ducts.
 - a. Where sufficient space in submain and branch ducts is unavailable for Pitot-tube traverse measurements, measure airflow at terminal outlets and inlets and calculate the total airflow for that zone.
 2. Measure static pressure at a point downstream from the balancing damper, and adjust volume dampers until the proper static pressure is achieved.
 3. Remeasure each submain and branch duct after all have been adjusted. Continue to adjust submain and branch ducts to indicated airflows within specified tolerances.
- C. Measure air outlets and inlets without making adjustments.
1. Measure terminal outlets using a direct-reading hood or outlet manufacturer's written instructions and calculating factors.
- D. Adjust air outlets and inlets for each space to indicated airflows within specified tolerances of indicated values. Make adjustments using branch volume dampers rather than extractors and the dampers at air terminals.
1. Adjust each outlet in same room or space to within specified tolerances of indicated quantities without generating noise levels above the limitations prescribed by the Contract Documents.
 2. Adjust patterns of adjustable outlets for proper distribution without drafts.

3.6 PROCEDURES FOR VARIABLE-AIR-VOLUME SYSTEMS

- A. Compensating for Diversity: When the total airflow of all terminal units is more than the indicated airflow of the fan, place a selected number of terminal units at minimum set-point airflow with the remainder at maximum airflow condition until the total airflow of the terminal units equals the indicated airflow of the fan. Select the reduced-airflow terminal units so they are distributed evenly among the branch ducts.
- B. Pressure-Independent, Variable-Air-Volume Systems: After the fan systems have been adjusted, adjust the variable-air-volume systems as follows:
1. Set outdoor-air dampers at minimum, and set return- and exhaust-air dampers at a position that simulates full-cooling load.
 2. Select the terminal unit that is most critical to the supply-fan airflow and static pressure. Measure static pressure. Adjust system static pressure so the entering static pressure for the critical terminal unit is not less than the sum of the terminal-unit manufacturer's recommended minimum inlet static pressure plus the static pressure needed to overcome terminal-unit discharge system losses.
 3. Measure total system airflow. Adjust to within indicated airflow.
 4. Set terminal units at maximum airflow and adjust controller or regulator to deliver the designed maximum airflow. Use terminal-unit manufacturer's written instructions to make this adjustment. When total airflow is correct, balance the air outlets downstream from terminal units the same as described for constant-volume air systems.
 5. Set terminal units at minimum airflow and adjust controller or regulator to deliver the designed minimum airflow. Check air outlets for a proportional reduction in airflow the same as described for constant-volume air systems.
 - a. If air outlets are out of balance at minimum airflow, report the condition but leave outlets balanced for maximum airflow.
 6. Re-measure the return airflow to the fan while operating at maximum return airflow and minimum outdoor airflow.
 - a. Adjust the fan and balance the return-air ducts and inlets the same as described for constant-volume air systems.
 7. Measure static pressure at the most critical terminal unit and adjust the static-pressure controller at the main supply-air sensing station to ensure that adequate static pressure is maintained at the most critical unit.
 8. Record final fan-performance data.
- C. Pressure-Dependent, Variable-Air-Volume Systems without Diversity: After the fan systems have been adjusted, adjust the variable-air-volume systems as follows:
1. Balance variable-air-volume systems the same as described for constant-volume air systems.
 2. Set terminal units and supply fan at full-airflow condition.

3. Adjust inlet dampers of each terminal unit to indicated airflow and verify operation of the static-pressure controller. When total airflow is correct, balance the air outlets downstream from terminal units the same as described for constant-volume air systems.
 4. Readjust fan airflow for final maximum readings.
 5. Measure operating static pressure at the sensor that controls the supply fan if one is installed, and verify operation of the static-pressure controller.
 6. Set supply fan at minimum airflow if minimum airflow is indicated. Measure static pressure to verify that it is being maintained by the controller.
 7. Set terminal units at minimum airflow and adjust controller or regulator to deliver the designed minimum airflow. Check air outlets for a proportional reduction in airflow the same as described for constant-volume air systems.
 - a. If air outlets are out of balance at minimum airflow, report the condition but leave the outlets balanced for maximum airflow.
 8. Measure the return airflow to the fan while operating at maximum return airflow and minimum outdoor airflow.
 - a. Adjust the fan and balance the return-air ducts and inlets the same as described for constant-volume air systems.
- D. Pressure-Dependent, Variable-Air-Volume Systems with Diversity: After the fan systems have been adjusted, adjust the variable-air-volume systems as follows:
1. Set system at maximum indicated airflow by setting the required number of terminal units at minimum airflow. Select the reduced-airflow terminal units so they are distributed evenly among the branch ducts.
 2. Adjust supply fan to maximum indicated airflow with the variable-airflow controller set at maximum airflow.
 3. Set terminal units at full-airflow condition.
 4. Adjust terminal units starting at the supply-fan end of the system and continuing progressively to the end of the system. Adjust inlet dampers of each terminal unit to indicated airflow. When total airflow is correct, balance the air outlets downstream from terminal units the same as described for constant-volume air systems.
 5. Adjust terminal units for minimum airflow.
 6. Measure static pressure at the sensor.
 7. Measure the return airflow to the fan while operating at maximum return airflow and minimum outdoor airflow. Adjust the fan and balance the return-air ducts and inlets the same as described for constant-volume air systems.

3.7 GENERAL PROCEDURES FOR HYDRONIC SYSTEMS

- A. Prepare test reports with pertinent design data, and number in sequence starting at pump to end of system. Check the sum of branch-circuit flows against the approved pump flow rate. Correct variations that exceed plus or minus 5 percent.

- B. Prepare schematic diagrams of systems' "as-built" piping layouts.
- C. Prepare hydronic systems for testing and balancing according to the following, in addition to the general preparation procedures specified above:
 - 1. Open all manual valves for maximum flow.
 - 2. Check liquid level in expansion tank.
 - 3. Check makeup water-station pressure gage for adequate pressure for highest vent.
 - 4. Check flow-control valves for specified sequence of operation, and set at indicated flow.
 - 5. Set differential-pressure control valves at the specified differential pressure. Do not set at fully closed position when pump is positive-displacement type unless several terminal valves are kept open.
 - 6. Set system controls so automatic valves are wide open to heat exchangers.
 - 7. Check pump-motor load. If motor is overloaded, throttle main flow-balancing device so motor nameplate rating is not exceeded.
 - 8. Check air vents for a forceful liquid flow exiting from vents when manually operated.

3.8 PROCEDURES FOR CONSTANT-FLOW HYDRONIC SYSTEMS

- A. Measure water flow at pumps. Use the following procedures except for positive-displacement pumps:
 - 1. Verify impeller size by operating the pump with the discharge valve closed. Read pressure differential across the pump. Convert pressure to head and correct for differences in gage heights. Note the point on manufacturer's pump curve at zero flow and verify that the pump has the intended impeller size.
 - a. If impeller sizes must be adjusted to achieve pump performance, obtain approval from Architect.
 - 2. Check system resistance. With all valves open, read pressure differential across the pump and mark pump manufacturer's head-capacity curve. Adjust pump discharge valve until indicated water flow is achieved.
 - a. Monitor motor performance during procedures and do not operate motors in overload conditions.
 - 3. Verify pump-motor brake horsepower. Calculate the intended brake horsepower for the system based on pump manufacturer's performance data. Compare calculated brake horsepower with nameplate data on the pump motor. Report conditions where actual amperage exceeds motor nameplate amperage.
 - 4. Report flow rates that are not within plus or minus 10 percent of design.

- B. Measure flow at all automatic flow control valves to verify that valves are functioning as designed.
- C. Measure flow at all pressure-independent characterized control valves, with valves in fully open position, to verify that valves are functioning as designed.
- D. Set calibrated balancing valves, if installed, at calculated presettings.
- E. Measure flow at all stations and adjust, where necessary, to obtain first balance.
 - 1. System components that have Cv rating or an accurately cataloged flow-pressure-drop relationship may be used as a flow-indicating device.
- F. Measure flow at main balancing station and set main balancing device to achieve flow that is 5 percent greater than indicated flow.
- G. Adjust balancing stations to within specified tolerances of indicated flow rate as follows:
 - 1. Determine the balancing station with the highest percentage over indicated flow.
 - 2. Adjust each station in turn, beginning with the station with the highest percentage over indicated flow and proceeding to the station with the lowest percentage over indicated flow.
 - 3. Record settings and mark balancing devices.
- H. Measure pump flow rate and make final measurements of pump amperage, voltage, rpm, pump heads, and systems' pressures and temperatures including outdoor-air temperature.
- I. Measure the differential-pressure-control-valve settings existing at the conclusion of balancing.
- J. Check settings and operation of each safety valve. Record settings.

3.9 PROCEDURES FOR VARIABLE-FLOW HYDRONIC SYSTEMS

- A. Balance systems with automatic two- and three-way control valves by setting systems at maximum flow through heat-exchange terminals and proceed as specified above for hydronic systems.

3.10 PROCEDURES FOR MOTORS

- A. Motors, 1/2 HP and Larger: Test at final balanced conditions and record the following data:
 - 1. Manufacturer's name, model number, and serial number.
 - 2. Motor horsepower rating.

3. Motor rpm.
4. Efficiency rating.
5. Nameplate and measured voltage, each phase.
6. Nameplate and measured amperage, each phase.
7. Starter thermal-protection-element rating.

- B. Motors Driven by Variable-Frequency Controllers: Test for proper operation at speeds varying from minimum to maximum. Test the manual bypass of the controller to prove proper operation. Record observations including name of controller manufacturer, model number, serial number, and nameplate data.

3.11 PROCEDURES FOR CHILLERS

- A. Balance water flow through each evaporator and condenser] to within specified tolerances of indicated flow with all pumps operating. With only one chiller operating in a multiple chiller installation, do not exceed the flow for the maximum tube velocity recommended by the chiller manufacturer. Measure and record the following data with each chiller operating at design conditions:

1. Evaporator-water entering and leaving temperatures, pressure drop, and water flow.
2. For water-cooled chillers, condenser-water entering and leaving temperatures, pressure drop, and water flow.
3. Evaporator and condenser refrigerant temperatures and pressures, using instruments furnished by chiller manufacturer.
4. Power factor if factory-installed instrumentation is furnished for measuring kilowatts.
5. Kilowatt input if factory-installed instrumentation is furnished for measuring kilowatts.
6. Capacity: Calculate in tons of cooling.
7. For air-cooled chillers, verify condenser-fan rotation and record fan and motor data including number of fans and entering- and leaving-air temperatures.

3.12 PROCEDURES FOR CONDENSING UNITS

- A. Verify proper rotation of fans.
- B. Measure entering- and leaving-air temperatures.
- C. Record compressor data.

3.13 PROCEDURES FOR HEAT-TRANSFER COILS

- A. Measure, adjust, and record the following data for each water coil:
1. Entering- and leaving-water temperature.

2. Water flow rate.
3. Water pressure drop.
4. Dry-bulb temperature of entering and leaving air.
5. Wet-bulb temperature of entering and leaving air for cooling coils.
6. Airflow.
7. Air pressure drop.

B. Measure, adjust, and record the following data for each electric heating coil:

1. Nameplate data.
2. Airflow.
3. Entering- and leaving-air temperature at full load.
4. Voltage and amperage input of each phase at full load and at each incremental stage.
5. Calculated kilowatt at full load.
6. Fuse or circuit-breaker rating for overload protection.

C. Measure, adjust, and record the following data for each steam coil:

1. Dry-bulb temperature of entering and leaving air.
2. Airflow.
3. Air pressure drop.
4. Inlet steam pressure.

D. Measure, adjust, and record the following data for each refrigerant coil:

1. Dry-bulb temperature of entering and leaving air.
2. Wet-bulb temperature of entering and leaving air.
3. Airflow.
4. Air pressure drop.
5. Refrigerant suction pressure and temperature.

3.14 TOLERANCES

A. Set HVAC system's air flow rates and water flow rates within the following tolerances:

1. Supply, Return, and Exhaust Fans and Equipment with Fans: Plus or minus 10 percent.
2. Air Outlets and Inlets: Plus or minus 10 percent.
3. Heating-Water Flow Rate: Plus or minus 10 percent.
4. Cooling-Water Flow Rate: Plus or minus 10 percent.

3.15 REPORTING

A. Initial Construction-Phase Report: Based on examination of the Contract Documents as specified in "Examination" Article, prepare a report on the adequacy of design for

systems' balancing devices. Recommend changes and additions to systems' balancing devices to facilitate proper performance measuring and balancing. Recommend changes and additions to HVAC systems and general construction to allow access for performance measuring and balancing devices.

- B. Status Reports: Prepare biweekly progress reports to describe completed procedures, procedures in progress, and scheduled procedures. Include a list of deficiencies and problems found in systems being tested and balanced. Prepare a separate report for each system and each building floor for systems serving multiple floors.

3.16 FINAL REPORT

- A. General: Prepare a certified written report; tabulate and divide the report into separate sections for tested systems and balanced systems.
 - 1. Include a certification sheet at the front of the report's binder, signed and sealed by the certified testing and balancing engineer.
 - 2. Include a list of instruments used for procedures, along with proof of calibration.
- B. Final Report Contents: In addition to certified field-report data, include the following:
 - 1. Pump curves.
 - 2. Fan curves.
 - 3. Manufacturers' test data.
 - 4. Field test reports prepared by system and equipment installers.
 - 5. Other information relative to equipment performance; do not include Shop Drawings and product data.
- C. General Report Data: In addition to form titles and entries, include the following data:
 - 1. Title page.
 - 2. Name and address of the TAB contractor.
 - 3. Project name.
 - 4. Project location.
 - 5. Architect's name and address.
 - 6. Engineer's name and address.
 - 7. Contractor's name and address.
 - 8. Report date.
 - 9. Signature of TAB supervisor who certifies the report.
 - 10. Table of Contents with the total number of pages defined for each section of the report. Number each page in the report.
 - 11. Summary of contents including the following:
 - a. Indicated versus final performance.
 - b. Notable characteristics of systems.

- c. Description of system operation sequence if it varies from the Contract Documents.
 - 12. Nomenclature sheets for each item of equipment.
 - 13. Data for terminal units, including manufacturer's name, type, size, and fittings.
 - 14. Notes to explain why certain final data in the body of reports vary from indicated values.
 - 15. Test conditions for fans and pump performance forms including the following:
 - a. Settings for outdoor-, return-, and exhaust-air dampers.
 - b. Conditions of filters.
 - c. Cooling coil, wet- and dry-bulb conditions.
 - d. Face and bypass damper settings at coils.
 - e. Fan drive settings including settings and percentage of maximum pitch diameter.
 - f. Inlet vane settings for variable-air-volume systems.
 - g. Settings for supply-air, static-pressure controller.
 - h. Other system operating conditions that affect performance.
 - D. System Diagrams: Include schematic layouts of air and hydronic distribution systems. Present each system with single-line diagram and include the following:
 - 1. Quantities of outdoor, supply, return, and exhaust airflows.
 - 2. Water and steam flow rates.
 - 3. Duct, outlet, and inlet sizes.
 - 4. Pipe and valve sizes and locations.
 - 5. Terminal units.
 - 6. Balancing stations.
 - 7. Position of balancing devices.
- 3.17 ADDITIONAL TESTS
- A. Within 90 days of completing TAB, perform additional TAB to verify that balanced conditions are being maintained throughout and to correct unusual conditions.
 - B. Seasonal Periods: If initial TAB procedures were not performed during near-peak summer and winter conditions, perform additional TAB during near-peak summer and winter conditions.

END OF SECTION 230593

SECTION 230713

DUCT INSULATION

PART 1 - GENERAL

1.1 SUMMARY

A. Section includes insulating the following duct services:

1. Indoor, concealed supply and outdoor air.
2. Indoor, exposed supply and outdoor air.
3. Indoor, concealed return located in unconditioned space.
4. Indoor, exposed return located in unconditioned space.
5. Indoor, concealed, Type I, commercial, kitchen hood exhaust.
6. Indoor, exposed, Type I, commercial, kitchen hood exhaust.
7. Indoor, concealed oven and warewash exhaust.
8. Indoor, exposed oven and warewash exhaust.
9. Indoor, concealed exhaust between isolation damper and penetration of building exterior.
10. Indoor, exposed exhaust between isolation damper and penetration of building exterior.
11. Outdoor, concealed supply and return.
12. Outdoor, exposed supply and return.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Field quality-control reports.

1.3 QUALITY ASSURANCE

- A. Surface-Burning Characteristics: For insulation and related materials, as determined by testing identical Manufactures according to ASTM E 84, by a testing agency acceptable to authorities having jurisdiction. Factory label insulation and jacket materials and adhesive, mastic, tapes, and cement material containers, with appropriate markings of applicable testing agency.
 1. Insulation Installed Indoors: Flame-spread index of 25 or less, and smoke-developed index of 50 or less.
 2. Insulation Installed Outdoors: Flame-spread index of 75 or less, and smoke-developed index of 150 or less.

PART 2 - MANUFACTURES

2.1 INSULATION MATERIALS

- A. Comply with requirements in "Duct Insulation Schedule, General," "Indoor Duct and Plenum Insulation Schedule," and "Aboveground, Outdoor Duct and Plenum Insulation Schedule" articles for where insulating materials shall be applied.
- B. Manufactures shall not contain asbestos, lead, mercury, or mercury compounds.
- C. Manufactures that come in contact with stainless steel shall have a leachable chloride content of less than 50 ppm when tested according to ASTM C 871.
- D. Insulation materials for use on austenitic stainless steel shall be qualified as acceptable according to ASTM C 795.
- E. Foam insulation materials shall not use CFC or HCFC blowing agents in the manufacturing process.
- F. Mineral-Fiber Blanket Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 553, Type II and ASTM C 1290, Type III with factory-applied FSK jacket. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
 - 1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. CertainTeed Corp.; SoftTouch Duct Wrap.
 - b. Johns Manville; Microlite.
 - c. Knauf Insulation; Friendly Feel Duct Wrap.
 - d. Manson Insulation Inc.; Alley Wrap.
 - e. Owens Corning; SOFTR All-Service Duct Wrap.
- G. Mineral-Fiber Board Insulation: Mineral or glass fibers bonded with a thermosetting resin. Comply with ASTM C 612, Type IA or Type IB. For duct and plenum applications, provide insulation with factory-applied FSK jacket. Factory-applied jacket requirements are specified in "Factory-Applied Jackets" Article.
 - 1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. CertainTeed Corp.; Commercial Board.
 - b. Fibrex Insulations Inc.; FBX.
 - c. Johns Manville; 800 Series Spin-Glas.
 - d. Knauf Insulation; Insulation Board.
 - e. Manson Insulation Inc.; AK Board.

- f. Owens Corning; Fiberglas 700 Series.

2.2 FIRE-RATED INSULATION SYSTEMS

- A. Fire-Rated Blanket: High-temperature, flexible, blanket insulation with FSK jacket that is tested and certified to provide a 2-hour fire rating by an NRTL acceptable to authorities having jurisdiction.
 - 1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. CertainTeed Corp.; FlameChek.
 - b. Johns Manville; Firetemp Wrap.
 - c. Nelson Fire Stop Manufactures; Nelson FSB Flameshield Blanket.
 - d. Thermal Ceramics; FireMaster Duct Wrap.
 - e. 3M; Fire Barrier Wrap Manufactures.
 - f. Unifrax Corporation; FyreWrap.

2.3 ADHESIVES

- A. Materials shall be compatible with insulation materials, jackets, and substrates and for bonding insulation to itself and to surfaces to be insulated unless otherwise indicated.
- B. Mineral-Fiber Adhesive: Comply with MIL-A-3316C, Class 2, Grade A.
 - 1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; CP-127.
 - b. Eagle Bridges - Marathon Industries; 225.
 - c. Foster Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; 85-60/85-70.
 - d. Mon-Eco Industries, Inc.; 22-25.
- C. ASJ Adhesive, and FSK Jacket Adhesive: Comply with MIL-A-3316C, Class 2, Grade A for bonding insulation jacket lap seams and joints.
 - 1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; CP-82.

- b. Eagle Bridges - Marathon Industries; 225.
- c. Foster Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; 85-50.
- d. Mon-Eco Industries, Inc.; 22-25.

D. PVC Jacket Adhesive: Compatible with PVC jacket.

- 1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. Dow Corning Corporation; 739, Dow Silicone.
 - b. Johns Manville; Zeston Perma-Weld, CEEL-TITE Solvent Welding Adhesive.
 - c. P.I.C. Plastics, Inc.; Welding Adhesive.
 - d. Speedline Corporation; Polyco VP Adhesive.

2.4 MASTICS

A. Materials shall be compatible with insulation materials, jackets, and substrates; comply with MIL-PRF-19565C, Type II.

B. Vapor-Barrier Mastic: Water based; suitable for indoor use on below ambient services.

- 1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. Foster Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; 30-80/30-90.
 - b. Vimasco Corporation; 749.
- 2. Water-Vapor Permeance: ASTM E 96/E 96M, Procedure B, 0.013 perm at 43-mil dry film thickness.
- 3. Service Temperature Range: Minus 20 to plus 180 deg F.
- 4. Solids Content: ASTM D 1644, 58 percent by volume and 70 percent by weight.
- 5. Color: White.

C. Breather Mastic: Water based; suitable for indoor and outdoor use on above ambient services.

- 1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; CP-10.
 - b. Eagle Bridges - Marathon Industries; 550.

- c. Foster Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; 46-50.
 - d. Mon-Eco Industries, Inc.; 55-50.
 - e. Vimasco Corporation; WC-1/WC-5.
2. Water-Vapor Permeance: ASTM F 1249, 1.8 perms at 0.0625-inch dry film thickness.
 3. Service Temperature Range: Minus 20 to plus 180 deg F.
 4. Solids Content: 60 percent by volume and 66 percent by weight.
 5. Color: White.

2.5 SEALANTS

A. FSK and Metal Jacket Flashing Sealants:

1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; CP-76.
 - b. Eagle Bridges - Marathon Industries; 405.
 - c. Foster Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; 95-44.
 - d. Mon-Eco Industries, Inc.; 44-05.
2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F.
5. Color: Aluminum.

B. ASJ Flashing Sealants, and Vinyl and PVC Jacket Flashing Sealants:

1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; CP-76.
2. Materials shall be compatible with insulation materials, jackets, and substrates.
3. Fire- and water-resistant, flexible, elastomeric sealant.
4. Service Temperature Range: Minus 40 to plus 250 deg F.
5. Color: White.

2.6 FACTORY-APPLIED JACKETS

- A. Insulation system schedules indicate factory-applied jackets on various applications. When factory-applied jackets are indicated, comply with the following:
1. ASJ: White, kraft-paper, fiberglass-reinforced scrim with aluminum-foil backing; complying with ASTM C 1136, Type I.
 2. ASJ-SSL: ASJ with self-sealing, pressure-sensitive, acrylic-based adhesive covered by a removable protective strip; complying with ASTM C 1136, Type I.
 3. FSK Jacket: Aluminum-foil, fiberglass-reinforced scrim with kraft-paper backing; complying with ASTM C 1136, Type II.
 4. FSP Jacket: Aluminum-foil, fiberglass-reinforced scrim with polyethylene backing; complying with ASTM C 1136, Type II.
 5. Vinyl Jacket: White vinyl with a permeance of 1.3 perms when tested according to ASTM E 96/E 96M, Procedure A, and complying with NFPA 90A and NFPA 90B.

2.7 FIELD-APPLIED FABRIC-REINFORCING MESH

- A. Woven Polyester Fabric: Approximately 1 oz./sq. yd. with a thread count of 10 strands by 10 strands/sq. in., in a Leno weave, for ducts.
1. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. Foster Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; Mast-A-Fab.
 - b. Vimasco Corporation; Elastafab 894.

2.8 FIELD-APPLIED JACKETS

- A. Field-applied jackets shall comply with ASTM C 921, Type I, unless otherwise indicated.
- B. FSK Jacket: Aluminum-foil-face, fiberglass-reinforced scrim with kraft-paper backing.
- C. PVC Jacket: High-impact-resistant, UV-resistant PVC complying with ASTM D 1784, Class 16354-C; thickness as scheduled; roll stock ready for shop or field cutting and forming. Thickness is indicated in field-applied jacket schedules.
1. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - a. Johns Manville; Zeston.
 - b. P.I.C. Plastics, Inc.; FG Series.
 - c. Proto Corporation; LoSmoke.

- d. Speedline Corporation; SmokeSafe.
 - 2. Adhesive: As recommended by jacket material manufacturer.
 - 3. Color: Color-code jackets based on system.
- D. Aluminum Jacket: Comply with ASTM B 209, Alloy 3003, 3005, 3105, or 5005, Temper H-14.
- 1. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - a. Childers Brand, Specialty Construction Brands, Inc., a business of H. B. Fuller Company; Metal Jacketing Systems.
 - b. ITW Insulation Systems; Aluminum and Stainless Steel Jacketing.
 - c. RPR Manufactures, Inc.; Insul-Mate.
 - 2. Sheet and roll stock ready for shop or field sizing or Factory cut and rolled to size.
 - 3. Finish and thickness are indicated in field-applied jacket schedules.
 - 4. Moisture Barrier for Indoor Applications: 3-mil- thick, heat-bonded polyethylene and kraft paper.
 - 5. Moisture Barrier for Outdoor Applications: 2.5-mil- thick polysurlyn.
- E. Self-Adhesive Outdoor Jacket: 60-mil- thick, laminated vapor barrier and waterproofing membrane for installation over insulation located aboveground outdoors; consisting of a rubberized bituminous resin on a crosslaminated polyethylene film covered with stucco-embossed aluminum-foil facing.
- 1. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - a. Polyguard Manufactures, Inc.; Alumaguard 60.

2.9 TAPES

- A. ASJ Tape: White vapor-retarder tape matching factory-applied jacket with acrylic adhesive, complying with ASTM C 1136.
- 1. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - a. ABI, Ideal Tape Division; 428 AWF ASJ.
 - b. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0836.
 - c. Compac Corporation; 104 and 105.
 - d. Venture Tape; 1540 CW Plus, 1542 CW Plus, and 1542 CW Plus/SQ.

2. Width: 3 inches.
 3. Thickness: 11.5 mils.
 4. Adhesion: 90 ounces force/inch in width.
 5. Elongation: 2 percent.
 6. Tensile Strength: 40 lbf/inch in width.
 7. ASJ Tape Disks and Squares: Precut disks or squares of ASJ tape.
- B. FSK Tape: Foil-face, vapor-retarder tape matching factory-applied jacket with acrylic adhesive; complying with ASTM C 1136.
1. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - a. ABI, Ideal Tape Division; 491 AWF FSK.
 - b. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0827.
 - c. Compac Corporation; 110 and 111.
 - d. Venture Tape; 1525 CW NT, 1528 CW, and 1528 CW/SQ.
 2. Width: 3 inches.
 3. Thickness: 6.5 mils.
 4. Adhesion: 90 ounces force/inch in width.
 5. Elongation: 2 percent.
 6. Tensile Strength: 40 lbf/inch in width.
 7. FSK Tape Disks and Squares: Precut disks or squares of FSK tape.
- C. PVC Tape: White vapor-retarder tape matching field-applied PVC jacket with acrylic adhesive; suitable for indoor and outdoor applications.
1. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - a. ABI, Ideal Tape Division; 370 White PVC tape.
 - b. Compac Corporation; 130.
 - c. Venture Tape; 1506 CW NS.
 2. Width: 2 inches.
 3. Thickness: 6 mils.
 4. Adhesion: 64 ounces force/inch in width.
 5. Elongation: 500 percent.
 6. Tensile Strength: 18 lbf/inch in width.
- D. Aluminum-Foil Tape: Vapor-retarder tape with acrylic adhesive.
1. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:

- a. ABI, Ideal Tape Division; 488 AWF.
 - b. Avery Dennison Corporation, Specialty Tapes Division; Fasson 0800.
 - c. Compac Corporation; 120.
 - d. Venture Tape; 3520 CW.
2. Width: 2 inches.
 3. Thickness: 3.7 mils.
 4. Adhesion: 100 ounces force/inch in width.
 5. Elongation: 5 percent.
 6. Tensile Strength: 34 lbf/inch in width.

2.10 SECUREMENTS

- A. Aluminum Bands: ASTM B 209, Alloy 3003, 3005, 3105, or 5005; Temper H-14, 0.020 inch thick, 3/4 inch wide with closed seal.
 1. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - a. ITW Insulation Systems; Gerrard Strapping and Seals.
 - b. RPR Manufactures, Inc.; Insul-Mate Strapping, Seals, and Springs.
- B. Insulation Pins and Hangers:
 1. Metal, Adhesively Attached, Perforated-Base Insulation Hangers: Baseplate welded to projecting spindle that is capable of holding insulation, of thickness indicated, securely in position indicated when self-locking washer is in place. Comply with the following requirements:
 - a. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - 1) AGM Industries, Inc.; Tactoo Perforated Base Insul-Hangers.
 - 2) GEMCO; Perforated Base.
 - 3) Midwest Fasteners, Inc.; Spindle.
 - b. Baseplate: Perforated, galvanized carbon-steel sheet, 0.030 inch thick by 2 inches square.
 - c. Spindle: Stainless steel, fully annealed, 0.106-inch- diameter shank, length to suit depth of insulation indicated.
 - d. Adhesive: Recommended by hanger manufacturer. Product with demonstrated capability to bond insulation hanger securely to substrates indicated without damaging insulation, hangers, and substrates.
 2. Nonmetal, Adhesively Attached, Perforated-Base Insulation Hangers: Baseplate fastened to projecting spindle that is capable of holding insulation, of thickness

indicated, securely in position indicated when self-locking washer is in place. Comply with the following requirements:

- a. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - 1) GEMCO; Nylon Hangers.
 - 2) Midwest Fasteners, Inc.; Nylon Insulation Hangers.
 - b. Baseplate: Perforated, nylon sheet, 0.030 inch thick by 1-1/2 inches in diameter.
 - c. Spindle: Nylon, 0.106-inch- diameter shank, length to suit depth of insulation indicated, up to 2-1/2 inches.
 - d. Adhesive: Recommended by hanger manufacturer. Product with demonstrated capability to bond insulation hanger securely to substrates indicated without damaging insulation, hangers, and substrates.
3. Self-Sticking-Base Insulation Hangers: Baseplate welded to projecting spindle that is capable of holding insulation, of thickness indicated, securely in position indicated when self-locking washer is in place. Comply with the following requirements:
- a. Manufactures: Subject to compliance with requirements, available Product that may be incorporated into the Work include, but are not limited to, the following:
 - 1) AGM Industries, Inc.; Tactoo Self-Adhering Insul-Hangers.
 - 2) GEMCO; Peel & Press.
 - 3) Midwest Fasteners, Inc.; Self Stick.
 - b. Baseplate: Galvanized carbon-steel sheet, 0.030 inch thick by 2 inches square.
 - c. Spindle: Stainless steel, fully annealed, 0.106-inch- diameter shank, length to suit depth of insulation indicated.
 - d. Adhesive-backed base with a peel-off protective cover.
4. Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch-thick, stainless-steel sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.
- a. Manufactures: Subject to compliance with requirements, available Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - 1) AGM Industries, Inc.; RC-150.
 - 2) GEMCO; R-150.
 - 3) Midwest Fasteners, Inc.; WA-150.
 - 4) Nelson Stud Welding; Speed Clips.

- b. Protect ends with capped self-locking washers incorporating a spring steel insert to ensure permanent retention of cap in exposed locations.
 - 5. Nonmetal Insulation-Retaining Washers: Self-locking washers formed from 0.016-inch- thick nylon sheet, with beveled edge sized as required to hold insulation securely in place but not less than 1-1/2 inches in diameter.
 - a. Manufacturers: Subject to compliance with requirements, available manufacturers offering Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - 1) GEMCO.
 - 2) Midwest Fasteners, Inc.
 - C. Staples: Outward-clinching insulation staples, nominal 3/4-inch- wide, stainless steel or Monel.
 - D. Wire: 0.062-inch soft-annealed, stainless steel or 0.062-inch soft-annealed, galvanized steel.
 - 1. Manufacturers: Subject to compliance with requirements, available manufacturers offering Manufactures that may be incorporated into the Work include, but are not limited to, the following:
 - a. C & F Wire.
- 2.11 CORNER ANGLES
- A. PVC Corner Angles: 30 mils thick, minimum 1 by 1 inch, PVC according to ASTM D 1784, Class 16354-C. White or color-coded to match adjacent surface.
 - B. Aluminum Corner Angles: 0.040 inch thick, minimum 1 by 1 inch, aluminum according to ASTM B 209, Alloy 3003, 3005, 3105, or 5005; Temper H-14.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Surface Preparation: Clean and dry surfaces to receive insulation. Remove materials that will adversely affect insulation application.

3.2 GENERAL INSTALLATION REQUIREMENTS

- A. Install insulation materials, accessories, and finishes with smooth, straight, and even surfaces; free of voids throughout the length of ducts and fittings.

- B. Install insulation materials, vapor barriers or retarders, jackets, and thicknesses required for each item of duct system as specified in insulation system schedules.
- C. Install accessories compatible with insulation materials and suitable for the service. Install accessories that do not corrode, soften, or otherwise attack insulation or jacket in either wet or dry state.
- D. Install insulation with longitudinal seams at top and bottom of horizontal runs.
- E. Install multiple layers of insulation with longitudinal and end seams staggered.
- F. Keep insulation materials dry during application and finishing.
- G. Install insulation with tight longitudinal seams and end joints. Bond seams and joints with adhesive recommended by insulation material manufacturer.
- H. Install insulation with least number of joints practical.
- I. Where vapor barrier is indicated, seal joints, seams, and penetrations in insulation at hangers, supports, anchors, and other projections with vapor-barrier mastic.
 - 1. Install insulation continuously through hangers and around anchor attachments.
 - 2. For insulation application where vapor barriers are indicated, extend insulation on anchor legs from point of attachment to supported item to point of attachment to structure. Taper and seal ends at attachment to structure with vapor-barrier mastic.
 - 3. Install insert materials and install insulation to tightly join the insert. Seal insulation to insulation inserts with adhesive or sealing compound recommended by insulation material manufacturer.
- J. Apply adhesives, mastics, and sealants at manufacturer's recommended coverage rate and wet and dry film thicknesses.
- K. Install insulation with factory-applied jackets as follows:
 - 1. Draw jacket tight and smooth.
 - 2. Cover circumferential joints with 3-inch- wide strips, of same material as insulation jacket. Secure strips with adhesive and outward clinching staples along both edges of strip, spaced 4 inches o.c.
 - 3. Overlap jacket longitudinal seams at least 1-1/2 inches. Clean and dry surface to receive self-sealing lap. Staple laps with outward clinching staples along edge at 2 inches o.c.
 - a. For below ambient services, apply vapor-barrier mastic over staples.
 - 4. Cover joints and seams with tape, according to insulation material manufacturer's written instructions, to maintain vapor seal.
 - 5. Where vapor barriers are indicated, apply vapor-barrier mastic on seams and joints and at ends adjacent to duct flanges and fittings.

- L. Cut insulation in a manner to avoid compressing insulation more than 75 percent of its nominal thickness.
- M. Finish installation with systems at operating conditions. Repair joint separations and cracking due to thermal movement.
- N. Repair damaged insulation facings by applying same facing material over damaged areas. Extend patches at least 4 inches beyond damaged areas. Adhere, staple, and seal patches similar to butt joints.

3.3 PENETRATIONS

- A. Insulation Installation at Roof Penetrations: Install insulation continuously through roof penetrations.
 - 1. Seal penetrations with flashing sealant.
 - 2. For applications requiring only indoor insulation, terminate insulation above roof surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
 - 3. Extend jacket of outdoor insulation outside roof flashing at least 2 inches below top of roof flashing.
 - 4. Seal jacket to roof flashing with flashing sealant.
- B. Insulation Installation at Aboveground Exterior Wall Penetrations: Install insulation continuously through wall penetrations.
 - 1. Seal penetrations with flashing sealant.
 - 2. For applications requiring only indoor insulation, terminate insulation inside wall surface and seal with joint sealant. For applications requiring indoor and outdoor insulation, install insulation for outdoor applications tightly joined to indoor insulation ends. Seal joint with joint sealant.
 - 3. Extend jacket of outdoor insulation outside wall flashing and overlap wall flashing at least 2 inches.
 - 4. Seal jacket to wall flashing with flashing sealant.
- C. Insulation Installation at Interior Wall and Partition Penetrations (That Are Not Fire Rated): Install insulation continuously through walls and partitions.
- D. Insulation Installation at Fire-Rated Wall and Partition Penetrations: Terminate insulation at fire damper sleeves for fire-rated wall and partition penetrations. Externally insulate damper sleeves to match adjacent insulation and overlap duct insulation at least 2 inches.
 - 1. Comply with requirements in Section 07841 "Penetration Firestopping" for firestopping and fire-resistive joint sealers.
- E. Insulation Installation at Floor Penetrations:

1. Duct: For penetrations through fire-rated assemblies, terminate insulation at fire damper sleeves and externally insulate damper sleeve beyond floor to match adjacent duct insulation. Overlap damper sleeve and duct insulation at least 2 inches.
2. Seal penetrations through fire-rated assemblies. Comply with requirements in Section 07841 "Penetration Firestopping."

3.4 INSTALLATION OF MINERAL-FIBER INSULATION

A. Blanket Insulation Installation on Ducts and Plenums: Secure with adhesive and insulation pins.

1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of duct and plenum surfaces.
2. Apply adhesive to entire circumference of ducts and to all surfaces of fittings and transitions.
3. Install either capacitor-discharge-weld pins and speed washers or cupped-head, capacitor-discharge-weld pins on sides and bottom of horizontal ducts and sides of vertical ducts as follows:
 - a. On duct sides with dimensions 18 inches and smaller, place pins along longitudinal centerline of duct. Space 3 inches maximum from insulation end joints, and 16 inches o.c.
 - b. On duct sides with dimensions larger than 18 inches, place pins 16 inches o.c. each way, and 3 inches maximum from insulation joints. Install additional pins to hold insulation tightly against surface at cross bracing.
 - c. Pins may be omitted from top surface of horizontal, rectangular ducts and plenums.
 - d. Do not overcompress insulation during installation.
 - e. Impale insulation over pins and attach speed washers.
 - f. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.
4. For ducts and plenums with surface temperatures below ambient, install a continuous unbroken vapor barrier. Create a facing lap for longitudinal seams and end joints with insulation by removing 2 inches from one edge and one end of insulation segment. Secure laps to adjacent insulation section with 1/2-inch outward-clinching staples, 1 inch o.c. Install vapor barrier consisting of factory- or field-applied jacket, adhesive, vapor-barrier mastic, and sealant at joints, seams, and protrusions.
 - a. Repair punctures, tears, and penetrations with tape or mastic to maintain vapor-barrier seal.
 - b. Install vapor stops for ductwork and plenums operating below 50 deg F at 18-foot intervals. Vapor stops shall consist of vapor-barrier mastic applied in a Z-shaped pattern over insulation face, along butt end of insulation, and over the surface. Cover insulation face and surface to be insulated a

width equal to two times the insulation thickness, but not less than 3 inches.

5. Overlap unfaced blankets a minimum of 2 inches on longitudinal seams and end joints. At end joints, secure with steel bands spaced a maximum of 18 inches o.c.
 6. Install insulation on rectangular duct elbows and transitions with a full insulation section for each surface. Install insulation on round and flat-oval duct elbows with individually mitered gores cut to fit the elbow.
 7. Insulate duct stiffeners, hangers, and flanges that protrude beyond insulation surface with 6-inch- wide strips of same material used to insulate duct. Secure on alternating sides of stiffener, hanger, and flange with pins spaced 6 inches o.c.
- B. Board Insulation Installation on Ducts and Plenums: Secure with adhesive and insulation pins.
1. Apply adhesives according to manufacturer's recommended coverage rates per unit area, for 100 percent coverage of duct and plenum surfaces.
 2. Apply adhesive to entire circumference of ducts and to all surfaces of fittings and transitions.
 3. Install either capacitor-discharge-weld pins and speed washers or cupped-head, capacitor-discharge-weld pins on sides and bottom of horizontal ducts and sides of vertical ducts as follows:
 - a. On duct sides with dimensions 18 inches and smaller, place pins along longitudinal centerline of duct. Space 3 inches maximum from insulation end joints, and 16 inches o.c.
 - b. On duct sides with dimensions larger than 18 inches, space pins 16 inches o.c. each way, and 3 inches maximum from insulation joints. Install additional pins to hold insulation tightly against surface at cross bracing.
 - c. Pins may be omitted from top surface of horizontal, rectangular ducts and plenums.
 - d. Do not overcompress insulation during installation.
 - e. Cut excess portion of pins extending beyond speed washers or bend parallel with insulation surface. Cover exposed pins and washers with tape matching insulation facing.
 4. For ducts and plenums with surface temperatures below ambient, install a continuous unbroken vapor barrier. Create a facing lap for longitudinal seams and end joints with insulation by removing 2 inches from one edge and one end of insulation segment. Secure laps to adjacent insulation section with 1/2-inch outward-clinching staples, 1 inch o.c. Install vapor barrier consisting of factory- or field-applied jacket, adhesive, vapor-barrier mastic, and sealant at joints, seams, and protrusions.
 - a. Repair punctures, tears, and penetrations with tape or mastic to maintain vapor-barrier seal.

- b. Install vapor stops for ductwork and plenums operating below 50 deg F at 18-foot intervals. Vapor stops shall consist of vapor-barrier mastic applied in a Z-shaped pattern over insulation face, along butt end of insulation, and over the surface. Cover insulation face and surface to be insulated a width equal to two times the insulation thickness, but not less than 3 inches.
5. Install insulation on rectangular duct elbows and transitions with a full insulation section for each surface. Groove and score insulation to fit as closely as possible to outside and inside radius of elbows. Install insulation on round and flat-oval duct elbows with individually mitered gores cut to fit the elbow.
6. Insulate duct stiffeners, hangers, and flanges that protrude beyond insulation surface with 6-inch- wide strips of same material used to insulate duct. Secure on alternating sides of stiffener, hanger, and flange with pins spaced 6 inches o.c.

3.5 FIELD-APPLIED JACKET INSTALLATION

- A. Where FSK jackets are indicated, install as follows:
 1. Draw jacket material smooth and tight.
 2. Install lap or joint strips with same material as jacket.
 3. Secure jacket to insulation with manufacturer's recommended adhesive.
 4. Install jacket with 1-1/2-inch laps at longitudinal seams and 3-inch- wide joint strips at end joints.
 5. Seal openings, punctures, and breaks in vapor-retarder jackets and exposed insulation with vapor-barrier mastic.
- B. Where PVC jackets are indicated, install with 1-inch overlap at longitudinal seams and end joints; for horizontal applications, install with longitudinal seams along top and bottom of tanks and vessels. Seal with manufacturer's recommended adhesive.
 1. Apply two continuous beads of adhesive to seams and joints, one bead under lap and the finish bead along seam and joint edge.
- C. Where metal jackets are indicated, install with 2-inch overlap at longitudinal seams and end joints. Overlap longitudinal seams arranged to shed water. Seal end joints with weatherproof sealant recommended by insulation manufacturer. Secure jacket with stainless-steel bands 12 inches o.c. and at end joints.

3.6 FIRE-RATED INSULATION SYSTEM INSTALLATION

- A. Where fire-rated insulation system is indicated, secure system to ducts and duct hangers and supports to maintain a continuous fire rating.
- B. Insulate duct access panels and doors to achieve same fire rating as duct.

- C. Install firestopping at penetrations through fire-rated assemblies. Fire-stop systems are specified in Section 07841 "Penetration Firestopping."

3.7 FINISHES

- A. Insulation with ASJ or Other Paintable Jacket Material: Paint jacket with paint system identified below and as specified in Section 09912 "Interior Painting."
 - 1. Flat Acrylic Finish: Two finish coats over a primer that is compatible with jacket material and finish coat paint. Add fungicidal agent to render fabric mildew proof.
 - a. Finish Coat Material: Interior, flat, latex-emulsion size.
- B. Color: Final color as selected by Architect. Vary first and second coats to allow visual inspection of the completed Work.
- C. Do not field paint aluminum or stainless-steel jackets.

3.8 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Tests and Inspections:
 - 1. Inspect ductwork, randomly selected by Architect, by removing field-applied jacket and insulation in layers in reverse order of their installation. Extent of inspection shall be limited to one location(s) for each duct system defined in the "Duct Insulation Schedule, General" Article.
- C. All insulation applications will be considered defective Work if sample inspection reveals noncompliance with requirements.

3.9 DUCT INSULATION SCHEDULE, GENERAL

- A. Plenums and Ducts Requiring Insulation:
 - 1. Indoor, concealed supply and outdoor air.
 - 2. Indoor, exposed supply and outdoor air.
 - 3. Indoor, concealed return located in unconditioned space.
 - 4. Indoor, exposed return located in unconditioned space.
 - 5. Indoor, concealed, Type I, commercial, kitchen hood exhaust.
 - 6. Indoor, exposed, Type I, commercial, kitchen hood exhaust.
 - 7. Indoor, concealed oven and warewash exhaust.
 - 8. Indoor, exposed oven and warewash exhaust.
 - 9. Indoor, concealed exhaust between isolation damper and penetration of building exterior.

10. Indoor, exposed exhaust between isolation damper and penetration of building exterior.
11. Outdoor, concealed supply and return.
12. Outdoor, exposed supply and return.

B. Items Not Insulated:

1. Fibrous-glass ducts.
2. Metal ducts with duct liner of sufficient thickness to comply with energy code and ASHRAE/IESNA 90.1.
3. Factory-insulated flexible ducts.
4. Factory-insulated plenums and casings.
5. Flexible connectors.
6. Vibration-control devices.
7. Factory-insulated access panels and doors.

3.10 INDOOR DUCT AND PLENUM INSULATION SCHEDULE

- A. Concealed, Supply-Air Duct and Plenum Insulation: Mineral-fiber board, 3 inches thick and 3-lb/cu. ft. nominal density.
- B. Concealed, Return-Air Duct and Plenum Insulation: Mineral-fiber blanket, 2 inches thick and 1.5-lb/cu. ft. nominal density.
- C. Concealed, Outdoor-Air Duct and Plenum Insulation: Mineral-fiber blanket 2 inches thick and 1.5-lb/cu. ft. nominal density.
- D. Concealed, Exhaust-Air Duct and Plenum Insulation: Mineral-fiber blanket 1-1/2 inches thick and 0.75-lb/cu. ft. nominal density.
- E. Concealed, Type I, Commercial, Kitchen Hood Exhaust Duct and Plenum Insulation: Fire-rated board; thickness as required to achieve 2-hour fire rating.
- F. Exposed, Supply-Air Duct and Plenum Insulation: Mineral-fiber board 2 inches thick and 1.5-lb/cu. ft. nominal density.
- G. Exposed, Return-Air Duct and Plenum Insulation: Mineral-fiber board 1-1/2 inches thick and 0.75-lb/cu. ft. nominal density.
- H. Exposed, Outdoor-Air Duct and Plenum Insulation: Mineral-fiber board 1-1/2 inches thick and 0.75-lb/cu. ft. nominal density.
- I. Exposed, Exhaust-Air Duct and Plenum Insulation: Mineral-fiber board 1-1/2 inches thick and 0.75-lb/cu. ft. nominal density.
- J. Exposed, Type I, Commercial, Kitchen Hood Exhaust Duct and Plenum Insulation: Fire-rated board; thickness as required to achieve 2-hour fire rating.

3.11 INDOOR, FIELD-APPLIED JACKET SCHEDULE

- A. Install jacket over insulation material. For insulation with factory-applied jacket, install the field-applied jacket over the factory-applied jacket.
- B. If more than one material is listed, selection from materials listed is Contractor's option.
- C. Ducts and Plenums, Concealed:
 - 1. PVC, Color-Coded by System 30 mils thick.
 - 2. Aluminum, Smooth or Stucco Embossed 0.032 inch thick.
- D. Ducts and Plenums, Exposed:
 - 1. PVC, Color-Coded by System 30 mils thick.
 - 2. Aluminum, Stucco Embossed 0.032 inch thick.

END OF SECTION 230713

SECTION 233113

METAL DUCTS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Rectangular ducts and fittings.
2. Round ducts and fittings.
3. Sheet metal materials.
4. Sealants and gaskets.
5. Hangers and supports.
6. Seismic-restraint devices.

1.2 PERFORMANCE REQUIREMENTS

- A. Delegated Duct Design: Duct construction, including sheet metal thicknesses, seam and joint construction, reinforcements, and hangers and supports, shall comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" and performance requirements and design criteria indicated in "Duct Schedule" Article.
- B. Structural Performance: Duct hangers and supports shall withstand the effects of gravity loads and stresses within limits and under conditions described in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- C. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.

1.3 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings:
 1. Fabrication, assembly, and installation, including plans, elevations, sections, components, and attachments to other work.
 2. Factory- and shop-fabricated ducts and fittings.
 3. Duct layout indicating sizes, configuration, and static-pressure classes.
 4. Elevation of top of ducts.
 5. Dimensions of main duct runs from building grid lines.
 6. Fittings.
 7. Reinforcement and spacing.

8. Seam and joint construction.
9. Penetrations through fire-rated and other partitions.
10. Equipment installation based on equipment being used on Project.
11. Locations for duct accessories, including dampers, turning vanes, and access doors and panels.
12. Hangers and supports, including methods for duct and building attachment and vibration isolation.

C. Delegated-Design Submittal:

1. Sheet metal thicknesses.
2. Joint and seam construction and sealing.
3. Reinforcement details and spacing.
4. Materials, fabrication, assembly, and spacing of hangers and supports.
5. Design Calculations: Calculations, including analysis data signed and sealed by the qualified professional engineer responsible for their preparation] for selecting hangers and supports.

1.4 INFORMATIONAL SUBMITTALS

A. Coordination Drawings: Plans, drawn to scale, on which the following items are shown and coordinated with each other, using input from installers of the items involved:

1. Duct installation in congested spaces, indicating coordination with general construction, building components, and other building services. Indicate proposed changes to duct layout.
2. Suspended ceiling components.
3. Structural members to which duct will be attached.
4. Size and location of initial access modules for acoustical tile.
5. Penetrations of smoke barriers and fire-rated construction.
6. Items penetrating finished ceiling including the following:
 - a. Lighting fixtures.
 - b. Air outlets and inlets.
 - c. Speakers.
 - d. Sprinklers.
 - e. Access panels.
 - f. Perimeter moldings.

B. Welding certificates.

1.5 QUALITY ASSURANCE

A. Welding Qualifications: Qualify procedures and personnel according to the following:

1. AWS D1.1/D1.1M, "Structural Welding Code - Steel," for hangers and supports.

2. AWS D1.2/D1.2M, "Structural Welding Code - Aluminum," for aluminum supports.
 3. AWS D9.1M/D9.1, "Sheet Metal Welding Code," for duct joint and seam welding.
- B. ASHRAE Compliance: Applicable requirements in ASHRAE 62.1, Section 5 - "Systems and Equipment" and Section 7 - "Construction and System Start-up."
- C. ASHRAE/IESNA Compliance: Applicable requirements in ASHRAE/IESNA 90.1, Section 6.4.4 - "HVAC System Construction and Insulation."

PART 2 - PRODUCTS

2.1 RECTANGULAR DUCTS AND FITTINGS

- A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" based on indicated static-pressure class unless otherwise indicated.
- B. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-1, "Rectangular Duct/Transverse Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- C. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 2-2, "Rectangular Duct/Longitudinal Seams," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- D. Elbows, Transitions, Offsets, Branch Connections, and Other Duct Construction: Select types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 4, "Fittings and Other Construction," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."

2.2 ROUND DUCTS AND FITTINGS

- A. General Fabrication Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 3, "Round, Oval, and Flexible Duct," based on indicated static-pressure class unless otherwise indicated.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

- a. Lindab Inc.
 - b. McGill AirFlow LLC.
 - c. SEMCO Incorporated.
 - d. Sheet Metal Connectors, Inc.
 - e. Spiral Manufacturing Co., Inc.
- B. Transverse Joints: Select joint types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-1, "Round Duct Transverse Joints," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
1. Transverse Joints in Ducts Larger Than 60 Inches in Diameter: Flanged.
- C. Longitudinal Seams: Select seam types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-2, "Round Duct Longitudinal Seams," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
1. Fabricate round ducts larger Than 90 inches in diameter with butt-welded longitudinal seams.
- D. Tees and Laterals: Select types and fabricate according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-5, "90 Degree Tees and Laterals," and Figure 3-6, "Conical Tees," for static-pressure class, applicable sealing requirements, materials involved, duct-support intervals, and other provisions in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- 2.3 SHEET METAL MATERIALS
- A. General Material Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.
- B. Galvanized Sheet Steel: Comply with ASTM A 653/A 653M.
1. Galvanized Coating Designation: G90.
 2. Finishes for Surfaces Exposed to View: Mill phosphatized.
- C. Carbon-Steel Sheets: Comply with ASTM A 1008/A 1008M, with oiled, matte finish for exposed ducts.
- D. Stainless-Steel Sheets: Comply with ASTM A 480/A 480M, Type 304 or 316, as indicated in the "Duct Schedule" Article; cold rolled, annealed, sheet. Exposed

surface finish shall be No. 2B, No. 2D, No. 3, or No. 4 as indicated in the "Duct Schedule" Article.

- E. Aluminum Sheets: Comply with ASTM B 209 Alloy 3003, H14 temper; with mill finish for concealed ducts, and standard, one-side bright finish for duct surfaces exposed to view.
- F. Reinforcement Shapes and Plates: ASTM A 36/A 36M, steel plates, shapes, and bars; black and galvanized.
 - 1. Where black- and galvanized-steel shapes and plates are used to reinforce aluminum ducts, isolate the different metals with butyl rubber, neoprene, or EPDM gasket materials.
- G. Tie Rods: Galvanized steel, 1/4-inch minimum diameter for lengths 36 inches or less; 3/8-inch minimum diameter for lengths longer than 36 inches.

2.4 SEALANT AND GASKETS

- A. General Sealant and Gasket Requirements: Surface-burning characteristics for sealants and gaskets shall be a maximum flame-spread index of 25 and a maximum smoke-developed index of 50 when tested according to UL 723; certified by an NRTL.
- B. Two-Part Tape Sealing System:
 - 1. Tape: Woven cotton fiber impregnated with mineral gypsum and modified acrylic/silicone activator to react exothermically with tape to form hard, durable, airtight seal.
 - 2. Tape Width: 6 inches.
 - 3. Sealant: Modified styrene acrylic.
 - 4. Water resistant.
 - 5. Mold and mildew resistant.
 - 6. Maximum Static-Pressure Class: 10-inch wg, positive and negative.
 - 7. Service: Indoor and outdoor.
 - 8. Service Temperature: Minus 40 to plus 200 deg F.
 - 9. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum.
 - 10. For indoor applications, sealant shall have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
 - 11. Sealant shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."
- C. Water-Based Joint and Seam Sealant:
 - 1. Application Method: Brush on.
 - 2. Solids Content: Minimum 65 percent.

3. Shore A Hardness: Minimum 20.
4. Water resistant.
5. Mold and mildew resistant.
6. VOC: Maximum 75 g/L (less water).
7. Maximum Static-Pressure Class: 10-inch wg, positive and negative.
8. Service: Indoor or outdoor.
9. Substrate: Compatible with galvanized sheet steel (both PVC coated and bare), stainless steel, or aluminum sheets.

D. Flanged Joint Sealant: Comply with ASTM C 920.

1. General: Single-component, acid-curing, silicone, elastomeric.
2. Type: S.
3. Grade: NS.
4. Class: 25.
5. Use: O.
6. For indoor applications, sealant shall have a VOC content of 250 g/L or less when calculated according to 40 CFR 59, Subpart D (EPA Method 24).
7. Sealant shall comply with the testing and product requirements of the California Department of Health Services' "Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers."

E. Flange Gaskets: Butyl rubber, neoprene, or EPDM polymer with polyisobutylene plasticizer.

F. Round Duct Joint O-Ring Seals:

1. Seal shall provide maximum 3 cfm/100 sq. ft. at 1-inch wg and shall be rated for 10-inch wg static-pressure class, positive or negative.
2. EPDM O-ring to seal in concave bead in coupling or fitting spigot.
3. Double-lipped, EPDM O-ring seal, mechanically fastened to factory-fabricated couplings and fitting spigots.

2.5 HANGERS AND SUPPORTS

- A. Hanger Rods for Noncorrosive Environments: Cadmium-plated steel rods and nuts.
- B. Hanger Rods for Corrosive Environments: Electrogalvanized, all-thread rods or galvanized rods with threads painted with zinc-chromate primer after installation.
- C. Strap and Rod Sizes: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 5-1, "Rectangular Duct Hangers Minimum Size," and Table 5-2, "Minimum Hanger Sizes for Round Duct."
- D. Steel Cables for Galvanized-Steel Ducts: Galvanized steel complying with ASTM A 603.

- E. Steel Cables for Stainless-Steel Ducts: Stainless steel complying with ASTM A 492.
- F. Steel Cable End Connections: Cadmium-plated steel assemblies with brackets, swivel, and bolts designed for duct hanger service; with an automatic-locking and clamping device.
- G. Duct Attachments: Sheet metal screws, blind rivets, or self-tapping metal screws; compatible with duct materials.
- H. Trapeze and Riser Supports:
 - 1. Supports for Galvanized-Steel Ducts: Galvanized-steel shapes and plates.
 - 2. Supports for Stainless-Steel Ducts: Stainless-steel shapes and plates.
 - 3. Supports for Aluminum Ducts: Aluminum or galvanized steel coated with zinc chromate.

2.6 SEISMIC-RESTRAINT DEVICES

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1. Cooper B-Line, Inc.; a division of Cooper Industries.
 - 2. Ductmate Industries, Inc.
 - 3. Hilti Corp.
 - 4. Kinetics Noise Control.
 - 5. Loos & Co.; Cableware Division.
 - 6. Mason Industries.
 - 7. TOLCO; a brand of NIBCO INC.
 - 8. Unistrut Corporation; Tyco International, Ltd.
- B. Channel Support System: Shop- or field-fabricated support assembly made of slotted steel channels rated in tension, compression, and torsion forces and with accessories for attachment to braced component at one end and to building structure at the other end. Include matching components and corrosion-resistant coating.
- C. Restraint Cables: ASTM A 492, stainless-steel cables with end connections made of cadmium-plated steel assemblies with brackets, swivel, and bolts designed for restraining cable service; and with an automatic-locking and clamping device or double-cable clips.
- D. Hanger Rod Stiffener: Steel tube or steel slotted-support-system sleeve with internally bolted connections to hanger rod.
- E. Mechanical Anchor Bolts: Drilled-in and stud-wedge or female-wedge type. Select anchor bolts with strength required for anchor and as tested according to ASTM E 488.

PART 3 - EXECUTION

3.1 DUCT INSTALLATION

- A. Drawing plans, schematics, and diagrams indicate general location and arrangement of duct system. Indicated duct locations, configurations, and arrangements were used to size ducts and calculate friction loss for air-handling equipment sizing and for other design considerations. Install duct systems as indicated unless deviations to layout are approved on Shop Drawings and Coordination Drawings.
- B. Install ducts according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" unless otherwise indicated.
- C. Install round ducts in maximum practical lengths.
- D. Install ducts with fewest possible joints.
- E. Install factory- or shop-fabricated fittings for changes in direction, size, and shape and for branch connections.
- F. Unless otherwise indicated, install ducts vertically and horizontally, and parallel and perpendicular to building lines.
- G. Install ducts close to walls, overhead construction, columns, and other structural and permanent enclosure elements of building.
- H. Install ducts with a clearance of 1 inch, plus allowance for insulation thickness.
- I. Route ducts to avoid passing through transformer vaults and electrical equipment rooms and enclosures.
- J. Where ducts pass through non-fire-rated interior partitions and exterior walls and are exposed to view, cover the opening between the partition and duct or duct insulation with sheet metal flanges of same metal thickness as the duct. Overlap openings on four sides by at least 1-1/2 inches.
- K. Where ducts pass through fire-rated interior partitions and exterior walls, install fire dampers.
- L. Protect duct interiors from moisture, construction debris and dust, and other foreign materials. Comply with SMACNA's "IAQ Guidelines for Occupied Buildings Under Construction," Appendix G, "Duct Cleanliness for New Construction Guidelines."

3.2 INSTALLATION OF EXPOSED DUCTWORK

- A. Protect ducts exposed in finished spaces from being dented, scratched, or damaged.

- B. Trim duct sealants flush with metal. Create a smooth and uniform exposed bead. Do not use two-part tape sealing system.
- C. Grind welds to provide smooth surface free of burrs, sharp edges, and weld splatter. When welding stainless steel with a No. 3 or 4 finish, grind the welds flush, polish the exposed welds, and treat the welds to remove discoloration caused by welding.
- D. Maintain consistency, symmetry, and uniformity in the arrangement and fabrication of fittings, hangers and supports, duct accessories, and air outlets.
- E. Repair or replace damaged sections and finished work that does not comply with these requirements.

3.3 ADDITIONAL INSTALLATION REQUIREMENTS FOR COMMERCIAL KITCHEN HOOD EXHAUST DUCT

- A. Install commercial kitchen hood exhaust ducts without dips and traps that may hold grease, and sloped a minimum of 2 percent to drain grease back to the hood.
- B. Install fire-rated access panel assemblies at each change in direction and at maximum intervals of 12 feet in horizontal ducts, and at every floor for vertical ducts, or as indicated on Drawings. Locate access panel on top or sides of duct a minimum of 1-1/2 inches from bottom of duct.
- C. Do not penetrate fire-rated assemblies except as allowed by applicable building codes and authorities having jurisdiction.

3.4 DUCT SEALING

- A. Seal ducts for duct static-pressure, seal classes, and leakage classes specified in "Duct Schedule" Article according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
- B. Seal ducts to the following seal classes according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible":
 - 1. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible."
 - 2. Outdoor, Supply-Air Ducts: Seal Class A.
 - 3. Outdoor, Exhaust Ducts: Seal Class C.
 - 4. Outdoor, Return-Air Ducts: Seal Class C.
 - 5. Unconditioned Space, Supply-Air Ducts in Pressure Classes 2-Inch wg and Lower: Seal Class B.
 - 6. Unconditioned Space, Supply-Air Ducts in Pressure Classes Higher Than 2-Inch wg: Seal Class A.
 - 7. Unconditioned Space, Exhaust Ducts: Seal Class C.
 - 8. Unconditioned Space, Return-Air Ducts: Seal Class B.

9. Conditioned Space, Supply-Air Ducts in Pressure Classes 2-Inch wg and Lower: Seal Class C.
10. Conditioned Space, Supply-Air Ducts in Pressure Classes Higher Than 2-Inch wg: Seal Class B.
11. Conditioned Space, Exhaust Ducts: Seal Class B.
12. Conditioned Space, Return-Air Ducts: Seal Class C.

3.5 HANGER AND SUPPORT INSTALLATION

- A. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Chapter 5, "Hangers and Supports."
- B. Building Attachments: Concrete inserts, powder-actuated fasteners, or structural-steel fasteners appropriate for construction materials to which hangers are being attached.
 1. Where practical, install concrete inserts before placing concrete.
 2. Install powder-actuated concrete fasteners after concrete is placed and completely cured.
 3. Use powder-actuated concrete fasteners for standard-weight aggregate concretes or for slabs more than 4 inches thick.
 4. Do not use powder-actuated concrete fasteners for lightweight-aggregate concretes or for slabs less than 4 inches thick.
 5. Do not use powder-actuated concrete fasteners for seismic restraints.
- C. Hanger Spacing: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 5-1, "Rectangular Duct Hangers Minimum Size," and Table 5-2, "Minimum Hanger Sizes for Round Duct," for maximum hanger spacing; install hangers and supports within 24 inches of each elbow and within 48 inches of each branch intersection.
- D. Hangers Exposed to View: Threaded rod and angle or channel supports.
- E. Support vertical ducts with steel angles or channel secured to the sides of the duct with welds, bolts, sheet metal screws, or blind rivets; support at each floor and at a maximum intervals of 16 feet.
- F. Install upper attachments to structures. Select and size upper attachments with pull-out, tension, and shear capacities appropriate for supported loads and building materials where used.

3.6 CONNECTIONS

- A. Make connections to equipment with flexible connectors complying with Section 23330 "Air Duct Accessories."

- B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for branch, outlet and inlet, and terminal unit connections.

3.7 DUCT CLEANING

- A. Clean new and existing duct system(s) before testing, adjusting, and balancing.
- B. Use service openings for entry and inspection.
 - 1. Create new openings and install access panels appropriate for duct static-pressure class if required for cleaning access. Provide insulated panels for insulated or lined duct. Patch insulation and liner as recommended by duct liner manufacturer.
 - 2. Disconnect and reconnect flexible ducts as needed for cleaning and inspection.
 - 3. Remove and reinstall ceiling to gain access during the cleaning process.
- C. Particulate Collection and Odor Control:
 - 1. When venting vacuuming system inside the building, use HEPA filtration with 99.97 percent collection efficiency for 0.3-micron-size (or larger) particles.
 - 2. When venting vacuuming system to outdoors, use filter to collect debris removed from HVAC system, and locate exhaust downwind and away from air intakes and other points of entry into building.
- D. Clean the following components by removing surface contaminants and deposits:
 - 1. Air outlets and inlets (registers, grilles, and diffusers).
 - 2. Supply, return, and exhaust fans including fan housings, plenums (except ceiling supply and return plenums), scrolls, blades or vanes, shafts, baffles, dampers, and drive assemblies.
 - 3. Air-handling unit internal surfaces and components including mixing box, coil section, air wash systems, spray eliminators, condensate drain pans, humidifiers and dehumidifiers, filters and filter sections, and condensate collectors and drains.
 - 4. Coils and related components.
 - 5. Return-air ducts, dampers, actuators, and turning vanes except in ceiling plenums and mechanical equipment rooms.
 - 6. Supply-air ducts, dampers, actuators, and turning vanes.
 - 7. Dedicated exhaust and ventilation components and makeup air systems.
- E. Mechanical Cleaning Methodology:
 - 1. Clean metal duct systems using mechanical cleaning methods that extract contaminants from within duct systems and remove contaminants from building.
 - 2. Use vacuum-collection devices that are operated continuously during cleaning. Connect vacuum device to downstream end of duct sections so areas being cleaned are under negative pressure.

3. Use mechanical agitation to dislodge debris adhered to interior duct surfaces without damaging integrity of metal ducts, duct liner, or duct accessories.
4. Clean fibrous-glass duct liner with HEPA vacuuming equipment; do not permit duct liner to get wet. Replace fibrous-glass duct liner that is damaged, deteriorated, or delaminated or that has friable material, mold, or fungus growth.
5. Clean coils and coil drain pans according to NADCA 1992. Keep drain pan operational. Rinse coils with clean water to remove latent residues and cleaning materials; comb and straighten fins.
6. Provide drainage and cleanup for wash-down procedures.
7. Antimicrobial Agents and Coatings: Apply EPA-registered antimicrobial agents if fungus is present. Apply antimicrobial agents according to manufacturer's written instructions after removal of surface deposits and debris.

3.8 START UP

- A. Air Balance: Comply with requirements in Section 23059 "Testing, Adjusting, and Balancing for HVAC."

3.9 DUCT SCHEDULE

- A. Fabricate ducts with galvanized sheet steel.
- B. Supply Ducts:
 1. Ducts Connected to Fan Coil Units, Furnaces, Heat Pumps, and Terminal Units:
 - a. Pressure Class: Positive 2-inch wg.
 - b. Minimum SMACNA Seal Class: C.
 - c. SMACNA Leakage Class for Rectangular: 24 .
 - d. SMACNA Leakage Class for Round and Flat Oval: 24 .
 2. Ducts Connected to Constant-Volume Air-Handling Units:
 - a. Pressure Class: Positive 3-inch wg.
 - b. Minimum SMACNA Seal Class: B.
 - c. SMACNA Leakage Class for Rectangular: 24.
 - d. SMACNA Leakage Class for Round and Flat Oval: 24.
 3. Ducts Connected to Variable-Air-Volume Air-Handling Units:
 - a. Pressure Class: Positive 4-inch wg.
 - b. Minimum SMACNA Seal Class: B.
 - c. SMACNA Leakage Class for Rectangular: 6.
 - d. SMACNA Leakage Class for Round and Flat Oval: 6.
 4. Ducts Connected to Equipment Not Listed Above:

- a. Pressure Class: Positive 4-inch wg.
- b. Minimum SMACNA Seal Class: A.
- c. SMACNA Leakage Class for Rectangular: 12.
- d. SMACNA Leakage Class for Round and Flat Oval: 12.

C. Return Ducts:

1. Ducts Connected to Fan Coil Units, Furnaces, Heat Pumps, and Terminal Units:

- a. Pressure Class: Positive or negative 2-inch wg.
- b. Minimum SMACNA Seal Class: A.
- c. SMACNA Leakage Class for Rectangular: 24.
- d. SMACNA Leakage Class for Round and Flat Oval: 24.

2. Ducts Connected to Air-Handling Units:

- a. Pressure Class: Positive or negative 3-inch wg.
- b. Minimum SMACNA Seal Class: A.
- c. SMACNA Leakage Class for Rectangular: 24.
- d. SMACNA Leakage Class for Round and Flat Oval: 24.

3. Ducts Connected to Equipment Not Listed Above:

- a. Pressure Class: Positive or negative 4-inch wg.
- b. Minimum SMACNA Seal Class: A.
- c. SMACNA Leakage Class for Rectangular: 12.
- d. SMACNA Leakage Class for Round and Flat Oval: 12.

D. Exhaust Ducts:

1. Ducts Connected to Fans Exhausting (ASHRAE 62.1, Class 1 and 2) Air:

- a. Pressure Class: Negative 3-inch wg.
- b. Minimum SMACNA Seal Class: A if negative pressure, and A if positive pressure.
- c. SMACNA Leakage Class for Rectangular: 24.
- d. SMACNA Leakage Class for Round and Flat Oval: 24.

2. Ducts Connected to Air-Handling Units:

- a. Pressure Class: Positive or negative 3-inch wg.
- b. Minimum SMACNA Seal Class: A if negative pressure, and A if positive pressure.
- c. SMACNA Leakage Class for Rectangular: 24.
- d. SMACNA Leakage Class for Round and Flat Oval: 24.

3. Ducts Connected to Commercial Kitchen Hoods: Comply with NFPA 96.

- a. Exposed to View: Type 304, stainless-steel sheet, No. 3 finish.

- b. Concealed: Type 304, stainless-steel sheet, No. 2D finish.
 - c. Welded seams and joints.
 - d. Pressure Class: Positive or negative 4-inch wg.
 - e. Minimum SMACNA Seal Class: Welded seams, joints, and penetrations.
 - f. SMACNA Leakage Class: 3.
4. Ducts Connected to Dishwasher Hoods:
- a. Type 304, stainless-steel sheet.
 - b. Exposed to View: No. 3 finish.
 - c. Concealed: No. 2D finish.
 - d. Welded seams and flanged joints with watertight EPDM gaskets.
 - e. Pressure Class: Positive or negative 3-inch wg.
 - f. Minimum SMACNA Seal Class: Welded seams, joints, and penetrations.
 - g. SMACNA Leakage Class: 3.
5. Ducts Connected to Fans Exhausting Laboratory and Process (ASHRAE 62.1, Class 3 and 4) Air:
- a. Type 304, stainless-steel sheet.
 - 1) Exposed to View: No. 3 finish.
 - 2) Concealed: No. 2D finish.
 - b. PVC-coated, galvanized sheet steel with thicker coating on duct interior.
 - c. Pressure Class: Positive or negative 6-inch wg.
 - d. Minimum SMACNA Seal Class: A Welded seams, joints, and penetrations.
 - e. SMACNA Leakage Class: 3.
6. Ducts Connected to Equipment Not Listed Above:
- a. Pressure Class: Positive or negative 4-inch wg.
 - b. Minimum SMACNA Seal Class: A if negative pressure, and A if positive pressure.
 - c. SMACNA Leakage Class for Rectangular: 24.
 - d. SMACNA Leakage Class for Round and Flat Oval: 24.
- E. Outdoor-Air (Not Filtered, Heated, or Cooled) Ducts:
1. Ducts Connected to Fan Coil Units, Furnaces, Heat Pumps, and Terminal Units:
- a. Pressure Class: Positive or negative 2-inch wg.
 - b. Minimum SMACNA Seal Class: A.
 - c. SMACNA Leakage Class for Rectangular: 24.
 - d. SMACNA Leakage Class for Round and Flat Oval: 24.
2. Ducts Connected to Air-Handling Units:
- a. Pressure Class: Positive or negative 3-inch wg.

- b. Minimum SMACNA Seal Class: A.
 - c. SMACNA Leakage Class for Rectangular: 24.
 - d. SMACNA Leakage Class for Round and Flat Oval: 24.
 - 3. Ducts Connected to Equipment Not Listed Above:
 - a. Pressure Class: Positive or negative 4-inch wg.
 - b. Minimum SMACNA Seal Class: A.
 - c. SMACNA Leakage Class for Rectangular: 12.
 - d. SMACNA Leakage Class for Round and Flat Oval: 12.
- F. Intermediate Reinforcement:
 - 1. Galvanized-Steel Ducts: Galvanized steel or carbon steel coated with zinc-chromate primer.
 - 2. PVC-Coated Ducts:
 - a. Exposed to Airstream: Match duct material.
 - b. Not Exposed to Airstream: Match duct material.
 - 3. Stainless-Steel Ducts:
 - a. Exposed to Airstream: Match duct material.
 - b. Not Exposed to Airstream: Match duct material.
 - 4. Aluminum Ducts: Aluminum.
- G. Elbow Configuration:
 - 1. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-2, "Rectangular Elbows."
 - a. Velocity 1000 fpm or Lower:
 - 1) Radius Type RE 1 with minimum 0.5 radius-to-diameter ratio.
 - 2) Mitered Type RE 4 without vanes.
 - b. Velocity 1000 to 1500 fpm:
 - 1) Radius Type RE 1 with minimum 1.0 radius-to-diameter ratio.
 - 2) Radius Type RE 3 with minimum 0.5 radius-to-diameter ratio and two vanes.
 - 3) Mitered Type RE 2 with vanes complying with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-3, "Vanes and Vane Runners," and Figure 4-4, "Vane Support in Elbows."
 - c. Velocity 1500 fpm or Higher:
 - 1) Radius Type RE 1 with minimum 1.5 radius-to-diameter ratio.
 - 2) Radius Type RE 3 with minimum 1.0 radius-to-diameter ratio and two vanes.

- 3) Mitered Type RE 2 with vanes complying with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-3, "Vanes and Vane Runners," and Figure 4-4, "Vane Support in Elbows."
 2. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-2, "Rectangular Elbows."
 - a. Radius Type RE 1 with minimum 1.5 radius-to-diameter ratio.
 - b. Radius Type RE 3 with minimum 1.0 radius-to-diameter ratio and two vanes.
 - c. Mitered Type RE 2 with vanes complying with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-3, "Vanes and Vane Runners," and Figure 4-4, "Vane Support in Elbows."
 3. Round Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-4, "Round Duct Elbows."
 - a. Minimum Radius-to-Diameter Ratio and Elbow Segments: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Table 3-1, "Mitered Elbows." Elbows with less than 90-degree change of direction have proportionately fewer segments.
 - 1) Velocity 1000 fpm or Lower: 0.5 radius-to-diameter ratio and three segments for 90-degree elbow.
 - 2) Velocity 1000 to 1500 fpm: 1.0 radius-to-diameter ratio and four segments for 90-degree elbow.
 - 3) Velocity 1500 fpm or Higher: 1.5 radius-to-diameter ratio and five segments for 90-degree elbow.
 - b. Round Elbows, 12 Inches and Smaller in Diameter: Stamped or pleated.
 - c. Round Elbows, 14 Inches and Larger in Diameter: Standing seam.
- H. Branch Configuration:
 1. Rectangular Duct: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 4-6, "Branch Connection."
 - a. Rectangular Main to Rectangular Branch: 45-degree entry.
 - b. Rectangular Main to Round Branch: Spin in.
 2. Round: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible," Figure 3-5, "90 Degree Tees and Laterals," and Figure 3-6, "Conical Tees." Saddle taps are permitted in existing duct.
 - a. Velocity 1000 fpm or Lower: 90-degree tap.
 - b. Velocity 1000 to 1500 fpm: Conical tap.
 - c. Velocity 1500 fpm or Higher: 45-degree lateral.

END OF SECTION 233113

SECTION 233300
AIR DUCT ACCESSORIES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Backdraft and pressure relief dampers.
2. Manual volume dampers.
3. Control dampers.
4. Fire dampers.
5. Smoke dampers.
6. Flange connectors.
7. Turning vanes.
8. Duct-mounted access doors.
9. Flexible ducts.
10. Duct accessory hardware.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product.

B. Shop Drawings: For duct accessories. Include plans, elevations, sections, details and attachments to other work.

1. Detail duct accessories fabrication and installation in ducts and other construction. Include dimensions, weights, loads, and required clearances; and method of field assembly into duct systems and other construction. Include the following:
 - a. Special fittings.
 - b. Manual volume damper installations.
 - c. Control-damper installations.
 - d. Fire-damper and smoke-damper installations, including sleeves; and duct-mounted access doors.
 - e. Wiring Diagrams: For power, signal, and control wiring.

1.3 CLOSEOUT SUBMITTALS

A. Operation and maintenance data.

PART 2 - PRODUCTS

2.1 ASSEMBLY DESCRIPTION

- A. Comply with NFPA 90A, "Installation of Air Conditioning and Ventilating Systems," and with NFPA 90B, "Installation of Warm Air Heating and Air Conditioning Systems."
- B. Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for acceptable materials, material thicknesses, and duct construction methods unless otherwise indicated. Sheet metal materials shall be free of pitting, seam marks, roller marks, stains, discolorations, and other imperfections.

2.2 MATERIALS

- A. Galvanized Sheet Steel: Comply with ASTM A 653/A 653M.
 - 1. Galvanized Coating Designation: G90.
 - 2. Exposed-Surface Finish: Mill phosphatized.
- B. Stainless-Steel Sheets: Comply with ASTM A 480/A 480M, Type 304, and having a No. 2 finish for concealed ducts and finish for exposed ducts.
- C. Aluminum Sheets: Comply with ASTM B 209, Alloy 3003, Temper H14; with mill finish for concealed ducts and standard, 1-side bright finish for exposed ducts.
- D. Extruded Aluminum: Comply with ASTM B 221, Alloy 6063, Temper T6.
- E. Reinforcement Shapes and Plates: Galvanized-steel reinforcement where installed on galvanized sheet metal ducts; compatible materials for aluminum and stainless-steel ducts.
- F. Tie Rods: Galvanized steel, 1/4-inch minimum diameter for lengths 36 inches or less; 3/8-inch minimum diameter for lengths longer than 36 inches.

2.3 BACKDRAFT AND PRESSURE RELIEF DAMPERS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1. Air Balance Inc.; a division of Mestek, Inc.
 - 2. American Warming and Ventilating; a division of Mestek, Inc.
 - 3. Cesco Products; a division of Mestek, Inc.
 - 4. Greenheck Fan Corporation.
 - 5. Lloyd Industries, Inc.
 - 6. Nailor Industries Inc.
 - 7. NCA Manufacturing, Inc.

8. Pottorff.
 9. Ruskin Company.
 10. Vent Products Company, Inc.
- B. Description: Gravity balanced.
- C. Maximum Air Velocity: 1000 fpm.
- D. Maximum System Pressure: 3-inch wg.
- E. Frame: Hat-shaped, 0.05-inch- thick stainless steel, with welded corners or mechanically attached and mounting flange.
- F. Blades: Multiple single-piece blades, off-center pivoted, maximum 6-inch width, 0.050-inch- thick aluminum sheet with sealed edges.
- G. Blade Action: Parallel.
- H. Blade Seals: Neoprene, mechanically locked.
- I. Blade Axles:
1. Material: Stainless steel.
 2. Diameter: 0.20 inch.
- J. Tie Bars and Brackets: Aluminum.
- K. Return Spring: Adjustable tension.
- L. Bearings: Steel ball or synthetic pivot bushings.
- M. Accessories:
1. Adjustment device to permit setting for varying differential static pressure.
 2. Counterweights and spring-assist kits for vertical airflow installations.
 3. Electric actuators.
 4. Chain pulls.
 5. Screen Mounting: Front mounted in sleeve.
 - a. Sleeve Thickness: 20 gage minimum.
 - b. Sleeve Length: 6 inches minimum.
 6. Screen Material: Aluminum.
 7. Screen Type: Insect.
 8. 90-degree stops.

2.4 MANUAL VOLUME DAMPERS

- A. Standard, Steel, Manual Volume Dampers:

1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Air Balance Inc.; a division of Mestek, Inc.
 - b. American Warming and Ventilating; a division of Mestek, Inc.
 - c. Flexmaster U.S.A., Inc.
 - d. McGill AirFlow LLC.
 - e. Nailor Industries Inc.
 - f. Pottorff.
 - g. Ruskin Company.
 - h. Trox USA Inc.
 - i. Vent Products Company, Inc.
 2. Standard leakage rating, with linkage outside airstream.
 3. Suitable for horizontal or vertical applications.
 4. Frames:
 - a. Frame: Hat-shaped, 0.05-inch- thick stainless steel.
 - b. Mitered and welded corners.
 - c. Flanges for attaching to walls and flangeless frames for installing in ducts.
 5. Blades:
 - a. Multiple or single blade.
 - b. Parallel- or opposed-blade design.
 - c. Stiffen damper blades for stability.
 - d. Stainless-steel, 0.064 inch thick.
 6. Blade Axles: Stainless steel.
 7. Bearings:
 - a. Molded synthetic
 - b. Dampers in ducts with pressure classes of 3-inch wg or less shall have axles full length of damper blades and bearings at both ends of operating shaft.
 8. Tie Bars and Brackets: Galvanized steel.
- B. Standard, Aluminum, Manual Volume Dampers:
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Air Balance Inc.; a division of Mestek, Inc.
 - b. American Warming and Ventilating; a division of Mestek, Inc.
 - c. McGill AirFlow LLC.

- d. Nailor Industries Inc.
 - e. Pottorff.
 - f. Ruskin Company.
 - g. Trox USA Inc.
 - h. Vent Products Company, Inc.
 - 2. Standard leakage rating, with linkage outside airstream.
 - 3. Suitable for horizontal or vertical applications.
 - 4. Frames: Hat-shaped, 0.10-inch- thick, aluminum sheet channels; frames with flanges for attaching to walls and flangeless frames for installing in ducts.
 - 5. Blades:
 - a. Multiple or single blade.
 - b. Parallel- or opposed-blade design.
 - c. Stiffen damper blades for stability.
 - d. Roll-Formed Aluminum Blades: 0.10-inch- thick aluminum sheet.
 - 6. Blade Axles: Stainless steel.
 - 7. Bearings:
 - a. Molded synthetic.
 - b. Dampers in ducts with pressure classes of 3-inch wg or less shall have axles full length of damper blades and bearings at both ends of operating shaft.
 - 8. Tie Bars and Brackets: Aluminum.
- C. Jackshaft:
- 1. Size: 1-inch diameter.
 - 2. Material: Galvanized-steel pipe rotating within pipe-bearing assembly mounted on supports at each mullion and at each end of multiple-damper assemblies.
 - 3. Length and Number of Mountings: As required to connect linkage of each damper in multiple-damper assembly.
- D. Damper Hardware:
- 1. Zinc-plated, die-cast core with dial and handle made of 3/32-inch- thick zinc-plated steel, and a 3/4-inch hexagon locking nut.
 - 2. Include center hole to suit damper operating-rod size.
 - 3. Include elevated platform for insulated duct mounting.

2.5 CONTROL DAMPERS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

1. American Warming and Ventilating; a division of Mestek, Inc.
2. Arrow United Industries; a division of Mestek, Inc.
3. Cesco Products; a division of Mestek, Inc.
4. Greenheck Fan Corporation.
5. Lloyd Industries, Inc.
6. McGill AirFlow LLC.
7. Metal Form Manufacturing, Inc.
8. Nailor Industries Inc.
9. NCA Manufacturing, Inc.
10. Pottorff.
11. Ruskin Company.
12. Vent Products Company, Inc.
13. Young Regulator Company.

B. Frames:

1. Angle shaped.
2. 0.05-inch- thick stainless steel.
3. Interlocking, gusseted corners.

C. Blades:

1. Multiple blade with maximum blade width of 8 inches.
2. Parallel-blade design.
3. Stainless steel.
4. 0.064 inch thick single skin or 0.0747-inch- thick dual skin.
5. Blade Edging: Closed-cell neoprene.
6. Blade Edging: Inflatable seal blade edging, or replaceable rubber seals.

D. Blade Axles: 1/2-inch- diameter; stainless steel; blade-linkage hardware of zinc-plated steel and brass; ends sealed against blade bearings.

1. Operating Temperature Range: From minus 40 to plus 200 deg F.

E. Bearings:

1. Molded synthetic.
2. Dampers in ducts with pressure classes of 3-inch wg or less shall have axles full length of damper blades and bearings at both ends of operating shaft.
3. Thrust bearings at each end of every blade.

2.6 FIRE DAMPERS

A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:

1. Air Balance Inc.; a division of Mestek, Inc.

2. Arrow United Industries; a division of Mestek, Inc.
 3. Cesco Products; a division of Mestek, Inc.
 4. Greenheck Fan Corporation.
 5. Nailor Industries Inc.
 6. NCA Manufacturing, Inc.
 7. Pottorff.
 8. Prefco; Perfect Air Control, Inc.
 9. Ruskin Company.
 10. Vent Products Company, Inc.
 11. Ward Industries, Inc.; a division of Hart & Cooley, Inc.
- B. Type: Dynamic; rated and labeled according to UL 555 by an NRTL.
- C. Closing rating in ducts up to 4-inch wg static pressure class and minimum 2000-fpm velocity.
- D. Fire Rating: 1-1/2 hours.
- E. Frame: Curtain type with blades outside airstream except when located behind grille where blades may be inside airstream; fabricated with roll-formed, 0.034-inch- thick galvanized steel; with mitered and interlocking corners.
- F. Mounting Sleeve: Factory- or field-installed, galvanized sheet steel.
1. Minimum Thickness: 0.138 inch or 0.39 inch thick, as indicated, and of length to suit application.
 2. Exception: Omit sleeve where damper-frame width permits direct attachment of perimeter mounting angles on each side of wall or floor; thickness of damper frame must comply with sleeve requirements.
- G. Mounting Orientation: Vertical or horizontal as indicated.
- H. Blades: Roll-formed, interlocking, 0.034-inch- thick, galvanized sheet steel. In place of interlocking blades, use full-length, 0.034-inch- thick, galvanized-steel blade connectors.
- I. Horizontal Dampers: Include blade lock and stainless-steel closure spring.
- J. Heat-Responsive Device: resettable link and switch package, factory installed, 165 deg F and 212 deg F rated.
- 2.7 SMOKE DAMPERS
- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
1. Air Balance Inc.; a division of Mestek, Inc.

2. Cesco Products; a division of Mestek, Inc.
 3. Greenheck Fan Corporation.
 4. Nailor Industries Inc.
 5. Pottorff.
 6. Ruskin Company.
- B. General Requirements: Label according to UL 555S by an NRTL.
- C. Smoke Detector: Integral, factory wired for single-point connection.
- D. Frame: Hat-shaped, 0.094-inch- thick, galvanized sheet steel, with interlocking, gusseted or mechanically attached corners.
- E. Blades: Roll-formed, horizontal, overlapping, 0.063-inch-thick, galvanized sheet steel.
- F. Leakage: Class II.
- G. Rated pressure and velocity to exceed design airflow conditions.
- H. Mounting Sleeve: Factory-installed, 0.05-inch-thick, galvanized sheet steel; length to suit wall or floor application with factory-furnished silicone calking.
- I. Damper Motors: Modulating or two-position action.
- J. Comply with NEMA designation, temperature rating, service factor, and enclosure type.
1. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
 2. Permanent-Split-Capacitor or Shaded-Pole Motors: With oil-immersed and sealed gear trains.
 3. Spring-Return Motors: Equip with an integral spiral-spring mechanism where indicated. Enclose entire spring mechanism in a removable housing designed for service or adjustments. Size for running torque rating of 150 in. x lbf and breakaway torque rating of 150 in. x lbf.
 4. Outdoor Motors and Motors in Outdoor-Air Intakes: Equip with O-ring gaskets designed to make motors weatherproof. Equip motors with internal heaters to permit normal operation at minus 40 deg F.
 5. Nonspring-Return Motors: For dampers larger than 25 sq. ft., size motor for running torque rating of 150 in. x lbf and breakaway torque rating of 300 in. x lbf.
 6. Electrical Connection: 115 V, single phase, 60 Hz.
- K. Accessories:
1. Auxiliary switches for fan control or position indication.
 2. Test and reset switches, remote mounted.

2.8 FLANGE CONNECTORS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1. Ductmate Industries, Inc.
 - 2. Nexus PDQ; Division of Shilco Holdings Inc.
 - 3. Ward Industries, Inc.; a division of Hart & Cooley, Inc.
- B. Description: Add-on or roll-formed, factory-fabricated, slide-on transverse flange connectors, gaskets, and components.
- C. Material: Galvanized steel.
- D. Gage and Shape: Match connecting ductwork.

2.9 TURNING VANES

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1. Ductmate Industries, Inc.
 - 2. Duro Dyne Inc.
 - 3. Elgen Manufacturing.
 - 4. METALAIRE, Inc.
 - 5. SEMCO Incorporated.
 - 6. Ward Industries, Inc.; a division of Hart & Cooley, Inc.
- B. Manufactured Turning Vanes for Metal Ducts: Curved blades of galvanized sheet steel; support with bars perpendicular to blades set; set into vane runners suitable for duct mounting.
 - 1. Acoustic Turning Vanes: Fabricate airfoil-shaped aluminum extrusions with perforated faces and fibrous-glass fill.
- C. Manufactured Turning Vanes for Nonmetal Ducts: Fabricate curved blades of resin-bonded fiberglass with acrylic polymer coating; support with bars perpendicular to blades set; set into vane runners suitable for duct mounting.
- D. General Requirements: Comply with SMACNA's "HVAC Duct Construction Standards - Metal and Flexible"; Figures 4-3, "Vaness and Vane Runners," and 4-4, "Vane Support in Elbows."
- E. Vane Construction: Double wall.

2.10 DUCT-MOUNTED ACCESS DOORS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
1. American Warming and Ventilating; a division of Mestek, Inc.
 2. Cesco Products; a division of Mestek, Inc.
 3. Ductmate Industries, Inc.
 4. Elgen Manufacturing.
 5. Flexmaster U.S.A., Inc.
 6. Greenheck Fan Corporation.
 7. McGill AirFlow LLC.
 8. Nailor Industries Inc.
 9. Pottorff.
 10. Ventfabrics, Inc.
 11. Ward Industries, Inc.; a division of Hart & Cooley, Inc.
- B. Duct-Mounted Access Doors: Fabricate access panels according to SMACNA's "HVAC Duct Construction Standards - Metal and Flexible"; Figures 7-2, "Duct Access Doors and Panels," and 7-3, "Access Doors - Round Duct."
1. Door:
 - a. Double wall, rectangular.
 - b. Galvanized sheet metal with insulation fill and thickness as indicated for duct pressure class.
 - c. Vision panel.
 - d. Hinges and Latches: 1-by-1-inch butt or piano hinge and cam latches.
 - e. Fabricate doors airtight and suitable for duct pressure class.
 2. Frame: Galvanized sheet steel, with bend-over tabs and foam gaskets.
 3. Number of Hinges and Locks:
 - a. Access Doors Less Than 12 Inches Square: No hinges and two sash locks.
 - b. Access Doors up to 18 Inches Square: Continuous and two sash locks.
 - c. Access Doors up to 24 by 48 Inches: Continuous and two compression latches.
 - d. Access Doors Larger Than 24 by 48 Inches: Four hinges and two compression latches with outside and inside handles.
- C. Pressure Relief Access Door:
1. Door and Frame Material: Galvanized sheet steel.
 2. Door: Double wall with insulation fill with metal thickness applicable for duct pressure class.
 3. Operation: Open outward for positive-pressure ducts and inward for negative-pressure ducts.
 4. Factory set at 10-inch wg.

5. Doors close when pressures are within set-point range.
6. Hinge: Continuous piano.
7. Latches: Cam.
8. Seal: Neoprene or foam rubber.
9. Insulation Fill: 1-inch- thick, fibrous-glass or polystyrene-foam board.

2.11 FLEXIBLE DUCTS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 1. Flexmaster U.S.A., Inc.
 2. McGill AirFlow LLC.
 3. Ward Industries, Inc.; a division of Hart & Cooley, Inc.
- B. Insulated, Flexible Duct: UL 181, Class 1, aluminum laminate and polyester film with latex adhesive supported by helically wound, spring-steel wire; fibrous-glass insulation; aluminized vapor-barrier film.
 1. Pressure Rating: 10-inch wg positive and 1.0-inch wg negative.
 2. Maximum Air Velocity: 4000 fpm.
 3. Temperature Range: Minus 20 to plus 210 deg F.
 4. Insulation R-value: Comply with ASHRAE/IESNA 90.1.
- C. Flexible Duct Connectors:
 1. Clamps: Stainless-steel band with cadmium-plated hex screw to tighten band with a worm-gear action in sizes 3 through 18 inches, to suit duct size.
 2. Non-Clamp Connectors: Adhesive plus sheet metal screws.

2.12 DUCT ACCESSORY HARDWARE

- A. Instrument Test Holes: Cast iron or cast aluminum to suit duct material, including screw cap and gasket. Size to allow insertion of pitot tube and other testing instruments and of length to suit duct-insulation thickness.
- B. Adhesives: High strength, quick setting, neoprene based, waterproof, and resistant to gasoline and grease.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Install duct accessories according to applicable details in SMACNA's "HVAC Duct Construction Standards - Metal and Flexible" for metal ducts and in NAIMA AH116, "Fibrous Glass Duct Construction Standards," for fibrous-glass ducts.
- B. Install duct accessories of materials suited to duct materials; use galvanized-steel accessories in galvanized-steel and fibrous-glass ducts, stainless-steel accessories in stainless-steel ducts, and aluminum accessories in aluminum ducts.
- C. Install backdraft dampers at inlet of exhaust fans or exhaust ducts as close as possible to exhaust fan unless otherwise indicated.
- D. Install volume dampers at points on supply, return, and exhaust systems where branches extend from larger ducts. Where dampers are installed in ducts having duct liner, install dampers with hat channels of same depth as liner, and terminate liner with nosing at hat channel.
 - 1. Install steel volume dampers in steel ducts.
 - 2. Install aluminum volume dampers in aluminum ducts.
- E. Set dampers to fully open position before testing, adjusting, and balancing.
- F. Install test holes at fan inlets and outlets and elsewhere as indicated.
- G. Install fire and smoke dampers according to UL listing.
- H. Install duct access doors on sides of ducts to allow for inspecting, adjusting, and maintaining accessories and equipment at the following locations:
 - 1. On both sides of duct coils.
 - 2. Upstream from duct filters.
 - 3. At outdoor-air intakes and mixed-air plenums.
 - 4. At drain pans and seals.
 - 5. Downstream from manual volume dampers, control dampers, backdraft dampers, and equipment.
 - 6. Adjacent to and close enough to fire or smoke dampers, to reset or reinstall fusible links. Access doors for access to fire or smoke dampers having fusible links shall be pressure relief access doors and shall be outward operation for access doors installed upstream from dampers and inward operation for access doors installed downstream from dampers.
 - 7. Control devices requiring inspection.
 - 8. Elsewhere as indicated.
- I. Install access doors with swing against duct static pressure.

J. Access Door Sizes:

1. One-Hand or Inspection Access: 8 by 5 inches.
2. Two-Hand Access: 12 by 6 inches.
3. Head and Hand Access: 18 by 10 inches.
4. Head and Shoulders Access: 21 by 14 inches.
5. Body Access: 25 by 14 inches.
6. Body plus Ladder Access: 25 by 17 inches.

K. Label access doors to indicate the purpose of access door.

L. Install flexible connectors to connect ducts to equipment.

M. Connect terminal units to supply ducts with maximum 12-inch lengths of flexible duct. Do not use flexible ducts to change directions.

N. Connect diffusers or light troffer boots to ducts with maximum 60-inch lengths of flexible duct clamped or strapped in place.

O. Connect flexible ducts to metal ducts with adhesive plus sheet metal screws.

P. Install duct test holes where required for testing and balancing purposes.

3.2 FIELD QUALITY CONTROL

A. Tests and Inspections:

1. Operate dampers to verify full range of movement.
2. Inspect locations of access doors and verify that purpose of access door can be performed.
3. Operate fire and smoke dampers to verify full range of movement and verify that proper heat-response device is installed.
4. Inspect turning vanes for proper and secure installation.

END OF SECTION 233300

SECTION 237313

INDOOR CENTRAL-STATION AIR-HANDLING UNITS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Constant-air-volume, single-zone air-handling units.
2. Constant-air-volume, multi-zone air-handling units.
3. Constant-air-volume, dual-duct air-handling units.

1.2 PERFORMANCE REQUIREMENTS

- ###### A. Delegated Design: Design vibration isolation details, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.

1.3 ACTION SUBMITTALS

A. Product Data: For each air-handling unit indicated.

1. Unit dimensions and weight.
2. Cabinet material, metal thickness, finishes, insulation, and accessories.
3. Fans:
 - a. Certified fan-performance curves with system operating conditions indicated.
 - b. Certified fan-sound power ratings.
 - c. Fan construction and accessories.
 - d. Motor ratings, electrical characteristics, and motor accessories.
4. Certified coil-performance ratings with system operating conditions indicated.
5. Dampers, including housings, linkages, and operators.
6. Filters with performance characteristics.

1.4 INFORMATIONAL SUBMITTALS

- ###### A. Source quality-control reports.

1.5 CLOSEOUT SUBMITTALS

- A. Operation and maintenance data.

1.6 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. NFPA Compliance: Comply with NFPA 90A for design, fabrication, and installation of air-handling units and components.
- C. Comply with NFPA 70.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1. Air Enterprises, Inc.
 - 2. Airtherm; a Mestek company.
 - 3. Buffalo Air Handling.
 - 4. Carrier Corporation; a member of the United Technologies Corporation Family.
 - 5. Coil Company, LLC.
 - 6. Dunham-Bush, Inc.
 - 7. Engineered Air.
 - 8. Mammoth Inc.
 - 9. McQuay International
 - 10. Scott Springfield Mfg. Inc.
 - 11. Trane; American Standard Inc.
 - 12. USA Coil & Air.
 - 13. YORK International Corporation.

2.2 UNIT CASINGS

- A. General Fabrication Requirements for Casings:
 - 1. Forming: Form walls, roofs, and floors with at least two breaks at each joint.
 - 2. Casing Joints: Sheet metal screws or pop rivets.
 - 3. Sealing: Seal all joints with water-resistant sealant.

4. Factory Finish for Steel and Galvanized-Steel Casings: Apply manufacturer's standard primer immediately after cleaning and pretreating.
 5. Airstream Surfaces: Surfaces in contact with the airstream shall comply with requirements in ASHRAE 62.1.
- B. Casing Insulation and Adhesive:
1. Materials: ASTM C 1071, Type I.
 2. Location and Application: Factory applied with adhesive and mechanical fasteners to the internal surface of section panels downstream from, and including, the cooling-coil section.
 - a. Liner Adhesive: Comply with ASTM C 916, Type I.
 - b. Mechanical Fasteners: Galvanized steel, suitable for adhesive attachment, mechanical attachment, or welding attachment to duct without damaging liner when applied as recommended by manufacturer and without causing leakage in cabinet.
 - c. Liner materials applied in this location shall have air-stream surface coated with a temperature-resistant coating or faced with a plain or coated fibrous mat or fabric depending on service-air velocity.
 3. Location and Application: Encased between outside and inside casing.
- C. Inspection and Access Panels and Access Doors:
1. Panel and Door Fabrication: Formed and reinforced, single- or double-wall and insulated panels of same materials and thicknesses as casing.
 2. Inspection and Access Panels:
 - a. Fasteners: Two or more camlock type for panel lift-out operation. Arrangement shall allow panels to be opened against air-pressure differential.
 - b. Gasket: Neoprene, applied around entire perimeters of panel frames.
 - c. Size: Large enough to allow inspection and maintenance of air-handling unit's internal components.
 3. Access Doors:
 - a. Hinges: A minimum of two ball-bearing hinges or stainless-steel piano hinge and two wedge-lever-type latches, operable from inside and outside. Arrange doors to be opened against air-pressure differential.
 - b. Gasket: Neoprene, applied around entire perimeters of panel frames.
 - c. Size: At least 18 inches wide by full height of unit casing up to a maximum height of 60 inches.
 4. Locations and Applications:
 - a. Fan Section: Doors and inspection and access panels.
 - b. Access Section: Doors.

- c. Coil Section: Inspection and access panel.
 - d. Damper Section: Inspection and access panels.
 - e. Filter Section: Inspection and access panels large enough to allow periodic removal and installation of filters.
 - f. Mixing Section: Doors.
 - g. Humidifier Section: Doors.
- 5. Service Light: 100-W vaporproof fixture with switched junction box located outside adjacent to door.
 - a. Locations: Each section accessed with door.
- D. Condensate Drain Pans:
 - 1. Fabricated with one percent slope in at least two planes to collect condensate from cooling coils (including coil piping connections, coil headers, and return bends) and from humidifiers and to direct water toward drain connection.
 - a. Length: Extend drain pan downstream from leaving face to comply with ASHRAE 62.1.
 - b. Depth: A minimum of 2 inches deep.
 - 2. Integral part of floor plating.
 - 3. Single-wall, galvanized-steel sheet.
 - 4. Drain Connection: Located at lowest point of pan and sized to prevent overflow. Terminate with threaded nipple on both ends of pan.
 - a. Minimum Connection Size: NPS 2.
 - 5. Pan-Top Surface Coating: Asphaltic waterproofing compound.
 - 6. Units with stacked coils shall have an intermediate drain pan to collect condensate from top coil.
- E. Service Platform: Aluminum 42 inches wide running entire length of unit and located on service access side, with angle side rails, 4-inch kick plates, and expanded metal floor. Provide platform with a fixed ladder that extends from the top of the side rail to the floor.
- F. Air-Handling-Unit Mounting Frame: Formed galvanized-steel channel or structural channel supports, designed for low deflection, welded with integral lifting lugs.
 - 1. Seismic Fabrication Requirements: Fabricate mounting base and attachment to air-handling unit sections, accessories, and components with reinforcement strong enough to withstand seismic when air-handling unit frame is anchored to building structure.

2.3 FAN, DRIVE, AND MOTOR SECTION

- A. Fan and Drive Assemblies: Statically and dynamically balanced and designed for continuous operation at maximum-rated fan speed and motor horsepower.
 - 1. Shafts: Designed for continuous operation at maximum-rated fan speed and motor horsepower, and with field-adjustable alignment.
 - a. Turned, ground, and polished hot-rolled steel with keyway. Ship with a protective coating of lubricating oil.
 - b. Designed to operate at no more than 70 percent of first critical speed at top of fan's speed range.
- B. Centrifugal Fan Housings: Formed- and reinforced-steel panels to form curved scroll housings with shaped cutoff and spun-metal inlet bell.
 - 1. Bracing: Steel angle or channel supports for mounting and supporting fan scroll, wheel, motor, and accessories.
 - 2. Horizontal-Flanged, Split Housing: Bolted construction.
 - 3. Housing for Supply Fan: Attach housing to fan-section casing with metal-edged flexible duct connector.
 - 4. Flexible Connector: Factory fabricated with a fabric strip 5-3/4 inches wide attached to 2 strips of 2-3/4-inch- wide, 0.028-inch- thick, galvanized-steel sheet or 0.032-inch- thick aluminum sheets; select metal compatible with casing.
 - a. Flexible Connector Fabric: Glass fabric, double coated with neoprene. Fabrics, coatings, and adhesives shall comply with UL 181, Class 1.
 - 1) Fabric Minimum Weight: 26 oz./sq. yd..
 - 2) Fabric Tensile Strength: 480 lbf/inch in the warp and 360 lbf/inch in the filling.
 - 3) Fabric Service Temperature: Minus 40 to plus 200 deg F.
- C. Plenum Fan Housings: Steel frame and panel; fabricated without fan scroll and volute housing.
- D. Backward-Inclined, Centrifugal Fan Wheels: Single-width-single-inlet and double-width-double-inlet construction with curved inlet flange, backplate, backward-inclined blades welded or riveted to flange and backplate; cast-iron or cast-steel hub riveted to backplate and fastened to shaft with set screws.
- E. Forward-Curved, Centrifugal Fan Wheels: Inlet flange, backplate, and shallow blades with inlet and tip curved forward in direction of airflow and mechanically fastened to flange and backplate; cast-steel hub swaged to backplate and fastened to shaft with set screws.
- F. Fan Shaft Bearings:

1. Prelubricated and Sealed, Ball Bearings: Self-aligning, pillow-block type with a rated life of 120,000 hours according to ABMA 9.
 2. Grease-Lubricated, Tapered-Roller Bearings: Self-aligning, pillow-block type with double-locking collars and 2-piece, cast-iron housing with grease lines extended to outside unit and a rated life of 120,000 hours according to ABMA 11.
 3. Grease-Lubricated Bearings: Self-aligning, pillow-block-type, ball or roller bearings with adapter mount and two-piece, cast-iron housing with grease lines extended to outside unit.
- G. Belt Drives: Factory mounted, with adjustable alignment and belt tensioning, and with 1.5 service factor based on fan motor.
1. Pulleys: Cast iron or cast steel with split, tapered bushing; dynamically balanced at factory.
 2. Motor Pulleys: Adjustable pitch for use with 5-hp motors and smaller; fixed pitch for use with motors larger than 5 hp. Select pulley size so pitch adjustment is at the middle of adjustment range at fan design conditions.
 3. Belts: Oil resistant, nonsparking, and nonstatic; in matched sets for multiple-belt drives.
 4. Belt Guards: Comply with requirements specified by OSHA and fabricate according to SMACNA's "HVAC Duct Construction Standards"; 0.1046-inch- thick, 3/4-inch diamond-mesh wire screen, welded to steel angle frame; prime coated.
- H. Internal Vibration Isolation: Fans shall be factory mounted with manufacturer's standard vibration isolation mounting devices having a minimum static deflection of 1 inch.
1. Seismic Fabrication Requirements: Fabricate fan section, internal mounting frame and attachment to fans, fan housings, motors, casings, accessories, and other fan section components with reinforcement strong enough to withstand seismic forces when fan-mounting frame and air-handling-unit mounting frame are anchored to building structure.
- I. Motor: Comply with NEMA designation, temperature rating, service factor, enclosure type.
1. Enclosure Type: Totally enclosed, fan cooled.
 2. NEMA Premium (TM) efficient motors as defined in NEMA MG 1.
 3. Motor Sizes: Minimum size as indicated. If not indicated, large enough so driven load will not require motor to operate in service factor range above 1.0.
 4. Controllers, Electrical Devices, and Wiring: Comply with requirements for electrical devices and connections specified in electrical Sections.
 5. Mount unit-mounted disconnect switches on exterior of unit.

2.4 COIL SECTION

A. General Requirements for Coil Section:

1. Comply with ARI 410.
2. Fabricate coil section to allow removal and replacement of coil for maintenance and to allow in-place access for service and maintenance of coil(s).
3. For multizone units, provide air deflectors and air baffles to balance airflow across coils.
4. Coils shall not act as structural component of unit.

B. Electrical Heating Coils, Controls, and Accessories: Comply with UL 1995.

1. Casing Assembly: Flanged type with galvanized-steel frame.
2. Sheathed Heating Elements: Coiled resistance wire of 80 percent nickel and 20 percent chromium surrounded by compacted magnesium-oxide powder in tubular-steel sheath; with spiral-wound, copper-plated, steel fins continuously brazed to sheath.
3. Open Heating Elements: Resistance wire of 80 percent nickel and 20 percent chromium supported and insulated by floating ceramic bushings recessed into casing openings, fastened to supporting brackets, and mounted in galvanized-steel frame.
4. Overtemperature Protection: Disk-type, automatically resetting, thermal-cutout, safety device; serviceable through terminal box without removing heater from coil section.
5. Secondary Protection: Load-carrying, manually resetting or manually replaceable, thermal cutouts; factory wired in series with each heater stage.
6. Control Panel: Unit mounted with disconnecting means and overcurrent protection.
 - a. Magnetic contactor.
 - b. Solid-state, stepless pulse controller.
 - c. Toggle switches, one per step.
 - d. Step controller.
 - e. Time-delay relay.
 - f. Pilot lights, one per step.
 - g. Airflow proving switch.

2.5 AIR FILTRATION SECTION

A. General Requirements for Air Filtration Section:

1. Comply with NFPA 90A.
2. Provide minimum arrestance according to ASHRAE 52.1, and a minimum efficiency reporting value (MERV) according to ASHRAE 52.2.

3. Provide filter holding frames arranged for flat or angular orientation, with access doors on both sides of unit. Filters shall be removable from one side or lifted out from access plenum.

B. Disposable Panel Filters:

1. Factory-fabricated, viscous-coated, flat-panel type.
2. Thickness: 2 inches.
3. Arrestance (ASHRAE 52.1): 80.
4. Merv (ASHRAE 52.2): 5.
5. Media: Interlaced glass fibers sprayed with nonflammable adhesive.
6. Frame: Galvanized steel, with metal grid on outlet side, steel rod grid on inlet side, hinged, and with pull and retaining handles.

C. Extended-Surface, Disposable Panel Filters:

1. Factory-fabricated, dry, extended-surface type.
2. Thickness: 2 inches.
3. Arrestance (ASHRAE 52.1): 90.
4. Merv (ASHRAE 52.2): 7.
5. Media: Fibrous material formed into deep-V-shaped pleats and held by self-supporting wire grid.
6. Media-Grid Frame: Fire-retardant, 3/4-inch particleboard with gaskets.
7. Mounting Frames: Welded, galvanized steel, with gaskets and fasteners, suitable for bolting together into built-up filter banks.

D. Filter Gage:

1. 2-inch-diameter, diaphragm-actuated dial in metal case.
2. Vent valves.
3. Black figures on white background.
4. Front recalibration adjustment.
5. 2 percent of full-scale accuracy.
6. Range: 0- to 4.0-inch wg.
7. Accessories: Static-pressure tips with integral compression fittings, 1/4-inch aluminum tubing, and 2- or 3-way vent valves.

2.6 DAMPERS

- A. General Requirements for Dampers: Leakage rate, according to AMCA 500, "Laboratory Methods for Testing Dampers for Rating," shall not exceed 2 percent of air quantity at 2000-fpm face velocity through damper and 4-inch wg pressure differential.

B. Electronic Damper Operators:

1. Direct-coupled type designed for minimum 60,000 full-stroke cycles at rated torque.

2. Electronic damper position indicator shall have visual scale indicating percent of travel and 2- to 10-V dc, feedback signal.
3. Operator Motors:
 - a. Comply with NEMA designation, temperature rating, service factor, enclosure type.
 - b. Size to operate with sufficient reserve power to provide smooth modulating action or two-position action.
 - c. Permanent Split-Capacitor or Shaded-Pole Type: Gear trains completely oil immersed and sealed. Equip spring-return motors with integral spiral-spring mechanism in housings designed for easy removal for service or adjustment of limit switches, auxiliary switches, or feedback potentiometer.
4. Nonspring-Return Motors for Dampers Larger Than 25 Sq. Ft.: Size for running torque of 150 in. x lbf and breakaway torque of 300 in. x lbf.
5. Spring-Return Motors for Dampers Larger Than 25 Sq. Ft.: Size for running and breakaway torque of 150 in. x lbf.
6. Size dampers for running torque calculated as follows:
 - a. Parallel-Blade Damper with Edge Seals: 7 inch-lb/sq. ft. of damper.
 - b. Opposed-Blade Damper with Edge Seals: 5 inch-lb/sq. ft. of damper.
 - c. Parallel-Blade Damper without Edge Seals: 4 inch-lb/sq. ft. of damper.
 - d. Opposed-Blade Damper without Edge Seals: 3 inch-lb/sq. ft. of damper.
 - e. Dampers with 2- to 3-Inch wg of Pressure Drop or Face Velocities of 1000 to 2500 fpm: Increase running torque by 1.5.
 - f. Dampers with 3- to 4-Inch wg of Pressure Drop or Face Velocities of 2500 to 3000 fpm: Increase running torque by 2.0.
7. Coupling: V-bolt and V-shaped, toothed cradle.
8. Overload Protection: Electronic overload or digital rotation-sensing circuitry.
9. Fail-Safe Operation: Mechanical, spring-return mechanism with external, manual gear release on nonspring-return actuators.
10. Power Requirements (Two-Position Spring Return): 230-V ac.
11. Power Requirements (Modulating): Maximum 10 VA at 24-V ac or 8 W at 24-V dc.
12. Proportional Signal: 2- to 10-V dc or 4 to 20 mA, and 2- to 10-V dc position feedback signal.
13. Temperature Rating: Minus 22 to plus 122 deg F.
14. Run Time: 12 seconds open, 5 seconds closed.

C. Pneumatic Damper Operators:

1. Rolling-diaphragm piston type with adjustable stops and spring return, sized to operate with sufficient reserve power to provide smooth modulating action or two-position action. Where actuators operate in sequence, provide pilot positioners.

2. Pneumatic Damper Position Indicator: Potentiometer mounted in enclosure with adjustable crank-arm assembly connected to damper to transmit 0 to 100 percent valve/damper travel.
 3. Pilot Positioners:
 - a. Start Point: Adjustable from 2 to 12 psig.
 - b. Operating Span: Adjustable from 5 to 13 psig.
 - c. Linearity: Plus or minus 10 percent of output signal span.
 - d. Hysteresis: 3 percent of span.
 - e. Response: 0.25-psig input change.
 - f. Maximum Pilot Signal Pressure: 20 psig.
 - g. Maximum Control Air-Supply Pressure: 60 psig.
 4. Actuator Housing: Molded or die-cast zinc or aluminum. Terminal unit actuators may be high-impact plastic with ambient temperature rating of 50 to 140 deg F unless located in return-air plenums.
 5. Inlet-Vane Operators: High pressure, with pilot positioners.
- D. Zone Dampers: Two single-blade, extruded-aluminum dampers offset 90 degrees from each other on cadmium-plated steel operating rod rotating in sintered bronze or nylon bearings mounted in a single aluminum frame. Provide blade gaskets and edge seals, and mechanically fasten blades to operating rod.
- E. Face-and-Bypass Dampers: Opposed-blade, extruded-aluminum dampers with cadmium-plated steel operating rods rotating in sintered bronze or nylon bearings mounted in a single aluminum frame and with operating rods connected with a common linkage. Provide blade gaskets and edge seals, and mechanically fasten blades to operating rod.
- F. Outdoor- and Return-Air Mixing Dampers: Parallel-blade, extruded-aluminum dampers mechanically fastened to cadmium-plated steel operating rod in reinforced cabinet. Connect operating rods with common linkage and interconnect linkages so dampers operate simultaneously.
- G. Mixing Section: Multiple-blade, air-mixer assembly located immediately downstream of mixing section.
- H. Combination Filter and Mixing Section:
1. Cabinet support members shall hold 2-inch- thick, pleated, flat, permanent or throwaway filters.
 2. Multiple-blade, air-mixer assembly shall mix air to prevent stratification, located immediately downstream of mixing box.
- 2.7 SOURCE QUALITY CONTROL
- A. Fan Sound-Power Level Ratings: Comply with AMCA 301, "Methods for Calculating Fan Sound Ratings from Laboratory Test Data." Test fans according to AMCA 300,

"Reverberant Room Method for Sound Testing of Fans." Fans shall bear AMCA-certified sound ratings seal.

- B. Fan Performance Rating: Factory test fan performance for airflow, pressure, power, air density, rotation speed, and efficiency. Rate performance according to AMCA 210, "Laboratory Methods of Testing Fans for Aerodynamic Performance Rating."
- C. Water Coils: Factory tested to 300 psig according to ARI 410 and ASHRAE 33.
- D. Refrigerant Coils: Factory tested to 450 psig according to ARI 410 and ASHRAE 33.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Equipment Mounting:
 - 1. Install air-handling units on cast-in-place concrete equipment bases.
- B. Suspended Units: Suspend and brace units from structural-steel support frame using threaded steel rods and spring hangers.
- C. Arrange installation of units to provide access space around air-handling units for service and maintenance.
- D. Do not operate fan system until filters (temporary or permanent) are in place. Replace temporary filters used during construction and testing, with new, clean filters.
- E. Install filter-gage, static-pressure taps upstream and downstream of filters. Mount filter gages on outside of filter housing or filter plenum in accessible position. Provide filter gages on filter banks, installed with separate static-pressure taps upstream and downstream of filters.
- F. Comply with requirements for piping specified in other Sections. Drawings indicate general arrangement of piping, fittings, and specialties.
- G. Install piping adjacent to air-handling unit to allow service and maintenance.
- H. Connect piping to air-handling units mounted on vibration isolators with flexible connectors.
- I. Connect condensate drain pans using NPS 1-1/4, ASTM B 88, Type M copper tubing. Extend to nearest equipment or floor drain. Construct deep trap at connection to drain pan and install cleanouts at changes in direction.
- J. Refrigerant Piping: Install shutoff valve and union or flange at each supply and return connection.

END OF SECTION 237313

***DIVISION* 26**

ELECTRICAL

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
Website: dammonengineering.com



SECTION 260500

COMMON WORK RESULTS FOR ELECTRICAL

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 01 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. Section Includes:
 - 1. Electrical equipment coordination and installation.
 - 2. Sleeves for raceways and cables.
 - 3. Sleeve seals.
 - 4. Grout.
 - 5. Common electrical installation requirements.

1.3 DEFINITIONS

- A. EPDM: Ethylene-propylene-diene terpolymer rubber.
- B. NBR: Acrylonitrile-butadiene rubber.

1.4 SUBMITTALS

- A. Product Data: For sleeve seals.

1.5 COORDINATION

- A. Coordinate arrangement, mounting, and support of electrical equipment:
 - 1. To allow maximum possible headroom unless specific mounting heights that reduce headroom are indicated.
 - 2. To provide for ease of disconnecting the equipment with minimum interference to other installations.
 - 3. To allow right of way for piping and conduit installed at required slope.
 - 4. So connecting raceways, cables, wireways, cable trays, and busways will be clear of obstructions and of the working and access space of other equipment.

- B. Coordinate installation of required supporting devices and set sleeves in cast-in-place concrete, masonry walls, and other structural components as they are constructed.
- C. Coordinate location of access panels and doors for electrical items that are behind finished surfaces or otherwise concealed.
- D. Coordinate sleeve selection and application with selection and application of firestopping specified in Division 07 Section "Penetration Firestopping."

PART 2 - PRODUCTS

2.1 SLEEVES FOR RACEWAYS AND CABLES

- A. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, galvanized steel, plain ends.
- B. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop, unless otherwise indicated.
- C. Sleeves for Rectangular Openings: Galvanized sheet steel.
 - 1. Minimum Metal Thickness:
 - a. For sleeve cross-section rectangle perimeter less than 50 inches and no side more than 16 inches, thickness shall be 0.052 inch.
 - b. For sleeve cross-section rectangle perimeter equal to, or more than, 50 inches and 1 or more sides equal to, or more than, 16 inches, thickness shall be 0.138 inch.

2.2 SLEEVE SEALS

- A. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and raceway or cable.
 - 1. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Advance Products & Systems, Inc.
 - b. Calpico, Inc.
 - c. Metraflex Co.
 - d. Pipeline Seal and Insulator, Inc.

3. Sealing Elements: EPDM or NBR interlocking links shaped to fit surface of cable or conduit. Include type and number required for material and size of raceway or cable.
4. Pressure Plates: Plastic, Carbon steel or Stainless steel. Include two for each sealing element.
5. Connecting Bolts and Nuts: Carbon steel with corrosion-resistant coating or Stainless steel of length required to secure pressure plates to sealing elements. Include one for each sealing element.

2.3 GROUT

- A. Nonmetallic, Shrinkage-Resistant Grout: ASTM C 1107, factory-packaged, nonmetallic aggregate grout, noncorrosive, nonstaining, mixed with water to consistency suitable for application and a 30-minute working time.

PART 3 - EXECUTION

3.1 COMMON REQUIREMENTS FOR ELECTRICAL INSTALLATION

- A. Comply with the National Electrical Code 2011 and the National Electrical Contractors Association (NECA) 1-2006.
- B. Measure indicated mounting heights to bottom of unit for suspended items and to center of unit for wall-mounting items.
- C. Headroom Maintenance: If mounting heights or other location criteria are not indicated, arrange and install components and equipment to provide maximum possible headroom consistent with these requirements.
- D. Equipment: Install to facilitate service, maintenance, and repair or replacement of components of both electrical equipment and other nearby installations. Connect in such a way as to facilitate future disconnecting with minimum interference with other items in the vicinity.
- E. Right of Way: Give to piping systems installed at a required slope.

3.2 SLEEVE INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Electrical penetrations occur when raceways, cables, wireways, cable trays, or busways penetrate concrete slabs, concrete or masonry walls, or fire-rated floor and wall assemblies.
- B. Concrete Slabs and Walls: Install sleeves for penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of slabs and walls.

- C. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
 - D. Fire-Rated Assemblies: Install sleeves for penetrations of fire-rated floor and wall assemblies unless openings compatible with firestop system used are fabricated during construction of floor or wall.
 - E. Cut sleeves to length for mounting flush with both surfaces of walls.
 - F. Extend sleeves installed in floors 2 inches above finished floor level.
 - G. Size pipe sleeves to provide 1/4-inch annular clear space between sleeve and raceway or cable, unless indicated otherwise.
 - H. Seal space outside of sleeves with grout for penetrations of concrete and masonry
 - 1. Promptly pack grout solidly between sleeve and wall so no voids remain. Tool exposed surfaces smooth; protect grout while curing.
 - I. Interior Penetrations of Non-Fire-Rated Walls and Floors: Seal annular space between sleeve and raceway or cable, using joint sealant appropriate for size, depth, and location of joint. Comply with requirements in Division 07 Section "Joint Sealants."
 - J. Fire-Rated-Assembly Penetrations: Maintain indicated fire rating of walls, partitions, ceilings, and floors at raceway and cable penetrations. Install sleeves and seal raceway and cable penetration sleeves with firestop materials. Comply with requirements in Division 07 Section "Penetration Firestopping."
 - K. Roof-Penetration Sleeves: Seal penetration of individual raceways and cables with flexible boot-type flashing units applied in coordination with roofing work.
 - L. Aboveground, Exterior-Wall Penetrations: Seal penetrations using cast-iron pipe sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.
 - M. Underground, Exterior-Wall Penetrations: Install cast-iron pipe sleeves. Size sleeves to allow for 1-inch annular clear space between raceway or cable and sleeve for installing mechanical sleeve seals.
- 3.3 SLEEVE-SEAL INSTALLATION
- A. Install to seal exterior wall penetrations.
 - B. Use type and number of sealing elements recommended by manufacturer for raceway or cable material and size. Position raceway or cable in center of sleeve. Assemble mechanical sleeve seals and install in annular space between raceway or cable and

sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

3.4 FIRESTOPPING

- A. Apply firestopping to penetrations of fire-rated floor and wall assemblies for electrical installations to restore original fire-resistance rating of assembly. Firestopping materials and installation requirements are specified in Division 07 Section "Penetration Firestopping."

END OF SECTION 260500

SECTION 260519

LOW-VOLTAGE ELECTRICAL POWER CONDUCTORS AND CABLES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Building wires and cables rated 600 V and less.
2. Connectors, splices, and terminations rated 600 V and less.

1.2 ACTION SUBMITTALS

A. Product Data: For each type of product.

1.3 INFORMATIONAL SUBMITTALS

A. Field quality-control reports.

PART 2 - PRODUCTS

2.1 CONDUCTORS AND CABLES

- A. Copper Conductors: Comply with NEMA WC 70/ICEA S-95-658.
- B. Conductor Insulation: Comply with NEMA WC 70/ICEA S-95-658 for Type THHN and THWN.
- C. Multiconductor Cable: Comply with NEMA WC 70/ICEA S-95-658 for armored cable, Type AC, metal-clad cable, Type MC and nonmetallic-sheathed cable, Type NM with ground wire.
- D. VFC Cable:
 1. Comply with UL 1277, UL 1685, and NFPA 70 for Type TC-ER cable.
 2. Comply with UL requirements for cables in direct burial applications.

2.2 CONNECTORS AND SPLICES

- A. Description: Factory-fabricated connectors and splices of size, ampacity rating, material, type, and class for application and service indicated.

2.3 SYSTEM DESCRIPTION

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with NFPA 70.

PART 3 - EXECUTION

3.1 CONDUCTOR MATERIAL APPLICATIONS

- A. Feeders: Copper; Solid for No. 10 AWG and smaller; stranded for No. 8 AWG and larger.
- B. Branch Circuits: Copper. Solid or stranded for No. 12 AWG and smaller; stranded for No. 10 AWG and larger, except VFC cable, which shall be extra flexible stranded.

3.2 CONDUCTOR INSULATION AND MULTICONDUCTOR CABLE APPLICATIONS AND WIRING METHODS

- A. Service Entrance: Type THWN, single conductors in raceway.
- B. Exposed Feeders: Type THHN, single conductors in raceway.
- C. Feeders Concealed in Ceilings, Walls, Partitions, and Crawlspace: Type THHN, single conductors in raceway.
- D. Feeders Installed below Raised Flooring: Type THHN, single conductors in raceway.
- E. Exposed Branch Circuits: Type THHN, single conductors in raceway.
- F. Branch Circuits Concealed in Ceilings, Walls, and Partitions, Including in Crawlspace: Type THHN, single conductors in raceway in all areas utilizing steel frame construction and Nonmetallic sheathed cable, Type NMC in all areas utilizing wood frame construction.
- G. Branch Circuits Concealed in Concrete, below Slabs-on-Grade, and Underground: Type THWN, single conductors in raceway.

- H. Branch Circuits Installed below Raised Flooring: Type THHN, single conductors in raceway.
- I. Cord Drops and Portable Appliance Connections: Type SO, hard service cord with stainless-steel, wire-mesh, strain relief device at terminations to suit application.
- J. VFC Output Circuits: with braided shield.

3.3 INSTALLATION OF CONDUCTORS AND CABLES

- A. Conceal cables in finished walls, ceilings, and floors unless otherwise indicated.
- B. Complete raceway installation between conductor and cable termination points according to Section 26053 "Raceways and Boxes for Electrical Systems" prior to pulling conductors and cables.
- C. Use manufacturer-approved pulling compound or lubricant where necessary; compound used must not deteriorate conductor or insulation. Do not exceed manufacturer's recommended maximum pulling tensions and sidewall pressure values.
- D. Use pulling means, including fish tape, cable, rope, and basket-weave wire/cable grips, that will not damage cables or raceway.
- E. Install exposed cables parallel and perpendicular to surfaces of exposed structural members, and follow surface contours where possible.
- F. Support cables according to Section 26059 "Hangers and Supports for Electrical Systems."

3.4 CONNECTIONS

- A. Tighten electrical connectors and terminals according to manufacturer's published torque-tightening values. If manufacturer's torque values are not indicated, use those specified in UL 486A-486B.
- B. Make splices, terminations, and taps that are compatible with conductor material and that possess equivalent or better mechanical strength and insulation ratings than un-spliced conductors.
- C. Wiring at Outlets: Install conductor at each outlet, with at least 6 inches of slack.

3.5 IDENTIFICATION

- A. Identify and color-code conductors and cables according to Section 26055 "Identification for Electrical Systems."

- B. Identify each spare conductor at each end with identity number and location of other end of conductor, and identify as spare conductor.

3.6 SLEEVE AND SLEEVE-SEAL INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Install sleeves and sleeve seals at penetrations of exterior floor and wall assemblies. Comply with requirements in Section 26054 "Sleeves and Sleeve Seals for Electrical Raceways and Cabling."

3.7 FIRESTOPPING

- A. Apply firestopping to electrical penetrations of fire-rated floor and wall assemblies to restore original fire-resistance rating of assembly according to Section 07841 "Penetration Firestopping."

3.8 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
 - 1. After installing conductors and cables and before electrical circuitry has been energized, test the service entrance, feeder conductors, ATS conductors and conductors for the Generator for compliance with requirements.
- B. Test and Inspection Reports: Prepare a written report to record the following:
 - 1. Procedures used.
 - 2. Results that comply with requirements.
 - 3. Results that do not comply with requirements and corrective action taken to achieve compliance with requirements.
- C. Cables will be considered defective if they do not pass tests and inspections.

END OF SECTION 260519

SECTION 260526

GROUNDING AND BONDING FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes grounding and bonding systems and equipment.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers: Subject to compliance with requirements, provide products by one of the following available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 1. Burndy; Part of Hubbell Electrical Systems.
 - 2. Dossert; AFL Telecommunications LLC.
 - 3. ERICO International Corporation.
 - 4. Fushi Copperweld Inc.
 - 5. Galvan Industries, Inc.; Electrical Products Division, LLC.
 - 6. Harger Lightning and Grounding.
 - 7. ILSCO.
 - 8. O-Z/Gedney; A Brand of the EGS Electrical Group.
 - 9. Robbins Lightning, Inc.
 - 10. Siemens Power Transmission & Distribution, Inc.
- B. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:

2.2 SYSTEM DESCRIPTION

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with UL 467 for grounding and bonding materials and equipment.

2.3 CONDUCTORS

- A. Insulated Conductors: Copper wire or cable insulated for 600 V unless otherwise required by applicable Code or authorities having jurisdiction.
- B. Bare Copper Conductors:
 - 1. Solid Conductors: ASTM B 3.
 - 2. Stranded Conductors: ASTM B 8.
 - 3. Tinned Conductors: ASTM B 33.
 - 4. Bonding Cable: 28 kcmil, 14 strands of No. 17 AWG conductor, 1/4 inch in diameter.
 - 5. Bonding Conductor: No. 4 or No. 6 AWG, stranded conductor.
 - 6. Bonding Jumper: Copper tape, braided conductors terminated with copper ferrules; 1-5/8 inches wide and 1/16 inch thick.
 - 7. Tinned Bonding Jumper: Tinned-copper tape, braided conductors terminated with copper ferrules; 1-5/8 inches wide and 1/16 inch thick.

2.4 CONNECTORS

- A. Listed and labeled by an NRTL acceptable to authorities having jurisdiction for applications in which used and for specific types, sizes, and combinations of conductors and other items connected.
- B. Bolted Connectors for Conductors and Pipes: Copper or copper alloy.
- C. Welded Connectors: Exothermic-welding kits of types recommended by kit manufacturer for materials being joined and installation conditions.
- D. Bus-Bar Connectors: Mechanical type, cast silicon bronze, solderless compression or exothermic-type wire terminals, and long-barrel, two-bolt connection to ground bus bar.

2.5 GROUNDING ELECTRODES

- A. Ground Rods: Copper-clad steel; 3/4 inch by 10 feet.

PART 3 - EXECUTION

3.1 APPLICATIONS

- A. Conductors: Install solid conductor for No. 8 AWG and smaller, and stranded conductors for No. 6 AWG and larger unless otherwise indicated.
- B. Underground Grounding Conductors: Install bare copper conductor, No. 2/0 AWG minimum.

1. Bury at least 24 inches below grade.

C. Conductor Terminations and Connections:

1. Pipe and Equipment Grounding Conductor Terminations: Bolted connectors.
2. Underground Connections: Welded connectors except at test wells and as otherwise indicated.
3. Connections to Ground Rods at Test Wells: Bolted connectors.
4. Connections to Structural Steel: Welded connectors.

3.2 GROUNDING AT THE SERVICE

- A. Equipment grounding conductors and grounding electrode conductors shall be connected to the ground bus. Install a main bonding jumper between the neutral and ground buses.

3.3 GROUNDING OVERHEAD LINES

- A. Comply with IEEE C2 grounding requirements.
- B. Install 2 parallel ground rods.
- C. Drive ground rods until tops are 12 inches below finished grade in undisturbed earth.
- D. Ground-Rod Connections: Install bolted connectors for underground connections and connections to rods.
- E. Lightning Arrester Grounding Conductors: Separate from other grounding conductors.
- F. Secondary Neutral and Transformer Enclosure. Interconnect and connect to grounding conductor.
- G. Protect grounding conductors running on surface of wood poles with molding extended from grade level up to and through communication service and transformer spaces.

3.4 GROUNDING UNDERGROUND DISTRIBUTION SYSTEM COMPONENTS

- A. Comply with IEEE C2 grounding requirements.
- B. Pad-Mounted Transformers and Switches: Install two ground rods around the pad. Ground pad-mounted equipment and noncurrent-carrying metal items associated with substations by connecting them to underground cable and grounding electrodes. Install tinned-copper conductor not less than No. 2 AWG for taps to equipment grounding terminals.

3.5 EQUIPMENT GROUNDING

- A. Install insulated equipment grounding conductors with all feeders and branch circuits.
- B. Install insulated equipment grounding conductors with the following items, in addition to those required by NFPA 70:
 - 1. Feeders and branch circuits.
 - 2. Lighting circuits.
 - 3. Receptacle circuits.
 - 4. Single-phase motor and appliance branch circuits.
 - 5. Three-phase motor and appliance branch circuits.
 - 6. Flexible raceway runs.
 - 7. Armored and metal-clad cable runs.
 - 8. Busway Supply Circuits: Install insulated equipment grounding conductor from grounding bus in the switchgear, switchboard, or distribution panel to equipment grounding bar terminal on busway.
 - 9. X-Ray Equipment Circuits: Install insulated equipment grounding conductor in circuits supplying x-ray equipment.
- C. Air-Duct Equipment Circuits: Install insulated equipment grounding conductor to duct-mounted electrical devices operating at 120 V and more, including air cleaners, heaters, dampers, humidifiers, and other duct electrical equipment. Bond conductor to each unit and to air duct and connected metallic piping.
- D. Water Heater, Heat-Tracing, and Antifrost Heating Cables: Install a separate insulated equipment grounding conductor to each electric water heater and heat-tracing cable. Bond conductor to heater units, piping, connected equipment, and components.
- E. Poles Supporting Outdoor Lighting Fixtures: Install grounding electrode and a separate insulated equipment grounding conductor in addition to grounding conductor installed with branch-circuit conductors.
- F. Metallic Fences: Comply with requirements of IEEE C2.
 - 1. Grounding Conductor: Bare copper, not less than No. 8 AWG.
 - 2. Gates: Shall be bonded to the grounding conductor with a flexible bonding jumper.
 - 3. Barbed Wire: Strands shall be bonded to the grounding conductor.

3.6 INSTALLATION

- A. Grounding Conductors: Route along shortest and straightest paths possible unless otherwise indicated or required by Code. Avoid obstructing access or placing conductors where they may be subjected to strain, impact, or damage.

- B. Ground Bonding Common with Lightning Protection System: Comply with NFPA 780 and UL 96 when interconnecting with lightning protection system. Bond electrical power system ground directly to lightning protection system grounding conductor at closest point to electrical service grounding electrode. Use bonding conductor sized same as system grounding electrode conductor, and install in conduit.
- C. Ground Rods: Drive rods until tops are 2 inches below finished floor or final grade unless otherwise indicated.
 - 1. Interconnect ground rods with grounding electrode conductor below grade and as otherwise indicated. Make connections without exposing steel or damaging coating if any.
 - 2. For grounding electrode system, install at least three rods spaced at least one-rod length from each other and located at least the same distance from other grounding electrodes, and connect to the service grounding electrode conductor.
- D. Test Wells: Ground rod driven through drilled hole in bottom of handhole and shall be at least 12 inches deep, with cover.
 - 1. Test Wells: Install at least one test well for each service unless otherwise indicated. Install at the ground rod electrically closest to service entrance. Set top of test well flush with finished grade or floor.
- E. Bonding Straps and Jumpers: Install in locations accessible for inspection and maintenance except where routed through short lengths of conduit.
 - 1. Bonding to Structure: Bond straps directly to basic structure, taking care not to penetrate any adjacent parts.
 - 2. Bonding to Equipment Mounted on Vibration Isolation Hangers and Supports: Install bonding so vibration is not transmitted to rigidly mounted equipment.
 - 3. Use exothermic-welded connectors for outdoor locations; if a disconnect-type connection is required, use a bolted clamp.
- F. Grounding and Bonding for Piping:
 - 1. Metal Water Service Pipe: Install insulated copper grounding conductors, in conduit, from building's main service equipment, or grounding bus, to main metal water service entrances to building. Connect grounding conductors to main metal water service pipes; use a bolted clamp connector or bolt a lug-type connector to a pipe flange by using one of the lug bolts of the flange. Where a dielectric main water fitting is installed, connect grounding conductor on street side of fitting. Bond metal grounding conductor conduit or sleeve to conductor at each end.
 - 2. Water Meter Piping: Use braided-type bonding jumpers to electrically bypass water meters. Connect to pipe with a bolted connector.
 - 3. Bond each aboveground portion of gas piping system downstream from equipment shutoff valve.

3.7 FIELD QUALITY CONTROL

- A. Perform tests and inspections. Inspect physical and mechanical condition. Verify tightness of accessible, bolted, electrical connections with a calibrated torque wrench according to manufacturer's written instructions.

END OF SECTION 260526

SECTION 260533

RACEWAYS AND BOXES FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Metal conduits, tubing, and fittings.
2. Nonmetal conduits, tubing, and fittings.
3. Metal wireways and auxiliary gutters.
4. Nonmetal wireways and auxiliary gutters.
5. Surface raceways.
6. Boxes, enclosures, and cabinets.
7. Handholes and boxes for exterior underground cabling.

1.2 ACTION SUBMITTALS

- A. Product Data: For surface raceways, wireways and fittings, floor boxes, hinged-cover enclosures, and cabinets.
- B. Shop Drawings: For custom enclosures and cabinets. Include plans, elevations, sections, and attachment details.

1.3 INFORMATIONAL SUBMITTALS

- A. Coordination Drawings: Conduit routing plans, drawn to scale, on which the following items are shown and coordinated with each other, using input from installers of items involved:
 1. Structural members in paths of conduit groups with common supports.
 2. HVAC and plumbing items and architectural features in paths of conduit groups with common supports.

PART 2 - PRODUCTS

2.1 METAL CONDUITS, TUBING, AND FITTINGS

- A. Listing and Labeling: Metal conduits, tubing, and fittings shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

- B. GRC: Comply with ANSI C80.1 and UL 6.
- C. ARC: Comply with ANSI C80.5 and UL 6A.
- D. IMC: Comply with ANSI C80.6 and UL 1242.
- E. PVC-Coated Steel Conduit: PVC-coated rigid steel conduit.
 - 1. Comply with NEMA RN 1.
 - 2. Coating Thickness: 0.040 inch, minimum.
- F. EMT: Comply with ANSI C80.3 and UL 797.
- G. FMC: Comply with UL 1; zinc-coated steel.
- H. LFMC: Flexible steel conduit with PVC jacket and complying with UL 360.
- I. Fittings for Metal Conduit: Comply with NEMA FB 1 and UL 514B.
 - 1. Conduit Fittings for Hazardous (Classified) Locations: Comply with UL 886 and NFPA 70.
 - 2. Fittings for EMT:
 - a. Material: Steel or die cast.
 - b. Type: Setscrew or compression.
 - 3. Expansion Fittings: PVC or steel to match conduit type, complying with UL 651, rated for environmental conditions where installed, and including flexible external bonding jumper.
 - 4. Coating for Fittings for PVC-Coated Conduit: Minimum thickness of 0.040 inch, with overlapping sleeves protecting threaded joints.
- J. Joint Compound for IMC, GRC, or ARC: Approved, as defined in NFPA 70, by authorities having jurisdiction for use in conduit assemblies, and compounded for use to lubricate and protect threaded conduit joints from corrosion and to enhance their conductivity.

2.2 NONMETALLIC CONDUITS, TUBING, AND FITTINGS

- A. Listing and Labeling: Nonmetallic conduits, tubing, and fittings shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. ENT: Comply with NEMA TC 13 and UL 1653.
- C. RNC: Type EPC-40-PVC, complying with NEMA TC 2 and UL 651 unless otherwise indicated.
- D. LFNC: Comply with UL 1660.

- E. Continuous HDPE: Comply with UL 651B.
- F. Coilable HDPE: Preassembled with conductors or cables, and complying with ASTM D 3485.
- G. Fittings for ENT and RNC: Comply with NEMA TC 3; match to conduit or tubing type and material.
- H. Fittings for LFNC: Comply with UL 514B.

2.3 METAL WIREWAYS AND AUXILIARY GUTTERS

- A. Description: Sheet metal, complying with UL 870 and NEMA 250, Type 1, Type 3R, Type 4 or Type 12 unless otherwise indicated, and sized according to NFPA 70.
 - 1. Metal wireways installed outdoors shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Fittings and Accessories: Include covers, couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings to match and mate with wireways as required for complete system.

2.4 NONMETALLIC WIREWAYS AND AUXILIARY GUTTERS

- A. Listing and Labeling: Nonmetallic wireways and auxiliary gutters shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Description: Fiberglass polyester, extruded and fabricated to required size and shape, without holes or knockouts. Cover shall be gasketed with oil-resistant gasket material and fastened with captive screws treated for corrosion resistance. Connections shall be flanged and have stainless-steel screws and oil-resistant gaskets.
- C. Description: PVC, extruded and fabricated to required size and shape, and having snap-on cover, mechanically coupled connections, and plastic fasteners.
- D. Fittings and Accessories: Couplings, offsets, elbows, expansion joints, adapters, hold-down straps, end caps, and other fittings shall match and mate with wireways as required for complete system.

2.5 SURFACE RACEWAYS

- A. Listing and Labeling: Surface raceways and tele-power poles shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

- B. Surface Metal Raceways: Galvanized steel with snap-on covers complying with UL 5.
- C. Surface Nonmetallic Raceways: Two- or three-piece construction, complying with UL 5A, and manufactured of rigid PVC. Product shall comply with UL 94 V-0 requirements for self-extinguishing characteristics.
- D. Tele-Power Poles:
 - 1. Material: Galvanized steel with ivory baked-enamel finish.
 - 2. Fittings and Accessories: Dividers, end caps, covers, cutouts, wiring harnesses, devices, mounting materials, and other fittings shall match and mate with tele-power pole as required for complete system.

2.6 BOXES, ENCLOSURES, AND CABINETS

- A. General Requirements for Boxes, Enclosures, and Cabinets: Boxes, enclosures, and cabinets installed in wet locations shall be listed for use in wet locations.
- B. Sheet Metal Outlet and Device Boxes: Comply with NEMA OS 1 and UL 514A.
- C. Cast-Metal Outlet and Device Boxes: Comply with NEMA FB 1, ferrous alloy or aluminum, Type FD, with gasketed cover.
- D. Nonmetallic Outlet and Device Boxes: Comply with NEMA OS 2 and UL 514C.
- E. Metal Floor Boxes:
 - 1. Material: Cast metal.
 - 2. Type: Fully adjustable or Semi-adjustable.
 - 3. Shape: Rectangular.
 - 4. Listing and Labeling: Metal floor boxes shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- F. Nonmetallic Floor Boxes: Nonadjustable, round or rectangular.
 - 1. Listing and Labeling: Nonmetallic floor boxes shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- G. Luminaire Outlet Boxes: Nonadjustable, designed for attachment of luminaire weighing 50 lb Outlet boxes designed for attachment of luminaires weighing more than 50 lb shall be listed and marked for the maximum allowable weight.
- H. Paddle Fan Outlet Boxes: Nonadjustable, designed for attachment of paddle fan weighing 70 lb.

1. Listing and labeling: Paddle fan outlet boxes shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
 - I. Small Sheet Metal Pull and Junction Boxes: NEMA OS 1.
 - J. Cast-Metal Access, Pull, and Junction Boxes: Comply with NEMA FB 1 and UL 1773, cast aluminum or galvanized, cast iron with gasketed cover.
 - K. Box extensions used to accommodate new building finishes shall be of same material as recessed box.
 - L. Device Box Dimensions: 4 inches square by 2-1/8 inches deep or 4 inches by 2-1/8 inches by 2-1/8 inches deep .
 - M. Gangable boxes are allowed.
 - N. Hinged-Cover Enclosures: Comply with UL 50 and NEMA 250, Type 1, Type 3R, Type 4 or Type 12 with continuous-hinge cover with flush latch unless otherwise indicated.
 1. Metal Enclosures: Steel, finished inside and out with manufacturer's standard enamel.
 2. Nonmetallic Enclosures: Plastic or Fiberglass.
 3. Interior Panels: Steel; all sides finished with manufacturer's standard enamel.
 - O. Cabinets:
 1. NEMA 250, Type 1, Type 3R or Type 12 galvanized-steel box with removable interior panel and removable front, finished inside and out with manufacturer's standard enamel.
 2. Hinged door in front cover with flush latch and concealed hinge.
 3. Key latch to match panelboards.
 4. Metal barriers to separate wiring of different systems and voltage.
 5. Accessory feet where required for freestanding equipment.
 6. Nonmetallic cabinets shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

2.7 HANDHOLES AND BOXES FOR EXTERIOR UNDERGROUND WIRING

- A. General Requirements for Handholes and Boxes:
 1. Boxes and handholes for use in underground systems shall be designed and identified as defined in NFPA 70, for intended location and application.
 2. Boxes installed in wet areas shall be listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.

- B. Polymer-Concrete Handholes and Boxes with Polymer-Concrete Cover: Molded of sand and aggregate, bound together with polymer resin, and reinforced with steel, fiberglass, or a combination of the two.
 - 1. Standard: Comply with SCTE 77.
 - 2. Configuration: Designed for flush burial with closed bottom unless otherwise indicated.
 - 3. Cover: Weatherproof, secured by tamper-resistant locking devices and having structural load rating consistent with enclosure and handhole location.
 - 4. Cover Finish: Nonskid finish shall have a minimum coefficient of friction of 0.50.
 - 5. Cover Legend: Molded lettering, "ELECTRIC."
 - 6. Conduit Entrance Provisions: Conduit-terminating fittings shall mate with entering ducts for secure, fixed installation in enclosure wall.

- C. Fiberglass Handholes and Boxes: Molded of fiberglass-reinforced polyester resin, with frame and covers of hot-dip galvanized-steel diamond plate.
 - 1. Standard: Comply with SCTE 77.
 - 2. Configuration: Designed for flush burial with open bottom unless otherwise indicated.
 - 3. Cover: Weatherproof, secured by tamper-resistant locking devices and having structural load rating consistent with enclosure and handhole location.
 - 4. Cover Finish: Nonskid finish shall have a minimum coefficient of friction of 0.50.
 - 5. Cover Legend: Molded lettering, "ELECTRIC."
 - 6. Conduit Entrance Provisions: Conduit-terminating fittings shall mate with entering ducts for secure, fixed installation in enclosure wall.

PART 3 - EXECUTION

3.1 RACEWAY APPLICATION

- A. Outdoors: Apply raceway products as specified below unless otherwise indicated:
 - 1. Exposed Conduit: RNC, Type EPC-80-PVC.
 - 2. Concealed Conduit, Aboveground: RNC, Type EPC-40-PVC.
 - 3. Underground Conduit: RNC, Type EPC-40-PVC or Type EPC-80-PVC.
 - 4. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): LFMC or LFNC
 - 5. Boxes and Enclosures, Aboveground: NEMA 250, Type 3R or Type 4.

- B. Indoors: Apply raceway products as specified below unless otherwise indicated.
 - 1. Exposed, Not Subject to Physical Damage: EMT or RNC.
 - 2. Exposed, Not Subject to Severe Physical Damage: EMT or RNC identified for such use.

3. Exposed and Subject to Severe Physical Damage: GRC or IMC. Raceway locations include the following:
 - a. Loading dock.
 - b. Corridors used for traffic of mechanized carts, forklifts, and pallet-handling units.
 - c. Mechanical rooms.
 - d. Gymnasiums.
 - e. Apparatus Bays
4. Concealed in Ceilings and Interior Walls and Partitions: EMT, ENT or RNC, Type EPC-40-PVC.
5. Connection to Vibrating Equipment (Including Transformers and Hydraulic, Pneumatic, Electric Solenoid, or Motor-Driven Equipment): FMC, except use LFMC in damp or wet locations.
6. Damp or Wet Locations: GRC or IMC.
7. Boxes and Enclosures: NEMA 250, Type 1, except use NEMA 250, Type 4 stainless steel in institutional and commercial kitchens and damp or wet locations.

C. Minimum Raceway Size: 3/4-inch trade size.

D. Raceway Fittings: Compatible with raceways and suitable for use and location.

1. Rigid and Intermediate Steel Conduit: Use threaded rigid steel conduit fittings unless otherwise indicated. Comply with NEMA FB 2.10.
2. PVC Externally Coated, Rigid Steel Conduits: Use only fittings listed for use with this type of conduit. Patch and seal all joints, nicks, and scrapes in PVC coating after installing conduits and fittings. Use sealant recommended by fitting manufacturer and apply in thickness and number of coats recommended by manufacturer.
3. EMT: Use setscrew or compression, steel fittings. Comply with NEMA FB 2.10.
4. Flexible Conduit: Use only fittings listed for use with flexible conduit. Comply with NEMA FB 2.20.

E. Do not install aluminum conduits, boxes, or fittings in contact with concrete or earth.

F. Install surface raceways only where indicated on Drawings.

G. Do not install nonmetallic conduit where ambient temperature exceeds 120 deg F.

3.2 INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except where requirements on Drawings or in this article are stricter. Comply with NECA 102 for aluminum conduits. Comply with NFPA 70 limitations for types of raceways allowed in specific occupancies and number of floors.

- B. Keep raceways at least 12 inches away from parallel runs of flues and steam or hot-water pipes. Install horizontal raceway runs above water and steam piping.
- C. Comply with requirements in Section 26059 "Hangers and Supports for Electrical Systems" for hangers and supports.
- D. Arrange stub-ups so curved portions of bends are not visible above finished slab.
- E. Install no more than the equivalent of three 90-degree bends in any conduit run except for control wiring conduits, for which fewer bends are allowed. Support within 12 inches of changes in direction.
- F. Conceal conduit and EMT within finished walls, ceilings, and floors unless otherwise indicated. Install conduits parallel or perpendicular to building lines.
- G. Support conduit within 12 inches of enclosures to which attached.
- H. Raceways Embedded in Slabs:
 - 1. Run conduit larger than 1-inch trade size, parallel or at right angles to main reinforcement. Where at right angles to reinforcement, place conduit close to slab support. Secure raceways to reinforcement at maximum 10 foot intervals.
 - 2. Arrange raceways to cross building expansion joints at right angles with expansion fittings.
 - 3. Arrange raceways to keep a minimum of 2 inches of concrete cover in all directions.
 - 4. Do not embed threadless fittings in concrete unless specifically approved by Architect for each specific location.
 - 5. Change from ENT to RNC, Type EPC-40-PVC, GRC or IMC before rising above floor.
- I. Stub-ups to Above Recessed Ceilings:
 - 1. Use EMT, IMC, or RMC for raceways.
 - 2. Use a conduit bushing or insulated fitting to terminate stub-ups not terminated in hubs or in an enclosure.
- J. Threaded Conduit Joints, Exposed to Wet, Damp, Corrosive, or Outdoor Conditions: Apply listed compound to threads of raceway and fittings before making up joints. Follow compound manufacturer's written instructions.
- K. Coat field-cut threads on PVC-coated raceway with a corrosion-preventing conductive compound prior to assembly.
- L. Raceway Terminations at Locations Subject to Moisture or Vibration: Use insulating bushings to protect conductors including conductors smaller than No. 4 AWG.
- M. Terminate threaded conduits into threaded hubs or with locknuts on inside and outside of boxes or cabinets. Install bushings on conduits up to 1-1/4-inch trade size

and insulated throat metal bushings on 1-1/2-inch trade size and larger conduits terminated with locknuts. Install insulated throat metal grounding bushings on service conduits.

- N. Install pull wires in empty raceways. Use polypropylene or monofilament plastic line with not less than 200-lb tensile strength. Leave at least 12 inches of slack at each end of pull wire. Cap underground raceways designated as spare above grade alongside raceways in use.
- O. Surface Raceways:
1. Install surface raceway with a minimum 2-inch radius control at bend points.
 2. Secure surface raceway with screws or other anchor-type devices at intervals not exceeding 48 inches and with no less than two supports per straight raceway section. Support surface raceway according to manufacturer's written instructions. Tape and glue are not acceptable support methods.
- P. Install raceway sealing fittings at accessible locations according to NFPA 70 and fill them with listed sealing compound. For concealed raceways, install each fitting in a flush steel box with a blank cover plate having a finish similar to that of adjacent plates or surfaces.
- Q. Install devices to seal raceway interiors at accessible locations. Locate seals so no fittings or boxes are between the seal and the following changes of environments. Seal the interior of all raceways at the following points:
1. Where conduits pass from warm to cold locations, such as boundaries of refrigerated spaces.
 2. Where an underground service raceway enters a building or structure.
 3. Where otherwise required by NFPA 70.
- R. Expansion-Joint Fittings:
1. Install in each run of aboveground RNC that is located where environmental temperature change may exceed 30 deg F and that has straight-run length that exceeds 25 feet.
 2. Install type and quantity of fittings that accommodate temperature change listed for each of the following locations:
 - a. Outdoor Locations Not Exposed to Direct Sunlight: 125 deg F temperature change.
 - b. Outdoor Locations Exposed to Direct Sunlight: 155 deg F temperature change.
 - c. Indoor Spaces Connected with Outdoors without Physical Separation: 125 deg F temperature change.
 - d. Attics: 135 deg F temperature change.

3. Install fitting(s) that provide expansion and contraction for at least 0.00041 inch per foot of length of straight run per degree F of temperature change for PVC conduits.
 4. Install expansion fittings at all locations where conduits cross building or structure expansion joints.
 5. Install each expansion-joint fitting with position, mounting, and piston setting selected according to manufacturer's written instructions for conditions at specific location at time of installation. Install conduit supports to allow for expansion movement.
- S. Flexible Conduit Connections: Comply with NEMA RV 3. Use a maximum of 72 inches of flexible conduit for recessed and semirecessed luminaires, equipment subject to vibration, noise transmission, or movement; and for transformers and motors.
1. Use LFMC in damp or wet locations subject to severe physical damage.
 2. Use LFMC or LFNC in damp or wet locations not subject to severe physical damage.
- T. Mount boxes at heights indicated on Drawings. If mounting heights of boxes are not individually indicated, give priority to ADA requirements.
- U. Recessed Boxes in Masonry Walls: Saw-cut opening for box in center of cell of masonry block, and install box flush with surface of wall. Prepare block surfaces to provide a flat surface for a raintight connection between the box and cover plate or the supported equipment and box.
- V. Horizontally separate boxes mounted on opposite sides of walls so they are not in the same vertical channel.
- W. Locate boxes so that cover or plate will not span different building finishes.
- X. Support boxes of three gangs or more from more than one side by spanning two framing members or mounting on brackets specifically designed for the purpose.
- Y. Fasten junction and pull boxes to or support from building structure. Do not support boxes by conduits.
- Z. Set metal floor boxes level and flush with finished floor surface.
- AA. Set nonmetallic floor boxes level. Trim after installation to fit flush with finished floor surface.
- 3.3 INSTALLATION OF UNDERGROUND CONDUIT
- A. Direct-Buried Conduit:

1. Excavate trench bottom to provide firm and uniform support for conduit. Prepare trench bottom at a minimum of 4 feet in depth for pipe less than 6 inches in nominal diameter.
2. Backfill 6" with small rock to set bedding for pipe. Top of pipe shall be minimum of 3 feet below existing grade after conduit installation.
3. After installing conduit, backfill and compact with granular material in 6" lifts. Compact to 95% density. Start at tie-in point, and work toward end of conduit run, leaving conduit at end of run free to move with expansion and contraction as temperature changes during this process. Firmly hand tamp backfill around conduit to provide maximum supporting strength. After placing controlled backfill to within 12 inches of finished grade, make final conduit connection at end of run and complete backfilling with normal compaction.
4. Install manufactured duct elbows for stub-up at poles and equipment and at building entrances through floor unless otherwise indicated. Encase elbows for stub-up ducts throughout length of elbow.
5. Install manufactured rigid steel conduit elbows for stub-ups at poles and equipment and at building entrances through floor.
 - a. Couple steel conduits to ducts with adapters designed for this purpose, and encase coupling with 3 inches of concrete for a minimum of 12 inches on each side of the coupling.
 - b. For stub-ups at equipment mounted on outdoor concrete bases and where conduits penetrate building foundations, extend steel conduit horizontally a minimum of 60 inches from edge of foundation or equipment base. Install insulated grounding bushings on terminations at equipment.
6. Underground Warning Tape: Comply with requirements in Section 26055 "Identification for Electrical Systems."

3.4 INSTALLATION OF UNDERGROUND HANDHOLES AND BOXES

- A. Install handholes and boxes level and plumb and with orientation and depth coordinated with connecting conduits to minimize bends and deflections required for proper entrances.
- B. Unless otherwise indicated, support units on a level bed of crushed stone or gravel, graded from 1/2-inch sieve to No. 4 sieve and compacted to same density as adjacent undisturbed earth.
- C. Elevation: In paved areas, set so cover surface will be flush with finished grade. Set covers of other enclosures 1 inch above finished grade.
- D. Install handholes with bottom below frost line.
- E. Field-cut openings for conduits according to enclosure manufacturer's written instructions. Cut wall of enclosure with a tool designed for material to be cut. Size

holes for terminating fittings to be used, and seal around penetrations after fittings are installed.

3.5 SLEEVE AND SLEEVE-SEAL INSTALLATION FOR ELECTRICAL PENETRATIONS

- A. Install sleeves and sleeve seals at penetrations of exterior floor and wall assemblies. Comply with requirements in Section 26054 "Sleeves and Sleeve Seals for Electrical Raceways and Cabling."

3.6 FIRESTOPPING

- A. Install firestopping at penetrations of fire-rated floor and wall assemblies. Comply with requirements in Section 07841 "Penetration Firestopping."

3.7 PROTECTION

- A. Protect coatings, finishes, and cabinets from damage and deterioration.
 - 1. Repair damage to galvanized finishes with zinc-rich paint recommended by manufacturer.
 - 2. Repair damage to PVC coatings or paint finishes with matching touchup coating recommended by manufacturer.

END OF SECTION 260533

SECTION 260544

SLEEVES AND SLEEVE SEALS FOR ELECTRICAL RACEWAYS AND CABLING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Sleeves for raceway and cable penetration of non-fire-rated construction walls and floors.
2. Sleeve-seal systems.
3. Sleeve-seal fittings.
4. Grout.
5. Silicone sealants.

B. Related Requirements:

1. Section 07841 "Penetration Firestopping" for penetration firestopping installed in fire-resistance-rated walls, horizontal assemblies, and smoke barriers, with and without penetrating items.

1.2 ACTION SUBMITTALS

- ###### A. Product Data: For each type of product.

PART 2 - PRODUCTS

2.1 SLEEVES

A. Wall Sleeves:

1. Steel Pipe Sleeves: ASTM A 53/A 53M, Type E, Grade B, Schedule 40, zinc coated, plain ends.
2. Cast-Iron Pipe Sleeves: Cast or fabricated "wall pipe," equivalent to ductile-iron pressure pipe, with plain ends and integral waterstop unless otherwise indicated.

- ###### B. Sleeves for Conduits Penetrating Non-Fire-Rated Gypsum Board Assemblies: Galvanized-steel sheet; 0.0239-inch minimum thickness; round tube closed with welded longitudinal joint, with tabs for screw-fastening the sleeve to the board.

- ###### C. Sleeves for Rectangular Openings:

1. Material: Galvanized sheet steel.
2. Minimum Metal Thickness:
 - a. For sleeve cross-section rectangle perimeter less than 50 inches and with no side larger than 16 inches, thickness shall be 0.052 inch.
 - b. For sleeve cross-section rectangle perimeter 50 inches or more and one or more sides larger than 16 inches, thickness shall be 0.138 inch.

2.2 SLEEVE-SEAL SYSTEMS

- A. Description: Modular sealing device, designed for field assembly, to fill annular space between sleeve and raceway or cable.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Advance Products & Systems, Inc.
 - b. CALPICO, Inc.
 - c. Metraflex Company (The).
 - d. Pipeline Seal and Insulator, Inc.
 - e. Proco Products, Inc.
 3. Sealing Elements: EPDM rubber interlocking links shaped to fit surface of pipe. Include type and number required for pipe material and size of pipe.
 4. Pressure Plates: Carbon steel, Plastic or Stainless steel.
 5. Connecting Bolts and Nuts: Carbon steel, with corrosion-resistant coating or Stainless steel of length required to secure pressure plates to sealing elements.

2.3 SLEEVE-SEAL FITTINGS

- A. Description: Manufactured plastic, sleeve-type, waterstop assembly made for embedding in concrete slab or wall. Unit shall have plastic or rubber waterstop collar with center opening to match piping OD.
1. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 2. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - a. Presealed Systems.

2.4 GROUT

- A. Description: Nonshrink; recommended for interior and exterior sealing openings in non-fire-rated walls or floors.
- B. Standard: ASTM C 1107/C 1107M, Grade B, post-hardening and volume-adjusting, dry, hydraulic-cement grout.
- C. Design Mix: 5000-psi , 28-day compressive strength.
- D. Packaging: Premixed and factory packaged.

2.5 SILICONE SEALANTS

- A. Silicone Sealants: Single-component, silicone-based, neutral-curing elastomeric sealants of grade indicated below.
 - 1. Grade: Pourable (self-leveling) formulation for openings in floors and other horizontal surfaces that are not fire rated.
- B. Silicone Foams: Multicomponent, silicone-based liquid elastomers that, when mixed, expand and cure in place to produce a flexible, nonshrinking foam.

PART 3 - EXECUTION

3.1 SLEEVE INSTALLATION FOR NON-FIRE-RATED ELECTRICAL PENETRATIONS

- A. Comply with NECA 1.
- B. Comply with NEMA VE 2 for cable tray and cable penetrations.
- C. Sleeves for Conduits Penetrating Above-Grade Non-Fire-Rated Concrete and Masonry-Unit Floors and Walls:
 - 1. Interior Penetrations of Non-Fire-Rated Walls and Floors:
 - a. Seal annular space between sleeve and raceway or cable, using joint sealant appropriate for size, depth, and location of joint. Comply with requirements in Section 07920 "Joint Sealants."
 - b. Seal space outside of sleeves with mortar or grout. Pack sealing material solidly between sleeve and wall so no voids remain. Tool exposed surfaces smooth; protect material while curing.
 - 2. Use pipe sleeves unless penetration arrangement requires rectangular sleeved opening.
 - 3. Size pipe sleeves to provide 1/4-inch annular clear space between sleeve and raceway or cable unless sleeve seal is to be installed.

4. Install sleeves for wall penetrations unless core-drilled holes or formed openings are used. Install sleeves during erection of walls. Cut sleeves to length for mounting flush with both surfaces of walls. Deburr after cutting.
5. Install sleeves for floor penetrations. Extend sleeves installed in floors 2 inches above finished floor level. Install sleeves during erection of floors.

D. Sleeves for Conduits Penetrating Non-Fire-Rated Gypsum Board Assemblies:

1. Use circular metal sleeves unless penetration arrangement requires rectangular sleeved opening.
2. Seal space outside of sleeves with approved joint compound for gypsum board assemblies.

E. Roof-Penetration Sleeves: Seal penetration of individual raceways and cables with flexible boot-type flashing units applied in coordination with roofing work.

F. Aboveground, Exterior-Wall Penetrations: Seal penetrations using steel or cast-iron pipe sleeves and mechanical sleeve seals. Select sleeve size to allow for 1-inch annular clear space between pipe and sleeve for installing mechanical sleeve seals.

G. Underground, Exterior-Wall and Floor Penetrations: Install cast-iron pipe sleeves. Size sleeves to allow for 1-inch annular clear space between raceway or cable and sleeve for installing sleeve-seal system.

3.2 SLEEVE-SEAL-SYSTEM INSTALLATION

- A. Install sleeve-seal systems in sleeves in exterior concrete walls and slabs-on-grade at raceway entries into building.
- B. Install type and number of sealing elements recommended by manufacturer for raceway or cable material and size. Position raceway or cable in center of sleeve. Assemble mechanical sleeve seals and install in annular space between raceway or cable and sleeve. Tighten bolts against pressure plates that cause sealing elements to expand and make watertight seal.

3.3 SLEEVE-SEAL-FITTING INSTALLATION

- A. Install sleeve-seal fittings in new walls and slabs as they are constructed.
- B. Assemble fitting components of length to be flush with both surfaces of concrete slabs and walls. Position waterstop flange to be centered in concrete slab or wall.
- C. Secure nailing flanges to concrete forms.
- D. Using grout, seal the space around outside of sleeve-seal fittings.

END OF SECTION 260544

SECTION 260553

IDENTIFICATION FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Identification for raceways.
2. Identification of power and control cables.
3. Identification for conductors.
4. Underground-line warning tape.
5. Warning labels and signs.
6. Instruction signs.
7. Equipment identification labels.
8. Miscellaneous identification products.

1.2 ACTION SUBMITTALS

- A. Product Data: For each electrical identification product indicated.
- B. Identification Schedule: An index of nomenclature of electrical equipment and system components used in identification signs and labels.
- C. Samples: For each type of label and sign to illustrate size, colors, lettering style, mounting provisions, and graphic features of identification products.

1.3 QUALITY ASSURANCE

- A. Comply with ANSI A13.1.
- B. Comply with NFPA 70.
- C. Comply with 29 CFR 1910.144 and 29 CFR 1910.145.
- D. Comply with ANSI Z535.4 for safety signs and labels.
- E. Adhesive-attached labeling materials, including label stocks, laminating adhesives, and inks used by label printers, shall comply with UL 969.

1.4 COORDINATION

- A. Coordinate identification names, abbreviations, colors, and other features with requirements in the Contract Documents, Shop Drawings, manufacturer's wiring diagrams, and the Operation and Maintenance Manual, and with those required by codes, standards, and 29 CFR 1910.145. Use consistent designations throughout project.
- B. Coordinate installation of identifying devices with completion of covering and painting of surfaces where devices are to be applied.
- C. Coordinate installation of identifying devices with location of access panels and doors.
- D. Install identifying devices before installing acoustical ceilings and similar concealment.

PART 2 - PRODUCTS

2.1 POWER RACEWAY IDENTIFICATION MATERIALS

- A. Comply with ANSI A13.1 for minimum size of letters for legend and for minimum length of color field for each raceway size.
- B. Colors for Raceways Carrying Circuits at 600 V or Less:
 - 1. Black letters on an orange field.
 - 2. Legend: Indicate voltage and system or service type.
- C. Self-Adhesive Vinyl Labels for Raceways Carrying Circuits at 600 V or Less: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.
- D. Snap-Around Labels for Raceways Carrying Circuits at 600 V or Less: Slit, pretensioned, flexible, preprinted, color-coded acrylic sleeve, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- E. Snap-Around, Color-Coding Bands for Raceways Carrying Circuits at 600 V or Less: Slit, pretensioned, flexible, solid-colored acrylic sleeve, 2 inches long, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.

2.2 ARMORED AND METAL-CLAD CABLE IDENTIFICATION MATERIALS

- A. Comply with ANSI A13.1 for minimum size of letters for legend and for minimum length of color field for each raceway and cable size.
- B. Colors for Raceways Carrying Circuits at 600 V and Less:
 - 1. Black letters on an orange field.
 - 2. Legend: Indicate voltage and system or service type.

- C. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.
- D. Self-Adhesive Vinyl Tape: Colored, heavy duty, waterproof, fade resistant; 2 inches wide; compounded for outdoor use.

2.3 POWER AND CONTROL CABLE IDENTIFICATION MATERIALS

- A. Comply with ANSI A13.1 for minimum size of letters for legend and for minimum length of color field for each raceway and cable size.
- B. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.
- C. Write-On Tags: Polyester tag, 0.015 inch thick, with corrosion-resistant grommet and cable tie for attachment to conductor or cable.
 - 1. Marker for Tags: Machine-printed, permanent, waterproof, black ink marker recommended by printer manufacturer.
- D. Snap-Around Labels: Slit, pretensioned, flexible, preprinted, color-coded acrylic sleeve, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.
- E. Snap-Around, Color-Coding Bands: Slit, pretensioned, flexible, solid-colored acrylic sleeve, 2 inches long, with diameter sized to suit diameter of raceway or cable it identifies and to stay in place by gripping action.

2.4 CONDUCTOR IDENTIFICATION MATERIALS

- A. Color-Coding Conductor Tape: Colored, self-adhesive vinyl tape not less than 3 mils thick by 1 to 2 inches wide.
- B. Self-Adhesive Vinyl Labels: Preprinted, flexible label laminated with a clear, weather- and chemical-resistant coating and matching wraparound adhesive tape for securing ends of legend label.
- C. Marker Tapes: Vinyl or vinyl-cloth, self-adhesive wraparound type, with circuit identification legend machine printed by thermal transfer or equivalent process.
- D. Write-On Tags: Polyester tag, 0.015 inch thick, with corrosion-resistant grommet and cable tie for attachment to conductor or cable.
 - 1. Marker for Tags: Machine-printed, permanent, waterproof, black ink marker recommended by printer manufacturer.

2.5 FLOOR MARKING TAPE

- A. 2-inch- wide, 5-mil pressure-sensitive vinyl tape, with black and white stripes and clear vinyl overlay.

2.6 UNDERGROUND-LINE WARNING TAPE

A. Tape:

1. Recommended by manufacturer for the method of installation and suitable to identify and locate underground electrical and communications utility lines.
2. Printing on tape shall be permanent and shall not be damaged by burial operations.
3. Tape material and ink shall be chemically inert, and not subject to degrading when exposed to acids, alkalis, and other destructive substances commonly found in soils.

B. Color and Printing:

1. Comply with ANSI Z535.1 through ANSI Z535.5.
2. Inscriptions for Red-Colored Tapes: ELECTRIC LINE, HIGH VOLTAGE.
3. Inscriptions for Orange-Colored Tapes: TELEPHONE CABLE, CATV CABLE, COMMUNICATIONS CABLE, OPTICAL FIBER CABLE.

C. Tag:

1. Pigmented polyolefin, bright-colored, continuous-printed on one side with the inscription of the utility, compounded for direct-burial service.
2. Thickness: 4 mils .
3. Weight: 18.5 lb/1000 sq. ft.
4. 3-Inch Tensile According to ASTM D 882: 30 lbf , and 2500 psi.

2.7 WARNING LABELS AND SIGNS

A. Comply with NFPA 70 and 29 CFR 1910.145.

B. Self-Adhesive Warning Labels: Factory-printed, multicolor, pressure-sensitive adhesive labels, configured for display on front cover, door, or other access to equipment unless otherwise indicated.

C. Baked-Enamel Warning Signs:

1. Preprinted aluminum signs, punched or drilled for fasteners, with colors, legend, and size required for application.
2. 1/4-inch grommets in corners for mounting.
3. Nominal size, 7 by 10 inches.

D. Metal-Backed, Butyrate Warning Signs:

1. Weather-resistant, nonfading, preprinted, cellulose-acetate butyrate signs with 0.0396-inch galvanized-steel backing; and with colors, legend, and size required for application.
2. 1/4-inch grommets in corners for mounting.

3. Nominal size, 10 by 14 inches.

E. Warning label and sign shall include, but are not limited to, the following legends:

1. Multiple Power Source Warning: "DANGER - ELECTRICAL SHOCK HAZARD - EQUIPMENT HAS MULTIPLE POWER SOURCES."
2. Workspace Clearance Warning: "WARNING - OSHA REGULATION - AREA IN FRONT OF ELECTRICAL EQUIPMENT MUST BE KEPT CLEAR FOR 36 INCHES."

2.8 INSTRUCTION SIGNS

A. Engraved, laminated acrylic or melamine plastic, minimum 1/16 inch thick for signs up to 20 sq. inches and 1/8 inch thick for larger sizes.

1. Engraved legend with black letters on white face.
2. Punched or drilled for mechanical fasteners.
3. Framed with mitered acrylic molding and arranged for attachment at applicable equipment.

B. Adhesive Film Label: Machine printed, in black, by thermal transfer or equivalent process. Minimum letter height shall be 3/8 inch.

C. Adhesive Film Label with Clear Protective Overlay: Machine printed, in black, by thermal transfer or equivalent process. Minimum letter height shall be 3/8 inch. Overlay shall provide a weatherproof and UV-resistant seal for label.

2.9 EQUIPMENT IDENTIFICATION LABELS

A. Adhesive Film Label with Clear Protective Overlay: Machine printed, in black, by thermal transfer or equivalent process. Minimum letter height shall be 3/8 inch. Overlay shall provide a weatherproof and UV-resistant seal for label.

B. Self-Adhesive, Engraved, Laminated Acrylic or Melamine Label: Adhesive backed, with white letters on a dark-gray background. Minimum letter height shall be 3/8 inch.

C. Stenciled Legend: In nonfading, waterproof, black ink or paint. Minimum letter height shall be 1 inch.

2.10 MISCELLANEOUS IDENTIFICATION PRODUCTS

A. Paint: Comply with requirements in painting Sections for paint materials and application requirements. Select paint system applicable for surface material and location (exterior or interior).

B. Fasteners for Labels and Signs: Self-tapping, stainless-steel screws or stainless-steel machine screws with nuts and flat and lock washers.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Location: Install identification materials and devices at locations for most convenient viewing without interference with operation and maintenance of equipment.
- B. Apply identification devices to surfaces that require finish after completing finish work.
- C. Self-Adhesive Identification Products: Clean surfaces before application, using materials and methods recommended by manufacturer of identification device.
- D. Attach signs and plastic labels that are not self-adhesive type with mechanical fasteners appropriate to the location and substrate.
- E. System Identification Color-Coding Bands for Raceways and Cables: Each color-coding band shall completely encircle cable or conduit. Place adjacent bands of two-color markings in contact, side by side. Locate bands at changes in direction, at penetrations of walls and floors, at 50-foot maximum intervals in straight runs, and at 25-foot maximum intervals in congested areas.
- F. Underground-Line Warning Tape: During backfilling of trenches install continuous underground-line warning tape directly above line at 6 to 8 inches below finished grade. Use multiple tapes where width of multiple lines installed in a common trench or concrete envelope exceeds 16 inches overall.
- G. Painted Identification: Comply with requirements in painting Sections for surface preparation and paint application.

3.2 IDENTIFICATION SCHEDULE

- A. Accessible Raceways and Metal-Clad Cables, 600 V or Less, for Service, Feeder, and Branch Circuits More Than 30 A, and 120 V to ground: Install labels at 10-foot maximum intervals.
- B. Accessible Raceways and Cables within Buildings: Identify the covers of each junction and pull box of the following systems with self-adhesive vinyl labels with the wiring system legend and system voltage. System legends shall be as follows:
 - 1. Emergency Power.
 - 2. Power.
 - 3. UPS.
- C. Power-Circuit Conductor Identification, 600 V or Less: For conductors in vaults, pull and junction boxes, manholes, and handholes, use color-coding conductor tape to identify the phase.
 - 1. Color-Coding for Phase and Voltage Level Identification, 600 V or Less: Use colors listed below for ungrounded service, feeder and branch-circuit conductors.

- a. Color shall be factory applied or field applied for sizes larger than No. 8 AWG, if authorities having jurisdiction permit.
 - b. Colors for 208/120-V Circuits:
 - 1) Phase A: Black.
 - 2) Phase B: Red.
 - 3) Phase C: Blue.
 - c. Colors for 480/277-V Circuits:
 - 1) Phase A: Brown.
 - 2) Phase B: Orange.
 - 3) Phase C: Yellow.
 - d. Field-Applied, Color-Coding Conductor Tape: Apply in half-lapped turns for a minimum distance of 6 inches from terminal points and in boxes where splices or taps are made. Apply last two turns of tape with no tension to prevent possible unwinding. Locate bands to avoid obscuring factory cable markings.
- D. Install instructional sign including the color-code for grounded and ungrounded conductors using adhesive-film-type labels.
- E. Conductors to Be Extended in the Future: Attach write-on tags to conductors and list source.
- F. Auxiliary Electrical Systems Conductor Identification: Identify field-installed alarm, control, and signal connections.
- 1. Identify conductors, cables, and terminals in enclosures and at junctions, terminals, and pull points. Identify by system and circuit designation.
 - 2. Use system of marker tape designations that is uniform and consistent with system used by manufacturer for factory-installed connections.
 - 3. Coordinate identification with Project Drawings, manufacturer's wiring diagrams, and the Operation and Maintenance Manual.
- G. Locations of Underground Lines: Identify with underground-line warning tape for power, lighting, communication, and control wiring and optical fiber cable.
- 1. Limit use of underground-line warning tape to direct-buried cables.
 - 2. Install underground-line warning tape for both direct-buried cables and cables in raceway.
- H. Workspace Indication: Install floor marking tape to show working clearances in the direction of access to live parts. Workspace shall be as required by NFPA 70 and 29 CFR 1926.403 unless otherwise indicated. Do not install at flush-mounted panelboards and similar equipment in finished spaces.
- I. Warning Labels for Indoor Cabinets, Boxes, and Enclosures for Power and Lighting: Self-adhesive warning labels, Baked-enamel warning signs or Metal-backed, butyrate warning signs.
- 1. Comply with 29 CFR 1910.145.

2. Identify system voltage with black letters on an orange background.
 3. Apply to exterior of door, cover, or other access.
 4. For equipment with multiple power or control sources, apply to door or cover of equipment including, but not limited to, the following:
 - a. Power transfer switches.
 - b. Controls with external control power connections.
- J. Operating Instruction Signs: Install instruction signs to facilitate proper operation and maintenance of electrical systems and items to which they connect. Install instruction signs with approved legend where instructions are needed for system or equipment operation.
- K. Emergency Operating Instruction Signs: Install instruction signs with white legend on a red background with minimum 3/8-inch- high letters for emergency instructions at equipment used for power transfer or load shedding.
- L. Equipment Identification Labels: On each unit of equipment, install unique designation label that is consistent with wiring diagrams, schedules, and the Operation and Maintenance Manual. Apply labels to disconnect switches and protection equipment, central or master units, control panels, control stations, terminal cabinets, and racks of each system. Systems include power, lighting, control, communication, signal, monitoring, and alarm systems unless equipment is provided with its own identification.
1. Labeling Instructions:
 - a. Indoor Equipment: Adhesive film label with clear protective overlay or Self-adhesive, engraved, laminated acrylic or melamine label. Unless otherwise indicated, provide a single line of text with 1/2-inch- high letters on 1-1/2-inch-high label; where two lines of text are required, use labels 2 inches high.
 - b. Outdoor Equipment: Engraved, laminated acrylic or melamine label or Stenciled legend 4 inches high.
 - c. Elevated Components: Increase sizes of labels and letters to those appropriate for viewing from the floor.
 - d. Unless provided with self-adhesive means of attachment, fasten labels with appropriate mechanical fasteners that do not change the NEMA or NRTL rating of the enclosure.

END OF SECTION 260553

SECTION 260529

HANGERS AND SUPPORTS FOR ELECTRICAL SYSTEMS

PART 1 - GENERAL

1.1 SUMMARY

A. Section includes:

1. Hangers and supports for electrical equipment and systems.
2. Construction requirements for concrete bases.

1.2 PERFORMANCE REQUIREMENTS

- A. Delegated Design: Design supports for multiple raceways, including comprehensive engineering analysis by a qualified professional engineer, using performance requirements and design criteria indicated.
- B. Design supports for multiple raceways capable of supporting combined weight of supported systems and its contents.
- C. Design equipment supports capable of supporting combined operating weight of supported equipment and connected systems and components.
- D. Rated Strength: Adequate in tension, shear, and pullout force to resist maximum loads calculated or imposed for this Project, with a minimum structural safety factor of five times the applied force.

1.3 SUBMITTALS

- A. Product Data: For steel slotted support systems.
- B. Shop Drawings: Show fabrication and installation details and include calculations for the following:
 1. Trapeze hangers. Include Product Data for components.
 2. Steel slotted channel systems. Include Product Data for components.
 3. Equipment supports.
- C. Welding certificates.

1.4 QUALITY ASSURANCE

- A. Welding: Qualify procedures and personnel according to AWS D1.1/D1.1M, "Structural Welding Code - Steel."
- B. Comply with NFPA 70.

1.5 COORDINATION

- A. Coordinate size and location of concrete bases. Cast anchor-bolt inserts into bases. Concrete, reinforcement, and formwork requirements are specified in Division 3.
- B. Coordinate installation of roof curbs, equipment supports, and roof penetrations.

PART 2 - PRODUCTS

2.1 SUPPORT, ANCHORAGE, AND ATTACHMENT COMPONENTS

- A. Steel Slotted Support Systems: Comply with MFMA-4, factory-fabricated components for field assembly.
 - 1. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - 2. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - a. Allied Tube & Conduit.
 - b. Cooper B-Line, Inc.
 - c. ERICO International Corporation.
 - d. GS Metals Corp.
 - e. Thomas & Betts Corporation.
 - f. Unistrut; Atkore International.
 - g. Wesanco, Inc.
 - 3. Metallic Coatings: Hot-dip galvanized after fabrication and applied according to MFMA-4.
 - 4. Nonmetallic Coatings: Manufacturer's standard PVC, polyurethane, or polyester coating applied according to MFMA-4.
 - 5. Painted Coatings: Manufacturer's standard painted coating applied according to MFMA-4.
 - 6. Channel Dimensions: Selected for applicable load criteria.
- B. Raceway and Cable Supports: As described in NECA 1 and NECA 101.

- C. Conduit and Cable Support Devices: Steel or Steel and malleable-iron hangers, clamps, and associated fittings, designed for types and sizes of raceway or cable to be supported.
- D. Support for Conductors in Vertical Conduit: Factory-fabricated assembly consisting of threaded body and insulating wedging plug or plugs for non-armored electrical conductors or cables in riser conduits. Plugs shall have number, size, and shape of conductor gripping pieces as required to suit individual conductors or cables supported. Body shall be malleable iron.
- E. Structural Steel for Fabricated Supports and Restraints: ASTM A 36/A 36M, steel plates, shapes, and bars; black and galvanized.
- F. Mounting, Anchoring, and Attachment Components: Items for fastening electrical items or their supports to building surfaces include the following:
 - 1. Powder-Actuated Fasteners: Threaded-steel stud, for use in hardened portland cement concrete, steel, or wood, with tension, shear, and pullout capacities appropriate for supported loads and building materials where used.
 - a. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - b. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1) Hilti, Inc.
 - 2) ITW Ramset/Red Head; Illinois Tool Works, Inc.
 - 3) MKT Fastening, LLC.
 - 4) Simpson Strong-Tie Co., Inc.
 - 2. Mechanical-Expansion Anchors: Insert-wedge-type, zinc-coated or stainless steel, for use in hardened portland cement concrete with tension, shear, and pullout capacities appropriate for supported loads and building materials in which used.
 - a. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
 - b. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1) Cooper B-Line, Inc.
 - 2) Empire Tool and Manufacturing Co., Inc.
 - 3) Hilti, Inc.
 - 4) ITW Ramset/Red Head; Illinois Tool Works, Inc.
 - 5) MKT Fastening, LLC.

3. Concrete Inserts: Steel or malleable-iron, slotted support system units similar to MSS Type 18; complying with MFMA-4 or MSS SP-58.
4. Clamps for Attachment to Steel Structural Elements: MSS SP-58, type suitable for attached structural element.
5. Through Bolts: Structural type, hex head, and high strength. Comply with ASTM A 325.
6. Toggle Bolts: All-steel springhead type.
7. Hanger Rods: Threaded steel.

2.2 FABRICATED METAL EQUIPMENT SUPPORT ASSEMBLIES

- A. Description: Welded or bolted, structural-steel shapes, shop or field fabricated to fit dimensions of supported equipment.
- B. Materials: Comply with requirements in Section 05500 "Metal Fabrications" for steel shapes and plates.

PART 3 - EXECUTION

3.1 APPLICATION

- A. Comply with NECA 1 and NECA 101 for application of hangers and supports for electrical equipment and systems except if requirements in this Section are stricter.
- B. Maximum Support Spacing and Minimum Hanger Rod Size for Raceway: Space supports for EMT, IMC, and RMC as required by NFPA 70. Minimum rod size shall be 1/4 inch in diameter.
- C. Multiple Raceways or Cables: Install trapeze-type supports fabricated with steel slotted or other support system, sized so capacity can be increased by at least 25 percent in future without exceeding specified design load limits.
 1. Secure raceways and cables to these supports with two-bolt conduit clamps.
- D. Spring-steel clamps designed for supporting single conduits without bolts may be used for 1-1/2-inch and smaller raceways serving branch circuits and communication systems above suspended ceilings and for fastening raceways to trapeze supports.

3.2 SUPPORT INSTALLATION

- A. Comply with NECA 1 and NECA 101 for installation requirements except as specified in this Article.
- B. Raceway Support Methods: In addition to methods described in NECA 1, EMT, IMC and RMC may be supported by openings through structure members, as permitted in NFPA 70.

- C. Strength of Support Assemblies: Where not indicated, select sizes of components so strength will be adequate to carry present and future static loads within specified loading limits. Minimum static design load used for strength determination shall be weight of supported components plus 200 lb.

- D. Mounting and Anchorage of Surface-Mounted Equipment and Components: Anchor and fasten electrical items and their supports to building structural elements by the following methods unless otherwise indicated by code:
 - 1. To Wood: Fasten with lag screws or through bolts.
 - 2. To New Concrete: Bolt to concrete inserts.
 - 3. To Masonry: Approved toggle-type bolts on hollow masonry units and expansion anchor fasteners on solid masonry units.
 - 4. To Existing Concrete: Expansion anchor fasteners.
 - 5. Instead of expansion anchors, powder-actuated driven threaded studs provided with lock washers and nuts may be used in existing standard-weight concrete 4 inches thick or greater. Do not use for anchorage to lightweight-aggregate concrete or for slabs less than 4 inches thick.
 - 6. To Steel: Welded threaded studs complying with AWS D1.1/D1.1M, with lock washers and nuts or Beam clamps (MSS Type 19, 21, 23, 25, or 27) complying with MSS SP-69.
 - 7. To Light Steel: Sheet metal screws.
 - 8. Items Mounted on Hollow Walls and Nonstructural Building Surfaces: Mount cabinets, panelboards, disconnect switches, control enclosures, pull and junction boxes, transformers, and other devices on slotted-channel racks attached to substrate by means that meet seismic-restraint strength and anchorage requirements.

- E. Drill holes for expansion anchors in concrete at locations and to depths that avoid reinforcing bars.

3.3 INSTALLATION OF FABRICATED METAL SUPPORTS

- A. Comply with installation requirements in Section 05500 "Metal Fabrications" for site-fabricated metal supports.

- B. Cut, fit, and place miscellaneous metal supports accurately in location, alignment, and elevation to support and anchor electrical materials and equipment.

- C. Field Welding: Comply with AWS D1.1/D1.1M.

3.4 CONCRETE BASES

- A. Construct concrete bases of dimensions indicated but not less than 4 inches larger in both directions than supported unit, and so anchors will be a minimum of 10 bolt diameters from edge of the base.

- B. Use 3000-psi, 28-day compressive-strength concrete. Concrete materials, reinforcement, and placement requirements are specified in Section 03300 "Cast-in-Place Concrete."
- C. Anchor equipment to concrete base.
 - 1. Place and secure anchorage devices. Use supported equipment manufacturer's setting drawings, templates, diagrams, instructions, and directions furnished with items to be embedded.
 - 2. Install anchor bolts to elevations required for proper attachment to supported equipment.
 - 3. Install anchor bolts according to anchor-bolt manufacturer's written instructions.

3.5 PAINTING

- A. Touchup: Clean field welds and abraded areas of shop paint. Paint exposed areas immediately after erecting hangers and supports. Use same materials as used for shop painting. Comply with SSPC-PA 1 requirements for touching up field-painted surfaces.
 - 1. Apply paint by brush or spray to provide minimum dry film thickness of 2.0 mils.
- B. Touchup: Comply with requirements in Section 09912 "Interior Painting" for cleaning and touchup painting of field welds, bolted connections, and abraded areas of shop paint on miscellaneous metal.
- C. Galvanized Surfaces: Clean welds, bolted connections, and abraded areas and apply galvanizing-repair paint to comply with ASTM A 780.

END OF SECTION 260529

SECTION 262416

PANELBOARDS

PART 1 - GENERAL

1.1 SUMMARY

- A. Section includes distribution panelboards and lighting and appliance branch-circuit panelboards.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of product indicated.
- B. Shop Drawings: For each panelboard and related equipment.
 - 1. Include dimensioned plans, elevations, sections, and details. Show tabulations of installed devices, equipment features, and ratings.
 - 2. Detail enclosure types and details for types other than NEMA 250, Type 1.
 - 3. Detail bus configuration, current, and voltage ratings.
 - 4. Short-circuit current rating of panelboards and overcurrent protective devices.
 - 5. Include evidence of NRTL listing for series rating of installed devices.
 - 6. Detail features, characteristics, ratings, and factory settings of individual overcurrent protective devices and auxiliary components.
 - 7. Include wiring diagrams for power, signal, and control wiring.
 - 8. Include time-current coordination curves for each type and rating of overcurrent protective device included in panelboards.

1.3 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.
- B. Panelboard schedules for installation in panelboards.

1.4 CLOSEOUT SUBMITTALS

- A. Operation and maintenance data.

1.5 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with NEMA PB 1.
- C. Comply with NFPA 70.

1.6 WARRANTY

- A. Special Warranty: Manufacturer's standard form in which manufacturer agrees to repair or replace transient voltage suppression devices that fail in materials or workmanship within specified warranty period.
 - 1. Warranty Period: Five years from date of Substantial Completion.

PART 2 - PRODUCTS

2.1 GENERAL REQUIREMENTS FOR PANELBOARDS

- A. Fabricate and test panelboards according to IEEE 344 to withstand seismic forces.
- B. Enclosures: Flush-mounted cabinets.
 - 1. Rated for environmental conditions at installed location.
 - a. Indoor Dry and Clean Locations: NEMA 250, Type 1.
 - b. Outdoor Locations: NEMA 250, Type 3R.
 - c. Other Wet or Damp Indoor Locations: NEMA 250, Type 4.
 - 2. Front: Secured to box with concealed trim clamps. For surface-mounted fronts, match box dimensions; for flush-mounted fronts, overlap box.
 - 3. Hinged Front Cover: Entire front trim hinged to box and with standard door within hinged trim cover.
 - 4. Directory Card: Inside panelboard door, mounted in transparent card holder.
- C. Incoming Mains Location: Top.
- D. Phase, Neutral, and Ground Buses: Hard-drawn copper.
- E. Conductor Connectors: Suitable for use with conductor material and sizes.
 - 1. Material: Hard-drawn copper.
 - 2. Main and Neutral Lugs: Mechanical type.
 - 3. Ground Lugs and Bus Configured Terminators: Compression or Mechanical type.

- F. Service Equipment Label: NRTL labeled for use as service equipment for panelboards with one or more main service disconnecting and overcurrent protective devices.
- G. Future Devices: Mounting brackets, bus connections, filler plates, and necessary appurtenances required for future installation of devices.
- H. Panelboard Short-Circuit Current Rating: Rated for series-connected system with integral or remote upstream overcurrent protective devices and labeled by an NRTL. Include size and type of allowable upstream and branch devices, and listed and labeled for series-connected short-circuit rating by an NRTL.
- I. Panelboard Short-Circuit Current Rating: Fully rated to interrupt symmetrical short-circuit current available at terminals.

2.2 PERFORMANCE REQUIREMENTS

- 1. The term "withstand" means "the unit will remain in place without separation of any parts from the device when subjected to the seismic forces specified and the unit will be fully operational after the seismic event."
- B. Surge Suppression: Factory installed as an integral part of indicated panelboards, complying with UL 1449 SPD Type 1.

2.3 DISTRIBUTION PANELBOARDS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - 1. Eaton Electrical Inc.; Cutler-Hammer Business Unit.
 - 2. General Electric Company; GE Consumer & Industrial - Electrical Distribution.
 - 3. Siemens Energy & Automation, Inc.
 - 4. Square D; a brand of Schneider Electric.
- C. Panelboards: NEMA PB 1, power and feeder distribution type.
- D. Doors: Secured with vault-type latch with tumbler lock; keyed alike.
- E. Mains: Circuit breaker.
- F. Branch Overcurrent Protective Devices: For Circuit-Breaker Frame Sizes 125 A and Smaller: Bolt-on circuit breakers.

- G. Branch Overcurrent Protective Devices: For Circuit-Breaker Frame Sizes Larger Than 125 A: Bolt-on circuit breakers; plug-in circuit breakers where individual positive-locking device requires mechanical release for removal.
- H. Branch Overcurrent Protective Devices: Fused switches.

2.4 LIGHTING AND APPLIANCE BRANCH-CIRCUIT PANELBOARDS

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - 1. Eaton Electrical Inc.; Cutler-Hammer Business Unit.
 - 2. General Electric Company; GE Consumer & Industrial - Electrical Distribution.
 - 3. Siemens Energy & Automation, Inc.
 - 4. Square D; a brand of Schneider Electric.
- C. Panelboards: NEMA PB 1, lighting and appliance branch-circuit type.
- D. Mains: lugs only.
- E. Branch Overcurrent Protective Devices: Bolt-on circuit breakers, replaceable without disturbing adjacent units.
- F. Doors: Concealed hinges; secured with flush latch with tumbler lock; keyed alike.
- G. Column-Type Panelboards: Narrow gutter extension, with cover, to overhead junction box equipped with ground and neutral terminal buses.

2.5 DISCONNECTING AND OVERCURRENT PROTECTIVE DEVICES

- A. Manufacturers: Subject to compliance with requirements, available manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Basis-of-Design Product: Subject to compliance with requirements, provide product indicated on Drawings or comparable product by one of the following:
 - 1. Eaton Electrical Inc.; Cutler-Hammer Business Unit.
 - 2. General Electric Company; GE Consumer & Industrial - Electrical Distribution.
 - 3. Siemens Energy & Automation, Inc.
 - 4. Square D; a brand of Schneider Electric.
- C. Molded-Case Circuit Breaker (MCCB): Comply with UL 489, with interrupting capacity to meet available fault currents.

1. Thermal-Magnetic Circuit Breakers: Inverse time-current element for low-level overloads, and instantaneous magnetic trip element for short circuits. Adjustable magnetic trip setting for circuit-breaker frame sizes 250 A and larger.
 2. Adjustable Instantaneous-Trip Circuit Breakers: Magnetic trip element with front-mounted, field-adjustable trip setting.
 3. Electronic trip circuit breakers with rms sensing; field-replaceable rating plug or field-replicable electronic trip; and the following field-adjustable settings:
 - a. Instantaneous trip.
 - b. Long- and short-time pickup levels.
 - c. Long- and short-time time adjustments.
 - d. Ground-fault pickup level, time delay, and I^2t response.
 4. Current-Limiting Circuit Breakers: Frame sizes 400 A and smaller; let-through ratings less than NEMA FU 1, RK-5.
 5. GFCI Circuit Breakers: Single- and two-pole configurations with Class A ground-fault protection (6-mA trip).
 6. Ground-Fault Equipment Protection (GFEP) Circuit Breakers: Class B ground-fault protection (30-mA trip).
 7. Arc-Fault Circuit Interrupter (AFCI) Circuit Breakers: Comply with UL 1699; 120/240-V, single-pole configuration.
 8. Molded-Case Circuit-Breaker (MCCB) Features and Accessories:
 - a. Standard frame sizes, trip ratings, and number of poles.
 - b. Lugs: Mechanical style, suitable for number, size, trip ratings, and conductor materials.
 - c. Application Listing: Appropriate for application; Type SWD for switching fluorescent lighting loads; Type HID for feeding fluorescent and high-intensity discharge (HID) lighting circuits.
 - d. Ground-Fault Protection: Integrally mounted relay and trip unit with adjustable pickup and time-delay settings, push-to-test feature, and ground-fault indicator.
 - e. Shunt Trip: 120V trip coil energized from separate circuit, set to trip at 55 percent of rated voltage.
 - f. Handle Clamp: Loose attachment, for holding circuit-breaker handle in on position.
- D. Fused Switch: NEMA KS 1, Type HD; clips to accommodate specified fuses; lockable handle.

2.6 ACCESSORY COMPONENTS AND FEATURES

- A. Portable Test Set: For testing functions of solid-state trip devices without removing from panelboard. Include relay and meter test plugs suitable for testing panelboard meters and switchboard class relays.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Receive, inspect, handle, store and install panelboards and accessories according to NEMA PB 1.1.
- B. Mount top of trim 90 inches above finished floor unless otherwise indicated.
- C. Mount panelboard cabinet plumb and rigid without distortion of box. Mount recessed panelboards with fronts uniformly flush with wall finish and mating with back box.
- D. Install overcurrent protective devices and controllers not already factory installed.
 - 1. Set field-adjustable, circuit-breaker trip ranges.
- E. Install filler plates in unused spaces.
- F. Stub four 1-inch empty conduits from panelboard into accessible ceiling space or space designated to be ceiling space in the future.
- G. Arrange conductors in gutters into groups and bundle and wrap with wire ties.
- H. Comply with NECA 1.

3.2 IDENTIFICATION

- A. Identify field-installed conductors, interconnecting wiring, and components; provide warning signs. complying with Section 26055 "Identification for Electrical Systems."
- B. Create a directory to indicate installed circuit loads and incorporating Owner's final room designations. Obtain approval before installing. Use a computer or typewriter to create directory; handwritten directories are not acceptable.
- C. Panelboard Nameplates: Label each panelboard with a nameplate complying with requirements for identification specified in Section 26055 "Identification for Electrical Systems."
- D. Device Nameplates: Label each branch circuit device in distribution panelboards with a nameplate complying with requirements for identification specified in Section 26055 "Identification for Electrical Systems."

3.3 FIELD QUALITY CONTROL

- A. Perform tests and inspections.
- B. Acceptance Testing Preparation:

1. Test insulation resistance for each panelboard bus, component, connecting supply, feeder, and control circuit.
 2. Test continuity of each circuit.
- C. Tests and Inspections:
1. Perform each visual and mechanical inspection and electrical test stated in NETA Acceptance Testing Specification. Certify compliance with test parameters.
 2. Correct malfunctioning units on-site, where possible, and retest to demonstrate compliance; otherwise, replace with new units and retest.
- D. Panelboards will be considered defective if they do not pass tests and inspections.
- E. Prepare test and inspection reports, including a certified report that identifies panelboards included and that describes scanning results. Include notation of deficiencies detected, remedial action taken, and observations after remedial action.

END OF SECTION 262416

SECTION 262726

WIRING DEVICES

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Receptacles, receptacles with integral GFCI, and associated device plates.
2. Twist-locking receptacles.
3. Pendant cord-connector devices.
4. Toggle Switches.
5. Weather-resistant receptacles.
6. Cord and plug sets.
7. Floor service outlets, poke-through assemblies, service poles, and multi-outlet assemblies.
8. Communications outlets.

1.2 ADMINISTRATIVE REQUIREMENTS

A. Coordination:

1. Receptacles for Owner-Furnished Equipment: Match plug configurations.

1.3 ACTION SUBMITTALS

A. Product Data: For each type of product.

B. Shop Drawings: List of legends and description of materials and process used for premarking wall plates.

1.4 INFORMATIONAL SUBMITTALS

A. Field quality-control reports.

1.5 CLOSEOUT SUBMITTALS

A. Operation and maintenance data.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Manufacturers' Names: Shortened versions (shown in parentheses) of the following manufacturers' names are used in other Part 2 articles:
1. Cooper Wiring Devices; Division of Cooper Industries, Inc. (Cooper).
 2. Hubbell Incorporated; Wiring Device-Kellems (Hubbell).
 3. Leviton Mfg. Company Inc. (Leviton).
 4. Pass & Seymour/Legrand (Pass & Seymour).
- B. Source Limitations: Obtain each type of wiring device and associated wall plate from single source from single manufacturer.

2.2 GENERAL WIRING-DEVICE REQUIREMENTS

- A. Wiring Devices, Components, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with NFPA 70.
- C. Devices that are manufactured for use with modular plug-in connectors may be substituted under the following conditions:
1. Connectors shall comply with UL 2459 and shall be made with stranding building wire.
 2. Devices shall comply with the requirements in this Section.

2.3 STRAIGHT-BLADE RECEPTACLES

- A. Convenience Receptacles, 125 V, 20 A: Comply with NEMA WD 1, NEMA WD 6 Configuration 5-20R, UL 498, and FS W-C-596.
1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cooper; 5351 (single), CR5362 (duplex).
 - b. Hubbell; HBL5351 (single), HBL5352 (duplex).
 - c. Leviton; 5891 (single), 5352 (duplex).
 - d. Pass & Seymour; 5361 (single), 5362 (duplex).
- B. Isolated-Ground, Duplex Convenience Receptacles, 125V, 20A: Comply with NEMA WD 1, NEMA WWD 6 configuration 5-20R, and UL 498

1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Hubbell; CR 5253IG.
 - b. Leviton; 5362-IG.
 - c. Pass & Seymour; IG6300.

- C. Tamper-Resistant Convenience Receptacles, 125V, 20A: Comply with NEMA WD 1, NEMA WWD 6 configuration 5-20R, and UL 498
 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cooper; TR8300.
 - b. Hubbell; HBL8300SG
 - c. Leviton; 8300-SGG.
 - d. Pass & Seymour; 63H.

2.4 GFCI RECEPTACLES

- A. General Description:
 1. Straight blade, feed or non-feed-through type.
 2. Comply with NEMA WD 1, NEMA WD 6, UL 498, UL 943 Class A, and FS W-C-596.
 3. Include indicator light that shows when the GFCI has malfunctioned and no longer provides proper GFCI protection.

- B. Duplex GFCI Convenience Receptacles, 125 V, 20 A:
 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cooper; VGF20.
 - b. Hubbell; GFR5352L.
 - c. Pass & Seymour; 2095.
 - d. Leviton; 7590.

2.5 TWIST-LOCKING RECEPTACLES

- A. Single Convenience Receptacles, 125V, 20A: Comply with NEMA WD 1, NEMA WWD 6 configuration L5-20R, and UL 498

1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cooper; L520R.
 - b. Hubbell; HBL2310
 - c. Leviton; 2310.
 - d. Pass & Seymour; L520-R.
- B. Isolated-Ground, Single Convenience Receptacles, 125V, 20A: Comply with NEMA WD 1, NEMA WWD 6 configuration L5-20R, and UL 498
 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Hubbell; IG 2310.
 - b. Leviton; 2310-IG.
 2. Equipment grounding contacts shall be connected only to the green grounding screw terminal of the device and with inherent electrical isolation from mounting strap. Isolation shall be integral to receptacle construction and not dependent on removable parts.

2.6 PENDANT CORD-CONNECTOR DEVICES

- A. Matching, locking-type plug and receptacle body connector, NEMA WD 6 configuration L5-20P and L5-20R, heavy-duty grade
 1. Body: Nylon with screw-open cable-gripping jaws and provision for attaching external cable grip.
 2. External Cable Grip: Woven wire-mesh type made of high-strength galvanized-steel wire strand, matched to cable diameter, and with attachment provision designed for corresponding connector.

2.7 TOGGLE SWITCHES

- C. Comply with NEMA WD 1, UL 20, and FS W-S-896.
- D. Switches, 120/277 V, 20 A:
 1. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a) Single Pole:
 - 1) Cooper; AH1221.
 - 2) Hubbell; HBL1221.
 - 3) Leviton; 1221-2.

4) Pass & Seymour; CSB20AC1.

b) Two Pole:

- 1) Cooper; AH1222.
- 2) Hubbell; HBL1222.
- 3) Leviton; 1222-2.
- 4) Pass & Seymour; CSB20AC2.

c) Three Way:

- 1) Cooper; AH1223.
- 2) Hubbell; HBL1223.
- 3) Leviton; 1223-2.
- 4) Pass & Seymour; CSB20AC3.

d) Four Way:

- 1) Cooper; AH1224.
- 2) Hubbell; HBL1224.
- 3) Leviton; 1224-2.
- 4) Pass & Seymour; CSB20AC4.

E. Pilot-Light Switches, 20 A:

1. **Products:** Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cooper; AH1221PL for 120 and 277 V.
 - b. Hubbell; HBL1201PL for 120 and 277 V.
 - c. Leviton; 1221-LH1.
 - d. Pass & Seymour; PS20AC1RPL for 120 V, PS20AC1RPL7 for 277 V.
2. **Description:** Single pole, with neon-lighted handle, illuminated when switch is "off."

F. Key-Operated Switches, 120/277 V, 20 A:

1. **Products:** Subject to compliance with requirements, provide one of the following:
 - a. Cooper; AH1221L.
 - b. Hubbell; HBL1221L.
 - c. Leviton; 1221-2L.
 - d. Pass & Seymour; PS20AC1-L.
2. **Description:** Single pole, with factory-supplied key in lieu of switch handle.

2.8 CORD AND PLUG SETS

- A. Description: Match voltage and current ratings and number of conductors to requirements of equipment being connected.
 - 1. Cord: Rubber-insulated, stranded-copper conductors, with Type SOW-A jacket; with green-insulated grounding conductor and equipment rating ampacity plus a minimum of 30 percent.
 - 2. Plug: Nylon body and integral cable-clamping jaws. Match cord and receptacle type for connection.

2.9 FLOOR SERVICE FITTINGS

- A. Type: Modular, flush-type, dual-service units suitable for wiring method used.
- B. Compartments: Barrier separates power from voice and data communication cabling.
- C. Service Plate: Rectangular, die-cast aluminum with satin finish.
- D. Power Receptacle: NEMA WD 6 configuration 5-20R, gray finish, unless otherwise indicated.
- E. Communications Outlet: Modular, color-coded RJ45 jacks for UTP cable. Coordinate jack type with drawing requirements.

2.10 POKE-THROUGH ASSEMBLIES

- A. Description: Factory-fabricated and -prewired assembly of below-floor junction box with multichanneled, through-floor raceway/firestop unit and detachable matching floor service outlet assembly as specified above.
 - 1. Service Outlet Assembly: Flush type with devices coordinated with drawings.
 - 2. Fire Rating: Unit is listed and labeled for fire rating of floor-ceiling assembly.
 - 3. Closure Plug: Arranged to close unused 3-inch cored openings and reestablish fire rating of floor.
 - 4. Wiring Raceways and Compartments: Sized for a minimum of four No. 12 AWG conductors and a minimum of four (4) 4-pair Category 6 UTP communication cables.
 - 5. Communications Outlets: Modular, color-coded RJ45 jacks for UTP cable.

2.11 COMMUNICATIONS OUTLETS

- A. Telephone Patch Block:
 - 1. Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Leviton, 40066-M50.

- B. Telephone Outlet:
 - 1. Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cooper, 3560-6
 - b. Leviton; 40649.
 - 2. Description: Single RJ-11 jack for terminating 100-ohm, balanced, four-wire UTP; TIA/EIA-568-B.1; complying with Category 5e. Comply with UL 1863.
- C. Data Outlet:
 - 1. Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Panduit, CJS688TGY.
 - b. Leviton; 61110-RW6.
 - 2. Description: Single RJ-45 jack for terminating 100-ohm, balanced, four-pair UTP; TIA/EIA-568-B.1; complying with Category 6. Comply with UL 1863
- D. Combination TV and Telephone Outlet:
 - 1. Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, the following:
 - a. Cooper; 3562.
 - b. Leviton; 40159.
 - 2. Description: Single RJ-45 jack for 100-ohm, balanced, four-pair UTP; TIA/EIA-568-B.1; complying with Category 6. Comply with UL 1863.

2.12 WALL PLATES

- A. Contractor is to coordinate the installation of wall plates with the General Contractor and Painter SubContractor. The plates are not to be installed until after all painting has been completed.
- B. Single and combination types shall match corresponding wiring devices.
 - 1. Plate-Securing Screws: Metal with head color to match plate finish.
 - 2. Material for Finished Spaces: Smooth, high-impact thermoplastic, 0.035-inch.
 - 3. Material for Apparatus Bay Switch Covers: thick, satin-finished, Type 302 stainless steel, 0.04-inch.
- C. Wet-Location, Weatherproof Cover Plates: NEMA 250, complying with Type 3R, weather-resistant, die-cast aluminum or thermoplastic with lockable cover.

2.13 FINISHES

- A. Device Color:
 - 1. Wiring Devices: White unless otherwise indicated or required by NFPA 70 or device listing.
- B. Wall Plate Color: For plastic covers, match device color.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Comply with NECA 1, including mounting heights listed in that standard, unless otherwise indicated.
- B. Coordination with Other Trades:
 - 1. Protect installed devices and their boxes. Do not place wall finish materials over device boxes and do not cut holes for boxes with routers that are guided by riding against outside of boxes.
 - 2. Keep outlet boxes free of plaster, drywall joint compound, mortar, cement, concrete, dust, paint, and other material that may contaminate the raceway system, conductors, and cables.
 - 3. Install device boxes in brick or block walls so that the cover plate does not cross a joint unless the joint is troweled flush with the face of the wall.
 - 4. Install wiring devices after all wall preparation, including painting, is complete.
- C. Conductors:
 - 1. Do not strip insulation from conductors until right before they are spliced or terminated on devices.
 - 2. Strip insulation evenly around the conductor using tools designed for the purpose. Avoid scoring or nicking of solid wire or cutting strands from stranded wire.
 - 3. The length of free conductors at outlets for devices shall meet provisions of NFPA 70, Article 300, without pigtails.
 - 4. Existing Conductors:
 - a. Cut back and pigtail, or replace all damaged conductors.
 - b. Straighten conductors that remain and remove corrosion and foreign matter.
 - c. Pigtail existing conductors is permitted, provided the outlet box is large enough.
- D. Device Installation:

1. Replace devices that have been in temporary use during construction and that were installed before building finishing operations were complete.
2. Keep each wiring device in its package or otherwise protected until it is time to connect conductors.
3. Do not remove surface protection, such as plastic film and smudge covers, until the last possible moment.
4. Connect devices to branch circuits using pigtails that are not less than 6 inches in length.
5. When there is a choice, use side wiring with binding-head screw terminals. Wrap solid conductor tightly clockwise, two-thirds to three-fourths of the way around terminal screw.
6. Use a torque screwdriver when a torque is recommended or required by manufacturer.
7. When conductors larger than No. 12 AWG are installed on 15- or 20-A circuits, splice No. 12 AWG pigtails for device connections.
8. Tighten unused terminal screws on the device.
9. When mounting into metal boxes, remove the fiber or plastic washers used to hold device-mounting screws in yokes, allowing metal-to-metal contact.

E. Receptacle Orientation:

1. Install ground pin of vertically mounted receptacles down, and on horizontally mounted receptacles to the right.

F. Device Plates: Do not use oversized or extra-deep plates. Repair wall finishes and remount outlet boxes when standard device plates do not fit flush or do not cover rough wall opening.

G. Dimmers:

1. Install dimmers within terms of their listing.
2. Verify that dimmers used for fan speed control are listed for that application.
3. Install unshared neutral conductors on line and load side of dimmers according to manufacturers' device listing conditions in the written instructions.

H. Arrangement of Devices: Unless otherwise indicated, mount flush, with long dimension vertical and with grounding terminal of receptacles on top. Group adjacent switches under single, multigang wall plates.

I. Adjust locations of service poles to suit arrangement of partitions and furnishings.

3.2 GFCI RECEPTACLES

- A. Install non-feed-through-type GFCI receptacles where protection of downstream receptacles is not required.

3.3 FIELD QUALITY CONTROL

- A. Perform the following tests and inspections:
 - 1. Test Instruments: Use instruments that comply with UL 1436.
 - 2. Test Instrument for Convenience Receptacles: Digital wiring analyzer with digital readout or illuminated digital-display indicators of measurement.
- B. Tests for Convenience Receptacles:
 - 1. Line Voltage: Acceptable range is 105 to 132 V.
 - 2. Percent Voltage Drop under 15-A Load: A value of 6 percent or higher is unacceptable.
 - 3. Ground Impedance: Values of up to 2 ohms are acceptable.
 - 4. GFCI Trip: Test for tripping values specified in UL 1436 and UL 943.
 - 5. Using the test plug, verify that the device and its outlet box are securely mounted.
 - 6. Tests shall be diagnostic, indicating damaged conductors, high resistance at the circuit breaker, poor connections, inadequate fault current path, defective devices, or similar problems. Correct circuit conditions, remove malfunctioning units and replace with new ones, and retest as specified above.
- C. Wiring device will be considered defective if it does not pass tests and inspections.
- D. Prepare test and inspection reports.

END OF SECTION 262726

SECTION 265100
INTERIOR LIGHTING

PART 1 - GENERAL

1.1 SUMMARY

A. Section Includes:

1. Interior lighting fixtures, lamps, and ballasts.
2. Emergency lighting units.
3. Exit signs.
4. Lighting fixture supports.
5. Retrofit kits for fluorescent lighting fixtures.

1.2 ACTION SUBMITTALS

- A. Product Data: For each type of lighting fixture, arranged in order of fixture designation. Include data on features, accessories, and finishes.
- B. Shop Drawings: Show details of nonstandard or custom lighting fixtures. Indicate dimensions, weights, methods of field assembly, components, features, and accessories. Product Certificates: For each type of ballast for bi-level and dimmer-controlled fixtures, from manufacturer.

1.3 INFORMATIONAL SUBMITTALS

- A. Field quality-control reports.

1.4 QUALITY ASSURANCE

- A. Electrical Components, Devices, and Accessories: Listed and labeled as defined in NFPA 70, by a qualified testing agency, and marked for intended location and application.
- B. Comply with NFPA 70.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Products: Subject to compliance with requirements, available products that may be incorporated into the Work include, but are not limited to, product(s) indicated on Drawings.

2.2 GENERAL REQUIREMENTS FOR LIGHTING FIXTURES AND COMPONENTS

- A. Recessed Fixtures: Comply with NEMA LE 4 for ceiling compatibility for recessed fixtures.
- B. Incandescent Fixtures: Comply with UL 1598. Where LER is specified, test according to NEMA LE 5A.
- C. Fluorescent Fixtures: Comply with UL 1598. Where LER is specified, test according to NEMA LE 5 and NEMA LE 5A as applicable.
- D. HID Fixtures: Comply with UL 1598. Where LER is specified, test according to NEMA LE 5B.
- E. Metal Parts: Free of burrs and sharp corners and edges.
- F. Sheet Metal Components: Steel unless otherwise indicated. Form and support to prevent warping and sagging.
- G. Doors, Frames, and Other Internal Access: Smooth operating, free of light leakage under operating conditions, and designed to permit relamping without use of tools. Designed to prevent doors, frames, lenses, diffusers, and other components from falling accidentally during relamping and when secured in operating position.
- H. Diffusers and Globes:
 - 1. Acrylic Lighting Diffusers: 100 percent virgin acrylic plastic. High resistance to yellowing and other changes due to aging, exposure to heat, and UV radiation.
 - a. Lens Thickness: At least 0.125 inch minimum unless otherwise indicated.
 - b. UV stabilized.
 - 2. Glass: Annealed crystal glass unless otherwise indicated.

2.3 BALLASTS FOR LINEAR FLUORESCENT LAMPS

- A. General Requirements for Electronic Ballasts:
 - 1. Comply with UL 935 and with ANSI C82.11.

2. Designed for type and quantity of lamps served.
 3. Ballasts shall be designed for full light output unless another BF, dimmer, or bi-level control is indicated.
 4. Sound Rating: Class A except Class B for T12/HO and T12/Slimline lamp ballasts.
 5. Total Harmonic Distortion Rating: Less than 10 percent.
 6. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
 7. Operating Frequency: 42 kHz or higher.
 8. Lamp Current Crest Factor: 1.7 or less.
 9. BF: 0.88 or higher.
 10. Power Factor: 0.95 or higher.
- B. Luminaires controlled by occupancy sensors shall have programmed-start ballasts.
- C. Electromagnetic Ballasts: Comply with ANSI C82.1; energy saving, high-power factor, Class P, and having automatic-reset thermal protection.
1. Ballast Manufacturer Certification: Indicated by label.
- D. Single Ballasts for Multiple Lighting Fixtures: Factory wired with ballast arrangements and bundled extension wiring to suit final installation conditions without modification or rewiring in the field.
- E. Ballasts for Low-Temperature Environments: Electronic type rated for 0 deg F starting and operating temperature with indicated lamp types.
- F. Ballasts for Residential Applications: Fixtures designated as "Residential" may use low-power-factor electronic ballasts having a Class B sound rating and total harmonic distortion of approximately 30 percent.
- G. Ballasts for Dimmer-Controlled Lighting Fixtures: Electronic type.
1. Dimming Range: 100 to 5 percent of rated lamp lumens.
 2. Ballast Input Watts: Can be reduced to 20 percent of normal.
 3. Compatibility: Certified by manufacturer for use with specific dimming control system and lamp type indicated.
 4. Control: Coordinate wiring from ballast to control device to ensure that the ballast, controller, and connecting wiring are compatible.
- H. Ballasts for Bi-Level Controlled Lighting Fixtures: Electronic type.
1. Operating Modes: Ballast circuit and leads provide for remote control of the light output of the associated lamp between high- and low-level and off.
 - a. High-Level Operation: 100 percent of rated lamp lumens.
 - b. Low-Level Operation: 30 percent of rated lamp lumens.
 2. Ballast shall provide equal current to each lamp in each operating mode.

3. Compatibility: Certified by manufacturer for use with specific bi-level control system and lamp type indicated.

I. Ballasts for Tri-Level Controlled Lighting Fixtures: Electronic type.

1. Operating Modes: Ballast circuit and leads provide for remote control of the light output of the associated lamp between high- and low-level and off.
 - a. High-Level Operation: 100 percent of rated lamp lumens.
 - b. Low-Level Operation: 30 and 60 percent of rated lamp lumens.
2. Ballast shall provide equal current to each lamp in each operating mode.
3. Compatibility: Certified by manufacturer for use with specific tri-level control system and lamp type indicated.

2.4 BALLASTS FOR COMPACT FLUORESCENT LAMPS

- A. Description: Electronic-programmed rapid-start type, complying with UL 935 and with ANSI C 82.11, designed for type and quantity of lamps indicated. Ballast shall be designed for full light output unless dimmer or bi-level control is indicated:

1. Lamp end-of-life detection and shutdown circuit.
2. Automatic lamp starting after lamp replacement.
3. Sound Rating: Class A.
4. Total Harmonic Distortion Rating: Less than 20 percent.
5. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
6. Operating Frequency: 20 kHz or higher.
7. Lamp Current Crest Factor: 1.7 or less.
8. BF: 0.95 or higher unless otherwise indicated.
9. Power Factor: 0.95, except fixtures designated as "Residential" may use low-power-factor electronic ballasts or higher.
10. Interference: Comply with 47 CFR 18, Ch. 1, Subpart C, for limitations on electromagnetic and radio-frequency interference for nonconsumer equipment.

2.5 EMERGENCY FLUORESCENT POWER UNIT

- A. Internal Type: Self-contained, modular, battery-inverter unit, factory mounted within lighting fixture body and compatible with ballast. Comply with UL 924.

1. Emergency Connection: Operate one fluorescent lamp(s) continuously at an output of 1100 lumens each. Connect unswitched circuit to battery-inverter unit and switched circuit to fixture ballast.
2. Nightlight Connection: Operate one fluorescent lamp continuously.
3. Test Push Button and Indicator Light: Visible and accessible without opening fixture or entering ceiling space.

- a. Push Button: Push-to-test type, in unit housing, simulates loss of normal power and demonstrates unit operability.
 - b. Indicator Light: LED indicates normal power on. Normal glow indicates trickle charge; bright glow indicates charging at end of discharge cycle.
4. Battery: Sealed, maintenance-free, nickel-cadmium type.
 5. Charger: Fully automatic, solid-state, constant-current type with sealed power transfer relay.
 6. Integral Self-Test: Factory-installed electronic device automatically initiates code-required test of unit emergency operation at required intervals. Test failure is annunciated by an integral audible alarm and a flashing red LED.

2.6 BALLASTS FOR HID LAMPS

- A. Electromagnetic Ballast for Metal-Halide Lamps: Comply with ANSI C82.4 and UL 1029. Include the following features unless otherwise indicated:
 1. Ballast Circuit: Constant-wattage autotransformer or regulating high-power-factor type.
 2. Minimum Starting Temperature: Minus 22 deg F for single-lamp ballasts.
 3. Rated Ambient Operating Temperature: 104 deg F.
 4. Open-circuit operation that will not reduce average life.
 5. Low-Noise Ballasts: Manufacturers' standard epoxy-encapsulated models designed to minimize audible fixture noise.
- B. Electronic Ballast for Metal-Halide Lamps: Include the following features unless otherwise indicated:
 1. Minimum Starting Temperature: Minus 20 deg F for single-lamp ballasts.
 2. Rated Ambient Operating Temperature: 130 deg F.
 3. Lamp end-of-life detection and shutdown circuit.
 4. Sound Rating: Class A.
 5. Total Harmonic Distortion Rating: Less than 20 percent.
 6. Transient Voltage Protection: IEEE C62.41.1 and IEEE C62.41.2, Category A or better.
 7. Lamp Current Crest Factor: 1.5 or less.
 8. Power Factor: 0.90 or higher.
 9. Interference: Comply with 47 CFR 18, Ch. 1, Subpart C, for limitations on electromagnetic and radio-frequency interference for nonconsumer equipment.
 10. Protection: Class P thermal cutout.
- C. High-Pressure Sodium Ballasts: Electromagnetic type, with solid-state igniter/starter. Igniter/starter shall have an average life in pulsing mode of 10,000 hours at an igniter/starter-case temperature of 90 deg C.
 1. Instant-Restrike Device: Integral with ballast, or solid-state potted module, factory installed within fixture and compatible with lamps, ballasts, and mogul sockets up to 150 W.

2. Minimum Starting Temperature: Minus 40 deg F .

2.7 EXIT SIGNS

- A. General Requirements for Exit Signs: Comply with UL 924; for sign colors, visibility, luminance, and lettering size, comply with authorities having jurisdiction.
- B. Internally Lighted Signs:
 1. Lamps for AC Operation: Fluorescent, two for each fixture, 20,000 hours of rated lamp life.
 2. Lamps for AC Operation: LEDs, 50,000 hours minimum rated lamp life.
 3. Self-Powered Exit Signs (Battery Type): Integral automatic charger in a self-contained power pack.
 - a. Battery: Sealed, maintenance-free, nickel-cadmium type.
 - b. Charger: Fully automatic, solid-state type with sealed transfer relay.
 - c. Operation: Relay automatically energizes lamp from battery when circuit voltage drops to 80 percent of nominal voltage or below. When normal voltage is restored, relay disconnects lamps from battery, and battery is automatically recharged and floated on charger.
 - d. Test Push Button: Push-to-test type, in unit housing, simulates loss of normal power and demonstrates unit operability.
 - e. LED Indicator Light: Indicates normal power on. Normal glow indicates trickle charge; bright glow indicates charging at end of discharge cycle.

2.8 EMERGENCY LIGHTING UNITS

- A. General Requirements for Emergency Lighting Units: Self-contained units complying with UL 924.
 1. Battery: Sealed, maintenance-free, lead-acid type.
 2. Charger: Fully automatic, solid-state type with sealed transfer relay.
 3. Operation: Relay automatically turns lamp on when power-supply circuit voltage drops to 80 percent of nominal voltage or below. Lamp automatically disconnects from battery when voltage approaches deep-discharge level. When normal voltage is restored, relay disconnects lamps from battery, and battery is automatically recharged and floated on charger.
 4. Test Push Button: Push-to-test type, in unit housing, simulates loss of normal power and demonstrates unit operability.
 5. LED Indicator Light: Indicates normal power on. Normal glow indicates trickle charge; bright glow indicates charging at end of discharge cycle.
 6. Wire Guard: Heavy-chrome-plated wire guard protects lamp heads or fixtures.
 7. Integral Time-Delay Relay: Holds unit on for fixed interval of 15 minutes when power is restored after an outage.

2.9 FLUORESCENT LAMPS

- A. T8 rapid-start lamps, rated 32 W maximum, nominal length of 48 inches, 2800 initial lumens (minimum), CRI 75 (minimum), color temperature 3500K, and average rated life 20,000 hours unless otherwise indicated.
- B. T8 rapid-start lamps, rated 17 W maximum, nominal length of 24 inches 1300 initial lumens (minimum), CRI 75 (minimum), color temperature 3500 K, and average rated life of 20,000 hours unless otherwise indicated.
- C. Compact Fluorescent Lamps: 4-Pin, CRI 80 (minimum), color temperature 3500 K, average rated life of 10,000 hours at three hours operation per start, and suitable for use with dimming ballasts unless otherwise indicated.
 - 1. 13 W: T4, double or triple tube, rated 900 initial lumens (minimum).
 - 2. 18 W: T4, double or triple tube, rated 1200 initial lumens (minimum).
 - 3. 26 W: T4, double or triple tube, rated 1800 initial lumens (minimum).
 - 4. 32 W: T4, triple tube, rated 2400 initial lumens (minimum).
 - 5. 42 W: T4, triple tube, rated 3200 initial lumens (minimum).
 - 6. 57 W: T4, triple tube, rated 4300 initial lumens (minimum).
 - 7. 70 W: T4, triple tube, rated 5200 initial lumens (minimum).

2.10 HID LAMPS

- A. High-Pressure Sodium Lamps: ANSI C78.42, CRI 21 (minimum), color temperature 1900 K, and average rated life of 24,000 hours, minimum.
- B. Metal-Halide Lamps: ANSI C78.43, with minimum CRI 65, and color temperature 4000 K.
- C. Pulse-Start, Metal-Halide Lamps: Minimum CRI 65, and color temperature 4000 K.
- D. Ceramic, Pulse-Start, Metal-Halide Lamps: Minimum CRI 80, and color temperature 4000 K.
- E. Low-Pressure Sodium Lamps: ANSI 78.41, CRI 0, and color temperature 1800 K.

2.11 LIGHTING FIXTURE SUPPORT COMPONENTS

- A. Comply with Section 26059 "Hangers and Supports for Electrical Systems" for channel- and angle-iron supports and nonmetallic channel and angle supports.
- B. Single-Stem Hangers: 1/2-inch steel tubing with swivel ball fittings and ceiling canopy. Finish same as fixture.
- C. Twin-Stem Hangers: Two, 1/2-inch steel tubes with single canopy designed to mount a single fixture. Finish same as fixture.

- D. Wires: ASTM A 641/A 641M, Class 3, soft temper, zinc-coated steel, 12 gage.
- E. Wires for Humid Spaces: ASTM A 580/A 580M, Composition 302 or 304, annealed stainless steel, 12 gage.
- F. Rod Hangers: 3/16-inch minimum diameter, cadmium-plated, threaded steel rod.
- G. Hook Hangers: Integrated assembly matched to fixture and line voltage and equipped with threaded attachment, cord, and locking-type plug.

2.12 RETROFIT KITS FOR FLUORESCENT LIGHTING FIXTURES

- A. Reflector Kit: UL 1598, Type I. Suitable for two- to four-lamp, surface-mounted or recessed lighting fixtures by improving reflectivity of fixture surfaces.
- B. Ballast and Lamp Change Kit: UL 1598, Type II. Suitable for changing existing ballast, lamps, and sockets.

PART 3 - EXECUTION

3.1 INSTALLATION

- A. Lighting fixtures: Set level, plumb, and square with ceilings and walls. Install lamps in each fixture.
- B. Comply with NFPA 70 for minimum fixture supports.
- C. Suspended Lighting Fixture Support:
 - 1. Pendants and Rods: Where longer than 48 inches, brace to limit swinging.
 - 2. Stem-Mounted, Single-Unit Fixtures: Suspend with twin-stem hangers.
 - 3. Continuous Rows: Use tubing or stem for wiring at one point and tubing or rod for suspension for each unit length of fixture chassis, including one at each end.
- D. Adjust aimable lighting fixtures to provide required light intensities.
- E. Connect wiring according to Section 26051 "Low-Voltage Electrical Power Conductors and Cables."

3.2 FIELD QUALITY CONTROL

- A. Test for Emergency Lighting: Interrupt power supply to demonstrate proper operation. Verify transfer from normal power to battery and retransfer to normal.

ST. TAMMANY FIRE PROTECTION DISTRICT NO. 1
NEW TRAINING FACILITY
34780 S. RANGE ROAD
SLIDELL LA 70460

- B. Prepare a written report of tests, inspections, observations, and verifications indicating and interpreting results. If adjustments are made to lighting system, retest to demonstrate compliance with standards.

END OF SECTION 265100

DIVISION 31

EARTHWORK

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
www.dammonengineering.com



SECTION 311000

SITE CLEARING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Protecting existing trees, shrubs, groundcovers, plants and grass to remain.
 - 2. Removing existing trees, shrubs, groundcovers, plants and grass.
 - 3. Clearing and grubbing.
 - 4. Stripping and stockpiling topsoil.
 - 5. Removing above- and below-grade site improvements.
 - 6. Disconnecting, capping or sealing, and removing site utilities.
 - 7. Temporary erosion and sedimentation control measures.

1.3 DEFINITIONS

- A. Topsoil: Natural or cultivated surface-soil layer containing organic matter and sand, silt, and clay particles; friable, pervious, and black or a darker shade of brown, gray, or red than underlying subsoil; reasonably free of subsoil, clay lumps, gravel, and other objects more than 2 inches in diameter; and free of subsoil and weeds, roots, toxic materials, or other non-soil materials.
- B. Tree Protection Zone: Area surrounding individual trees or groups of trees to be protected during construction, and defined by the drip line of individual trees or the perimeter drip line of groups of trees, unless otherwise indicated.

1.4 MATERIAL OWNERSHIP

- A. Except for stripped topsoil or other materials indicated to remain Owner's property, cleared materials shall become Contractor's property and shall be removed from Project site.

1.5 SUBMITTALS

- A. Photographs or videotape, sufficiently detailed, of existing conditions of trees and plantings, adjoining construction, and site improvements that might be misconstrued as damage caused by site clearing.
- B. Record drawings, according to Division 1, identifying and accurately locating capped utilities and other subsurface structural, electrical, and mechanical conditions.

1.6 QUALITY ASSURANCE

- A. Preinstallation Conference: Conduct conference at Project site to comply with requirements in Division 1 Section "Project Management and Coordination."

1.7 PROJECT CONDITIONS

- A. Traffic: Minimize interference with adjoining roads, streets, walks, and other adjacent occupied or used facilities during site-clearing operations.
 - 1. Do not close or obstruct streets, walks, or other adjacent occupied or used facilities without permission from Owner and authorities having jurisdiction.
 - 2. Provide alternate routes around closed or obstructed traffic ways if required by authorities having jurisdiction.
- B. Salvable Improvements: Carefully remove items indicated to be salvaged and store on Owner's premises where indicated.
- C. Utility Locator Service: Notify utility locator service for area where Project is located before site clearing.
- D. Do not commence site clearing operations until temporary erosion and sedimentation control measures are in place.

PART 2 - PRODUCTS

2.1 SOIL MATERIALS

- A. Satisfactory Soil Materials: Requirements for satisfactory soil materials are specified in Division 2 Section "Earthwork."
 - 1. Obtain approved borrow soil materials off-site when satisfactory soil materials are not available on-site.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Protect and maintain benchmarks and survey control points from disturbance during construction.
- B. Locate and clearly flag trees and vegetation to remain or to be relocated.
- C. Protect existing site improvements to remain from damage during construction.
 - 1. Restore damaged improvements to their original condition, as acceptable to Owner.

3.2 TEMPORARY EROSION AND SEDIMENTATION CONTROL

- A. Provide temporary erosion and sedimentation control measures to prevent soil erosion and discharge of soil-bearing water runoff or airborne dust to adjacent properties and walkways, according to requirements of authorities having jurisdiction.
- B. Inspect, repair, and maintain erosion and sedimentation control measures during construction until permanent vegetation has been established.
- C. Remove erosion and sedimentation controls and restore and stabilize areas disturbed during removal.

3.3 TREE PROTECTION

- A. Erect and maintain temporary orange fencing around tree protection zones before starting site clearing. Remove fence when construction is complete.
 - 1. Do not store construction materials, debris, or excavated material within fenced area.
 - 2. Do not permit vehicles, equipment, or foot traffic within fenced area.
 - 3. Maintain fenced area free of weeds and trash.
- B. Do not excavate within tree protection zones, unless otherwise indicated.
- C. Where excavation for new construction is required within tree protection zones, hand clear and excavate to minimize damage to root systems. Use narrow-tine spading forks, comb soil to expose roots, and cleanly cut roots as close to excavation as possible.
 - 1. Cover exposed roots with burlap and water regularly.
 - 2. Temporarily support and protect roots from damage until they are permanently redirected and covered with soil.

3. Coat cut faces of roots more than 1-1/2 inches in diameter with an emulsified asphalt or other approved coating formulated for use on damaged plant tissues.
4. Backfill with soil as soon as possible.

D. Repair or replace trees and vegetation indicated to remain that are damaged by construction operations, in a manner approved by Architect.

1. Employ an arborist, licensed in jurisdiction where Project is located, to submit details of proposed repairs and to repair damage to trees and shrubs.
2. Replace trees that cannot be repaired and restored to full-growth status, as determined by Architect.

3.4 UTILITIES

A. Owner will arrange for disconnecting and sealing indicated utilities that serve existing structures before site clearing, when requested by Contractor.

1. Verify that utilities have been disconnected and capped before proceeding with site clearing.

B. Locate, identify, disconnect, and seal or cap off utilities indicated to be removed.

1. Arrange with utility companies to shut off indicated utilities.
2. Owner will arrange to shut off indicated utilities when requested by Contractor.

C. Existing Utilities: Do not interrupt utilities serving facilities occupied by Owner or others unless permitted under the following conditions and then only after arranging to provide temporary utility services according to requirements indicated:

1. Notify Architect not less than two days in advance of proposed utility interruptions.
2. Do not proceed with utility interruptions without Architect's written permission.

D. Excavate for and remove underground utilities indicated to be removed.

E. Removal of underground utilities is included in Division 2 Sections covering site utilities.

3.5 CLEARING AND GRUBBING

A. Remove obstructions, trees, shrubs, grass, and other vegetation to permit installation of new construction.

1. Do not remove trees, shrubs, and other vegetation indicated to remain or to be relocated.

2. Cut minor roots and branches of trees indicated to remain in a clean and careful manner where such roots and branches obstruct installation of new construction.
 3. Grind stumps and remove roots, obstructions, and debris extending to a depth of 18 inches below exposed subgrade.
 4. Use only hand methods for grubbing within tree protection zone.
 5. Chip removed tree branches and dispose of off-site.
- B. Fill depressions caused by clearing and grubbing operations with satisfactory soil material unless further excavation or earthwork is indicated.
1. Place fill material in horizontal layers not exceeding a loose depth of 8 inches, and compact each layer to a density equal to adjacent original ground.
- 3.6 TOPSOIL STRIPPING
- A. Remove sod and grass before stripping topsoil.
- B. Strip topsoil to whatever depths are encountered in a manner to prevent intermingling with underlying subsoil or other waste materials.
1. Remove subsoil and nonsoil materials from topsoil, including trash, debris, weeds, roots, and other waste materials.
- C. Stockpile topsoil materials away from edge of excavations without intermixing with subsoil. Grade and shape stockpiles to drain surface water. Cover to prevent windblown dust.
1. Limit height of topsoil stockpiles to 72 inches.
 2. Do not stockpile topsoil within tree protection zones.
 3. Dispose of excess topsoil as specified for waste material disposal.
 4. Stockpile surplus topsoil to allow for re-spreading deeper topsoil.
- 3.7 SITE IMPROVEMENTS
- A. Remove existing above- and below-grade improvements as indicated and as necessary to facilitate new construction.
- B. Remove slabs, paving, curbs, gutters, and aggregate base as indicated.
1. Unless existing full-depth joints coincide with line of demolition, neatly saw-cut length of existing pavement to remain before removing existing pavement. Saw-cut faces vertically.
 2. Paint cut ends of steel reinforcement in concrete to remain to prevent corrosion.

3.8 DISPOSAL

- A. Disposal: Remove surplus soil material, unsuitable topsoil, obstructions, demolished materials, and waste materials including trash and debris, and legally dispose of them off Owner's property.
 - 1. Separate recyclable materials produced during site clearing from other non-recyclable materials. Store or stockpile without intermixing with other materials and transport them to recycling facilities.

END OF SECTION

SECTION 312000

EARTH MOVING

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:

1. Preparing subgrades for slabs-on-grade, walks, pavements and lawns and grasses.
2. Excavating and backfilling for buildings and structures.
3. Drainage course for slabs-on-grade.
4. Subbase course for concrete walks and pavements.
5. Subsurface drainage backfill for walls and trenches.
6. Excavating and backfilling for utility trenches.
7. Excavating and backfilling trenches for buried mechanical and electrical utilities and pits for buried utility structures.

1.3 DEFINITIONS

- A. Backfill: Soil material or controlled low-strength material used to fill an excavation.
1. Initial Backfill: Backfill placed beside and over pipe in a trench, including haunches to support sides of pipe.
 2. Final Backfill: Backfill placed over initial backfill to fill a trench.
- B. Bedding Course: Course placed over the excavated subgrade in a trench before laying pipe.
- C. Borrow Soil: Satisfactory soil imported from off-site for use as fill or backfill.
- D. Drainage Course: Course supporting the slab-on-grade that also minimizes upward capillary flow of pore water.
- E. Excavation: Removal of material encountered above subgrade elevations and to lines and dimensions indicated.
1. Authorized Additional Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions as directed by Architect. Authorized

additional excavation and replacement material will be paid for according to Contract provisions for unit prices.

2. Unauthorized Excavation: Excavation below subgrade elevations or beyond indicated lines and dimensions without direction by Architect. Unauthorized excavation, as well as remedial work directed by Architect, shall be without additional compensation.

F. Fill: Soil materials used to raise existing grades.

G. Structures: Buildings, footings, foundations, retaining walls, slabs, tanks, curbs, mechanical and electrical appurtenances, or other man-made stationary features constructed above or below the ground surface.

H. Subbase Course: Course placed between the subgrade and base course for hot-mix asphalt pavement, or course placed between the subgrade and a cement concrete pavement or a cement concrete or hot-mix asphalt walk.

I. Subgrade: Surface or elevation remaining after completing excavation, or top surface of a fill or backfill immediately below subbase, drainage fill, or topsoil materials.

J. Utilities: On-site underground pipes, conduits, ducts, and cables, as well as underground services within buildings.

1.4 SUBMITTALS

A. Product Data: For the following:

1. Each type of plastic warning tape.
2. Geotextile.
3. Controlled low-strength material, including design mixture.

B. Samples: 12-by-12-inch Sample of geotextile.

C. Material Test Reports: From a qualified testing agency indicating and interpreting test results for compliance of the following with requirements indicated:

1. Classification according to ASTM D 2487 of each on-site and borrow soil material proposed for fill and backfill.
2. Laboratory compaction curve according to ASTM D 698 for each on-site and borrow soil material proposed for fill and backfill.

D. Pre-excavation Photographs or Videotape: Show existing conditions of adjoining construction and site improvements, including finish surfaces, that might be misconstrued as damage caused by earthwork operations. Submit before earthwork begins.

1.5 QUALITY ASSURANCE

- A. Geotechnical Testing Agency Qualifications: An independent testing agency qualified according to ASTM E 329 to conduct soil materials, as documented according to ASTM D 3740 and ASTM E 548.
- B. Pre-excavation Conference: Conduct conference at Project site to comply with requirements in Division 1 Section "Project Management and Coordination."

1.6 PROJECT CONDITIONS

- A. Existing Utilities: Do not interrupt utilities serving facilities occupied by Owner or others unless permitted in writing by Architect and then only after arranging to provide temporary utility services according to requirements indicated.
 - 1. Notify Architect not less than two days in advance of proposed utility interruptions.
 - 2. Do not proceed with utility interruptions without Architect's written permission.
 - 3. Contact utility-locator service for area where Project is located before excavating.
- B. Demolish and completely remove from site existing underground utilities indicated to be removed. Coordinate with utility companies to shut off services if lines are active.

PART 2 - PRODUCTS

2.1 SOIL MATERIALS

- A. General: Provide borrow soil materials when sufficient satisfactory soil materials are not available from excavations.
- B. Satisfactory Soils: Provide in accordance with Geotechnical Engineering Report and with a maximum dimension of 3 inches; free of debris, waste, frozen materials, vegetation, and other deleterious matter.
- C. Unsatisfactory Soils: Soil Classification Groups that are not in accordance with Geotechnical Engineering Report.
 - 1. Unsatisfactory soils also include satisfactory soils not maintained within 2 percent of optimum moisture content at time of compaction.
- D. Subbase Material: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940; with at least 90

percent passing a 1-1/2-inch sieve and not more than 12 percent passing a No. 200 sieve.

- E. Base Course: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940; with at least 95 percent passing a 1-1/2-inch sieve and not more than 8 percent passing a No. 200 sieve.
- F. Engineered Fill: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940; with at least 90 percent passing a 1-1/2-inch sieve and not more than 12 percent passing a No. 200 sieve.
- G. Bedding Course: Naturally or artificially graded mixture of natural or crushed gravel, crushed stone, and natural or crushed sand; ASTM D 2940; except with 100 percent passing a 1-inch sieve and not more than 8 percent passing a No. 200 sieve.
- H. Drainage Course: Narrowly graded mixture of washed or crushed stone, or crushed or uncrushed gravel; ASTM D 448; coarse-aggregate grading Size 57; with 100 percent passing a 1-1/2-inch sieve and 0 to 5 percent passing a No. 8 sieve.
- I. Filter Material: Narrowly graded mixture of natural or crushed gravel, or crushed stone and natural sand; ASTM D 448; coarse-aggregate grading Size 67; with 100 percent passing a 1-inch sieve and 0 to 5 percent passing a No. 4 sieve.
- J. Sand: ASTM C 33; fine aggregate, natural, or manufactured sand.
- K. Impervious Fill: Clayey gravel and sand mixture capable of compacting to a dense state.

2.2 GEOTEXTILES

- A. Subsurface Drainage Geotextile: Nonwoven needle-punched geotextile, manufactured for subsurface drainage applications, made from polyolefins or polyesters; with elongation greater than 50 percent; complying with AASHTO M 288 and the following, measured per test methods referenced:
 - 1. Survivability: Class 2; AASHTO M 288.
 - 2. Grab Tensile Strength: 157 lbf; ASTM D 4632.
 - 3. Sewn Seam Strength: 142 lbf; ASTM D 4632.
 - 4. Tear Strength: 56 lbf; ASTM D 4533.
 - 5. Puncture Strength: 56 lbf; ASTM D 4833.
 - 6. Apparent Opening Size: No. 40 sieve, maximum; ASTM D 4751.
 - 7. Permittivity: 0.5 per second, minimum; ASTM D 4491.
 - 8. UV Stability: 50 percent after 500 hours' exposure; ASTM D 4355.
- B. Separation Geotextile: Woven geotextile fabric, manufactured for separation applications, made from polyolefins or polyesters; with elongation less than 50 percent; complying with AASHTO M 288 and the following, measured per test methods referenced:

1. Survivability: Class 2; AASHTO M 288.
2. Grab Tensile Strength: 247 lbf; ASTM D 4632.
3. Sewn Seam Strength: 222 lbf; ASTM D 4632.
4. Tear Strength: 90 lbf; ASTM D 4533.
5. Puncture Strength: 90 lbf; ASTM D 4833.
6. Apparent Opening Size: No. 60 sieve, maximum; ASTM D 4751.
7. Permittivity: 0.02 per second, minimum; ASTM D 4491.
8. UV Stability: 50 percent after 500 hours' exposure; ASTM D 4355.

2.3 CONTROLLED LOW-STRENGTH MATERIAL

- A. Controlled Low-Strength Material: Low-density, self-compacting, flowable concrete material as follows:
1. Portland Cement: ASTM C 150, Type I, II, or III.
 2. Fly Ash: ASTM C 618, Class C or F.
 3. Normal-Weight Aggregate: ASTM C 33.
 4. Foaming Agent: ASTM C 869.
 5. Water: ASTM C 94/C 94M.
 6. Air-Entraining Admixture: ASTM C 260.

2.4 ACCESSORIES

- A. Detectable Warning Tape: Acid- and alkali-resistant polyethylene film warning tape manufactured for marking and identifying underground utilities, a minimum of 6 inches wide and 4 mils thick, continuously inscribed with a description of the utility, with metallic core encased in a protective jacket for corrosion protection, detectable by metal detector when tape is buried up to 30 inches deep; colored as follows:
1. Red: Electric.
 2. Yellow: Gas, oil, steam, and dangerous materials.
 3. Orange: Telephone and other communications.
 4. Blue: Water systems.
 5. Green: Sewer systems.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Protect structures, utilities, sidewalks, pavements, and other facilities from damage caused by settlement, lateral movement, undermining, washout, and other hazards created by earthwork operations.

- B. Preparation of subgrade for earthwork operations including removal of vegetation, topsoil, debris, obstructions, and deleterious materials from ground surface is specified in Division 2 Section "Site Clearing."
- C. Protect and maintain erosion and sedimentation controls, which are specified in Division 2 Section "Site Clearing," during earthwork operations.
- D. Provide protective insulating materials to protect subgrades and foundation soils against freezing temperatures or frost.

3.2 DEWATERING

- A. Prevent surface water and ground water from entering excavations, from ponding on prepared subgrades, and from flooding Project site and surrounding area.
- B. Protect subgrades from softening, undermining, washout, and damage by rain or water accumulation.
 - 1. Reroute surface water runoff away from excavated areas. Do not allow water to accumulate in excavations. Do not use excavated trenches as temporary drainage ditches.
 - 2. Install a dewatering system, specified in Division 2 Section "Dewatering," to keep subgrades dry and convey ground water away from excavations. Maintain until dewatering is no longer required.

3.3 EXPLOSIVES

- A. Explosives: Do not use explosives.

3.4 EXCAVATION, GENERAL

- A. Unclassified Excavation: Excavate to subgrade elevations regardless of the character of surface and subsurface conditions encountered. Unclassified excavated materials may include rock, soil materials, and obstructions. No changes in the Contract Sum or the Contract Time will be authorized for rock excavation or removal of obstructions.
 - 1. If excavated materials intended for fill and backfill include unsatisfactory soil materials and rock, replace with satisfactory soil materials.
- B. Classified Excavation: Excavate to subgrade elevations. Material to be excavated will be classified as earth.
 - 1. Earth excavation includes excavating pavements and obstructions visible on surface; underground structures, utilities, and other items indicated to be

removed; together with soil, boulders, and other materials not classified as rock or unauthorized excavation.

3.5 EXCAVATION FOR STRUCTURES

- A. Excavate to indicated elevations and dimensions within a tolerance of plus or minus 1 inch. If applicable, extend excavations a sufficient distance from structures for placing and removing concrete formwork, for installing services and other construction, and for inspections.
 - 1. Excavations for Footings and Foundations: Do not disturb bottom of excavation. Excavate by hand to final grade just before placing concrete reinforcement. Trim bottoms to required lines and grades to leave solid base to receive other work.
 - 2. Excavation for Underground Tanks, Basins, and Mechanical or Electrical Utility Structures: Excavate to elevations and dimensions indicated within a tolerance of plus or minus 1 inch. Do not disturb bottom of excavations intended as bearing surfaces.

3.6 EXCAVATION FOR WALKS AND PAVEMENTS

- A. Excavate surfaces under walks and pavements to indicated lines, cross sections, elevations, and subgrades.

3.7 EXCAVATION FOR UTILITY TRENCHES

- A. Excavate trenches to indicated gradients, lines, depths, and elevations.
 - 1. Beyond building perimeter, excavate trenches to allow installation of top of pipe below frost line.
- B. Excavate trenches to uniform widths to provide the following clearance on each side of pipe or conduit. Excavate trench walls vertically from trench bottom to 12 inches higher than top of pipe or conduit, unless otherwise indicated.
 - 1. Clearance: 12 inches each side of pipe or conduit.
- C. Trench Bottoms: Excavate and shape trench bottoms to provide uniform bearing and support of pipes and conduit. Shape subgrade to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits. Remove projecting stones and sharp objects along trench subgrade.
 - 1. For pipes and conduit less than 6 inches in nominal diameter and flat-bottomed, multiple-duct conduit units, hand-excavate trench bottoms and support pipe and conduit on an undisturbed subgrade.

2. For pipes and conduit 6 inches or larger in nominal diameter, shape bottom of trench to support bottom 90 degrees of pipe circumference. Fill depressions with tamped sand backfill.

- D. Trench Bottoms: Excavate trenches 4 inches deeper than bottom of pipe elevation to allow for bedding course. Hand excavate for bell of pipe.

3.8 SUBGRADE INSPECTION

- A. Notify Architect when excavations have reached required subgrade.
- B. If Geotechnical Testing Agency determines that unsatisfactory soil is present, continue excavation and replace with compacted backfill or fill material as directed.
- C. Proof-roll subgrade below the building slabs and pavements with heavy pneumatic-tired equipment to identify soft pockets and areas of excess yielding. Do not proof-roll wet or saturated subgrades.
 1. Completely proof-roll subgrade in one direction, repeating proof-rolling in direction perpendicular to first direction. Limit vehicle speed to 3 mph.
 2. Proof-roll with a loaded 10-wheel, tandem-axle dump truck weighing not less than 15 tons.
 3. Excavate soft spots, unsatisfactory soils, and areas of excessive pumping or rutting, as determined by Architect, and replace with compacted backfill or fill as directed.
- D. Authorized additional excavation and replacement material will be paid for according to Contract provisions for unit prices.
- E. Reconstruct subgrades damaged by freezing temperatures, frost, rain, accumulated water, or construction activities, as directed by Architect, without additional compensation.

3.9 UNAUTHORIZED EXCAVATION

- A. Fill unauthorized excavation under foundations or wall footings by extending bottom elevation of concrete foundation or footing to excavation bottom, without altering top elevation. Lean concrete fill, with 28-day compressive strength of 2500 psi, may be used when approved by Architect.
 1. Fill unauthorized excavations under other construction or utility pipe as directed by Architect.

3.10 STORAGE OF SOIL MATERIALS

- A. Stockpile borrow soil materials and excavated satisfactory soil materials without intermixing. Place, grade, and shape stockpiles to drain surface water. Cover to prevent windblown dust.
 - 1. Stockpile soil materials away from edge of excavations. Do not store within drip line of remaining trees.

3.11 BACKFILL

- A. Place and compact backfill in excavations promptly, but not before completing the following:
 - 1. Construction below finish grade including, where applicable, subdrainage, dampproofing, waterproofing, and perimeter insulation.
 - 2. Surveying locations of underground utilities for Record Documents.
 - 3. Testing and inspecting underground utilities.
 - 4. Removing concrete formwork.
 - 5. Removing trash and debris.
 - 6. Removing temporary shoring and bracing, and sheeting.
 - 7. Installing permanent or temporary horizontal bracing on horizontally supported walls.
- B. Place backfill on subgrades free of mud, frost, snow, or ice.

3.12 UTILITY TRENCH BACKFILL

- A. Place backfill on subgrades free of mud, frost, snow, or ice.
- B. Place and compact bedding course on trench bottoms and where indicated. Shape bedding course to provide continuous support for bells, joints, and barrels of pipes and for joints, fittings, and bodies of conduits.
- C. Backfill trenches excavated under footings and within 18 inches of bottom of footings with satisfactory soil; fill with concrete to elevation of bottom of footings. Concrete is specified in Division 3 Section "Cast-in-Place Concrete."
- D. Provide 4-inch- thick, concrete-base slab support for piping or conduit less than 30 inches below surface of roadways. After installing and testing, completely encase piping or conduit in a minimum of 4 inches of concrete before backfilling or placing roadway subbase.
- E. Place and compact initial backfill of subbase material or satisfactory soil, free of particles larger than 1 inch in any dimension, to a height of 12 inches over the utility pipe or conduit.

1. Carefully compact initial backfill under pipe haunches and compact evenly up on both sides and along the full length of utility piping or conduit to avoid damage or displacement of piping or conduit. Coordinate backfilling with utilities testing.
- F. Controlled Low-Strength Material: Place initial backfill of controlled low-strength material to a height of 12 inches over the utility pipe or conduit.
- G. Backfill voids with satisfactory soil while installing and removing shoring and bracing.
- H. Place and compact final backfill of satisfactory soil to final subgrade elevation.
- I. Controlled Low-Strength Material: Place final backfill of controlled low-strength material to final subgrade elevation.
- J. Install warning tape directly above utilities, 12 inches below finished grade, except 6 inches below subgrade under pavements and slabs.

3.13 SOIL FILL

- A. Plow, scarify, bench, or break up sloped surfaces steeper than 1 vertical to 4 horizontal so fill material will bond with existing material.
- B. Place and compact fill material in layers to required elevations as follows:
 1. Under grass and planted areas, use satisfactory soil material.
 2. Under walks and pavements, use satisfactory soil material.
 3. Under steps and ramps, use engineered fill.
 4. Under building slabs, use engineered fill.
 5. Under footings and foundations, use engineered fill.
- C. Place soil fill on subgrades free of mud, frost, snow, or ice.

3.14 SOIL MOISTURE CONTROL

- A. Uniformly moisten or aerate subgrade and each subsequent fill or backfill soil layer before compaction to within 2 percent of optimum moisture content.
 1. Do not place backfill or fill soil material on surfaces that are muddy, frozen, or contain frost or ice.
 2. Remove and replace, or scarify and air dry otherwise satisfactory soil material that exceeds optimum moisture content by 2 percent and is too wet to compact to specified dry unit weight.

3.15 COMPACTION OF SOIL BACKFILLS AND FILLS

- A. Place backfill and fill soil materials in layers not more than 8 inches in loose depth for material compacted by heavy compaction equipment, and not more than 4 inches in loose depth for material compacted by hand-operated tampers.
- B. Place backfill and fill soil materials evenly on all sides of structures to required elevations, and uniformly along the full length of each structure.
- C. Compact soil materials to not less than the following percentages of maximum dry unit weight according to [ASTM D 698] [ASTM D 1557]:
 - 1. Under structures, building slabs, steps, and pavements, scarify and recompact top 12 inches of existing subgrade and each layer of backfill or fill soil material at 95 percent.
 - 2. Under walkways, scarify and recompact top 6 inches below subgrade and compact each layer of backfill or fill soil material at 92 percent.
 - 3. Under lawn or unpaved areas, scarify and recompact top 6 inches below subgrade and compact each layer of backfill or fill soil material at 85 percent.
 - 4. For utility trenches, compact each layer of initial and final backfill soil material at 85 percent.

3.16 GRADING

- A. General: Uniformly grade areas to a smooth surface, free of irregular surface changes. Comply with compaction requirements and grade to cross sections, lines, and elevations indicated.
 - 1. Provide a smooth transition between adjacent existing grades and new grades.
 - 2. Cut out soft spots, fill low spots, and trim high spots to comply with required surface tolerances.
- B. Site Grading: Slope grades to direct water away from buildings and to prevent ponding. Finish subgrades to required elevations within the following tolerances:
 - 1. Lawn or Unpaved Areas: Plus or minus 1 inch.
 - 2. Walks: Plus or minus 1 inch.
 - 3. Pavements: Plus or minus 1/2 inch.
- C. Grading inside Building Lines: Finish subgrade to a tolerance of 1/2 inch when tested with a 10-foot straightedge.

3.17 SUBSURFACE DRAINAGE

- A. Subdrainage Pipe: Specified in Division 2 Section "Storm Drainage."

- B. Subsurface Drain: Place subsurface drainage geotextile around perimeter of subdrainage trench. Place a 6-inch course of filter material on subsurface drainage geotextile to support subdrainage pipe. Encase subdrainage pipe in a minimum of 12 inches of filter material, placed in compacted layers 6 inches thick, and wrap in subsurface drainage geotextile, overlapping sides and ends at least 6 inches.
 - 1. Compact each filter material layer to 85 percent of maximum dry unit weight according to ASTM D 698 with a minimum of two passes of a plate-type vibratory compactor.
- C. Drainage Backfill: Place and compact filter material over subsurface drain, in width indicated, to within 12 inches of final subgrade, in compacted layers 6 inches thick. Overlay drainage backfill with 1 layer of subsurface drainage geotextile, overlapping sides and ends at least 6 inches.
 - 1. Compact each filter material layer to 85 percent of maximum dry unit weight according to ASTM D 698 with a minimum of two passes of a plate-type vibratory compactor.
 - 2. Place and compact impervious fill over drainage backfill in 6-inch thick compacted layers to final subgrade.

3.18 SUBBASE AND BASE COURSES

- A. Place subbase and base course on subgrades free of mud, frost, snow, or ice.
- B. On prepared subgrade, place subbase and base course under pavements and walks as follows:
 - 1. Install separation geotextile on prepared subgrade according to manufacturer's written instructions, overlapping sides and ends.
 - 2. Place base course material over subbase course under hot-mix asphalt pavement.
 - 3. Shape subbase and base course to required crown elevations and cross-slope grades.
 - 4. Place subbase and base course 6 inches or less in compacted thickness in a single layer.
 - 5. Place subbase and base course that exceeds 6 inches in compacted thickness in layers of equal thickness, with no compacted layer more than 6 inches thick or less than 3 inches thick.
 - 6. Compact subbase and base course at optimum moisture content to required grades, lines, cross sections, and thickness to not less than 95 percent of maximum dry unit weight according to ASTM D 698.
- C. Pavement Shoulders: Place shoulders along edges of subbase and base course to prevent lateral movement. Construct shoulders, at least 12 inches wide, of satisfactory soil materials and compact simultaneously with each subbase and base layer to not less than 95 percent of maximum dry unit weight according to ASTM D 698.

3.19 DRAINAGE COURSE

- A. Place drainage course on subgrades free of mud, frost, snow, or ice.
- B. On prepared subgrade, place and compact drainage course under cast-in-place concrete slabs-on-grade as follows:
 - 1. Install subdrainage geotextile on prepared subgrade according to manufacturer's written instructions, overlapping sides and ends.
 - 2. Place drainage course 6 inches or less in compacted thickness in a single layer.
 - 3. Place drainage course that exceeds 6 inches in compacted thickness in layers of equal thickness, with no compacted layer more than 6 inches thick or less than 3 inches thick.
 - 4. Compact each layer of drainage course to required cross sections and thicknesses to not less than 95 percent of maximum dry unit weight according to ASTM D 698.

3.20 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified independent geotechnical engineering testing agency to perform field quality-control testing.
- B. Allow testing agency to inspect and test subgrades and each fill or backfill layer. Proceed with subsequent earthwork only after test results for previously completed work comply with requirements.
- C. Footing Subgrade: At footing subgrades, at least one test of each soil stratum will be performed to verify design bearing capacities. Subsequent verification and approval of other footing subgrades may be based on a visual comparison of subgrade with tested subgrade when approved by Architect.
- D. Testing agency will test compaction of soils in place according to ASTM D 698, ASTM D 1556, ASTM D 2167, ASTM D 2922, and ASTM D 2937, as applicable. Tests will be performed at the following locations and frequencies:
 - 1. Paved and Building Slab Areas: At subgrade and at each compacted fill and backfill layer, at least 1 test for every 2000 sq. ft. or less of paved area or building slab, but in no case fewer than 3 tests.
 - 2. Foundation Wall Backfill: At each compacted backfill layer, at least 1 test for each 100 feet or less of wall length, but no fewer than 2 tests.
 - 3. Trench Backfill: At each compacted initial and final backfill layer, at least 1 test for each 150 feet or less of trench length, but no fewer than 2 tests.
- E. When testing agency reports that subgrades, fills, or backfills have not achieved degree of compaction specified, scarify and moisten or aerate, or remove and replace soil to depth required; recompact and retest until specified compaction is obtained.

3.21 PROTECTION

- A. Protecting Graded Areas: Protect newly graded areas from traffic, freezing, and erosion. Keep free of trash and debris.
- B. Repair and reestablish grades to specified tolerances where completed or partially completed surfaces become eroded, rutted, settled, or where they lose compaction due to subsequent construction operations or weather conditions.
 - 1. Scarify or remove and replace soil material to depth as directed by Architect; reshape and recompact.
- C. Where settling occurs before Project correction period elapses, remove finished surfacing, backfill with additional soil material, compact, and reconstruct surfacing.
 - 1. Restore appearance, quality, and condition of finished surfacing to match adjacent work, and eliminate evidence of restoration to greatest extent possible.

3.22 DISPOSAL OF SURPLUS AND WASTE MATERIALS

- A. Disposal: Remove surplus satisfactory soil and waste material, including unsatisfactory soil, trash, and debris, and legally dispose of it off Owner's property.
- B. Disposal: Transport surplus satisfactory soil to designated storage areas on Owner's property. Stockpile or spread soil as directed by Architect.
 - 1. Remove waste material, including unsatisfactory soil, trash, and debris, and legally dispose of it off Owner's property.

END OF DOCUMENT

SECTION 313116

TERMITE CONTROL

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes the following:
 - 1. Soil treatment with termiticide.

1.3 PERFORMANCE REQUIREMENTS

- A. Service Life of Soil Treatment: Soil treatment by use of a termiticide that is effective for not less than five years against infestation of subterranean termites.

1.4 SUBMITTALS

- A. Product Data: For termiticide.
 - 1. Include the EPA-Registered Label for termiticide products.
- B. Product Certificates: For termite control products, signed by product manufacturer.
- C. Qualification Data: For Installer of termite control products.
- D. Soil Treatment Application Report: After application of termiticide is completed, submit report for Owner's record information, including the following:
 - 1. Date and time of application.
 - 2. Moisture content of soil before application.
 - 3. Brand name and manufacturer of termiticide.
 - 4. Quantity of undiluted termiticide used.
 - 5. Dilutions, methods, volumes, and rates of application used.
 - 6. Areas of application.
 - 7. Water source for application.

1.5 QUALITY ASSURANCE

- A. Installer Qualifications: A specialist who is licensed according to regulations of authorities having jurisdiction to apply termite control treatment and products in jurisdiction where Project is located.
- B. Regulatory Requirements: Formulate and apply termiticides according to the EPA-Registered Label.
- C. Source Limitations: Obtain termite control products through one source.
- D. Preinstallation Conference: Conduct conference at Project site to comply with requirements in Division 1 Section "Project Management and Coordination" to schedule application of termiticide products.

1.6 PROJECT CONDITIONS

- A. Environmental Limitations: To ensure penetration, do not treat soil that is water saturated or frozen. Do not treat soil while precipitation is occurring. Comply with requirements of the EPA-Registered Label and requirements of authorities having jurisdiction.

1.7 COORDINATION

- A. Coordinate soil treatment application with excavating, filling, grading, and concreting operations. Treat soil under footings, grade beams, and ground-supported slabs before construction.

1.8 WARRANTY

- A. Special Warranty: Manufacturer's standard form, signed by Applicator and Contractor certifying that termite control work, consisting of applied soil termiticide treatment, will prevent infestation of subterranean termites. If subterranean termite activity or damage is discovered during warranty period, re-treat soil and repair or replace damage caused by termite infestation.

- 1. Warranty Period: Five years from date of Substantial Completion.

1.9 MAINTENANCE SERVICE

- A. Continuing Service: Beginning at Substantial Completion, provide 12 months continuing service including monitoring, inspection, and re-treatment for occurrences of termite activity. Provide a standard continuing service agreement. State services, obligations, conditions, and terms for agreement period; and terms for future renewal options.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

- A. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, the following:
- B. Manufacturers: Subject to compliance with requirements, provide products by one of the following:
 - 1. Termiticides:
 - a. Aventis Environmental Science USA LP; Termidor.
 - b. Bayer Corporation; Premise 75.
 - c. Dow AgroSciences LLC; Dursban TC or Equity.
 - d. FMC Corporation, Agricultural Products Group; Talstar, Prevail FT, Torpedo.
 - e. Syngenta; Demon TC.

2.2 SOIL TREATMENT

- A. Termiticide: Provide an EPA-registered termiticide complying with requirements of authorities having jurisdiction, in an aqueous solution formulated to prevent termite infestation. Provide quantity required for application at the label volume and rate for the maximum termiticide concentration allowed for each specific use, according to product's EPA-Registered Lab.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine substrates, areas, and conditions, with Applicator present, for compliance with requirements for moisture content of soil, interfaces with earthwork, slab and foundation work, landscaping, and other conditions affecting performance of termite control.
 - 1. Proceed with application only after unsatisfactory conditions have been corrected.

3.2 PREPARATION

- A. General: Comply with the most stringent requirements of authorities having jurisdiction and with manufacturer's written instructions for preparation before beginning application of termite control treatment. Remove all extraneous sources

of wood cellulose and other edible materials such as wood debris, tree stumps and roots, stakes, formwork, and construction waste wood from soil within and around foundations.

- B. Soil Treatment Preparation: Remove foreign matter and impermeable soil materials that could decrease treatment effectiveness on areas to be treated. Loosen, rake, and level soil to be treated except previously compacted areas under slabs and footings. Termiticides may be applied before placing compacted fill under slabs if recommended in writing by termiticide manufacturer.

- 1. Fit filling hose connected to water source at the site with a backflow preventer, complying with requirements of authorities having jurisdiction.

3.3 APPLICATION, GENERAL

- A. General: Comply with the most stringent requirements of authorities having jurisdiction and with manufacturer's EPA-Registered Label for products.

3.4 APPLYING SOIL TREATMENT

- A. Application: Mix soil treatment termiticide solution to a uniform consistency. Provide quantity required for application at the label volume and rate for the maximum specified concentration of termiticide, according to manufacturer's EPA-Registered Label, to the following so that a continuous horizontal and vertical termiticidal barrier or treated zone is established around and under building construction. Distribute treatment evenly.

- 1. Slabs-on-Grade and Basement Slabs: Under ground-supported slab construction, including footings, building slabs, and attached slabs as an overall treatment. Treat soil materials before concrete footings and slabs are placed.
 - 2. Foundations: Adjacent soil including soil along the entire inside perimeter of foundation walls, along both sides of interior partition walls, around plumbing pipes and electric conduit penetrating the slab, and around interior column footers, piers, and chimney bases; also along the entire outside perimeter, from grade to bottom of footing. Avoid soil washout around footings.
 - 3. Crawlspace: Soil under and adjacent to foundations as previously indicated. Treat adjacent areas including around entrance platform, porches, and equipment bases. Apply overall treatment only where attached concrete platform and porches are on fill or ground.
 - 4. Masonry: Treat voids.
 - 5. Penetrations: At expansion joints, control joints, and areas where slabs will be penetrated.

- B. Avoid disturbance of treated soil after application. Keep off treated areas until completely dry.

- C. Protect termiticide solution, dispersed in treated soils and fills, from being diluted until ground-supported slabs are installed. Use waterproof barrier according to EPA-Registered Label instructions.
- D. Post warning signs in areas of application.
- E. Reapply soil treatment solution to areas disturbed by subsequent excavation, grading, landscaping, or other construction activities following application.

END OF DOCUMENT

DIVISION 32

EXTERIOR IMPROVEMENTS

DAMMON ENGINEERING, INC.
554 OLD SPANISH TRAIL
SLIDELL, LOUISIANA 70458
Phone: 985-649-5832
Email: info@dammonengineering.com
www.dammonengineering.com



SECTION 321313
CONCRETE PAVEMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Supplementary Conditions and Division 1 Specification Sections, apply to this Section.

1.2 SUMMARY

- A. This Section includes exterior cement concrete pavement for the following:
 - 1. Driveways and roadways.
 - 2. Parking lots.
 - 3. Curbs and gutters.
 - 4. Walkways.
- B. Division 3 Section "Cast-in-Place Concrete" for general building applications of concrete.
- C. Cementitious Materials: Portland cement alone or in combination with one or more of blended hydraulic cement, fly ash and other pozzolans, and ground granulated blast-furnace slag.

1.3 SUBMITTALS

- A. Product Data: For each type of manufactured material and product indicated.
- B. Design Mixtures: For each concrete pavement mixture. Include alternate mixture designs when characteristics of materials, Project conditions, weather, test results, or other circumstances warrant adjustments.
- C. Qualification Data: For manufacturer.
- D. Material Test Reports: From a qualified testing agency indicating and interpreting test results for compliance of the following with requirements indicated, based on comprehensive testing of current materials:
 - 1. Aggregates.
- E. Material Certificates: Signed by manufacturers certifying that each of the following materials complies with requirements:

1. Cementitious materials.
2. Steel reinforcement and reinforcement accessories.
3. Fiber reinforcement.
4. Admixtures.
5. Curing compounds.
6. Applied finish materials.
7. Bonding agent or epoxy adhesive.
8. Joint fillers.

F. Field quality-control test reports.

G. Minutes of preinstallation conference.

1.4 QUALITY ASSURANCE

A. **Manufacturer Qualifications:** Manufacturer of ready-mixed concrete products who complies with ASTM C 94/C 94M requirements for production facilities and equipment.

1. Manufacturer certified according to NRMCA's "Certification of Ready Mixed Concrete Production Facilities."

B. **Testing Agency Qualifications:** An independent agency qualified according to ASTM C 1077 and ASTM E 329 for testing indicated, as documented according to ASTM E 548.

1. Personnel conducting field tests shall be qualified as ACI Concrete Field Testing Technician, Grade 1, according to ACI CP-01 or an equivalent certification program.

C. **ACI Publications:** Comply with ACI 301, "Specification for Structural Concrete," unless modified by requirements in the Contract Documents.

D. **Concrete Testing Service:** Engage a qualified independent testing agency to perform material evaluation tests and to design concrete mixtures.

E. **Mockups:** Cast mockups of full-size sections of concrete pavement to demonstrate typical joints, surface finish, texture, color, and standard of workmanship.

1. Build mockups in the location and of the size indicated or, if not indicated, as directed by Architect.
2. Notify Architect seven days in advance of dates and times when mockups will be constructed.
3. Obtain Architect's approval of mockups before starting construction.
4. Maintain approved mockups during construction in an undisturbed condition as a standard for judging the completed pavement.
5. Demolish and remove approved mockups from the site when directed by Architect.

6. Approved mockups may become part of the completed Work if undisturbed at time of Substantial Completion.

F. Preinstallation Conference: Conduct conference at Project site to comply with requirements in Division 1 Section "Project Management and Coordination."

1. Before submitting design mixtures, review concrete pavement mixture design and examine procedures for ensuring quality of concrete materials and concrete pavement construction practices. Require representatives, including the following, of each entity directly concerned with concrete pavement, to attend conference:

- a. Contractor's superintendent.
- b. Independent testing agency responsible for concrete design mixtures.
- c. Ready-mix concrete producer.
- d. Concrete pavement subcontractor.

1.5 PROJECT CONDITIONS

A. Traffic Control: Maintain access for vehicular and pedestrian traffic as required for other construction activities.

PART 2 - PRODUCTS

2.1 MANUFACTURERS

A. In other Part 2 articles where titles below introduce lists, the following requirements apply to product selection:

1. Available Products: Subject to compliance with requirements, products that may be incorporated into the Work include, but are not limited to, products specified.
2. Products: Subject to compliance with requirements, provide one of the products specified.
3. Available Manufacturers: Subject to compliance with requirements, manufacturers offering products that may be incorporated into the Work include, but are not limited to, manufacturers specified.
4. Manufacturers: Subject to compliance with requirements, provide products by one of the manufacturers specified.

2.2 FORMS

A. Form Materials: Plywood, metal, metal-framed plywood, or other approved panel-type materials to provide full-depth, continuous, straight, smooth exposed surfaces.

1. Use flexible or curved forms for curves with a radius 100 feet or less.

- B. Form-Release Agent: Commercially formulated form-release agent that will not bond with, stain, or adversely affect concrete surfaces and will not impair subsequent treatments of concrete surfaces.

2.3 STEEL REINFORCEMENT

- A. Plain-Steel Welded Wire Reinforcement: ASTM A 185, fabricated from as-drawn steel wire into flat sheets.
- B. Deformed-Steel Welded Wire Reinforcement: ASTM A 497, flat sheet.
- C. Epoxy-Coated Welded Wire Fabric: ASTM A 884/A 884M, Class A, plain steel.
- D. Reinforcing Bars: ASTM A 615/A 615M, Grade 60; deformed.
- E. Steel Bar Mats: ASTM A 184/A 184M; with ASTM A 615/A 615M, Grade 60, deformed bars; assembled with clips.
- F. Plain Steel Wire: ASTM A 82.
- G. Deformed-Steel Wire: ASTM A 496.
- H. Joint Dowel Bars: Plain steel bars, ASTM A 615/A 615M, Grade 60. Cut bars true to length with ends square and free of burrs.
- I. Tie Bars: ASTM A 615/A 615M, Grade 60, deformed.
- J. Hook Bolts: ASTM A 307, Grade A, internally and externally threaded. Design hook-bolt joint assembly to hold coupling against pavement form and in position during concreting operations, and to permit removal without damage to concrete or hook bolt.
- K. Bar Supports: Bolsters, chairs, spacers, and other devices for spacing, supporting, and fastening reinforcing bars, welded wire reinforcement, and dowels in place. Manufacture bar supports according to CRSI's "Manual of Standard Practice" from steel wire, plastic, or precast concrete of greater compressive strength than concrete, and as follows:
1. Equip wire bar supports with sand plates or horizontal runners where base material will not support chair legs.
- L. Zinc Repair Material: ASTM A 780.

2.4 CONCRETE MATERIALS

- A. Cementitious Material: Use one of the following cementitious materials, of the same type, brand, and source throughout the Project:
 - 1. Portland Cement: ASTM C 150, Type II gray. Supplement with the following:
 - a. Fly Ash: ASTM C 618, Class C.
 - b. Ground Granulated Blast-Furnace Slag: ASTM C 989, Grade 100 or 120.
- B. Normal-Weight Aggregates: ASTM C 33, uniformly graded. Provide aggregates from a single source.
 - 1. Maximum Coarse-Aggregate Size: 1 inch nominal.
 - 2. Fine Aggregate: Free of materials with deleterious reactivity to alkali in cement.
- C. Water: ASTM C 94/C 94M.
- D. Air-Entraining Admixture: ASTM C 260.
- E. Chemical Admixtures: Provide admixtures certified by manufacturer to be compatible with other admixtures and to contain not more than 0.1 percent water-soluble chloride ions by mass of cementitious material.
 - 1. Water-Reducing Admixture: ASTM C 494/C 494M, Type A.
 - 2. Retarding Admixture: ASTM C 494/C 494M, Type B.
 - 3. Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type D.
 - 4. High-Range, Water-Reducing Admixture: ASTM C 494/C 494M, Type F.
 - 5. High-Range, Water-Reducing and Retarding Admixture: ASTM C 494/C 494M, Type G.
 - 6. Plasticizing and Retarding Admixture: ASTM C 1017/C 1017M, Type II.

2.5 CURING MATERIALS

- A. Absorptive Cover: AASHTO M 182, Class 2, burlap cloth made from jute or kenaf, weighing approximately 9 oz./sq. yd. dry.
- B. Moisture-Retaining Cover: ASTM C 171, polyethylene film or white burlap-polyethylene sheet.
- C. Water: Potable.
- D. Evaporation Retarder: Waterborne, monomolecular film forming; manufactured for application to fresh concrete.
 - 1. Available Products:
 - a. Axim Concrete Technologies; Cimfilm.

- b. Burke by Edeco; BurkeFilm.
 - c. ChemMasters; Spray-Film.
 - d. Conspec Marketing & Manufacturing Co., Inc.; Aquafilm.
 - e. Dayton Superior Corporation; Sure Film.
 - f. Euclid Chemical Company (The); Eucobar.
 - g. Kaufman Products, Inc.; Vapor Aid.
 - h. Lambert Corporation; Lambco Skin.
 - i. L&M Construction Chemicals, Inc.; E-Con.
 - j. MBT Protection and Repair, ChemRex Inc.; Confilm.
 - k. Meadows, W. R., Inc.; Sealtight Evapre.
 - l. Metalcrete Industries; Waterhold.
 - m. Nox-Crete Products Group, Kinsman Corporation; Monofilm.
 - n. Sika Corporation, Inc.; SikaFilm.
 - o. Symons Corporation; Finishing Aid.
 - p. Vexcon Chemicals, Inc.; Certi-Vex EnvioAssist.
- E. Clear Waterborne Membrane-Forming Curing Compound: ASTM C 309, Type 1, Class B.
- 1. Available Products:
 - a. Anti-Hydro International, Inc.; AH Curing Compound #2 DR WB.
 - b. Burke by Edoko; Aqua Resin Cure.
 - c. ChemMasters; Safe-Cure Clear.
 - d. Conspec Marketing & Manufacturing Co., Inc.; W.B. Resin Cure.
 - e. Dayton Superior Corporation; Day Chem Rez Cure (J-11-W).
 - f. Euclid Chemical Company (The); Kurez DR VOX.
 - g. Kaufman Products, Inc.; Thinfilm 420.
 - h. Lambert Corporation; Aqua Kure-Clear.
 - i. L&M Construction Chemicals, Inc.; L&M Cure R.
 - j. Meadows, W. R., Inc.; 1100 Clear.
 - k. Nox-Crete Products Group, Kinsman Corporation; Resin Cure E.
 - l. Symons Corporation; Resi-Chem Clear.
 - m. Tamms Industries Inc.; Horncure WB 30.
 - n. Unitex; Hydro Cure 309.
 - o. Vexcon Chemicals, Inc.; Certi-Vex Enviocure 100.
- F. White Waterborne Membrane-Forming Curing Compound: ASTM C 309, Type 2, Class B.
- 1. Available Products:
 - a. Anti-Hydro International, Inc.; AH Curing Compound #2 WP WB.
 - b. Burke by Edoko; Resin Emulsion White.
 - c. ChemMasters; Safe-Cure 2000.
 - d. Conspec Marketing & Manufacturing Co., Inc.; W.B. Resin Cure.
 - e. Dayton Superior Corporation; Day-Chem White Pigmented Cure (J-10-W).
 - f. Euclid Chemical Company (The); Kurez VOX White Pigmented.
 - g. Kaufman Products, Inc.; Thinfilm 450.

- h. Lambert Corporation; Aqua Kure-White.
- i. L&M Construction Chemicals, Inc.; L&M Cure R-2.
- j. Meadows, W. R., Inc.; 1200-White.
- k. Symons Corporation; Resi-Chem White.
- l. Tamms Industries, Inc.; Horncure 200-W.
- m. Unitex; Hydro White.
- n. Vexcon Chemicals, Inc.; Certi-Vex Enviocure White 100.

2.6 RELATED MATERIALS

- A. Expansion- and Isolation-Joint-Filler Strips: ASTM D 1751, asphalt-saturated cellulosic fiber or ASTM D 1752, cork or self-expanding cork.
- B. Color Pigment: ASTM C 979, synthetic mineral-oxide pigments or colored water-reducing admixtures; color stable, free of carbon black, nonfading, and resistant to lime and other alkalis.
 - 1. Available Manufacturers:
 - a. Bayer Corporation.
 - b. ChemMasters.
 - c. Conspec Marketing & Manufacturing Co., Inc.
 - d. Davis Colors.
 - e. Elementis Pigments, Inc.
 - f. Hoover Color Corporation.
 - g. Lambert Corporation.
 - h. Scofield, L. M. Company.
 - i. Solomon Colors.
 - 2. Color: As selected by Architect from manufacturer's full range.
- C. Slip-Resistive Aggregate Finish: Factory-graded, packaged, rustproof, nonglazing, abrasive aggregate of fused aluminum-oxide granules or crushed emery with emery aggregate containing not less than 50 percent aluminum oxide and not less than 20 percent ferric oxide; unaffected by freezing, moisture, and cleaning materials.
- D. Bonding Agent: ASTM C 1059, Type II, non-redispersible, acrylic emulsion or styrene butadiene.
- E. Epoxy Bonding Adhesive: ASTM C 881, two-component epoxy resin, capable of humid curing and bonding to damp surfaces, of class suitable for application temperature and of grade to requirements, and as follows:
 - 1. Types I and II, non-load bearing or IV and V, load bearing, for bonding hardened or freshly mixed concrete to hardened concrete.

- F. Chemical Surface Retarder: Water-soluble, liquid-set retarder with color dye, for horizontal concrete surface application, capable of temporarily delaying final hardening of concrete to a depth of 1/8 to 1/4 inch.

1. AvailableProducts:

- a. Burke by Edeco; True Etch Surface Retarder.
- b. ChemMasters; Exposee.
- c. Conspec Marketing & Manufacturing Co., Inc.; Delay S.
- d. Euclid Chemical Company (The); Surface Retarder S.
- e. Kaufman Products, Inc.; Expose.
- f. Metalcrete Industries; Surfard.
- g. Nox-Crete Products Group, Kinsman Corporation; Crete-Nox TA.
- h. Scofield, L. M. Company; Lithotex.
- i. Sika Corporation, Inc.; Rugasol-S.
- j. Vexcon Chemicals, Inc.; Certi-Vex Envioset.

- G. Pigmented Mineral Dry-Shake Hardener: Factory-packaged dry combination of portland cement, graded quartz aggregate, color pigments, and plasticizing admixture. Use color pigments that are finely ground, nonfading mineral oxides interground with cement.

1. Available Products:

- a. Conspec Marketing & Manufacturing Co., Inc.; Conshake 600 Colortone.
- b. Dayton Superior Corporation; Quartz Tuff.
- c. Euclid Chemical Company (The); Surfex.
- d. Lambert Corporation; Colorhard.
- e. L&M Construction Chemicals, Inc.; Quartz Plate FF.
- f. MBT Protection and Repair, ChemRex Inc.; Mastercron.
- g. Metalcrete Industries; Floor Quartz.
- h. Scofield, L. M. Company; Lithochrome Color Hardener.
- i. Symons Corporation; Hard Top.

2. Color: As selected by Architect from manufacturer's full range.

- H. Rock Salt: Sodium chloride crystals, kiln dried, coarse gradation with 100 percent passing 3/8-inch sieve and 85 percent retained on a No. 8 sieve.

2.7 PAVEMENT MARKINGS

- A. Pavement-Marking Paint: Latex, waterborne emulsion, lead and chromate free, ready mixed, complying with FS TT-P-1952, with drying time of less than 45 minutes.

1. Color: As required by local authorities.

2.8 WHEEL STOPS

- A. Wheel Stops: Precast, air-entrained concrete, 2500-psi minimum compressive strength, 4-1/2 inches high by 9 inches wide by 72 inches long. Provide chamfered corners and drainage slots on underside and holes for anchoring to substrate.
 - 1. Dowels: Galvanized steel, 3/4-inch diameter, 10-inch minimum length.

2.9 CONCRETE MIXTURES

- A. Prepare design mixtures, proportioned according to ACI 301, for each type and strength of normal-weight concrete determined by either laboratory trial mixes or field experience.
 - 1. Use a qualified independent testing agency for preparing and reporting proposed concrete mixture designs for the trial batch method.
- B. Proportion mixtures to provide normal-weight concrete with the following properties:
 - 1. Compressive Strength (28 Days): See Plans.
 - 2. Maximum Water-Cementitious Materials Ratio at Point of Placement: 0.50.
 - 3. Slump Limit: 5 inches, plus or minus 1 inch.
- C. Add air-entraining admixture at manufacturer's prescribed rate to result in normal-weight concrete at point of placement having an air content as follows:
 - 1. Air Content: 5-1/2 percent plus or minus 1.5 percent for 1-1/2-inch nominal maximum aggregate size.
- D. Limit water-soluble, chloride-ion content in hardened concrete to 0.15 or 0.30 percent by weight of cement.
- E. Chemical Admixtures: Use admixtures according to manufacturer's written instructions.
 - 1. Use water-reducing admixture in concrete, as required, for placement and workability.
 - 2. Use water-reducing and retarding admixture when required by high temperatures, low humidity, or other adverse placement conditions.
- F. Cementitious Materials: Limit percentage, by weight, of cementitious materials other than portland cement according to ACI 301 requirements as follows:
 - 1. Fly Ash or Pozzolan: 25 percent.
 - 2. Ground Granulated Blast-Furnace Slag: 50 percent.
 - 3. Combined Fly Ash or Pozzolan, and Ground Granulated Blast-Furnace Slag: 50 percent, with fly ash or pozzolan not exceeding 25 percent.

- G. Color Pigment: Add color pigment to concrete mixture according to manufacturer's written instructions and to result in hardened concrete color consistent with approved mockup.

2.10 CONCRETE MIXING

- A. Ready-Mixed Concrete: Measure, batch, and mix concrete materials and concrete according to ASTM C 94/C 94M and ASTM C 1116. Furnish batch certificates for each batch discharged and used in the Work.
 - 1. When air temperature is between 85 deg F and 90 deg F, reduce mixing and delivery time from 1-1/2 hours to 75 minutes; when air temperature is above 90 deg F, reduce mixing and delivery time to 60 minutes.
- B. Project-Site Mixing: Measure, batch, and mix concrete materials and concrete according to ASTM C 94/C 94M. Mix concrete materials in appropriate drum-type batch machine mixer.
 - 1. For concrete mixes of 1 cu. yd. or smaller, continue mixing at least 1-1/2 minutes, but not more than 5 minutes after ingredients are in mixer, before any part of batch is released.
 - 2. For concrete mixes larger than 1 cu. yd., increase mixing time by 15 seconds for each additional 1 cu. yd.
 - 3. Provide batch ticket for each batch discharged and used in the Work, indicating Project identification name and number, date, mixture type, mixing time, quantity, and amount of water added.

PART 3 - EXECUTION

3.1 EXAMINATION

- A. Examine exposed subgrades and subbase surfaces for compliance with requirements for dimensional, grading, and elevation tolerances.
- B. Proof-roll prepared subbase surface below concrete pavements with heavy pneumatic-tired equipment to identify soft pockets and areas of excess yielding.
 - 1. Completely proof-roll subbase in one direction and repeat in perpendicular direction. Limit vehicle speed to 3 mph.
 - 2. Proof-roll with a loaded 10-wheel tandem-axle dump truck weighing not less than 15 tons.
 - 3. Subbase with soft spots and areas of pumping or rutting exceeding depth of 1/2 inch require correction according to requirements in Division 2 Section "Earthwork."

- C. Proceed with concrete pavement operations only after nonconforming conditions have been corrected and subgrade is ready to receive pavement.

3.2 PREPARATION

- A. Remove loose material from compacted subbase surface immediately before placing concrete.

3.3 EDGE FORMS AND SCREED CONSTRUCTION

- A. Set, brace, and secure edge forms, bulkheads, and intermediate screed guides for pavement to required lines, grades, and elevations. Install forms to allow continuous progress of work and so forms can remain in place at least 24 hours after concrete placement.
- B. Clean forms after each use and coat with form-release agent to ensure separation from concrete without damage.

3.4 STEEL REINFORCEMENT

- A. General: Comply with CRSI's "Manual of Standard Practice" for fabricating, placing, and supporting reinforcement.
- B. Clean reinforcement of loose rust and mill scale, earth, ice, or other bond-reducing materials.
- C. Arrange, space, and securely tie bars and bar supports to hold reinforcement in position during concrete placement. Maintain minimum cover to reinforcement.
- D. Install welded wire reinforcement in lengths as long as practicable. Lap adjoining pieces at least one full mesh, and lace splices with wire. Offset laps of adjoining widths to prevent continuous laps in either direction.
- E. Zinc-Coated Reinforcement: Use galvanized steel wire ties to fasten zinc-coated reinforcement. Repair cut and damaged zinc coatings with zinc repair material.
- F. Epoxy-Coated Reinforcement: Use epoxy-coated steel wire ties to fasten epoxy-coated reinforcement. Repair cut and damaged epoxy coatings with epoxy repair coating according to ASTM D 3963/D 3963M.
- G. Install fabricated bar mats in lengths as long as practicable. Handle units to keep them flat and free of distortions. Straighten bends, kinks, and other irregularities, or replace units as required before placement. Set mats for a minimum 2-inch overlap of adjacent mats.

3.5 JOINTS

- A. General: Form construction, isolation, and contraction joints and tool edgings true to line with faces perpendicular to surface plane of concrete. Construct transverse joints at right angles to centerline, unless otherwise indicated.
1. When joining existing pavement, place transverse joints to align with previously placed joints, unless otherwise indicated.
- B. Construction Joints: Set construction joints at side and end terminations of pavement and at locations where pavement operations are stopped for more than one-half hour unless pavement terminates at isolation joints.
1. Continue steel reinforcement across construction joints, unless otherwise indicated. Do not continue reinforcement through sides of pavement strips, unless otherwise indicated.
 2. Provide tie bars at sides of pavement strips where indicated.
 3. Butt Joints: Use bonding agent at joint locations where fresh concrete is placed against hardened or partially hardened concrete surfaces.
 4. Keyed Joints: Provide preformed keyway-section forms or bulkhead forms with keys, unless otherwise indicated. Embed keys at least 1-1/2 inches into concrete.
 5. Doweled Joints: Install dowel bars and support assemblies at joints where indicated. Lubricate or asphalt-coat one-half of dowel length to prevent concrete bonding to one side of joint.
- C. Isolation Joints: Form isolation joints of preformed joint-filler strips abutting concrete curbs, catch basins, manholes, inlets, structures, walks, other fixed objects, and where indicated.
1. Locate expansion joints at intervals of 30 feet, unless otherwise indicated.
 2. Extend joint fillers full width and depth of joint.
 3. Terminate joint filler not less than 1/2 inch or more than 1 inch below finished surface if joint sealant is indicated.
 4. Place top of joint filler flush with finished concrete surface if joint sealant is not indicated.
 5. Furnish joint fillers in one-piece lengths. Where more than one length is required, lace or clip joint-filler sections together.
 6. Protect top edge of joint filler during concrete placement with metal, plastic, or other temporary preformed cap. Remove protective cap after concrete has been placed on both sides of joint.
- D. Contraction Joints: Form weakened-plane contraction joints, sectioning concrete into areas as indicated. Construct contraction joints for a depth equal to at least one-fourth of the concrete thickness, as follows:
1. Grooved Joints: Form contraction joints after initial floating by grooving and finishing each edge of joint with grooving tool to a 1/4-inch radius. Repeat

grooving of contraction joints after applying surface finishes. Eliminate groover marks on concrete surfaces.

2. Sawed Joints: Form contraction joints with power saws equipped with shatterproof abrasive or diamond-rimmed blades. Cut 1/8-inch- wide joints into concrete when cutting action will not tear, abrade, or otherwise damage surface and before developing random contraction cracks.
3. Doweled Contraction Joints: Install dowel bars and support assemblies at joints where indicated. See plan details to prevent concrete bonding to one side of joint.

- E. Edging: Tool edges of pavement, gutters, curbs, and joints in concrete after initial floating with an edging tool to a 1/4-inch radius. Repeat tooling of edges after applying surface finishes. Eliminate tool marks on concrete surfaces.

3.6 CONCRETE PLACEMENT

- A. Inspection: Before placing concrete, inspect and complete formwork installation, steel reinforcement, and items to be embedded or cast in. Notify other trades to permit installation of their work.
- B. Remove snow, ice, or frost from subbase surface and reinforcement before placing concrete. Do not place concrete on frozen surfaces.
- C. Moisten subbase to provide a uniform dampened condition at time concrete is placed. Do not place concrete around manholes or other structures until they are at required finish elevation and alignment.
- D. Comply with ACI 301 requirements for measuring, mixing, transporting, and placing concrete.
- E. Do not add water to concrete during delivery or at Project site.
- F. Do not add water to fresh concrete after testing.
- G. Deposit and spread concrete in a continuous operation between transverse joints. Do not push or drag concrete into place or use vibrators to move concrete into place.
- H. Consolidate concrete according to ACI 301 by mechanical vibrating equipment supplemented by hand spading, rodding, or tamping.
 1. Consolidate concrete along face of forms and adjacent to transverse joints with an internal vibrator. Keep vibrator away from joint assemblies, reinforcement, or side forms. Use only square-faced shovels for hand spreading and consolidation. Consolidate with care to prevent dislocating reinforcement, dowels, and joint devices.
- I. Place concrete in two operations; strike off initial pour for entire width of placement and to the required depth below finish surface. Lay welded wire fabric or fabricated

bar mats immediately in final position. Place top layer of concrete, strike off, and screed.

1. Remove and replace concrete that has been placed for more than 15 minutes without being covered by top layer, or use bonding agent if approved by Architect.
- J. Screed pavement surfaces with a straightedge and strike off.
- K. Commence initial floating using bull floats or darbies to impart an open textured and uniform surface plane before excess moisture or bleed water appears on the surface. Do not further disturb concrete surfaces before beginning finishing operations or spreading surface treatments.
- L. Curbs and Gutters: When automatic machine placement is used for curb and gutter placement, submit revised mix design and laboratory test results that meet or exceed requirements. Produce curbs and gutters to required cross section, lines, grades, finish, and jointing as specified for formed concrete. If results are not approved, remove and replace with formed concrete.
- M. Slip-Form Pavers: When automatic machine placement is used for pavement, submit revised mix design and laboratory test results that meet or exceed requirements. Produce pavement to required thickness, lines, grades, finish, and jointing as required for formed pavement.
1. Compact subbase and prepare subgrade of sufficient width to prevent displacement of paver machine during operations.
- N. When adjoining pavement lanes are placed in separate pours, do not operate equipment on concrete until pavement has attained 85 percent of its 28-day compressive strength.
- O. Cold-Weather Placement: Comply with ACI 306.1 and as follows. Protect concrete work from physical damage or reduced strength that could be caused by frost, freezing actions, or low temperatures.
1. When air temperature has fallen to or is expected to fall below 40 deg F, uniformly heat water and aggregates before mixing to obtain a concrete mixture temperature of not less than 50 deg F and not more than 80 deg F at point of placement.
 2. Do not use frozen materials or materials containing ice or snow.
 3. Do not use calcium chloride, salt, or other materials containing antifreeze agents or chemical accelerators unless otherwise specified and approved in mix designs.
- P. Hot-Weather Placement: Comply with ACI 301 and as follows when hot-weather conditions exist:

1. Cool ingredients before mixing to maintain concrete temperature below 90 deg F at time of placement. Chilled mixing water or chopped ice may be used to control temperature, provided water equivalent of ice is calculated to total amount of mixing water. Using liquid nitrogen to cool concrete is Contractor's option.
2. Cover steel reinforcement with water-soaked burlap so steel temperature will not exceed ambient air temperature immediately before embedding in concrete.
3. Fog-spray forms, steel reinforcement, and subgrade just before placing concrete. Keep subgrade moisture uniform without standing water, soft spots, or dry areas.

3.7 FLOAT FINISHING

- A. General: Do not add water to concrete surfaces during finishing operations.
- B. Float Finish: Begin the second floating operation when bleed-water sheen has disappeared and concrete surface has stiffened sufficiently to permit operations. Float surface with power-driven floats, or by hand floating if area is small or inaccessible to power units. Finish surfaces to true planes. Cut down high spots and fill low spots. Refloat surface immediately to uniform granular texture.
 1. Burlap Finish: Drag a seamless strip of damp burlap across float-finished concrete, perpendicular to line of traffic, to provide a uniform, gritty texture.
 2. Medium-to-Fine-Textured Broom Finish: Draw a soft bristle broom across float-finished concrete surface perpendicular to line of traffic to provide a uniform, fine-line texture.
 3. Medium-to-Coarse-Textured Broom Finish: Provide a coarse finish by striating float-finished concrete surface 1/16 to 1/8 inch deep with a stiff-bristled broom, perpendicular to line of traffic.

3.8 CONCRETE PROTECTION AND CURING

- A. General: Protect freshly placed concrete from premature drying and excessive cold or hot temperatures.
- B. Comply with ACI 306.1 for cold-weather protection.
- C. Evaporation Retarder: Apply evaporation retarder to concrete surfaces if hot, dry, or windy conditions cause moisture loss approaching 0.2 lb/sq. ft. x h before and during finishing operations. Apply according to manufacturer's written instructions after placing, screeding, and bull floating or darbying concrete, but before float finishing.
- D. Begin curing after finishing concrete but not before free water has disappeared from concrete surface.

- E. Curing Methods: Cure concrete by moisture curing, moisture-retaining-cover curing, curing compound, or a combination of these as follows:
1. Moist Curing: Keep surfaces continuously moist for not less than seven days with the following materials:
 - a. Water.
 - b. Continuous water-fog spray.
 - c. Absorptive cover, water saturated and kept continuously wet. Cover concrete surfaces and edges with 12-inch lap over adjacent absorptive covers.
 2. Moisture-Retaining-Cover Curing: Cover concrete surfaces with moisture-retaining cover for curing concrete, placed in widest practicable width, with sides and ends lapped at least 12 inches, and sealed by waterproof tape or adhesive. Immediately repair any holes or tears during curing period using cover material and waterproof tape.
 3. Curing Compound: Apply uniformly in continuous operation by power spray or roller according to manufacturer's written instructions. Recoat areas subjected to heavy rainfall within three hours after initial application. Maintain continuity of coating and repair damage during curing period.

3.9 PAVEMENT TOLERANCES

- A. Comply with tolerances of ACI 117 and as follows:
1. Elevation: 1/4 inch.
 2. Thickness: Plus 3/8 inch, minus 1/4 inch.
 3. Surface: Gap below 10-foot- long, unlevelled straightedge not to exceed 1/4 inch.
 4. Lateral Alignment and Spacing of Tie Bars and Dowels: 1 inch.
 5. Vertical Alignment of Tie Bars and Dowels: 1/4 inch.
 6. Alignment of Tie-Bar End Relative to Line Perpendicular to Pavement Edge: 1/2 inch.
 7. Alignment of Dowel-Bar End Relative to Line Perpendicular to Pavement Edge: Length of dowel 1/4 inch per 12 inches.
 8. Joint Spacing: 3 inches.
 9. Contraction Joint Depth: Plus 1/4 inch, no minus.
 10. Joint Width: Plus 1/8 inch, no minus.

3.10 PAVEMENT MARKING

- A. Do not apply pavement-marking paint until layout, colors, and placement have been verified with Architect.
- B. Allow concrete pavement to cure for 28 days and be dry before starting pavement marking.

- C. Sweep and clean surface to eliminate loose material and dust.
- D. Apply paint with mechanical equipment to produce pavement markings of dimensions indicated with uniform, straight edges. Apply at manufacturer's recommended rates to provide a minimum wet film thickness of 15 mils.

3.11 WHEEL STOPS

- A. Securely attach wheel stops into pavement with not less than two galvanized steel dowels embedded in holes drilled or cast into wheel stops at one-quarter to one-third points. Firmly bond each dowel to wheel stop and to pavement. Securely install dowels into pavement and bond to wheel stop. Recess head of dowel beneath top of wheel stop.

3.12 FIELD QUALITY CONTROL

- A. Testing Agency: Owner will engage a qualified independent testing and inspecting agency to perform field tests and inspections and prepare test reports.
- B. Testing Services: Testing of composite samples of fresh concrete obtained according to ASTM C 172 shall be performed according to the following requirements:
 - 1. Testing Frequency: Obtain at least 1 composite sample for each 100 cu. yd.
 - a. When frequency of testing will provide fewer than five compressive-strength tests for each concrete mixture, testing shall be conducted from at least five randomly selected batches or from each batch if fewer than five are used.
 - 2. Slump: ASTM C 143/C 143M; one test at point of placement for each composite sample, but not less than one test for each day's pour of each concrete mix. Perform additional tests when concrete consistency appears to change.
 - 3. Air Content: ASTM C 231, pressure method; one test for each composite sample, but not less than one test for each day's pour of each concrete mix.
 - 4. Concrete Temperature: ASTM C 1064; one test hourly when air temperature is 40 deg F and below and when 80 deg F and above, and one test for each composite sample.
 - 5. Compression Test Specimens: ASTM C 31/C 31M; cast and laboratory cure one set of three standard cylinder specimens for each composite sample.
 - 6. Compressive-Strength Tests: ASTM C 39/C 39M; test 1 specimen at 7 days and 2 specimens at 28 days.
 - a. A compressive-strength test shall be the average compressive strength from 2 specimens obtained from same composite sample and tested at 28 days.

- C. Strength of each concrete mix will be satisfactory if average of any 3 consecutive compressive-strength tests equals or exceeds specified compressive strength and no compressive-strength test value falls below specified compressive strength by more than 500 psi.
- D. Test results shall be reported in writing to Architect, concrete manufacturer, and Contractor within 48 hours of testing. Reports of compressive-strength tests shall contain Project identification name and number, date of concrete placement, name of concrete testing and inspecting agency, location of concrete batch in Work, design compressive strength at 28 days, concrete mixture proportions and materials, compressive breaking strength, and type of break for both 7- and 28-day tests.
- E. Nondestructive Testing: Impact hammer, sonoscope, or other nondestructive device may be permitted by Architect but will not be used as sole basis for approval or rejection of concrete.
- F. Additional Tests: Testing and inspecting agency shall make additional tests of concrete when test results indicate that slump, air entrainment, compressive strengths, or other requirements have not been met, as directed by Architect.
- G. Remove and replace concrete pavement where test results indicate that it does not comply with specified requirements.
- H. Additional testing and inspecting, at Contractor's expense, will be performed to determine compliance of replaced or additional work with specified requirements.

3.13 REPAIRS AND PROTECTION

- A. Remove and replace concrete pavement that is broken, damaged, or defective or that does not comply with requirements in this Section.
- B. Drill test cores, where directed by Architect, when necessary to determine magnitude of cracks or defective areas. Fill drilled core holes in satisfactory pavement areas with portland cement concrete bonded to pavement with epoxy adhesive.
- C. Protect concrete from damage. Exclude traffic from pavement for at least 14 days after placement. When construction traffic is permitted, maintain pavement as clean as possible by removing surface stains and spillage of materials as they occur.
- D. Maintain concrete pavement free of stains, discoloration, dirt, and other foreign material. Sweep concrete pavement not more than two days before date scheduled for Substantial Completion inspections.

END OF DOCUMENT 321313