FILE_NAME: ...\1- Foundations w Structural Grid\Jimi Smith_Front Drive_NOLA\Garage only Dwgs\S102 – Garage Ceiling Joist Plan.rvta _ PLOT DATE & TIME: Tuesday, April 14, 2026 8:09:33 AM

DESIGN CRITERIA

THE CONSTRUCTION FOR SAID RESIDENCE, WHERE Vult WIND SPEED IS 140 MILES PER HOUR AND Vasd WIND SPEED IS 130 MPH, WIND EXPOSURE ZONE C, IS DESIGNED IN ACCORDANCE WITH: AMERICAN FOREST AND PAPER ASSOCIATION (AF&PA) WOOD FRAME CONSTRUCTION MANUAL FOR ONE AND TWO FAMILY DWELLINGS (WFCM) 2001 EDITION AS WELL AS THE INTERNATIONAL RESIDENTIAL CODE (IRC) 2021 EDITION. STRUCTURE SHALL BE BUILT TO THE 2021 INTERNATIONAL ENERGY CONSERVATION CODE (2021 IECC) AND STATE AMENDMENTS ADOPTED JULY 1, 2023.

ROOF NOTES

1. ALL JOIST SPANS,HEADERS AND GIRDERS REVIEWED AS #2 SOUTHERN YELLOW PINE.
2. ANY CHANGES IN THE SPECIES OR GRADE SHALL CONFORM TO THE APPROPRIATE SPAN TABLES, FLOOR JOIST CHAPTER 5, RAFTERS & CEILING JOIST CHAPTER 8, UNLESS NOTED ON THE CONSTRUCTION PLANS.
3. ALL JOIST, BEAMS, HEADERS, HIPS, VALLEYS, AND PURLINS SHALL BE SUPPORTED AND BRACED TO LOAD BEARING WALLS AS REQUIRED BY THE INTERNATIONAL RESIDENTIAL BUILDING CODE.
4. ALL SHALL BE SIZED FOR SPAN AND FOR ALL LOADS THAT WILL BE APPLIED.
5. CEILING JOISTS SPANS ARE BASED ON INTERNATIONAL RESIDENTIAL CODE (I.R.C.) SOUTHERN YELLOW PINE #2 LUMBER SPANS.
6. HEADER SIZES SHOULD BE BASED ON I.R.C. - TABLE R502.5
7. DESIGN AND LAYOUT OF TRIM JOISTS TO BE PROVIDED BY TRIM JOIST MANUFACTURER.
8. ALL LUMBER TO BE #2 SOUTHERN PINE.
9. TRIPLE UP ALL STUDS AT END OF BEAMS.

NOTE :PRE ENGINEERED LVL BEAM & GLUE LAM SHALL BE SIZED PER MANUFACTURER RECOMMENDATION

EXTERIOR WALLS

GA FILE NO. WP 8105 | **GENERIC** | **1 HOUR FIRE**

GYPSUM WALLBOARD, GYPSUM SHEATHING, WOOD STUDS

EXTERIOR SIDE: One layer 48" wide 5/8" type X gypsum sheathing applied parallel to 2 x 4 wood studs 24" o.c. with 1 3/4" galvanized roofing nails 4" o.c. at vertical joints and 7" o.c. at intermediate studs and top and bottom plates . Joints of gypsum sheathing may be left unreated. Extrerior cladding to be attached through sheathing to studs.

INTERIOR SIDE: One layer 5/8" type X gypsum wallboard, water-resistant gypsum backing board, or gypsum veneer base applied parallel or at right angles to studs with 6d coated nails 1 7/8" long, 0.0915" shank, 1/4" heads 7" o.c. **(LOAD-BEARING)**



Thickness: Varies
Approx. Weight: 7 psf
Fire Test: See WP 3510 (UL R3501-47, -48, 9-17-65, UL Design U309; UL R1319-129, 7-22-70, UL Design U314)

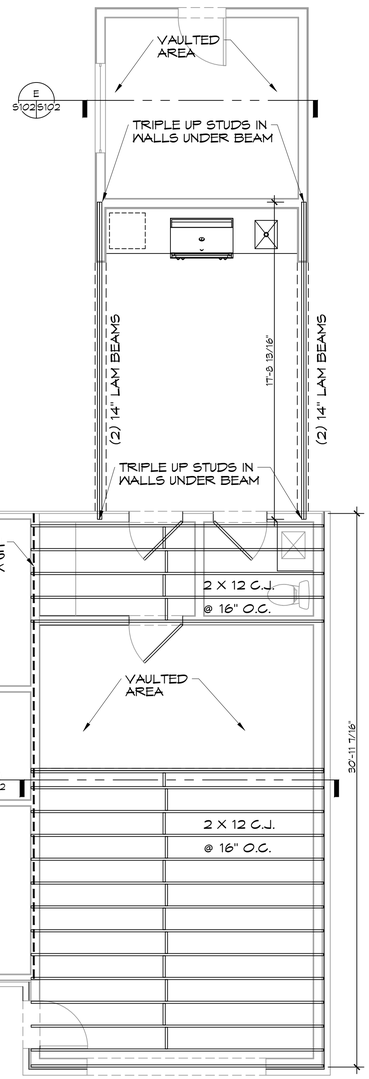

2 GARAGE CEILING JOIST PLAN
SCALE: 1/4"= 1'-0"

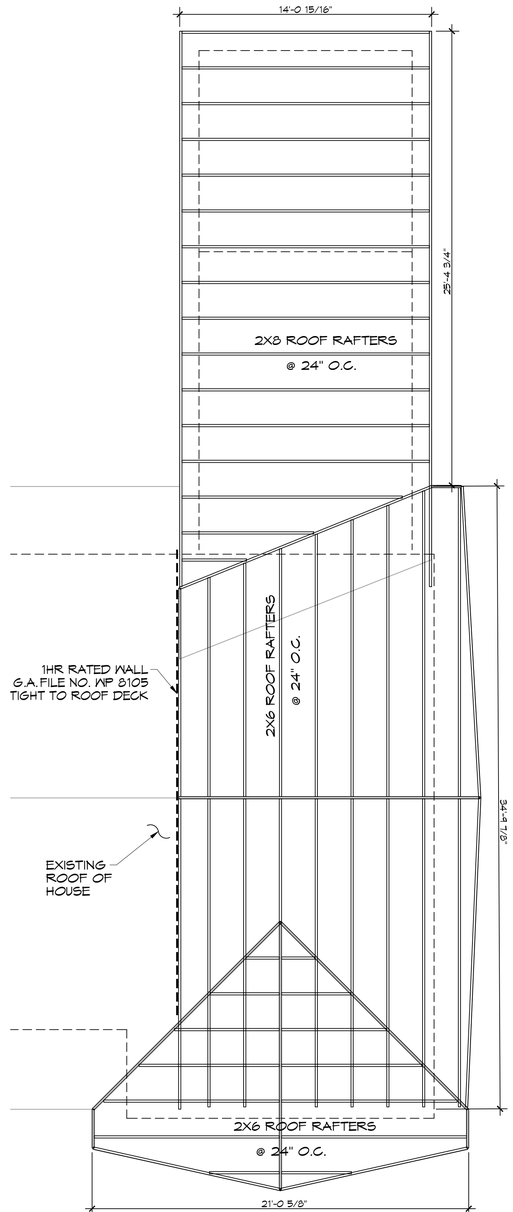

3 GARAGE ROOF RAFTER PLAN
SCALE: 1/4"= 1'-0"

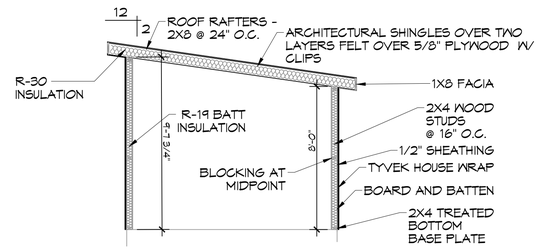

E S102|S102 GARDEN ROOM FRAMING SECTION
SCALE: 1/4" = 1'-0"

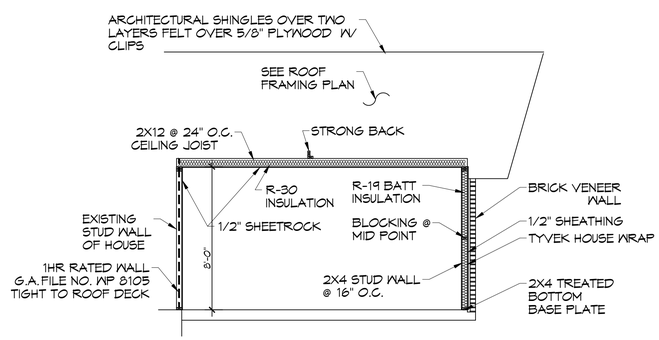

F S102|S102 GARAGE FRAMING SECTION
SCALE: 1/4" = 1'-0"

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
5544 Lodi Street Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
PROFESSIONAL ENGINEER

GARAGE, PATIO & SHED FRAMING PLAN

JIMI SMITH

6356 PRATT DRIVE
NEW ORLEANS, LA 70122

DRAWN BY: CJCD | CHECKED BY: BAM | DATE: 04-14-2026 | JOB No:

All plans, details, and specifications are the property of Dammon Engineering, Inc. and are not to be used in any way without the written permission of Dammon Engineering, Inc. Visual contact with these plans shall constitute prima facie evidence of the acceptance of these restrictions.

SHEET TITLE:
GARAGE CEILING JOIST AND ROOF RAFTER PLAN WITH SECTIONS

DRAWING NUMBER:
S102

SHEET No: 2 of 3