



EXISTING 480 VOLT, 3 ϕ , 4-WIRE
UTILITY PAD MOUNTED TRANSFORMER.

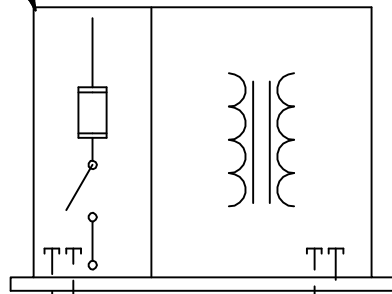

EXISTING METER

EXISTING
NEMA 3R 480V
LOAD BREAK
DISCONNECT

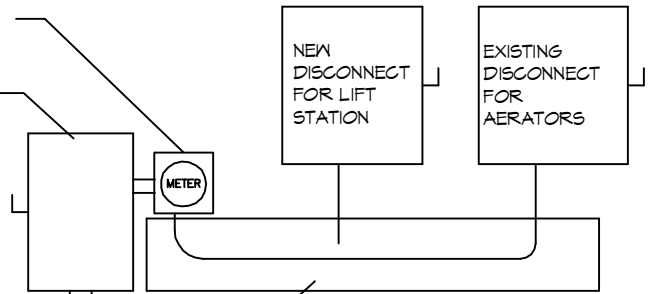

TAP WIRING
BETWEEN METER
AND EXISTING
DISCONNECT AND
FEED NEW
DISCONNECT.

